


INSULATION RESISTANCE



DATE 5/2/2018

PAGE 1

AMBIENT TEMP. 65 °F

JOB # 00001

SUBSTATION N/A

HUMIDITY 35 %


ASSET ID FT Lockout

POSITION N/A

TEST STATUS PASSED

EQUIPMENT LOCATION Lockout Labs office

INSULATION RESISTANCE CURVE

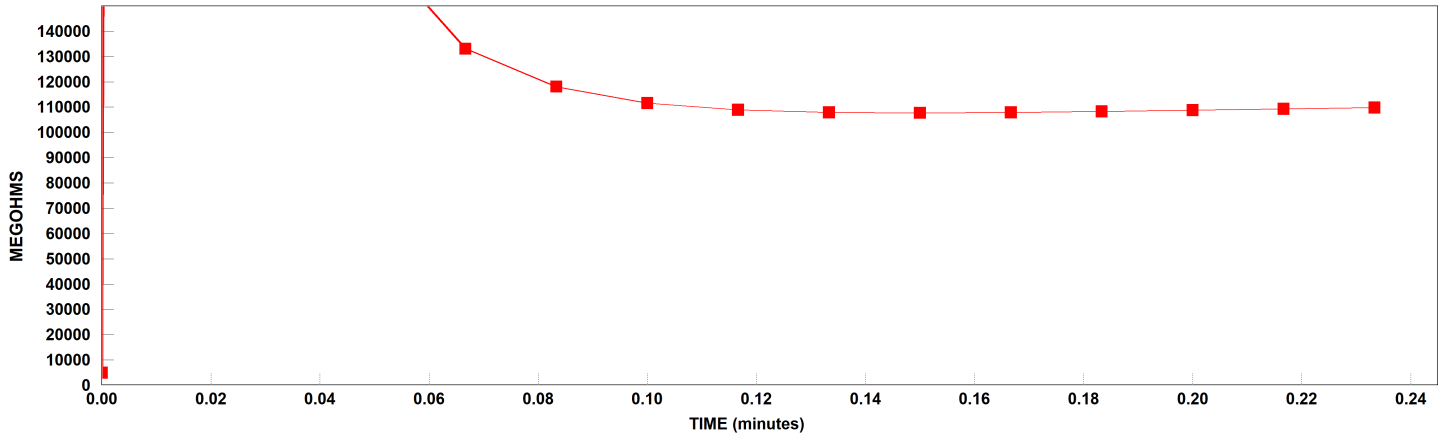

A : Red Square

B : Blue Circle

C : Green Triangle

COMMENTS:

DEFICIENCIES:

--	--

INSULATION TYPE: Solid Liquid TEMPERATURE 20 °C TEMPERATURE CORRECTION FACTOR TO 20 °C, TCF 1.00

TIME (minutes)	Volts (kV)	READING (megohms)	TEMP CORR. (megohms)	CURRENT uA	TIME (minutes)	Volts (kV)	READING (megohms)	TEMP CORR. (megohms)	CURRENT uA	TIME (minutes)	Volts (kV)	READING (megohms)	TEMP CORR. (megohms)	CURRENT uA
0.00	0.00	4,970.00	4,970.00	0.00										
0.02	2.36	1e+007	1e+007	0.00										
0.03	5.11	359,000.0	359,000.0	0.01										
0.05	5.11	173,500.0	173,500.0	0.03										
0.07	5.11	133,100.0	133,100.0	0.04										
0.08	5.11	118,100.0	118,100.0	0.04										
0.10	5.11	111,600.0	111,600.0	0.05										
0.12	5.11	108,900.0	108,900.0	0.05										
0.13	5.11	107,900.0	107,900.0	0.05										
0.15	5.11	107,700.0	107,700.0	0.05										
0.17	5.11	107,900.0	107,900.0	0.05										
0.18	5.11	108,300.0	108,300.0	0.05										
0.20	5.11	108,800.0	108,800.0	0.05										
0.22	5.11	109,300.0	109,300.0	0.05										
0.23	5.11	109,800.0	109,800.0	0.05										

TEST EQUIPMENT USED: MIT-525

TESTED BY: Lockout Labs