

# Water Distribution Workshop

Wednesday, November 15, 2017

City of Logan WDS – Getting To Compliance  
OTCO-D12999-OM (0.75hrs)




*Chester Martin*  
City of Logan ORC




*Curtis L. Truss Jr.*  
OTCO Executive Director

# Compliance

The practice of obeying a rule, law, in accordance with established standards set do try to fit specified requirements of accepted meets the requirements of regulations, policies, le prescribed regulations, policies, or the terms of a contract.

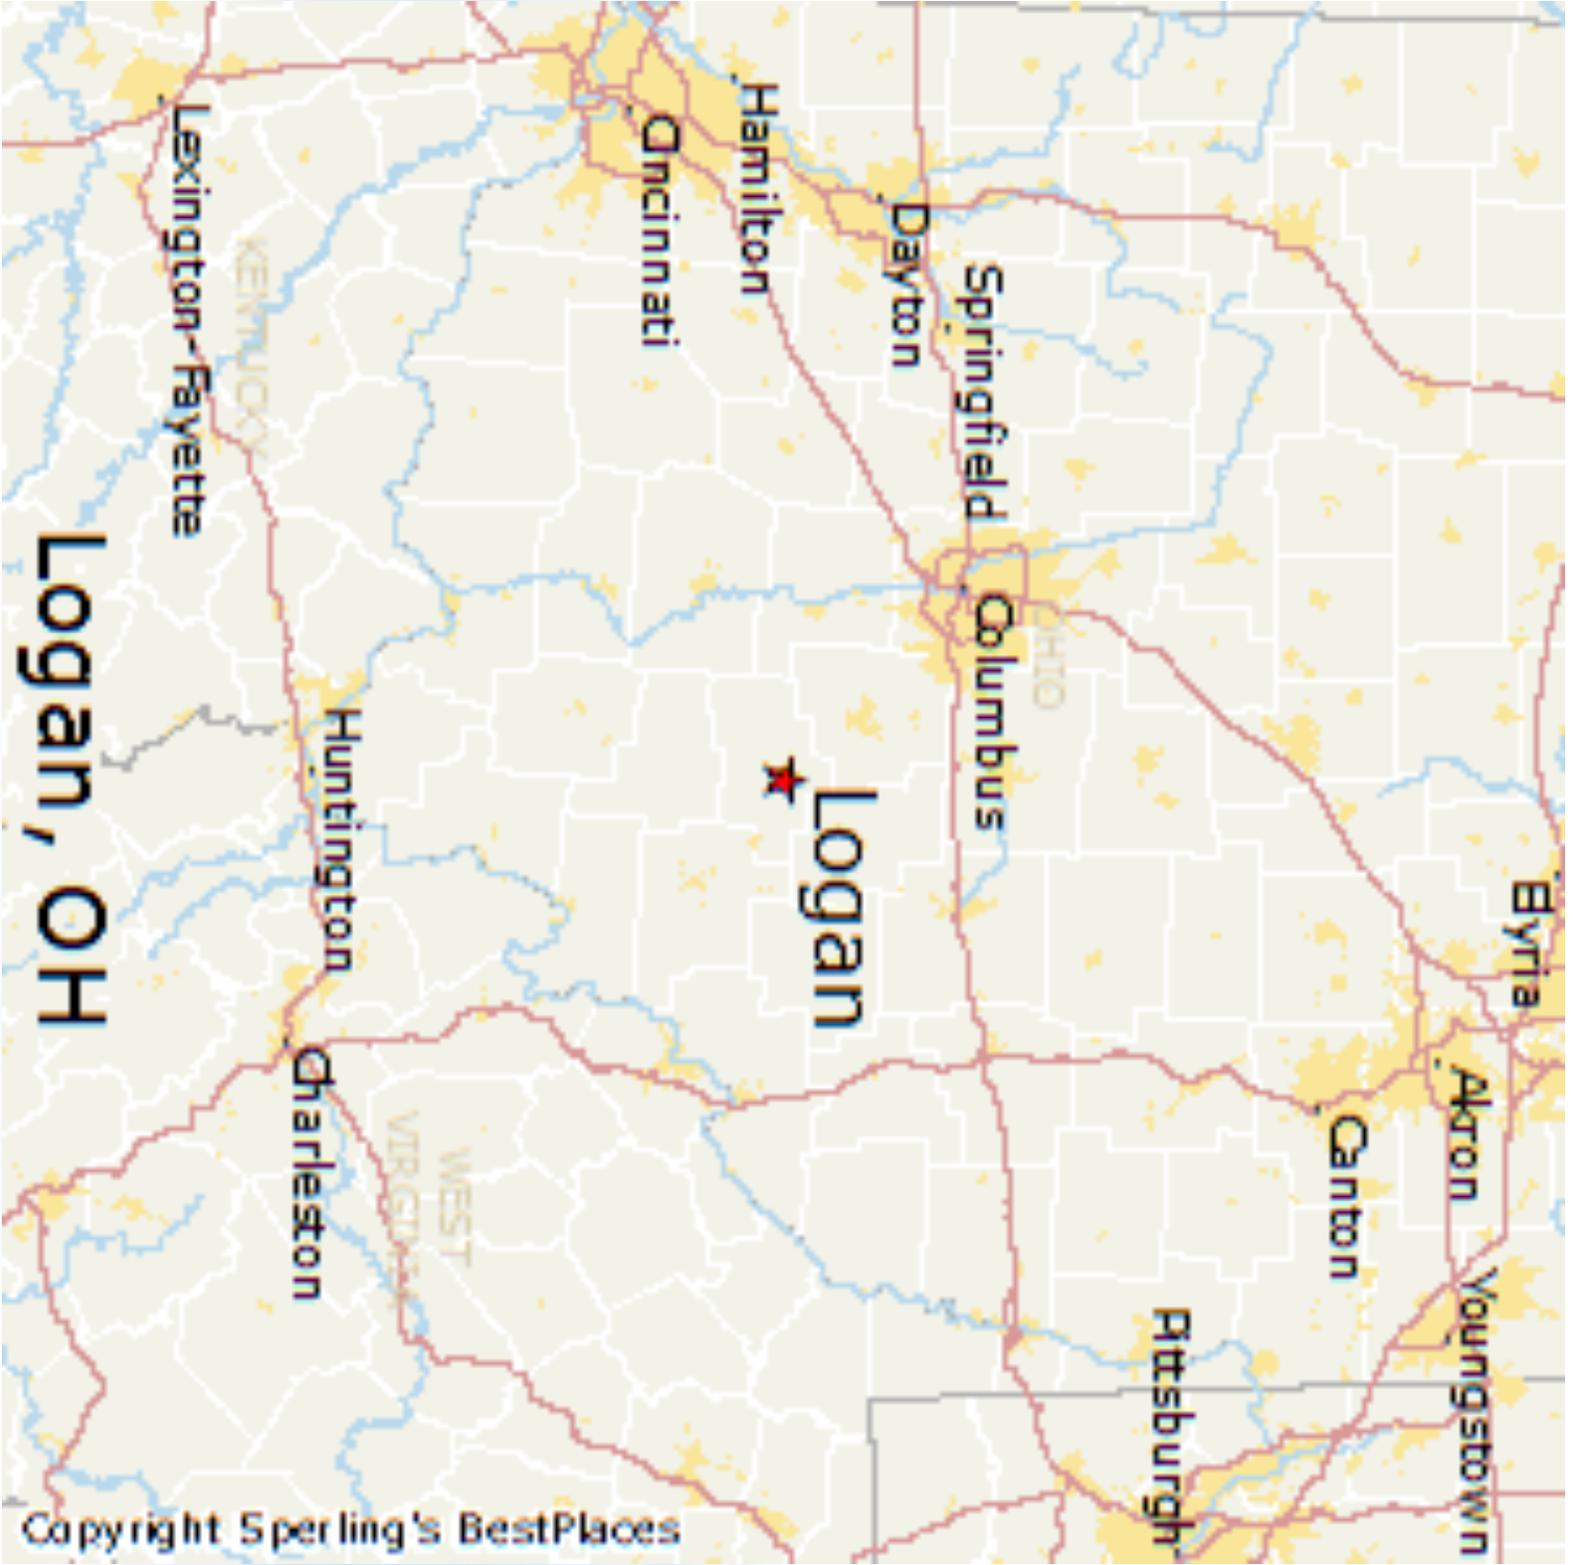




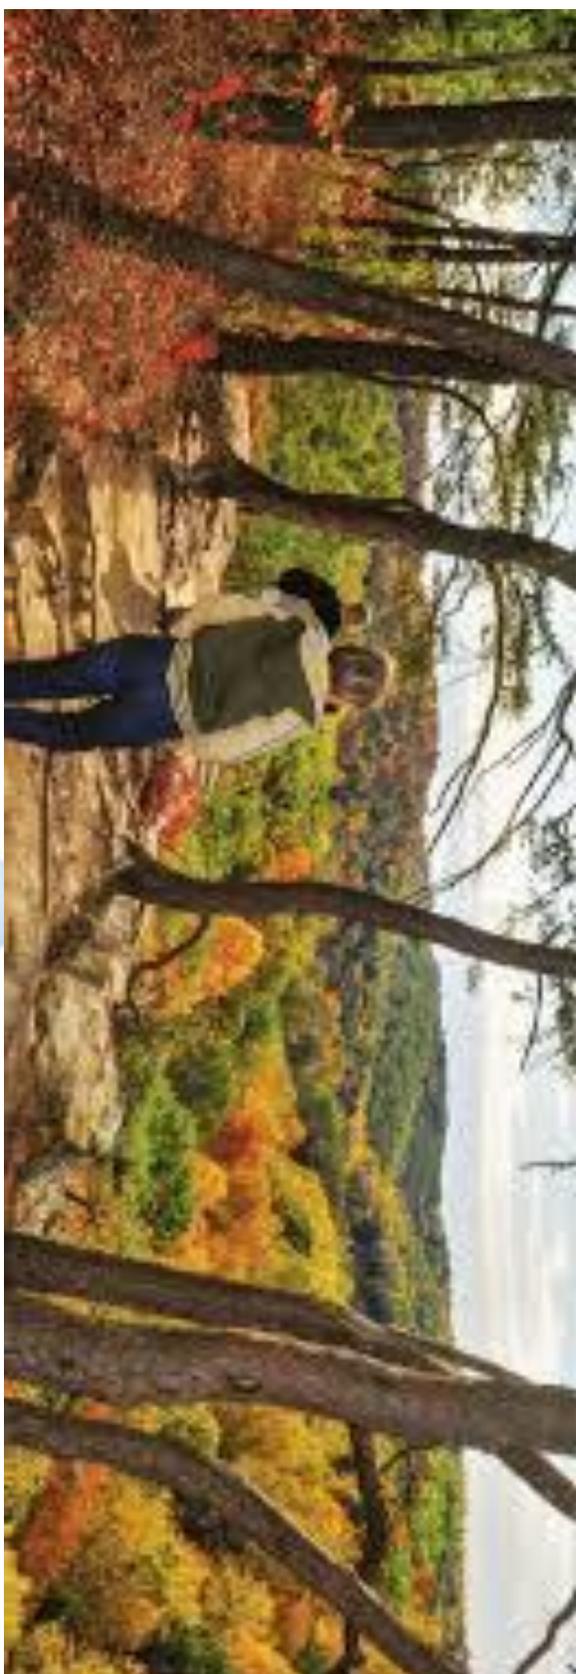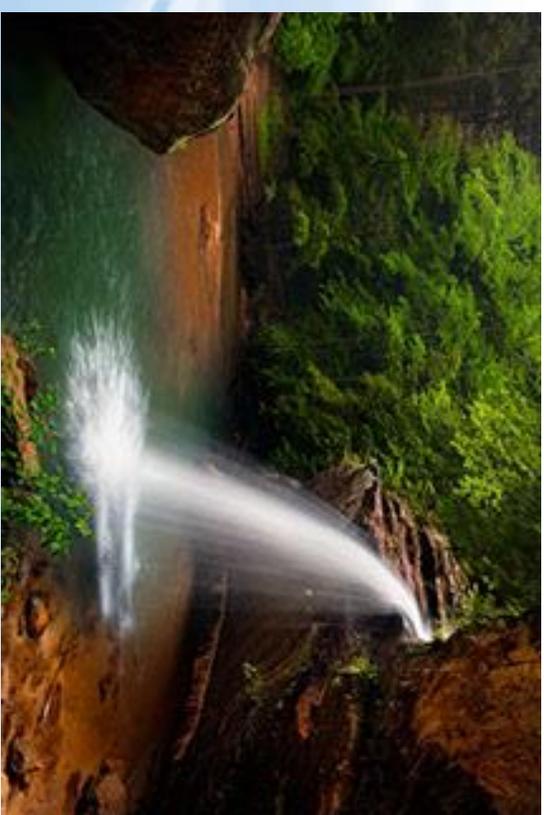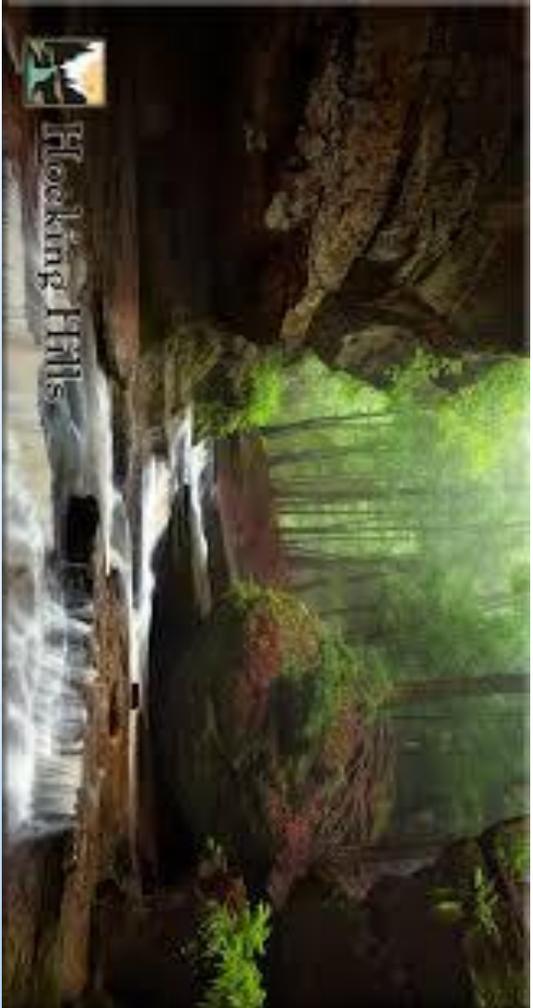






# Southwest District

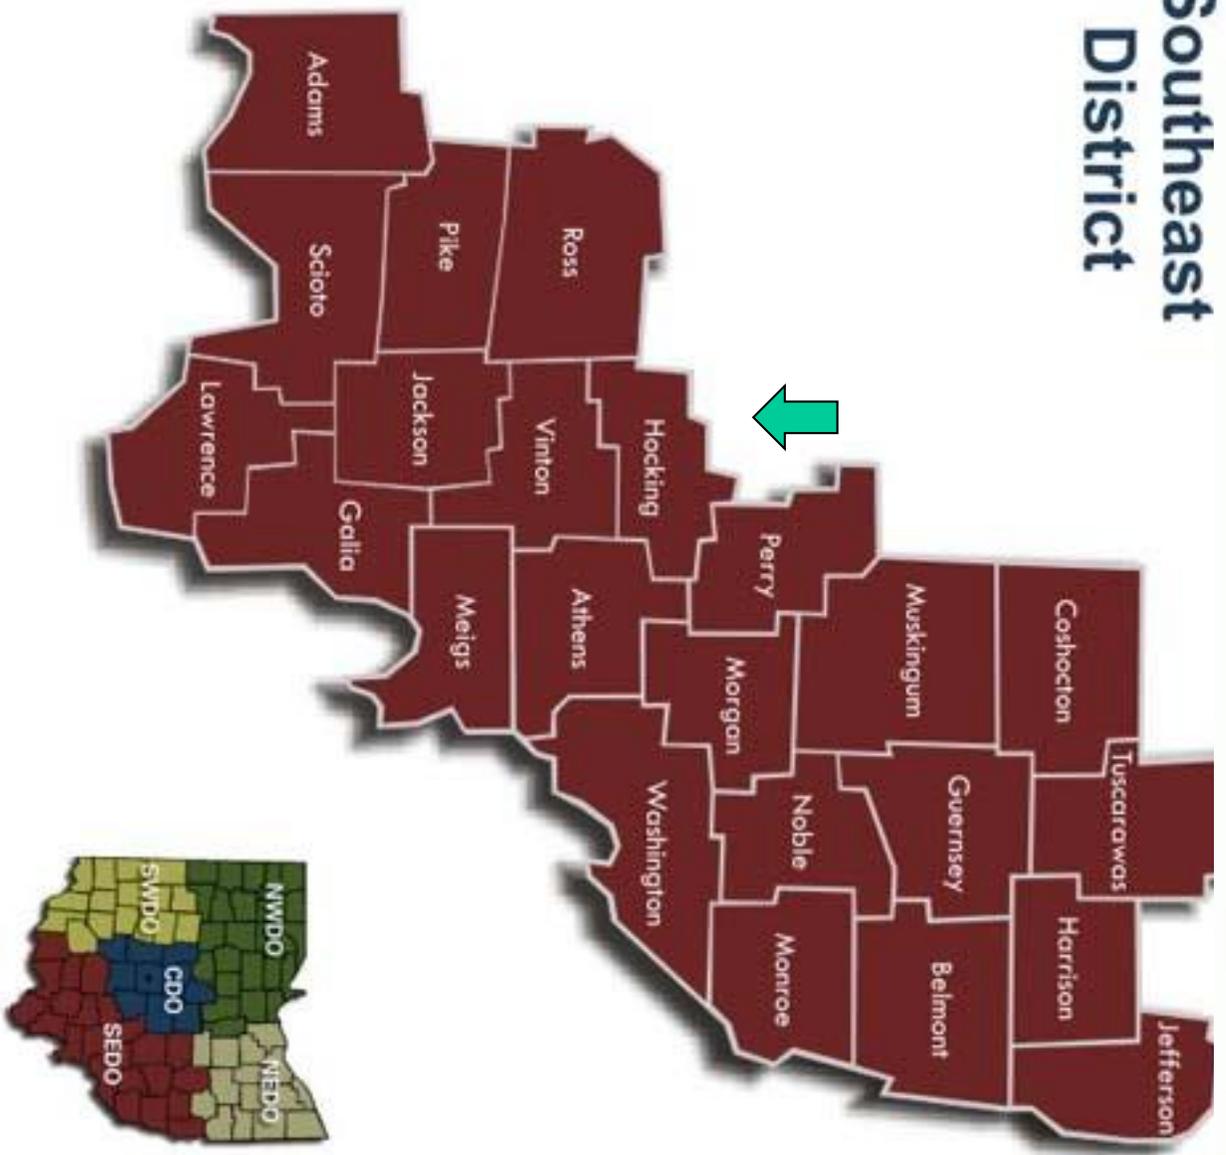


February 2014

May 2014

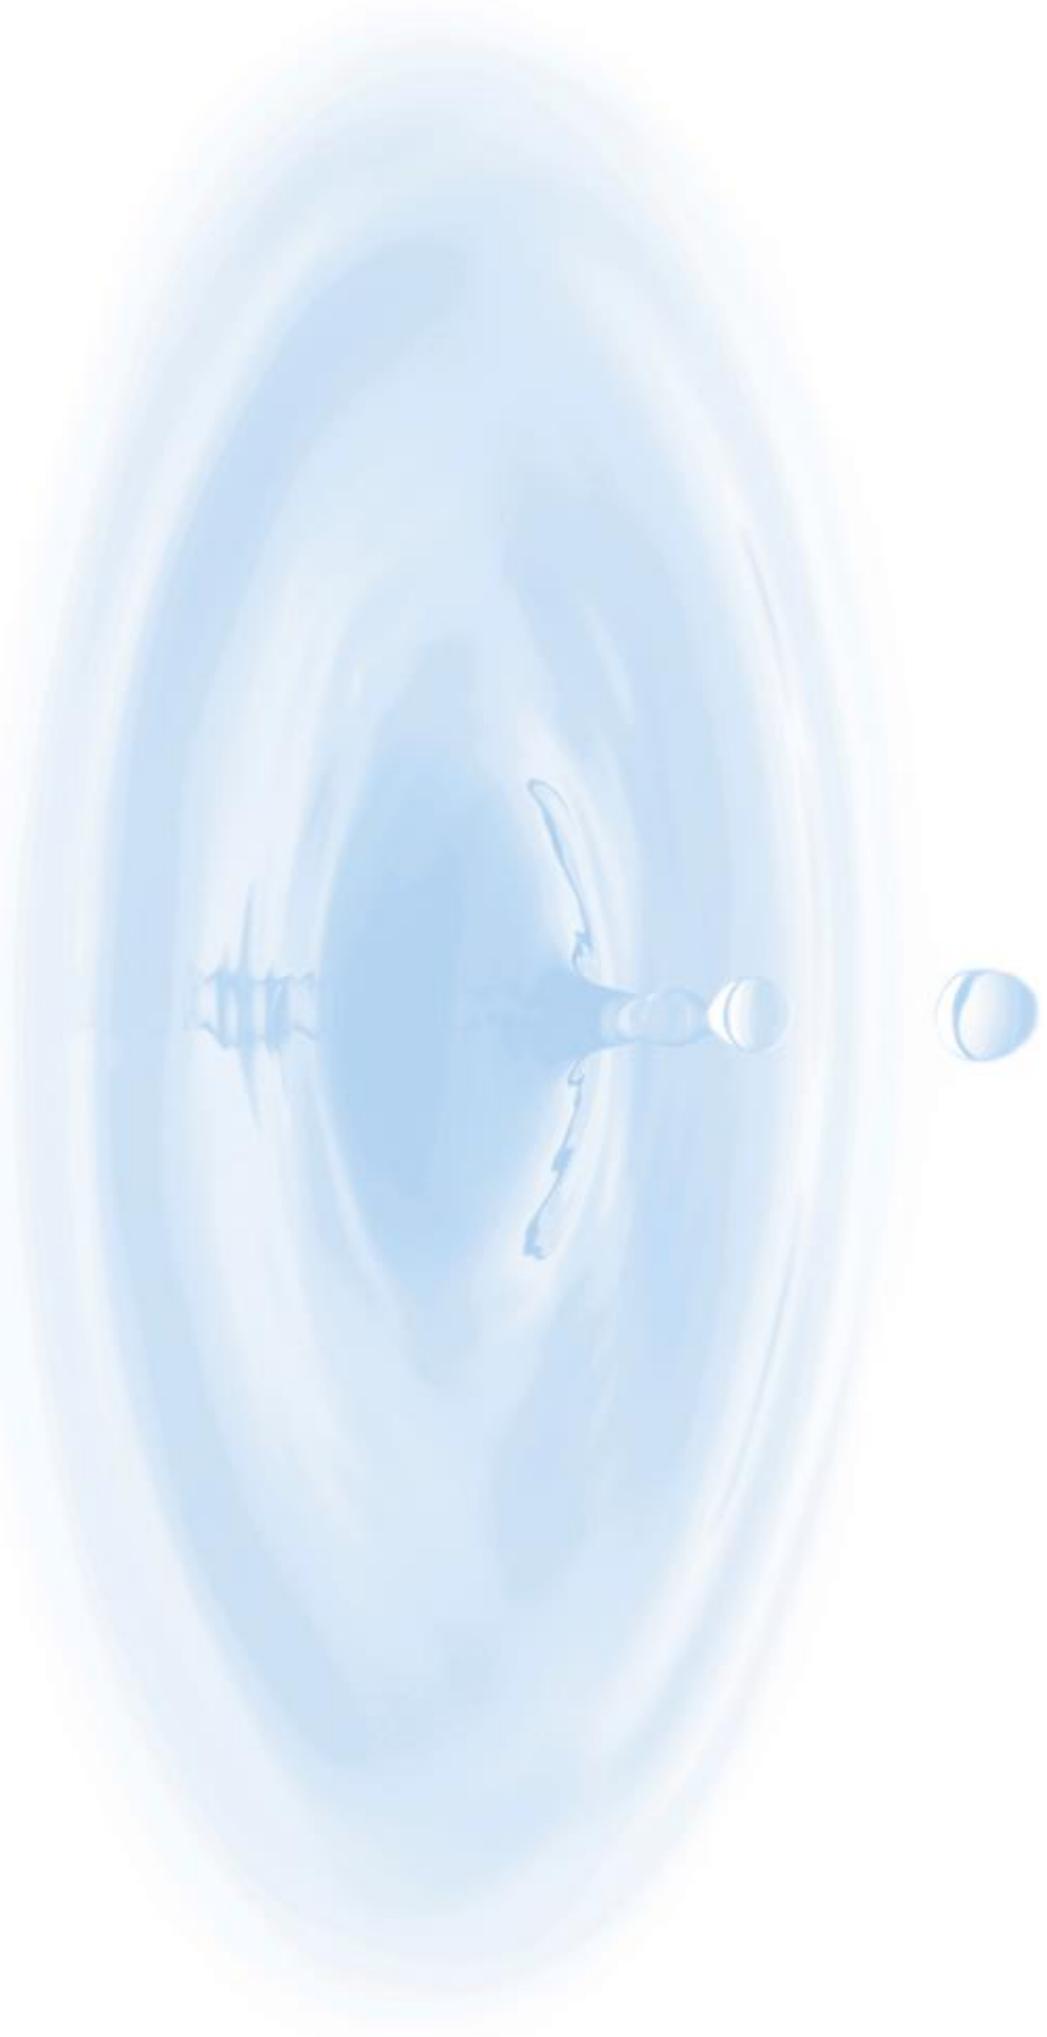




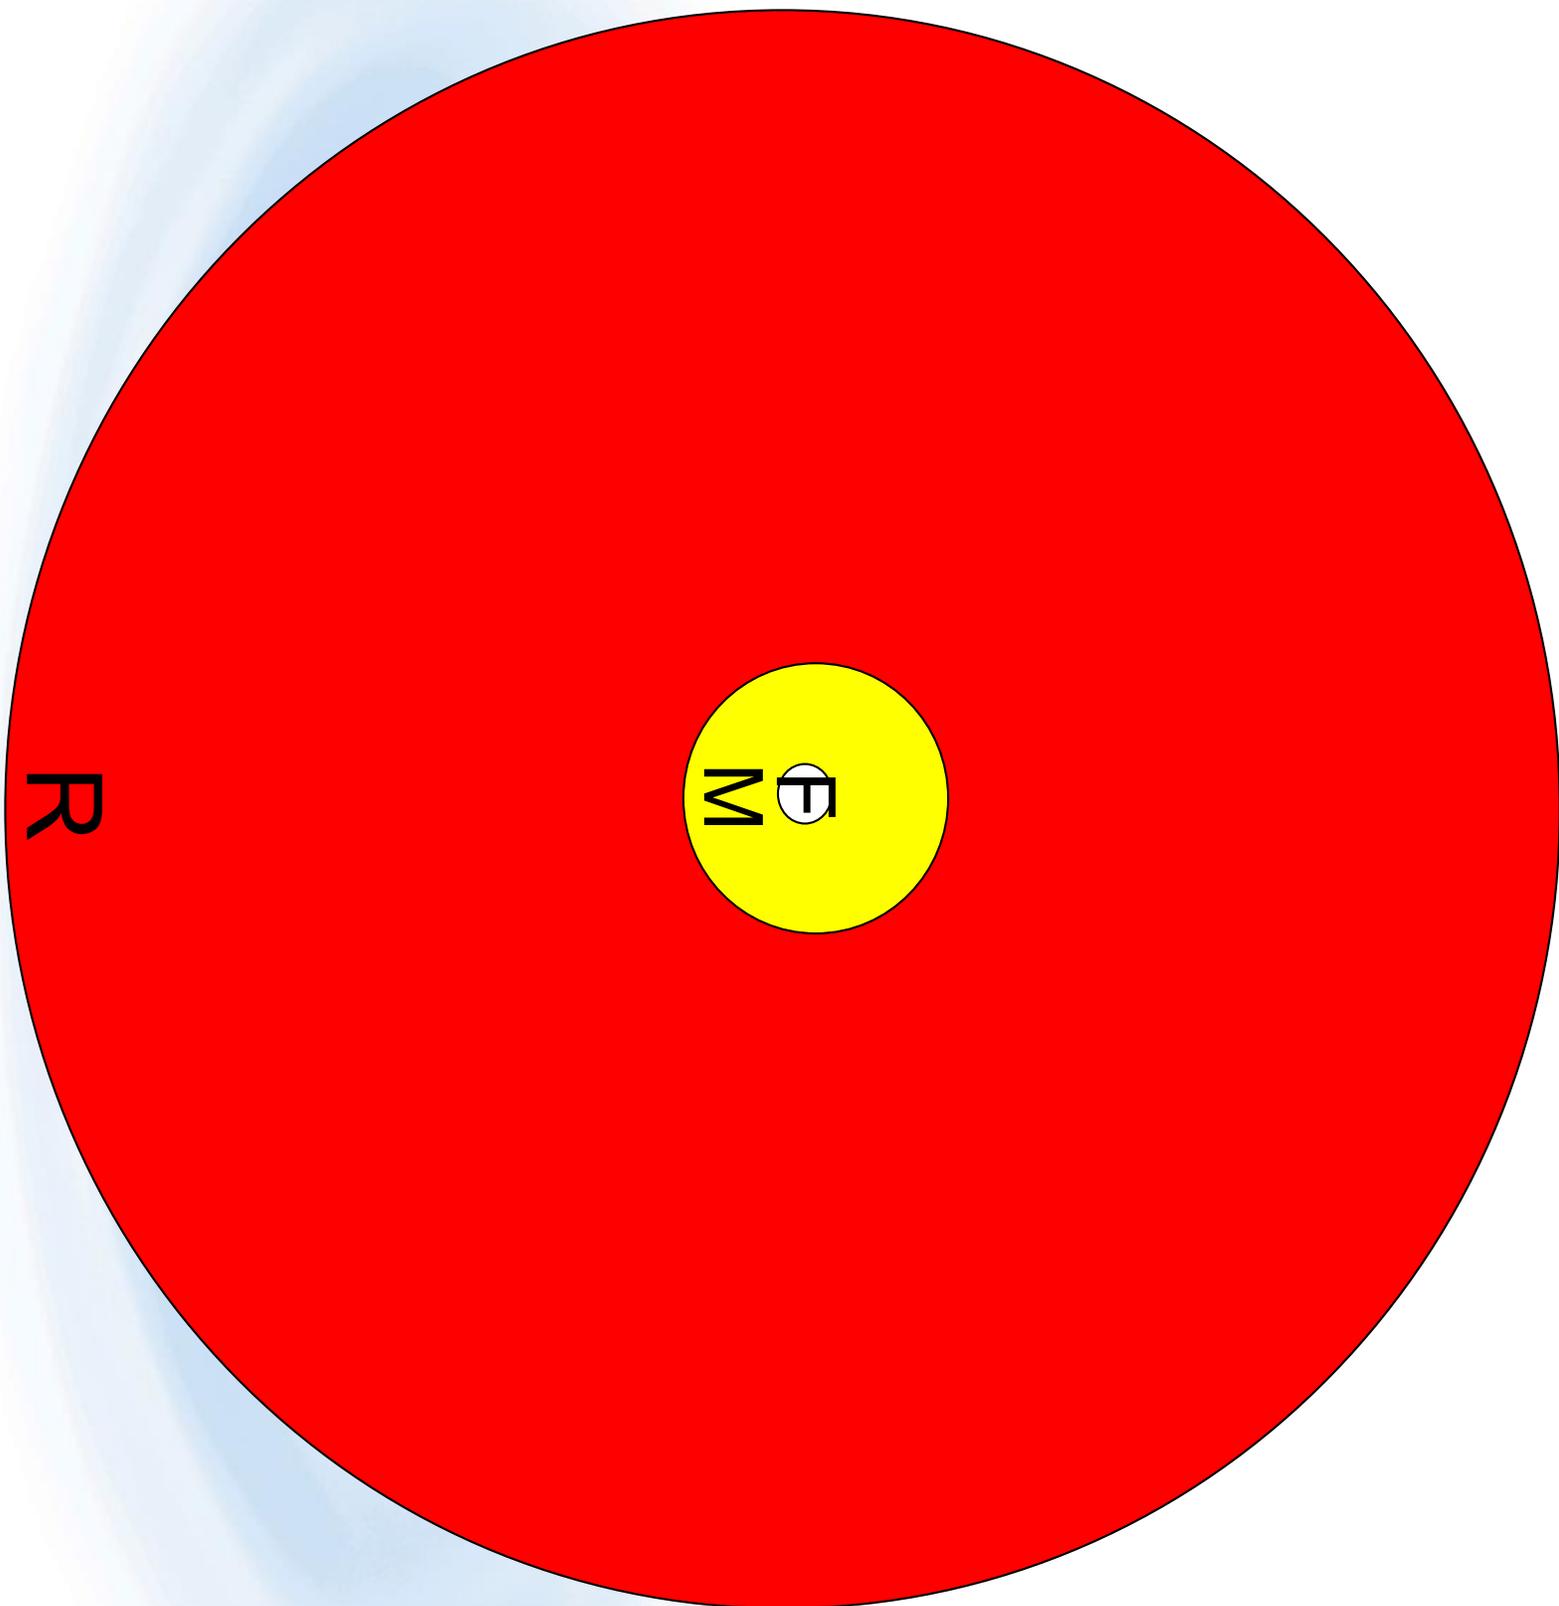



R




R

February 2014

May 2014

January 2016

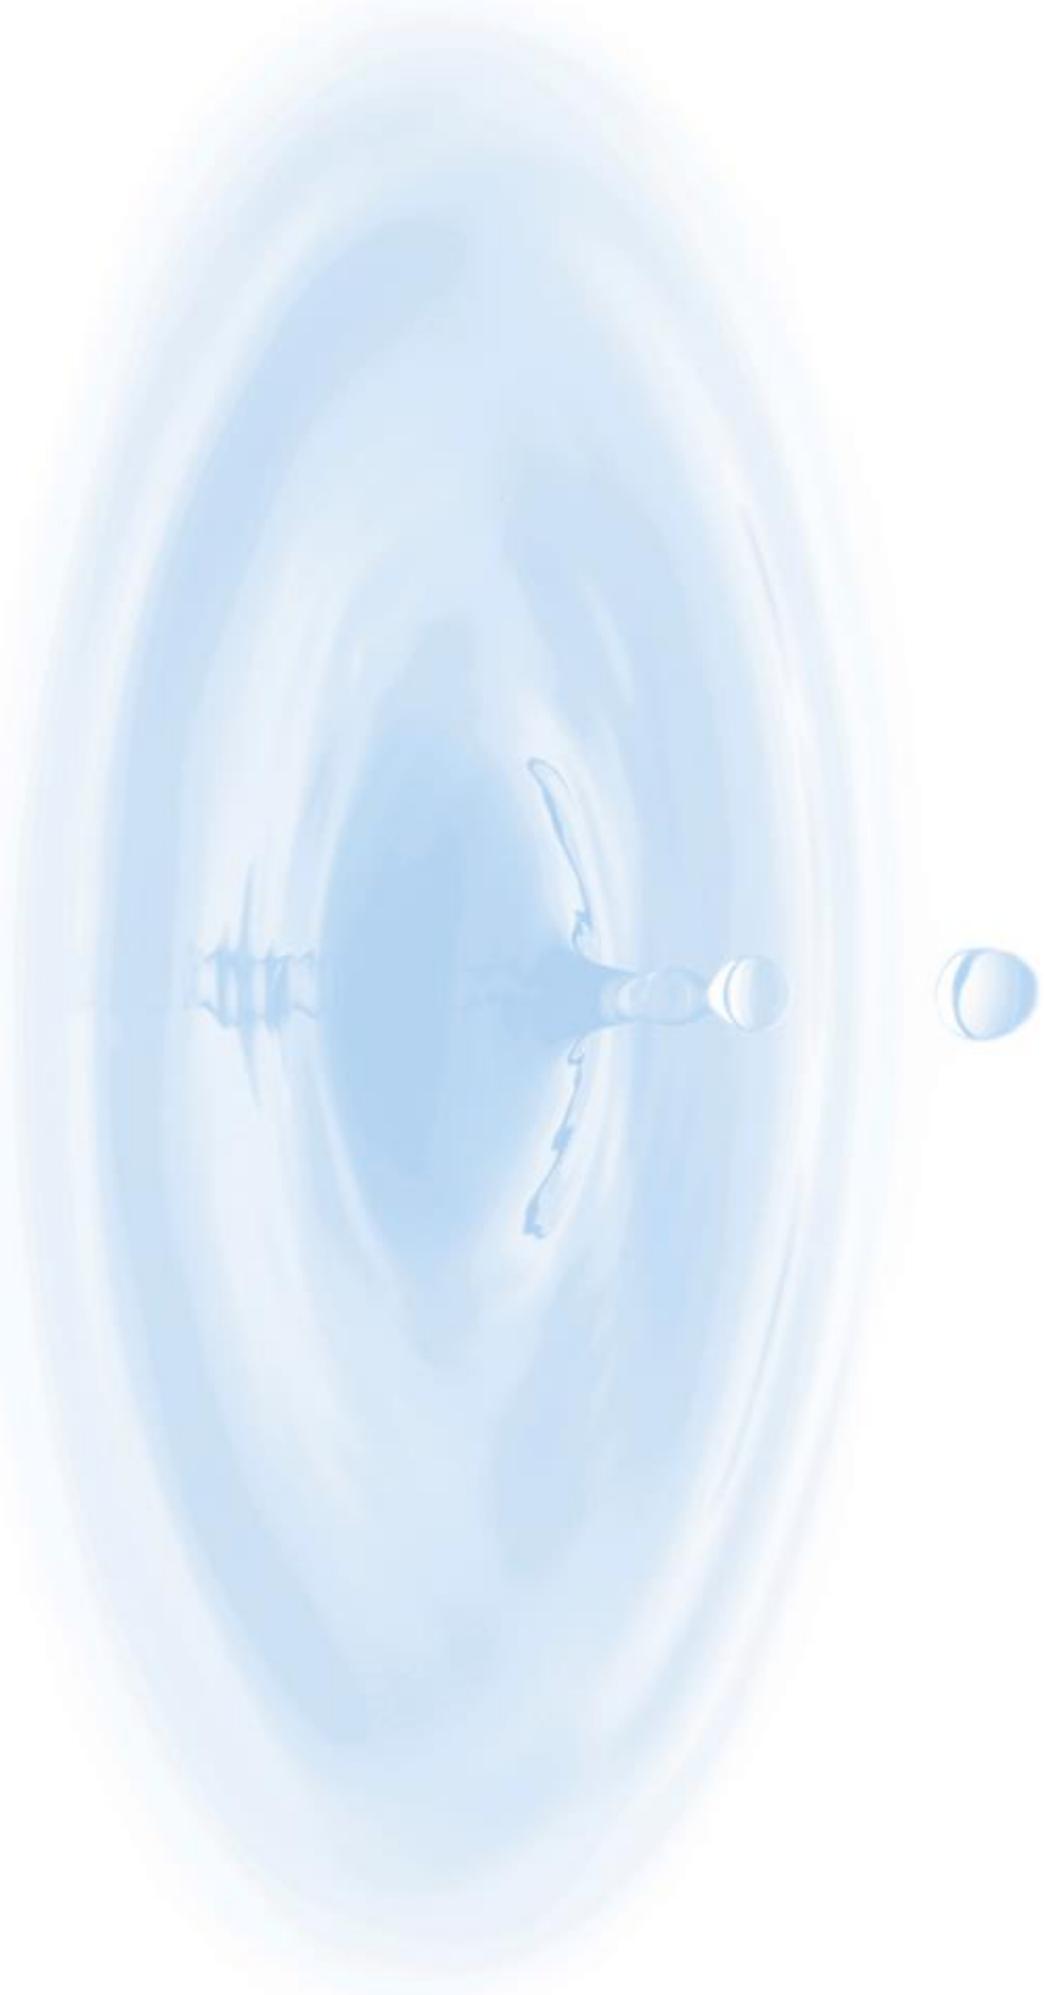



# CONDITIONAL LICENSE TO OPERATE OR MAINTAIN A PUBLIC WATER SYSTEM

THE OHIO EPA, PURSUANT TO SECTION 6109.21 OF THE OHIO REVISED CODE, HEREBY ISSUES THIS  
LICENSE TO OPERATE OR MAINTAIN A PUBLIC WATER SYSTEM TO

**LOGAN, CITY OF**

**PWS ID: OH3700612**

THE LICENSEE IS OBLIGATED TO ENSURE THAT THE PUBLIC WATER SYSTEM IS OPERATED AND  
MAINTAINED IN ACCORDANCE WITH THE REQUIREMENTS OF CHAPTER 6109 OF THE OHIO REVISED  
CODE, ALL OTHER APPLICABLE STATUTES AND THE ADMINISTRATIVE RULES ADOPTED THEREUNDER.

**THIS LICENSE WILL EXPIRE ON JANUARY 30, 2018**

APPLICATION FOR RENEWAL IS REQUIRED TO BE SUBMITTED TO THE OHIO EPA AT LEAST THIRTY  
DAYS PRIOR TO THIS DATE.

EFFECTIVE DATE: JANUARY 25, 2017

EXPIRATION DATE: JANUARY 30, 2018

LICENSE NUMBER: 3700612-1115462-2017

A handwritten signature in black ink, appearing to read "Craig W. Butler".

Craig W. Butler, Director




THE LICENSEE IS OBLIGATED TO ENSURE THAT THE PUBLIC WATER SYSTEM IS OPERATED AND MAINTAINED IN ACCORDANCE WITH THE REQUIREMENTS OF CHAPTER 6109 OF THE OHIO REVISED CODE. ALL OTHER APPLICABLE STATUTES AND THE ADMINISTRATIVE RULES ADOPTED THEREUNDER.

**THIS LICENSE WILL EXPIRE ON JANUARY 30, 2018**

APPLICATION FOR RENEWAL IS REQUIRED TO BE SUBMITTED TO THE OHIO EPA AT LEAST THIRTY DAYS PRIOR TO THIS DATE.

EFFECTIVE DATE: JANUARY 25, 2017  
EXPIRATION DATE: JANUARY 30, 2018  
LICENSE NUMBER: 3700612-1115462-2017

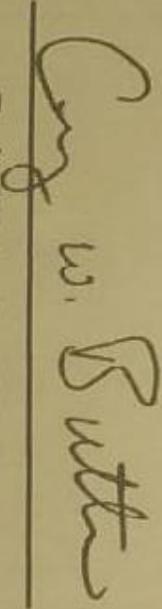  
\_\_\_\_\_  
Craig W. Butler, Director

Curtis L. Truss Jr.  
OTCO Executive Director  
curtis@otco.org

February 2014

May 2014

January 2016

September 2017

>9/26/2017



February 2014

May 2014

January 2016

September 2017

>9/26/2017

>Leak Detection Training (Finding and Orders)

<http://www.epa.ohio.gov/dsw/enforcement/enf.aspx>

[#1262610120-2017-enforcement-actions](#)

February 2014

May 2014

January 2016

September 2017

>9/26/2017

October 2017

>10/16/2017

<http://www.epa.ohio.gov/dsw/enforcement/enf.aspx>  
[#1262610120-2017-enforcement-actions](#)



Leak Detection Training 10/16/2017

February 2014

May 2014

September 2017

>9/26/2017

October 2017

>10/16/2017

>10/26/2017

*“It is my understanding that several years ago OTCO performed a GIS locational valve study for the City.*

*That list may be used to at least list the valves and prioritize those on strategic streets to halve and quarter the City.*

*Then the remaining valves can be listed in quadrants. Once generated, that list is not static nor is it supposed to be left as is.*

*The list should be manipulated and worked to achieve the compliance dates in the Orders.”*



501(c)(3) Non-Profit Educational Organizations

## Our Mission

To increase the sustainability of utility systems through the education and services of asset management, GIS, and GPS.



# Examples of systems



