

# **Measure Alkalinity for Better Process Control of Wastewater Treatment Plants**

**Cheap, Easy, and Effective Methods for Attaining  
Compliance**

**July 21, 2021**


**Jon van Dommelen**

**Ohio EPA – Compliance Assistance Unit**

# Activated Sludge Process Control and Troubleshooting Chart

Ohio EPA, OSW, CAU

November 2014

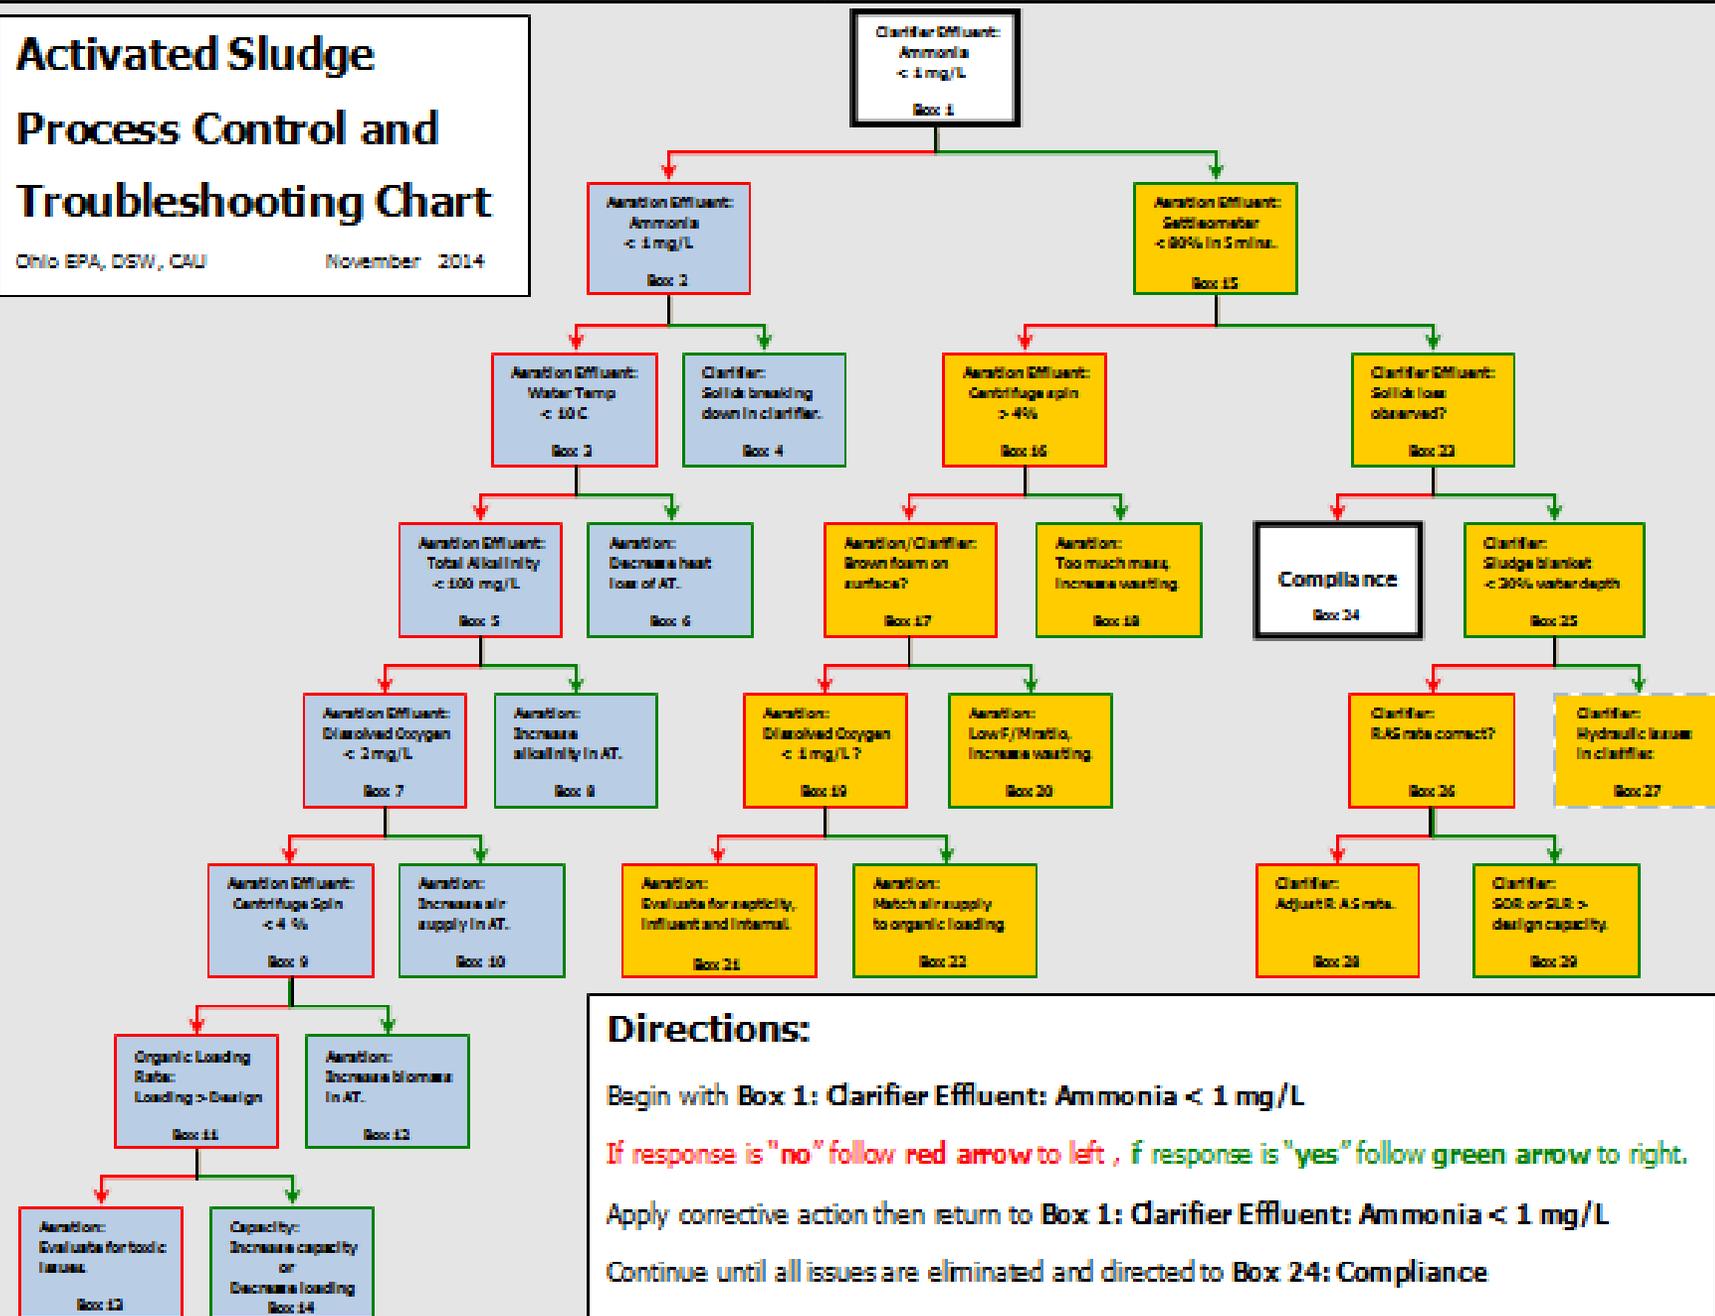

**Directions:**

Begin with **Box 1: Clarifier Effluent: Ammonia < 1 mg/L**

If response is "no" follow red arrow to left, if response is "yes" follow green arrow to right.


Apply corrective action then return to **Box 1: Clarifier Effluent: Ammonia < 1 mg/L**

Continue until all issues are eliminated and directed to **Box 24: Compliance**

# Activated Sludge Process Control and Troubleshooting Chart

Ohio EPA, OSW, CAU

November 2014

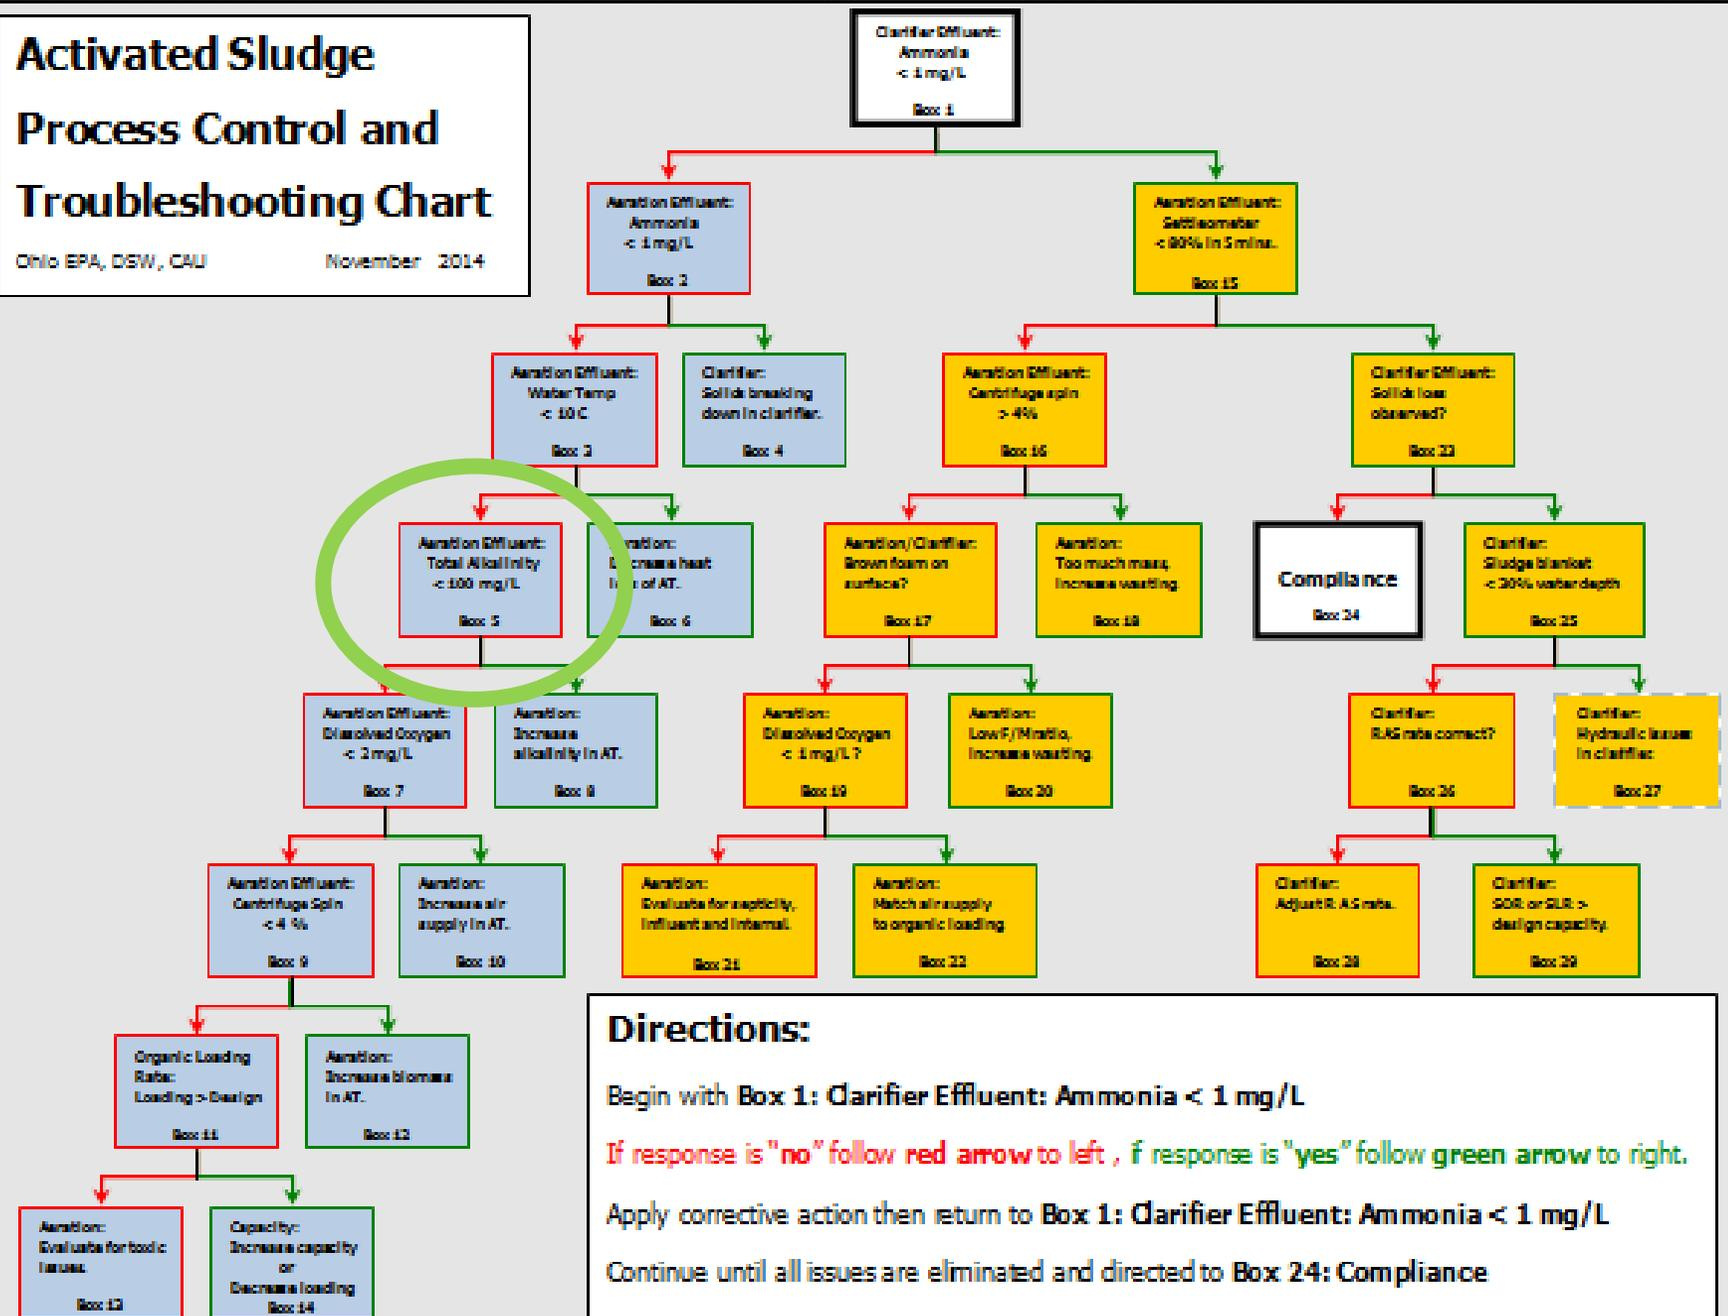


**Directions:**

Begin with **Box 1: Clarifier Effluent: Ammonia < 1 mg/L**

If response is "no" follow red arrow to left, if response is "yes" follow green arrow to right.

Apply corrective action then return to **Box 1: Clarifier Effluent: Ammonia < 1 mg/L**

Continue until all issues are eliminated and directed to **Box 24: Compliance**

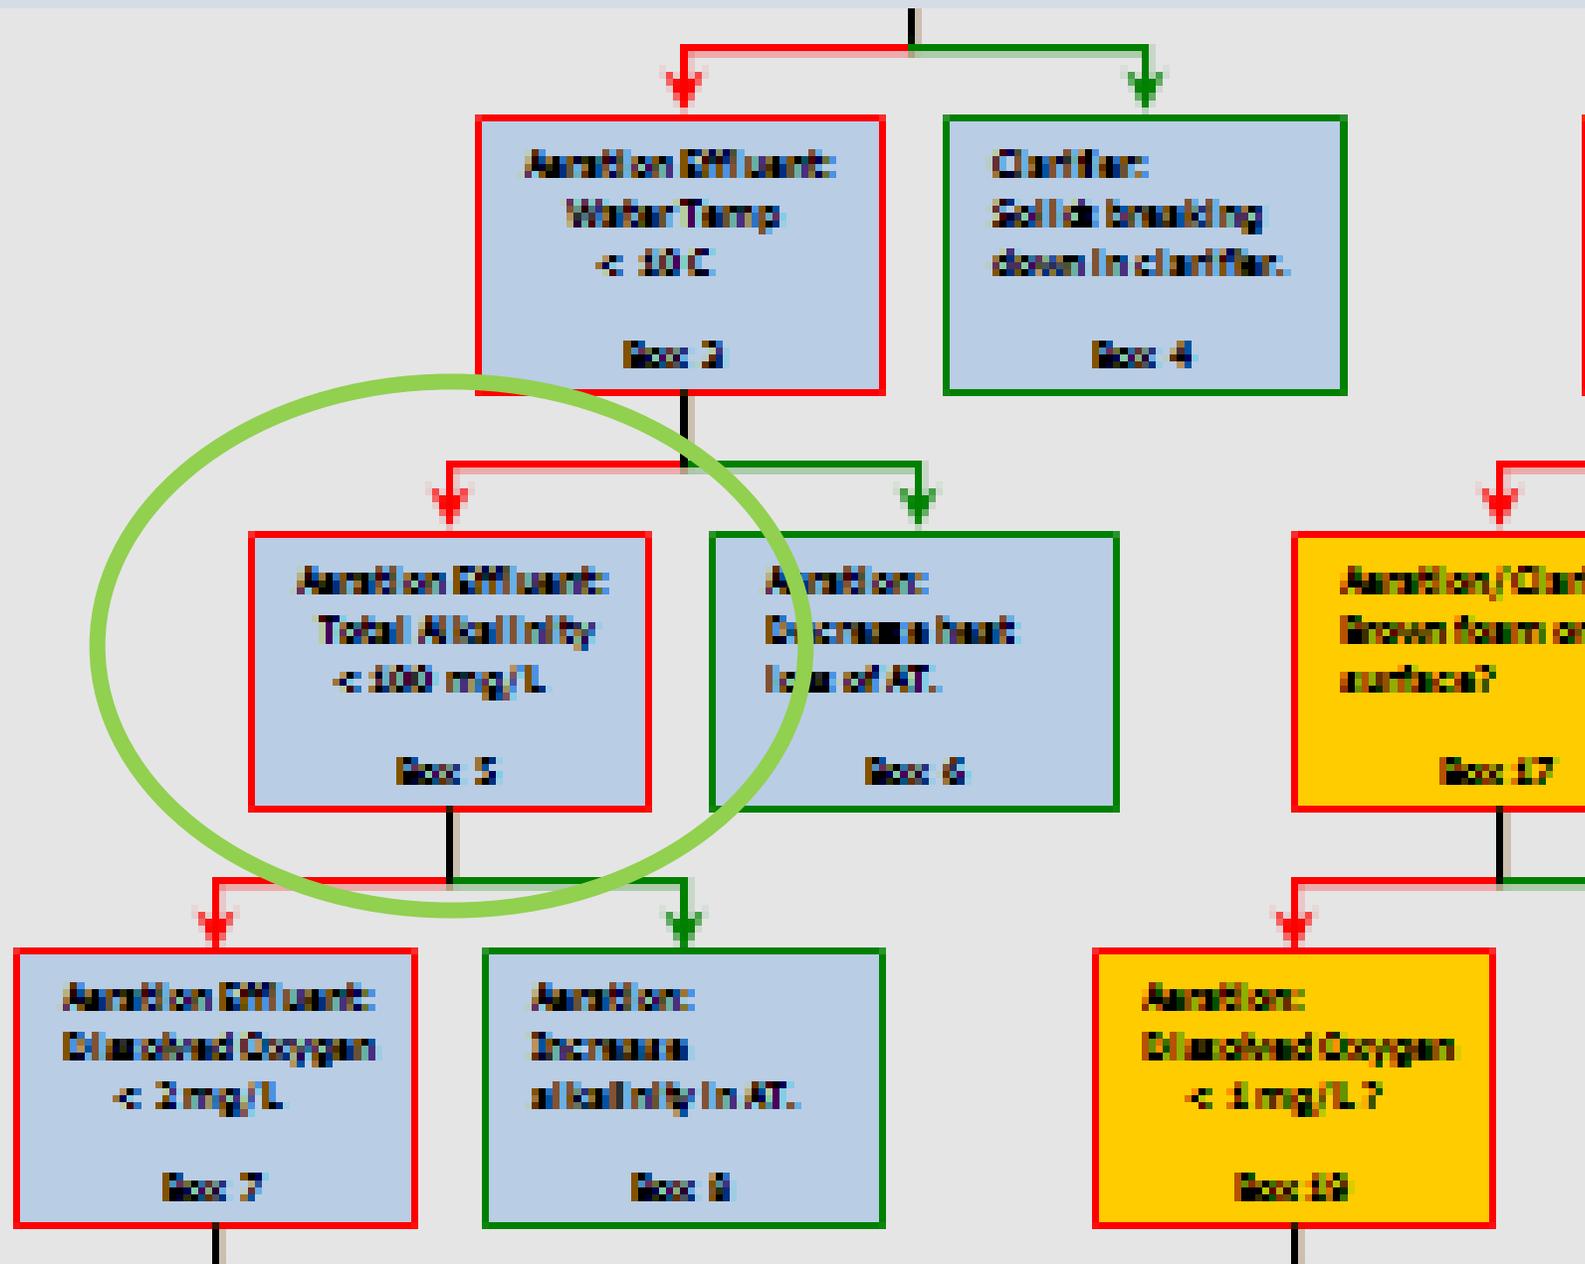

# Nitrification

## Why Nitrify?

Free Ammonia (unionized Ammonia) is toxic to aquatic organisms

Ionized Ammonia (ammonium) is an oxygen demanding substance

Nitrogen in any form is a nutrient (fertilizer)...

...and algae is a plant

# Nitrification

## Inhibitions to Nitrification in WWTPs:

Not enough dissolved oxygen (inefficient blowers; clogged diffusers)

Not enough temperature (winter)

Not enough biomass (nitrifiers)

Not enough time (capacity; high flows)

Not enough **alkalinity**

# Nitrification

Nitrifying bacteria are:

## Chemo-litho-auto-trophs

Energy Source:  
**Chemo** : Chemical Reaction  
Photo : Photon Reaction


Carbon Source:  
**Auto**: Inorganic Carbon  
Hetero: Organic Carbon

Electron Donor:  
**Litho** : Inorganic Chemicals  
Organo : Organic Chemicals


**Troph**: Eater

**“Rock Eaters”**

# Nitrification

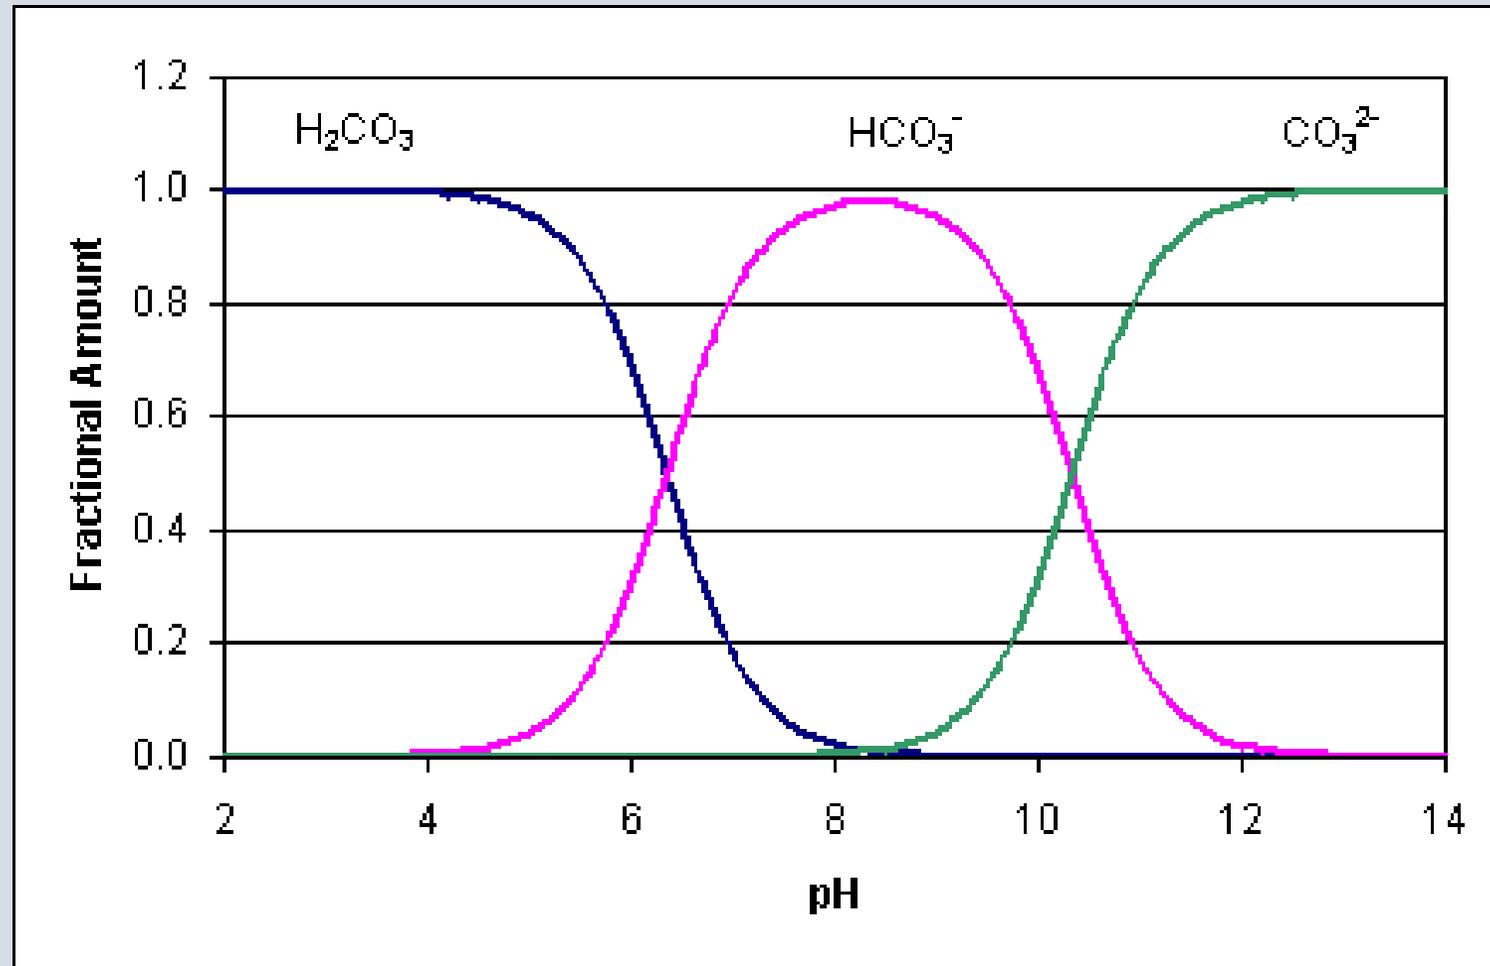

# Nitrification

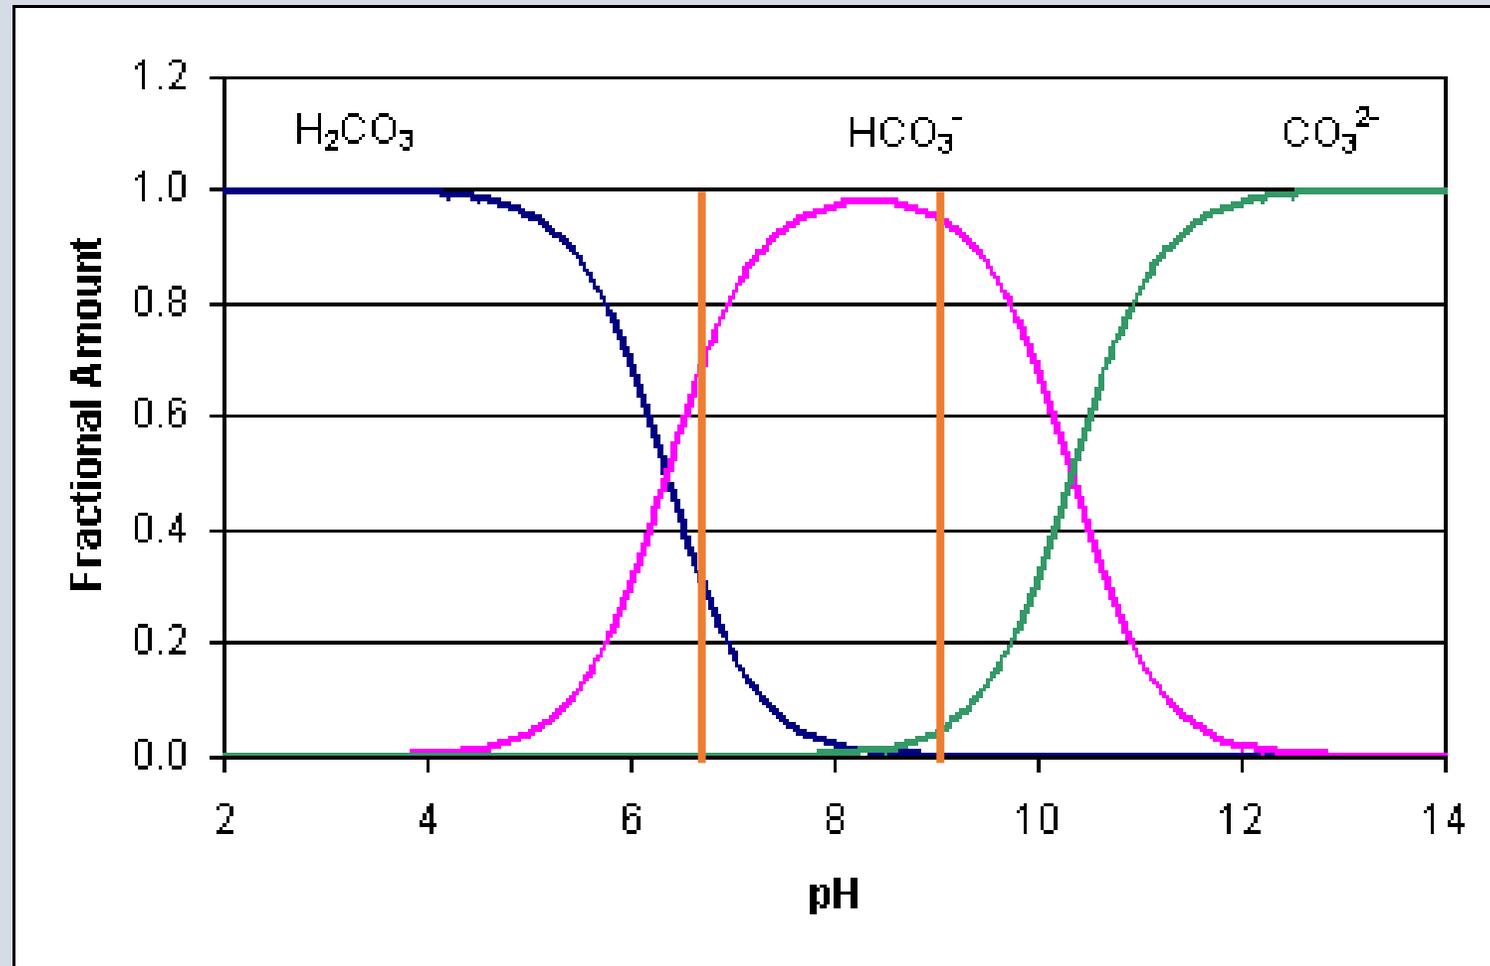

# Nitrification

**When the alkalinity is gone,**

**nitrification ceases...**

**until the alkalinity is replenished with influent,**

**and then nitrification proceeds,**

**until the alkalinity is gone again.**

# Nitrification

Typical Human Nitrogen Contribution in Domestic Wastewater:

16 grams/capita/d<sup>1</sup>

Per capita N	Per capita Q	mg/L NH <sub>3</sub> -N	Alkalinity for Nitrification (Bicarbonate Alkalinity)	Excess Alkalinity (Buffer)	Total Goal Alkalinity
16 gm	200 gpd	5.3 mg/L	38 mg/L	80 mg/L	118 mg/L
16 gm	100 gpd	10.6 mg/L	76 mg/L	80 mg/L	156 mg/L
16 gm	50 gpd	21.2 mg/L	152 mg/L	80 mg/L	232 mg/L
16 gm	25 gpd	42.4 mg/L	304 mg/L	80 mg/L	384 mg/L

<sup>1</sup> Sedlak, *Phosphorus and Nitrogen Removal from Municipal Wastewater*, Lewis Publishers, 2<sup>nd</sup> Ed.,1991

# Village of O\*\*\* WWTP



# Village of O


Parameter	Dilution	Meter	Concentration	Alkalinity Required
AT NH <sub>3</sub> -N	(1:9)	0.94	<b>9.4 mg/L</b>	67 mg/L
AT NO <sub>3</sub> -N	(1:0)	19.7	<b>19.7mg/L</b>	-
AT Alkalinity (LR)	12 drops (@5 mg / L / drop)	-	<b>60 mg/L</b>	67 (req) – 60 (available) + 80 (buffer) = 87 mg/L (additional)

The WWTP nitrifies until the alkalinity drops out.

When the Equalization Basin pumps influent into the aeration tank, nitrification continues,  
Until the alkalinity is gone again.

The County Water System is notorious for low alkalinity in the drinking water

# Nitrification

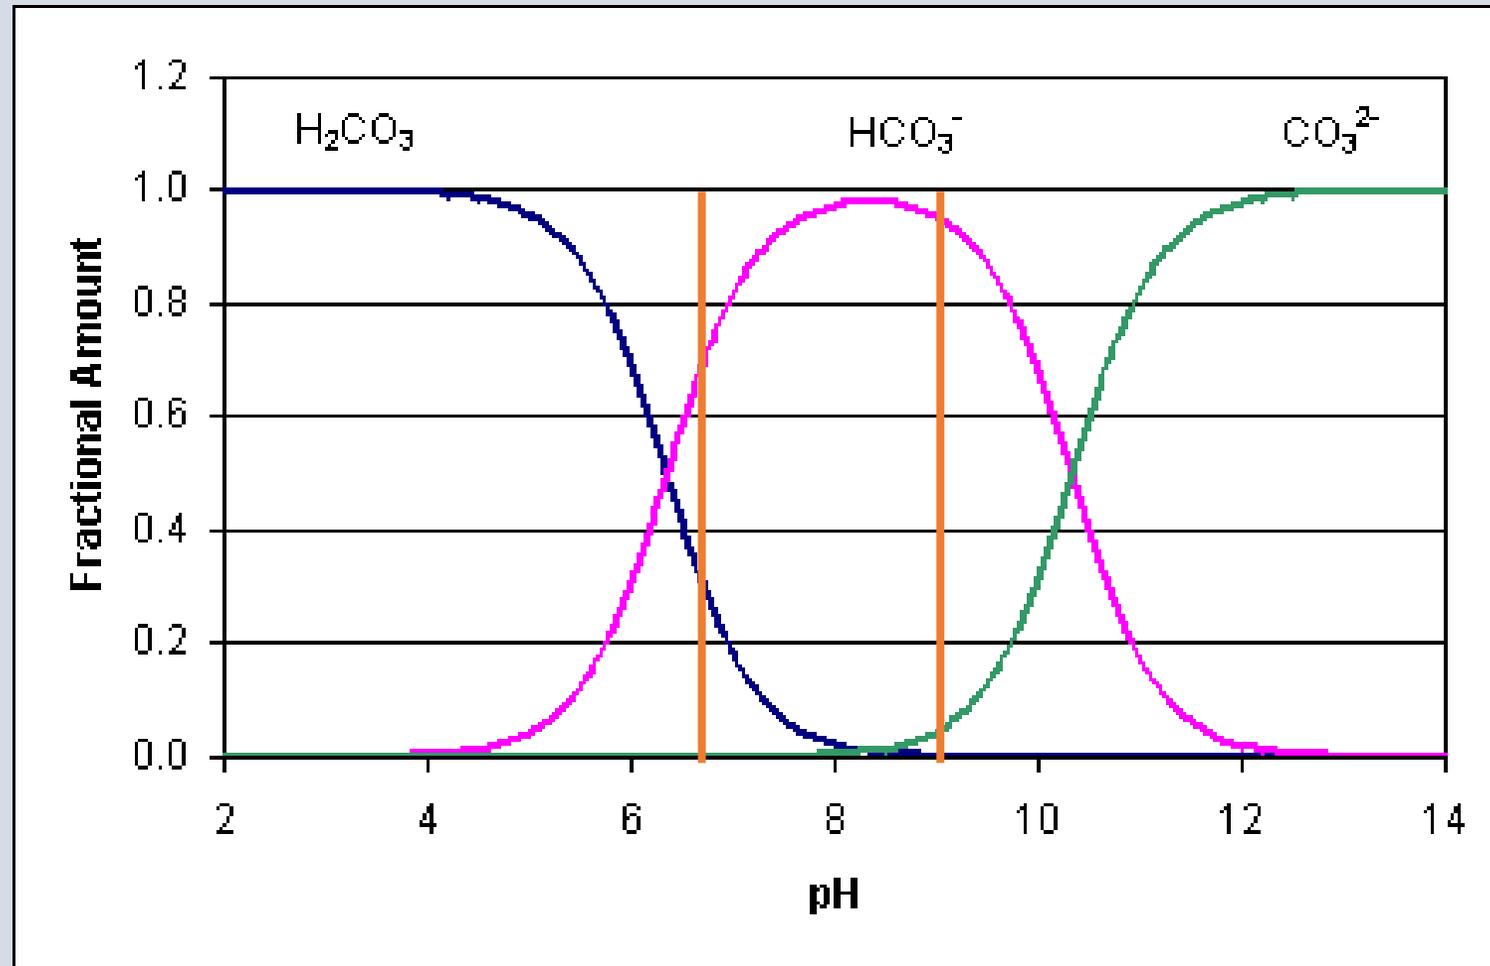

# Highland Local School District



# Highland Local School District



# Highland Local School District

- Trash Trap
- Flow Equalization
- Aeration: 2 trains – 25,000 gallon each
- Clarifier: 2 trains – one per train
- UFFM: 2
- Dosing Tank
- Sand Filters: 4
- UV Disinfection and Post Aeration

# Highland Local School District

In 2004:

New High School Constructed On Site

Existing High School Converted to Middle School (modernized)

Existing Middle School Converted to Elementary (modernized)

# Highland Local School District

## **Average Design Flow**

- **50,000 gpd**


## **Violations:**

- Ammonia

## **Symptoms from Operator:**


- Aeration Pinched Back or the pH Drops Out

# Highland School District WWTP Effluent Ammonia 2005-2008

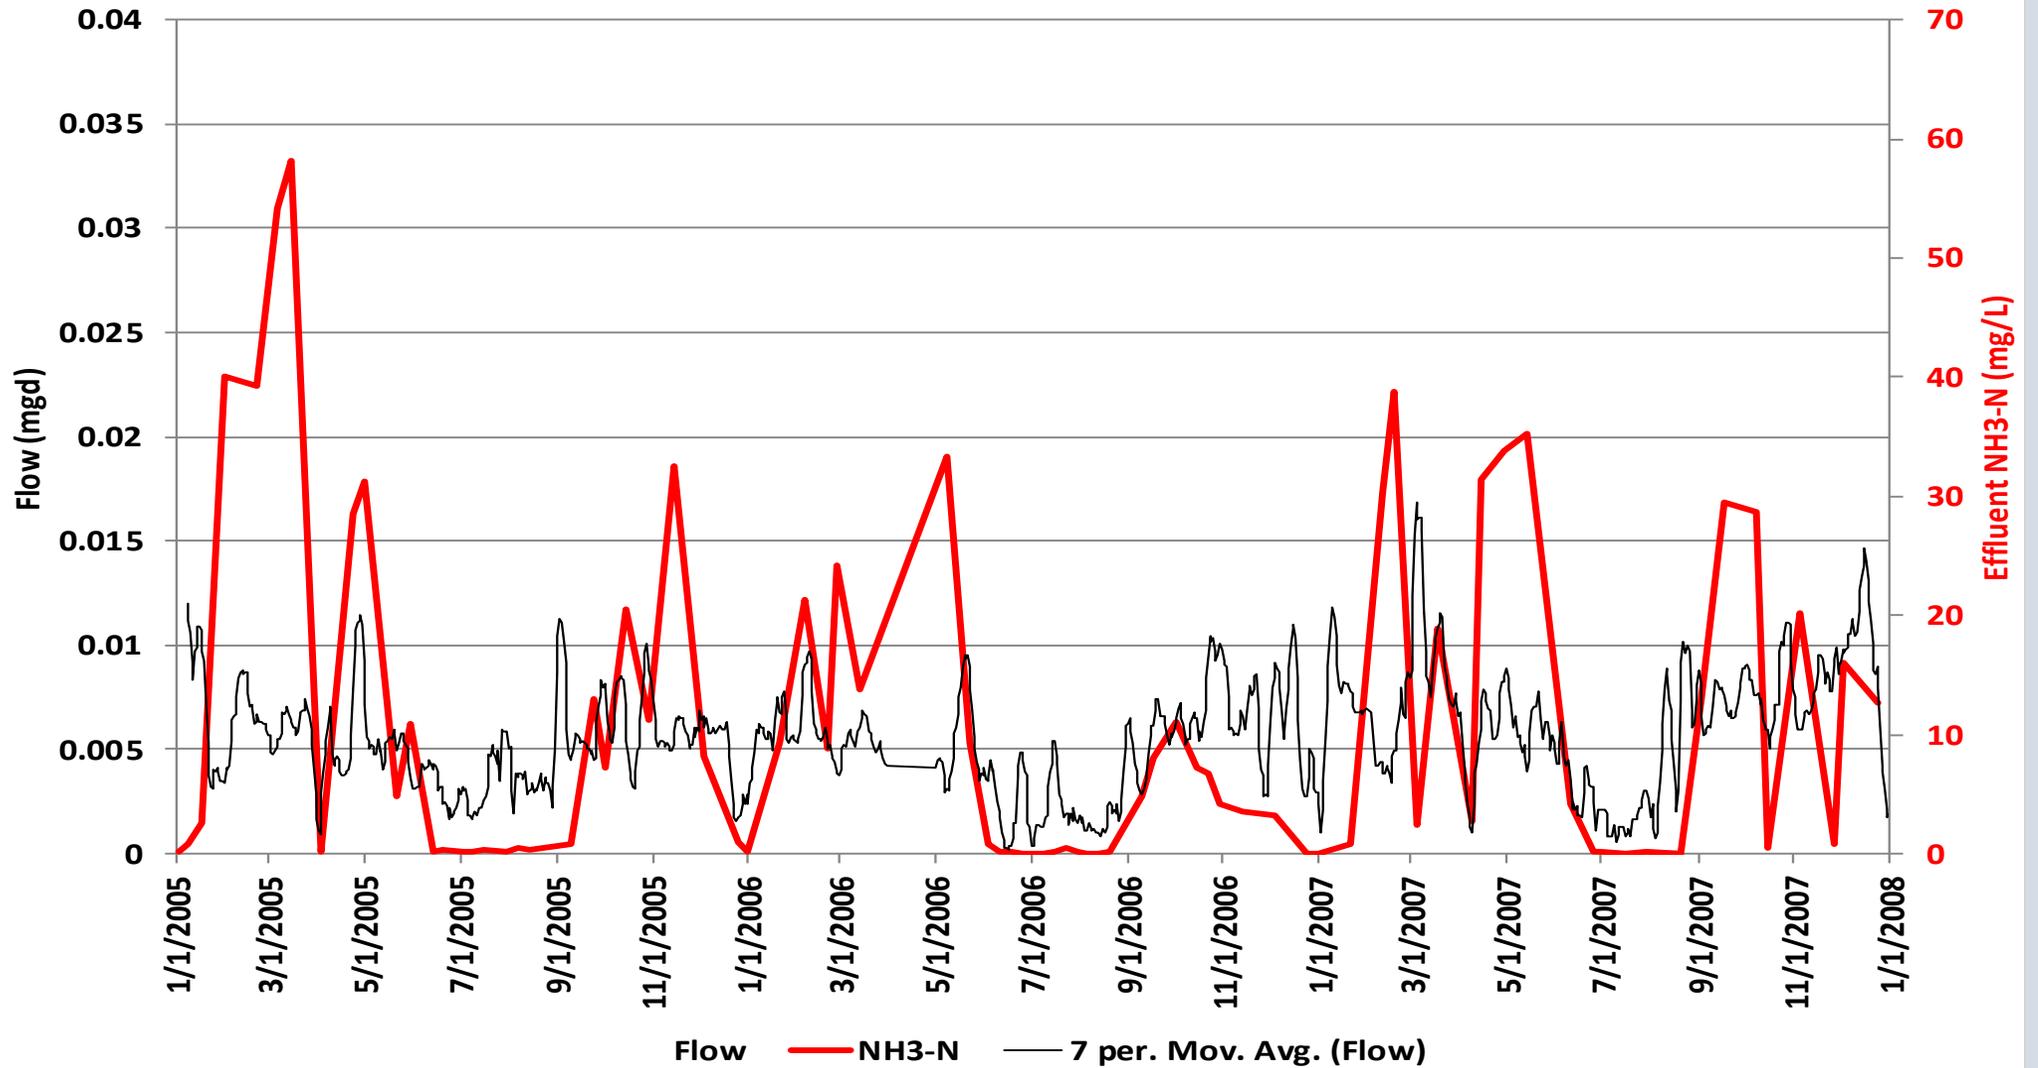

# Highland Local School District

- WWTP Alkalinity Limited
- Drinking water was low in alkalinity (~80 mg/L)
- Considered Feeding  $\text{NaHCO}_3$

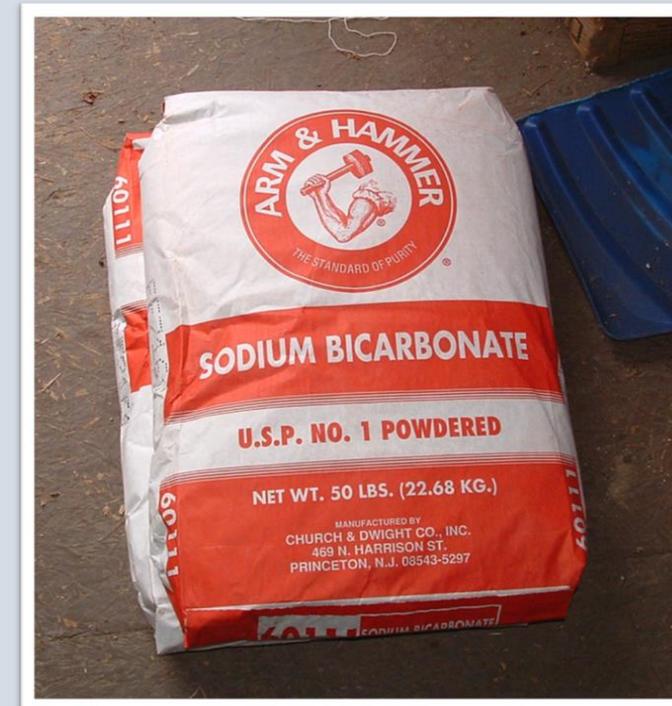


# Highland Local School District

**The School District  
Uses Well Water to  
Irrigate  
Athletic Fields**

**Well Alkalinity:  
> 400 mg/L**

**Started Dripping In  
Well Water**

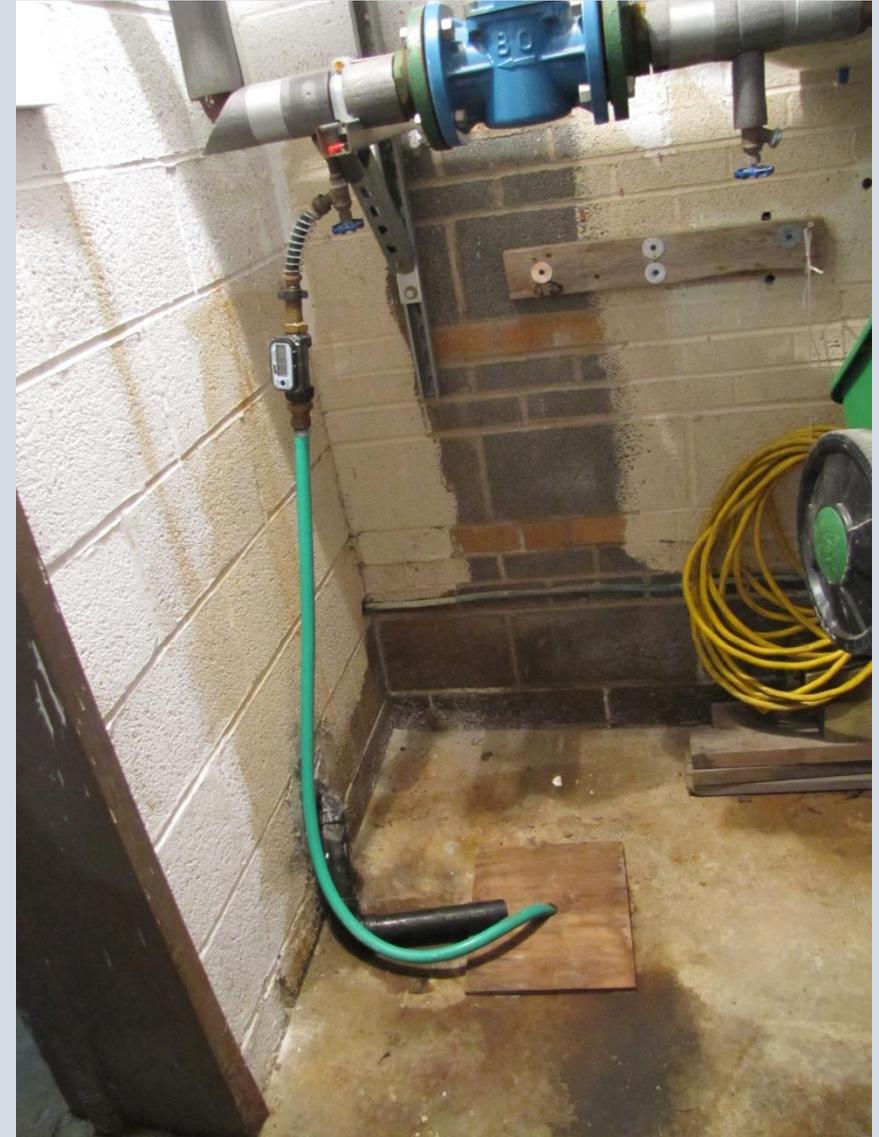


# Highland Local School District

- Started with ~ 2000 gpd (about 1.5 gpm)

Date	Day	Alkalinity	pH	NH3N	Temp	Notes
2/4	Monday	300	7.2	27	7	Started Well Feed 2000 gpd
2/5	Tuesday	340	7.2	44	9	Things worse! More Air?
2/6	Wednesday	300	-	8	-	Full Aeration
2/7	Thursday	100	6.9	3	6.5	Increased Well Feed to 7000 gpd
2/8	Friday	40	6.5	0.1	7.5	Hit the Limit!
2/11	Monday	120	7.1	0.4	5.5	Adjust Feed Rate

### Highland School District WWTP Effluent Ammonia 2005-2012

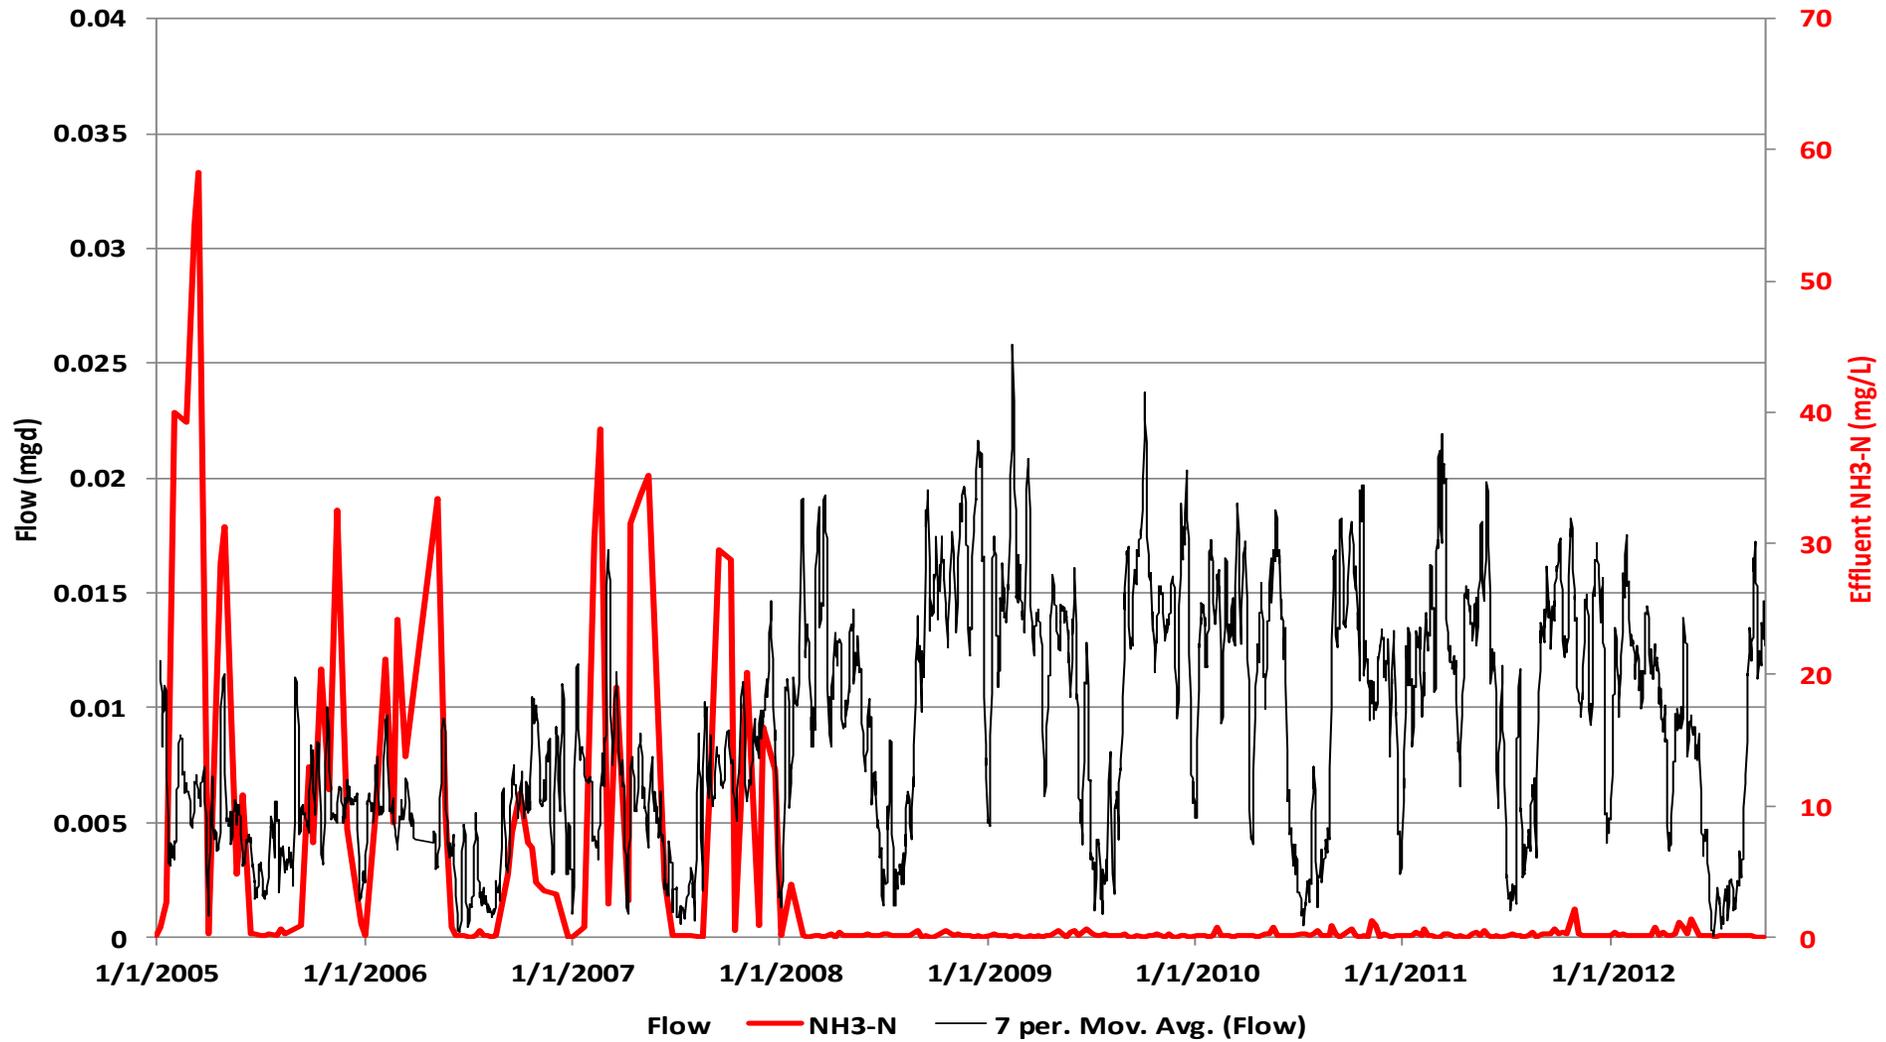

# Highland Local School District

From February 2008 up to Today

- Checks ammonia, Alkalinity
- Operates only One Treatment Train
- Runs Aeration On/Off to promote denitrification (~ 15 hours/day)
- Feeds approximately <5000 gpd Well Water
- Influent Flow: 12,000 – 15, 000 gpd
- In Compliance.

# Hardin Northern School District



# Hardin Northern School District



# Hardin Northern School District



# **Hardin Northern School District**

**10,000 gpd Package Plant**

**School Expanded and Remodeled in 2010**

**Water Conservation Plumbing**

# Hardin Northern School District

**10,000 gpd Package Plant**

**School Expanded and Remodeled in 2010**

**Water Conservation Plumbing**

**<1000 gallons per day influent flow**

# Hardin Northern School District

## Compliance Issues:

High Ammonia

High cBOD5

High Total Suspended Solids

**No conversion**

**No separation**

# Hardin Northern School District

## Compliance Issues:

**High Ammonia**

**High cBOD<sub>5</sub>**

**High Total Suspended Solids**

**High Operator Anxiety**

# Hardin Northern School District

## Initial Observations

### Settleometer

5 minutes

500 (very turbid)

30 minutes

100 (still very turbid)

# Hardin Northern School District

## Initial Observations

### Settleometer

5 minutes	500 (very turbid)
30 minutes	100 (still very turbid)

### Centrifuge Spins

Aeration Tank 1:	3.5
Aeration Tank 2:	2.5
Clarifier Core 1:	4.2
Clarifier Core 2:	4.2
RAS 1	: 3.5
RAS 2	: 3.2

# Hardin Northern School District

## Initial Observations

### Ammonia Profile

Influent (EQ)	> 150 mg/L
Aeration Tank 1	5.0 mg/L
Aeration Tank 2	4.6 mg/L
Sand Filter Dosing Tank	5.2 mg/L

# Hardin Northern School District

## Initial Observations

**Aeration Tank Temperature: ~ 5 – 6 C**

# Hardin Northern School District

## Initial Observations

**Aeration Tank Temperature: ~ 5 – 6 C**

**Aeration Cycle: 1.5 hours ON / 1.5 hours OFF**

# Hardin Northern School District

## Initial Observations

**Aeration Tank Temperature: ~ 5 – 6 C**


**Aeration Cycle: 1.5 hours ON / 1.5 hours OFF**

**Aeration Tank Alkalinity: 40 – 50 mg/L**

# Dataloggers: Onset "HOBO" Pressure Transducer





# Datasondes: YSI 600 XLM

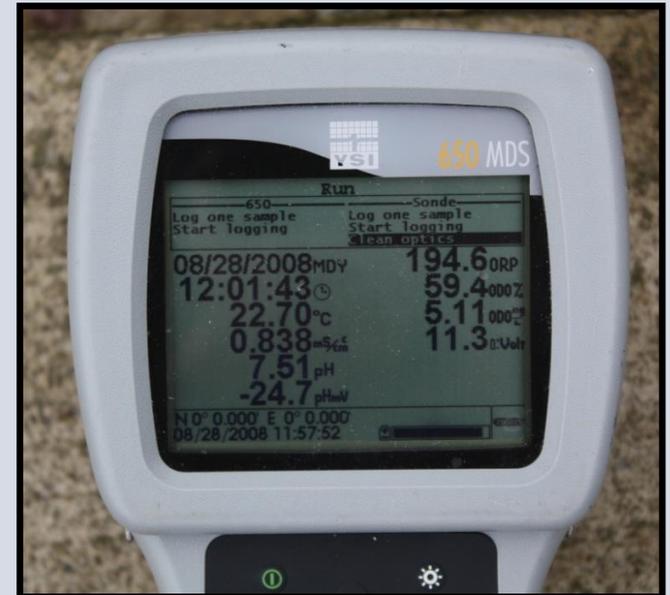

# Hardin Northern School District

## Aeration Tank 1

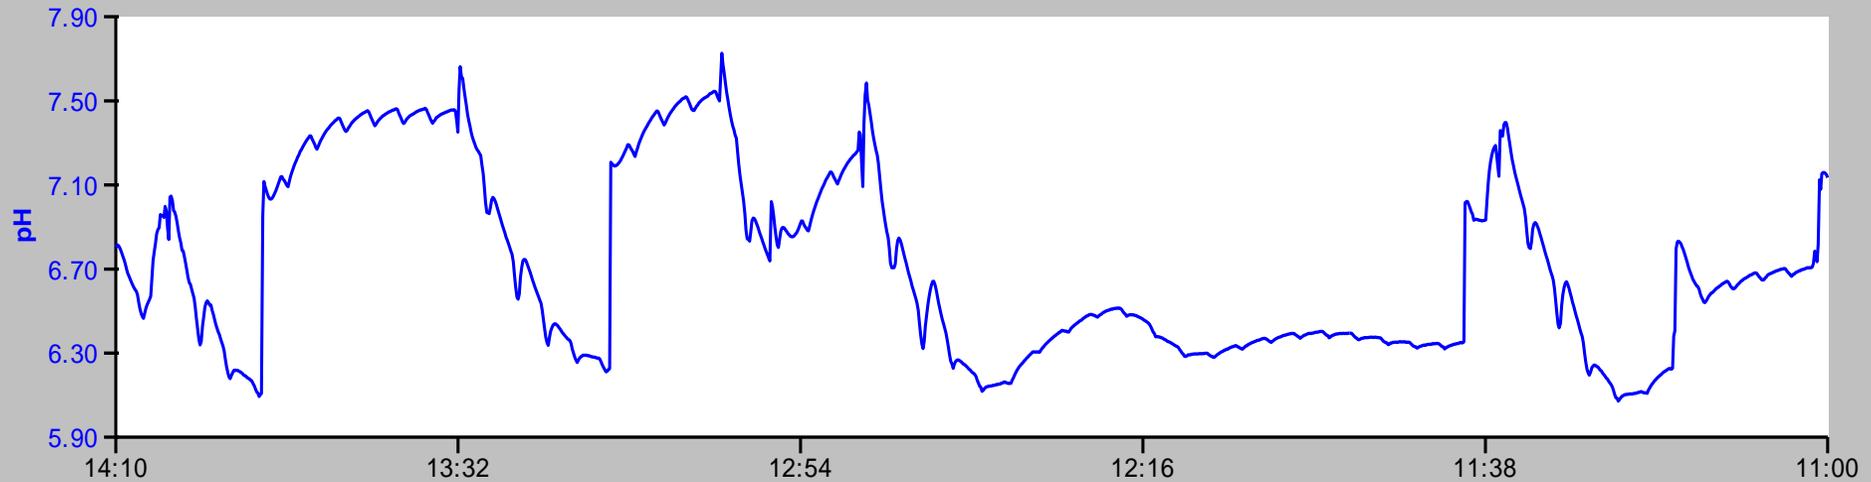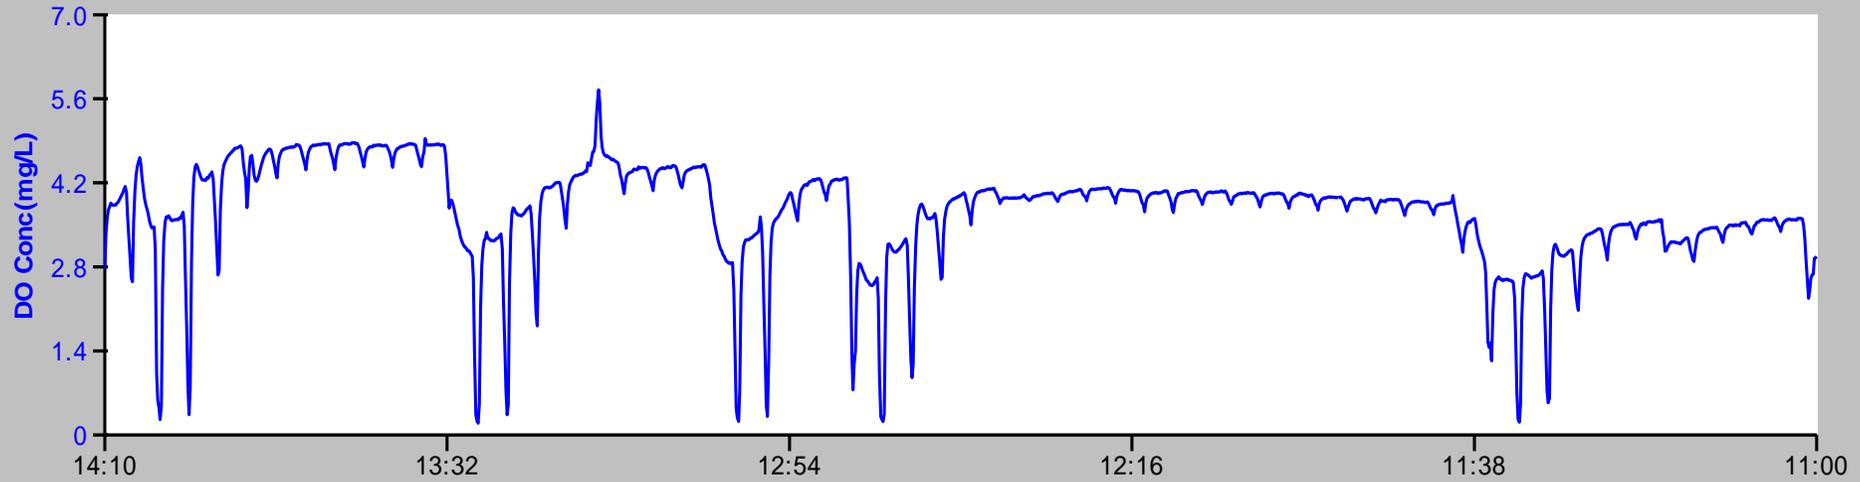

02/13/12

02/15/12

02/17/12


02/19/12

02/21/12


02/23/12

DateTime(M/D/Y)


# Hardin Northern School District Flow and pH Study Tuesday, February 14, 2012

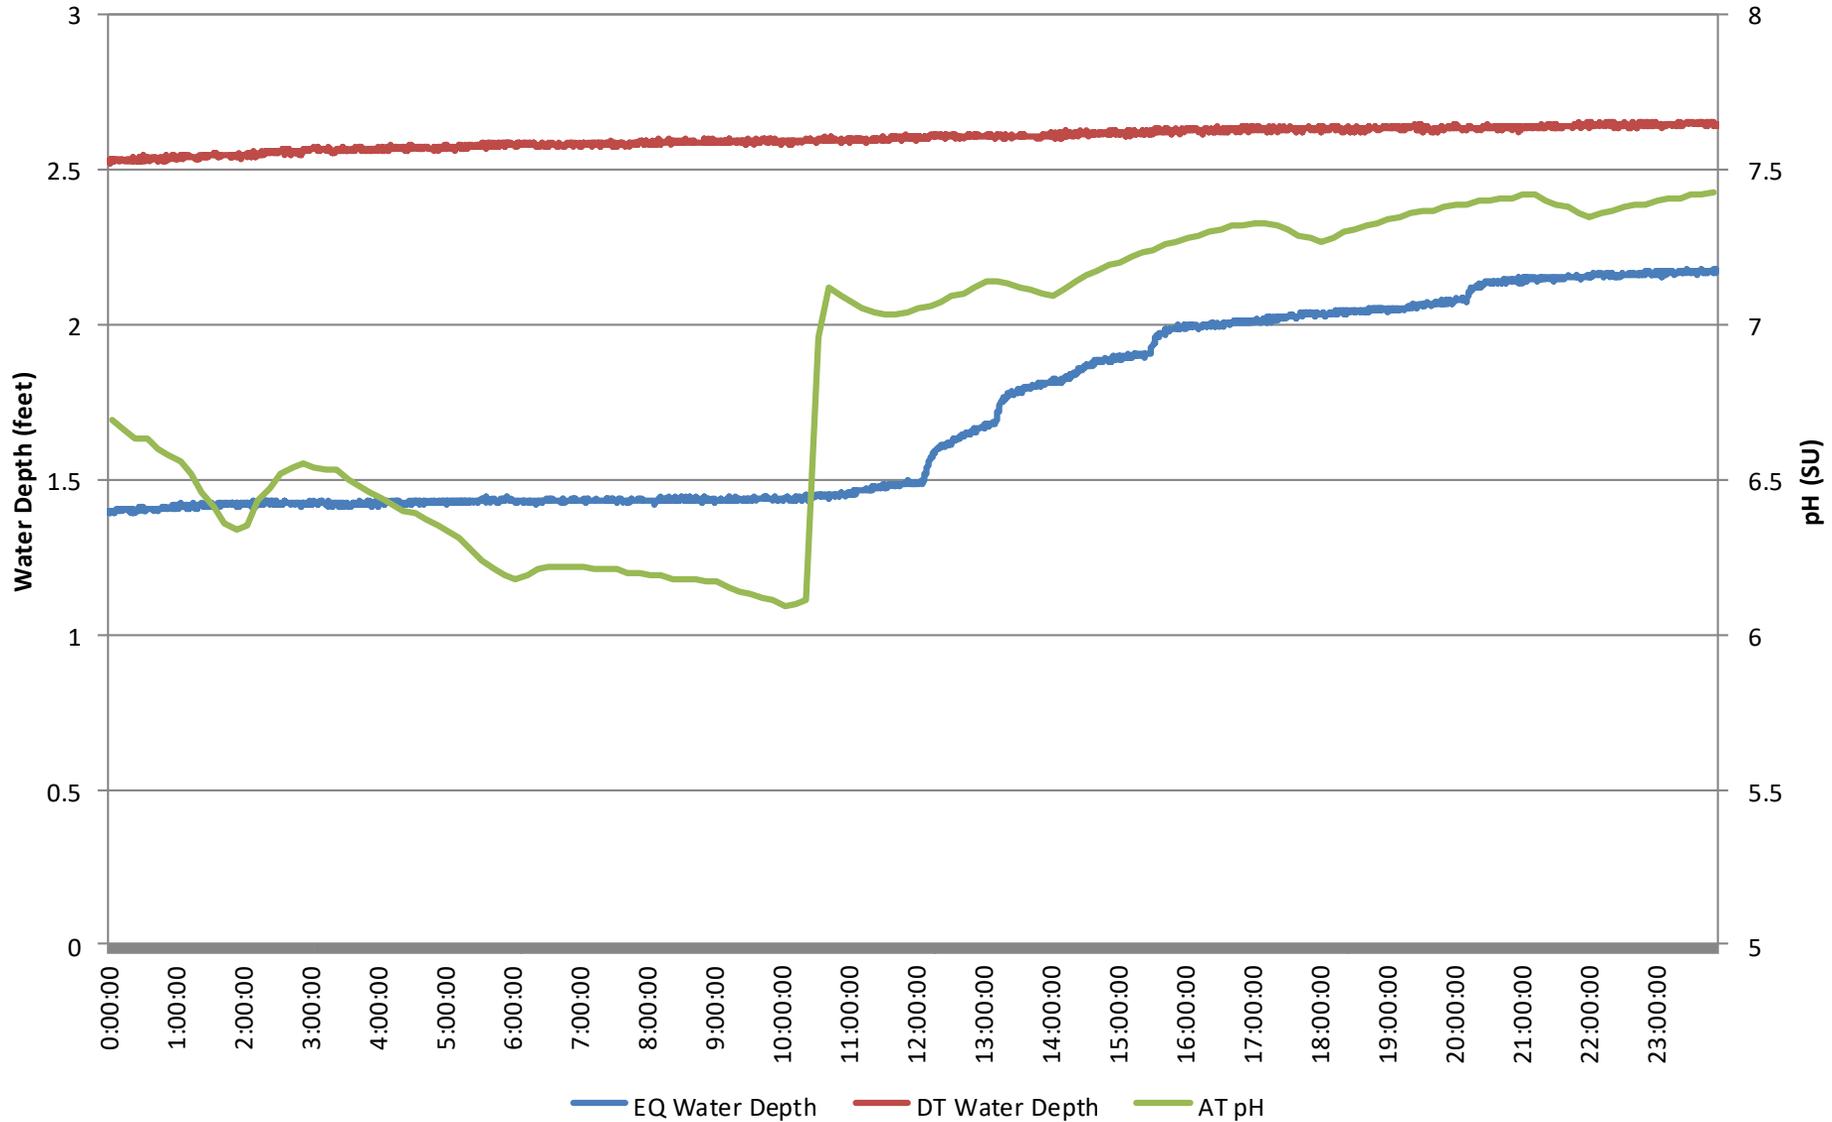


# Hardin Northern School District Flow and pH Study Wednesday, February 15, 2012

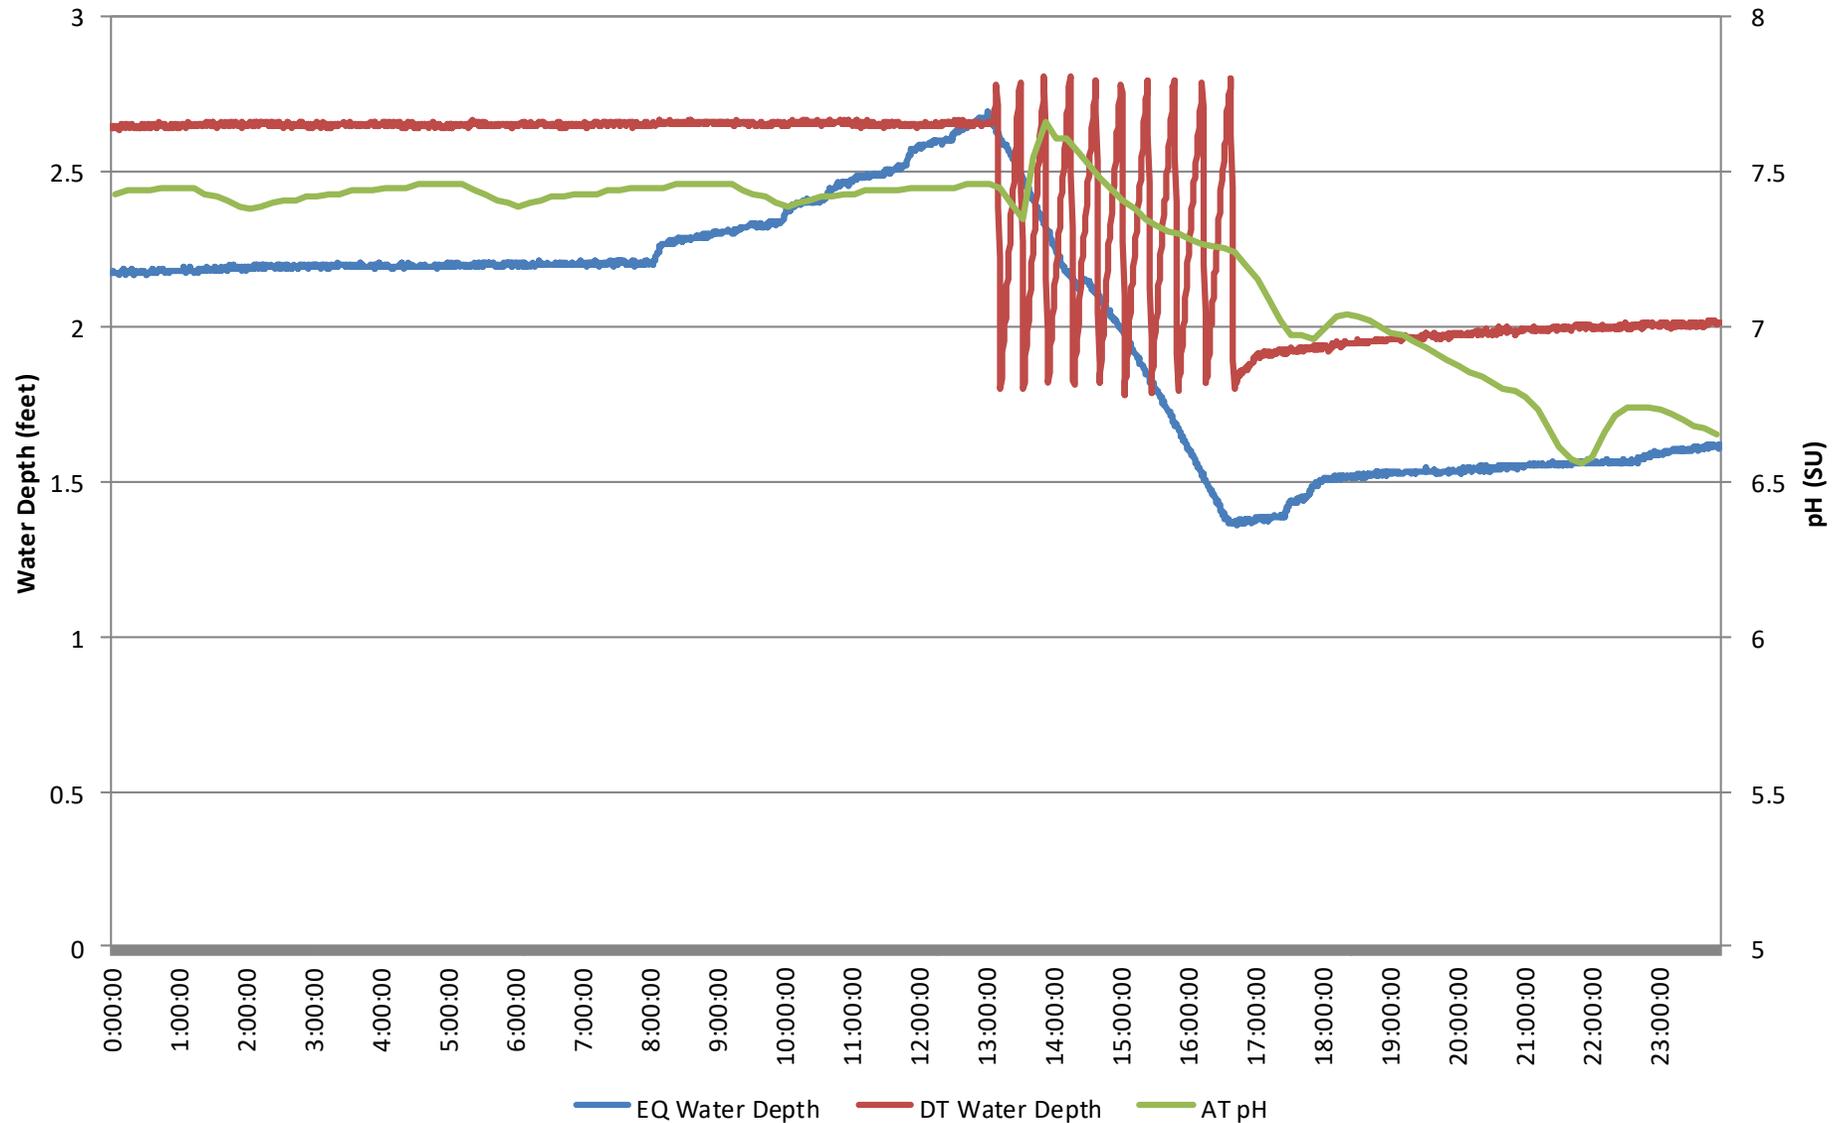


# Hardin Northern School District Flow and pH Study Thursday, February 16, 2012

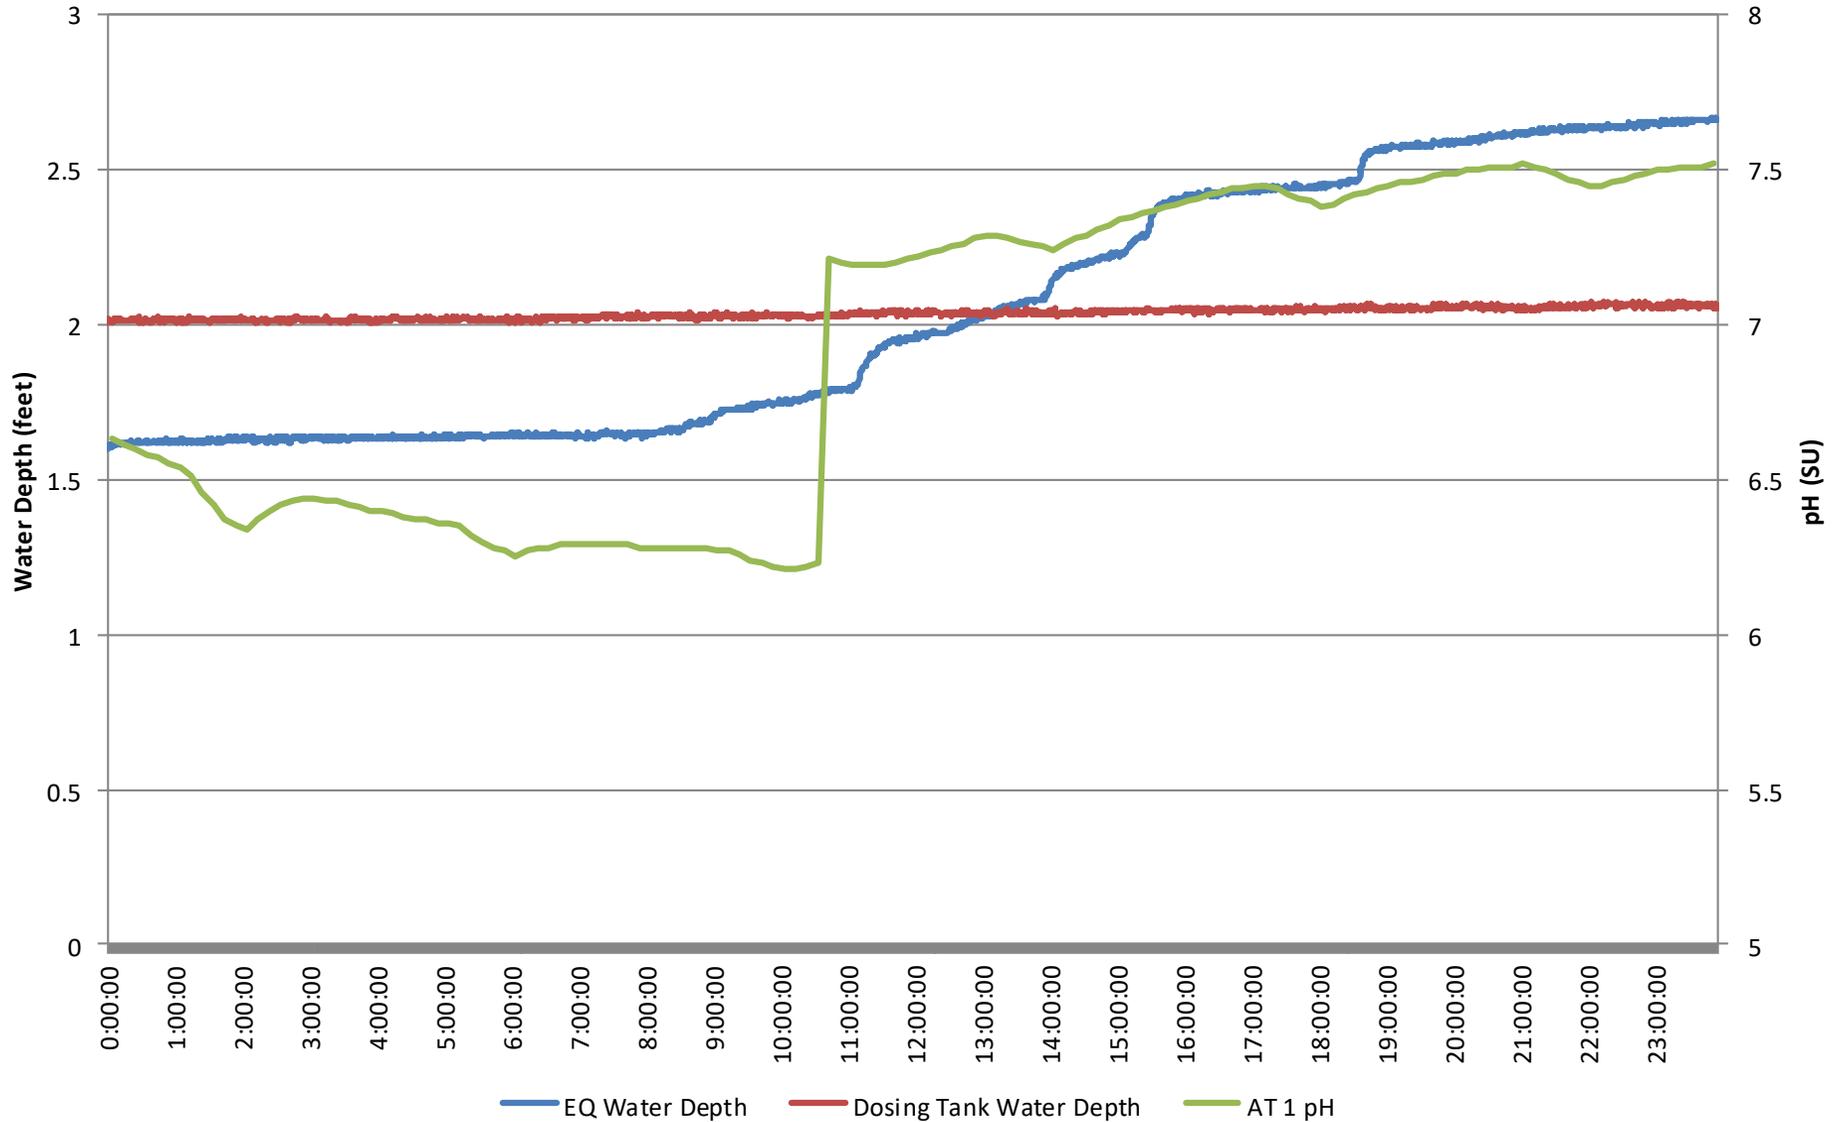


# Hardin Northern School District Flow and pH Study Friday, February 16, 2012

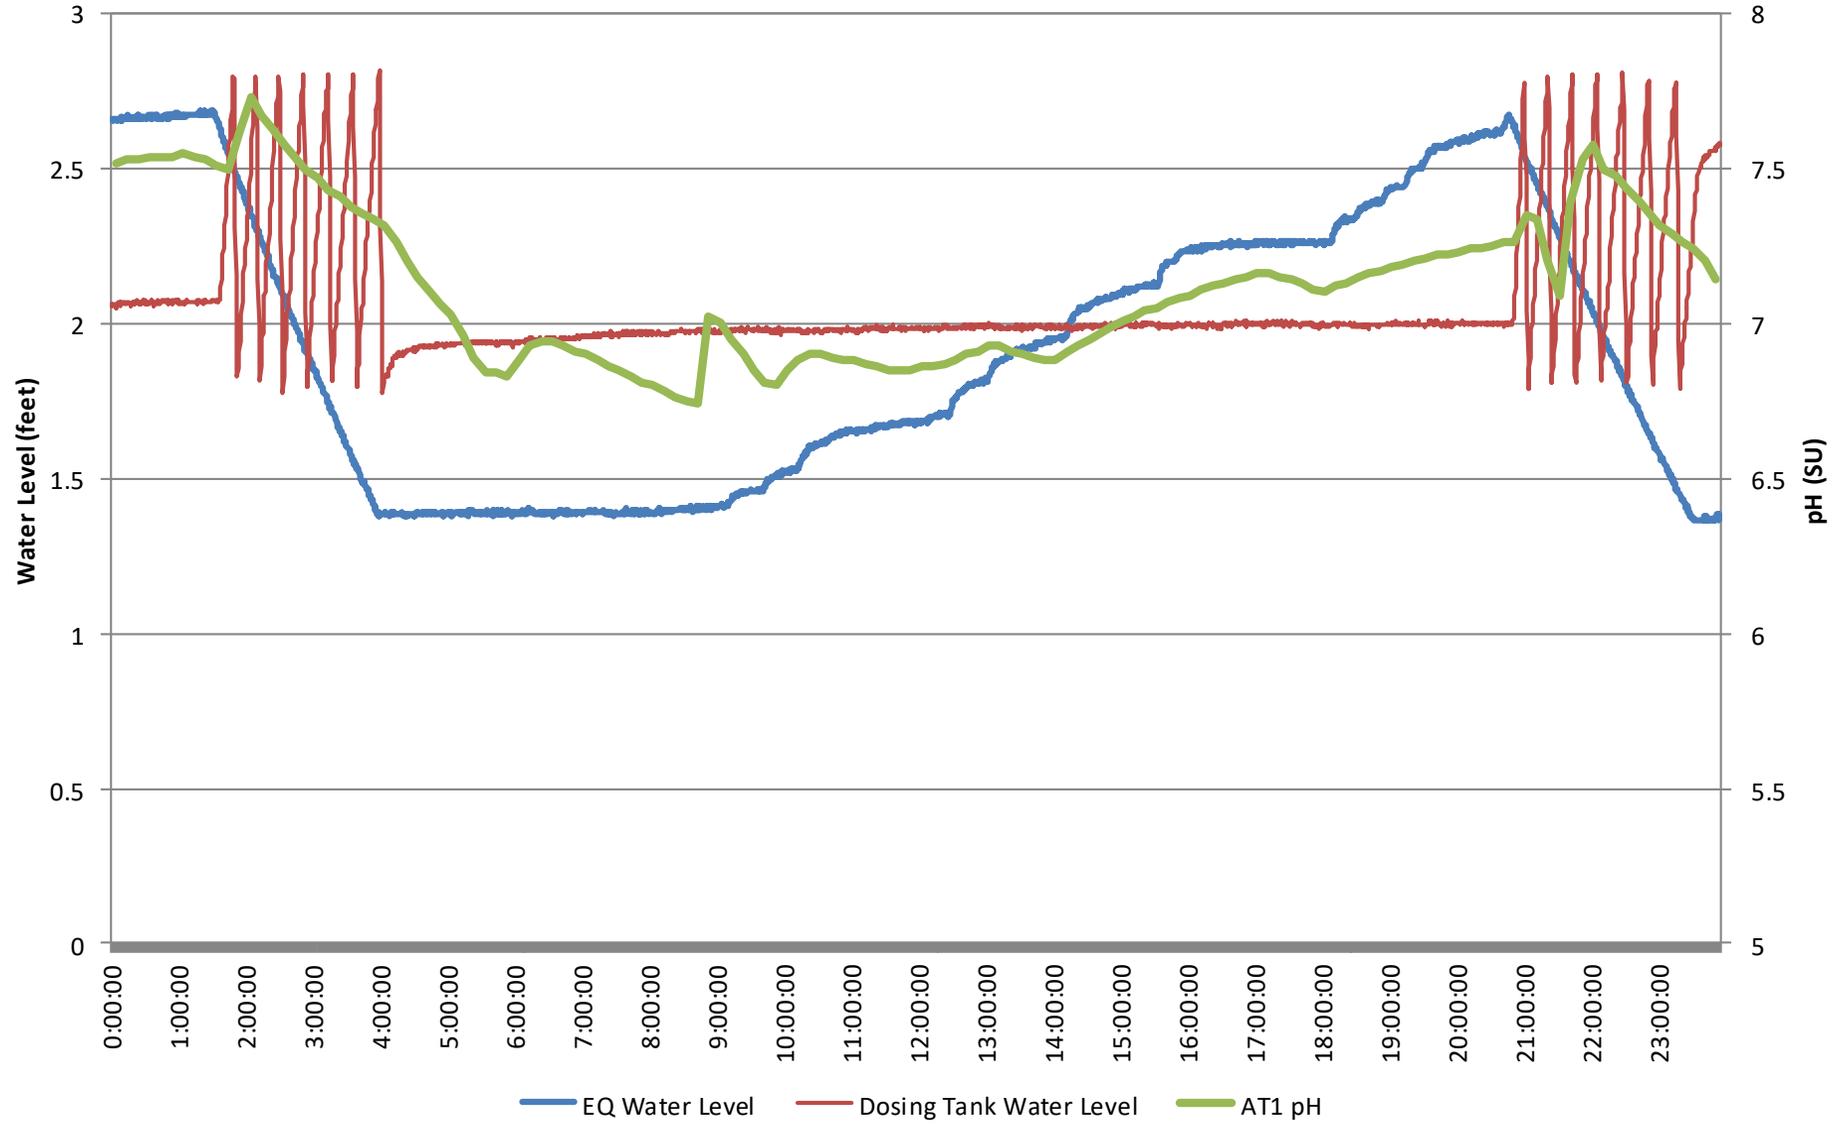


# Hardin Northern School District Flow and pH Study Saturday, February 18, 2012

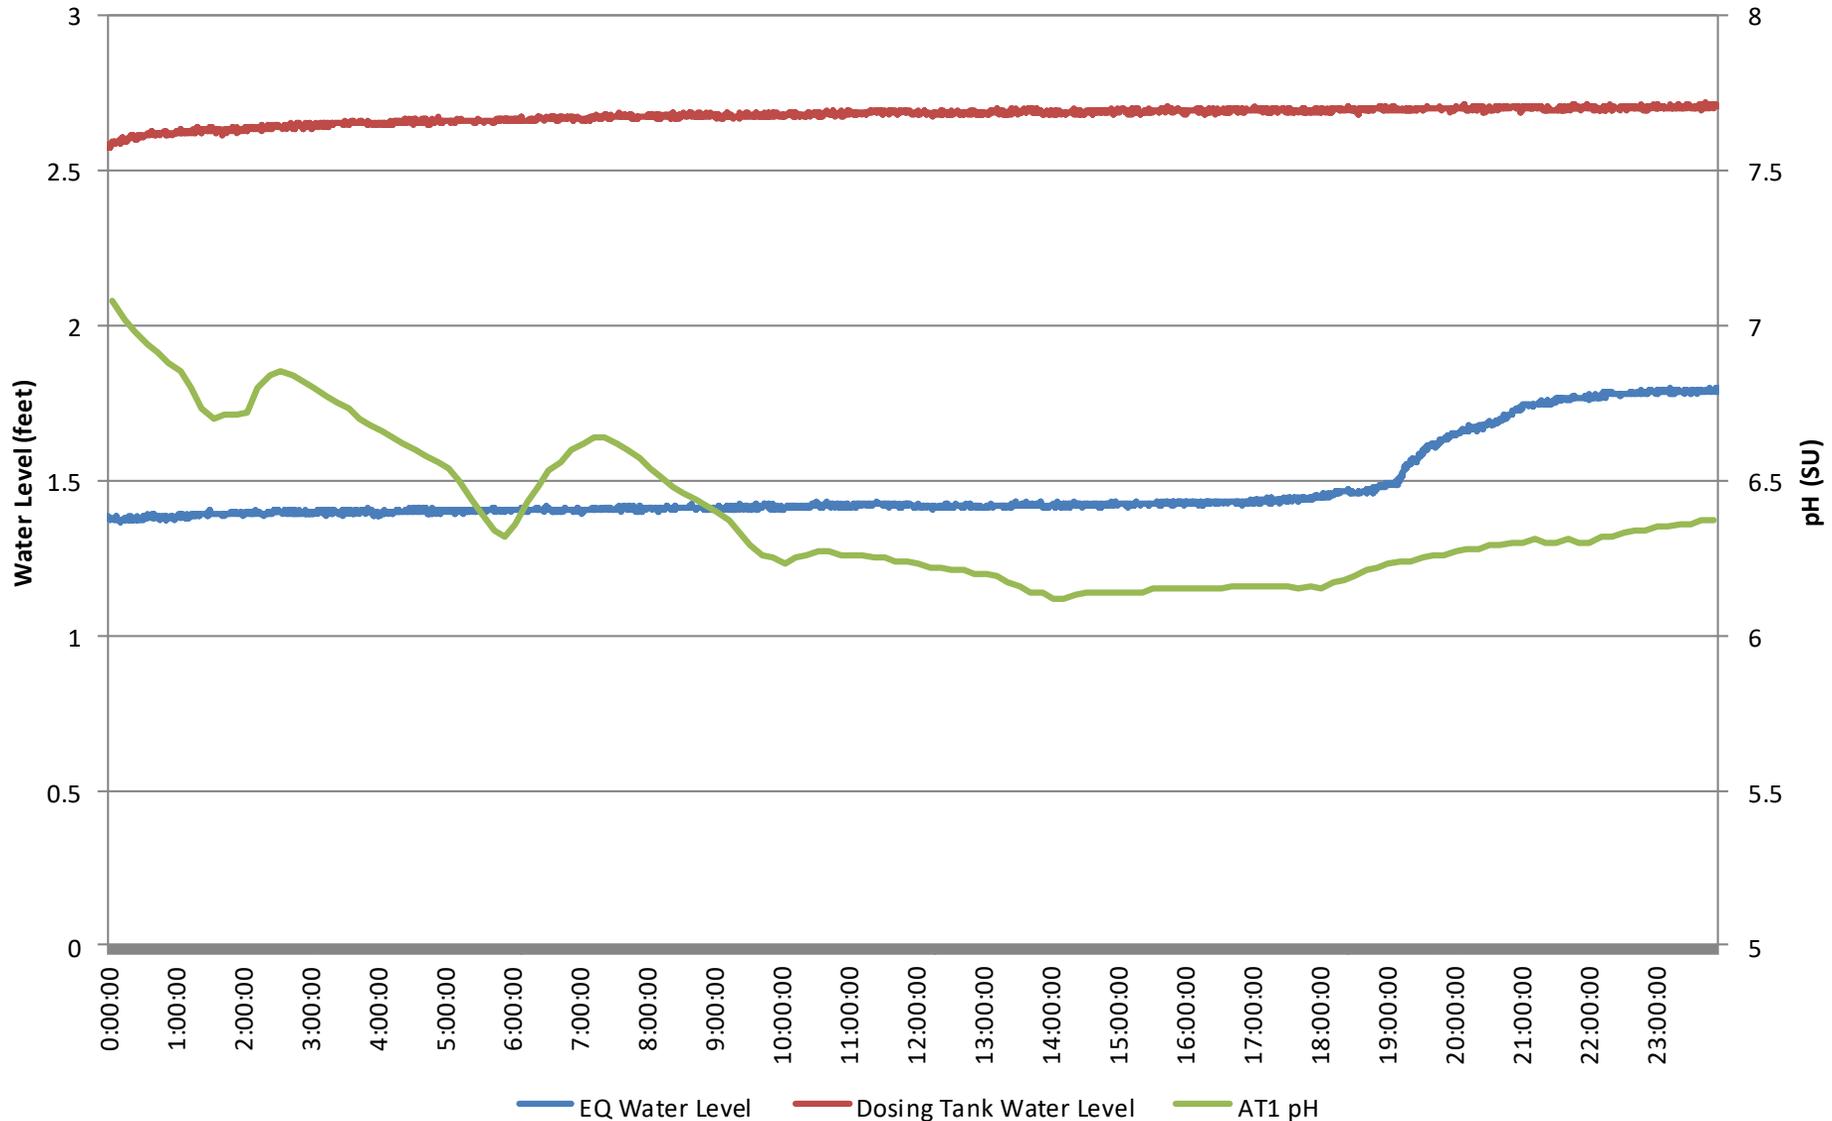


# Hardin Northern School District Flow and pH Study Sunday, February 19, 2012

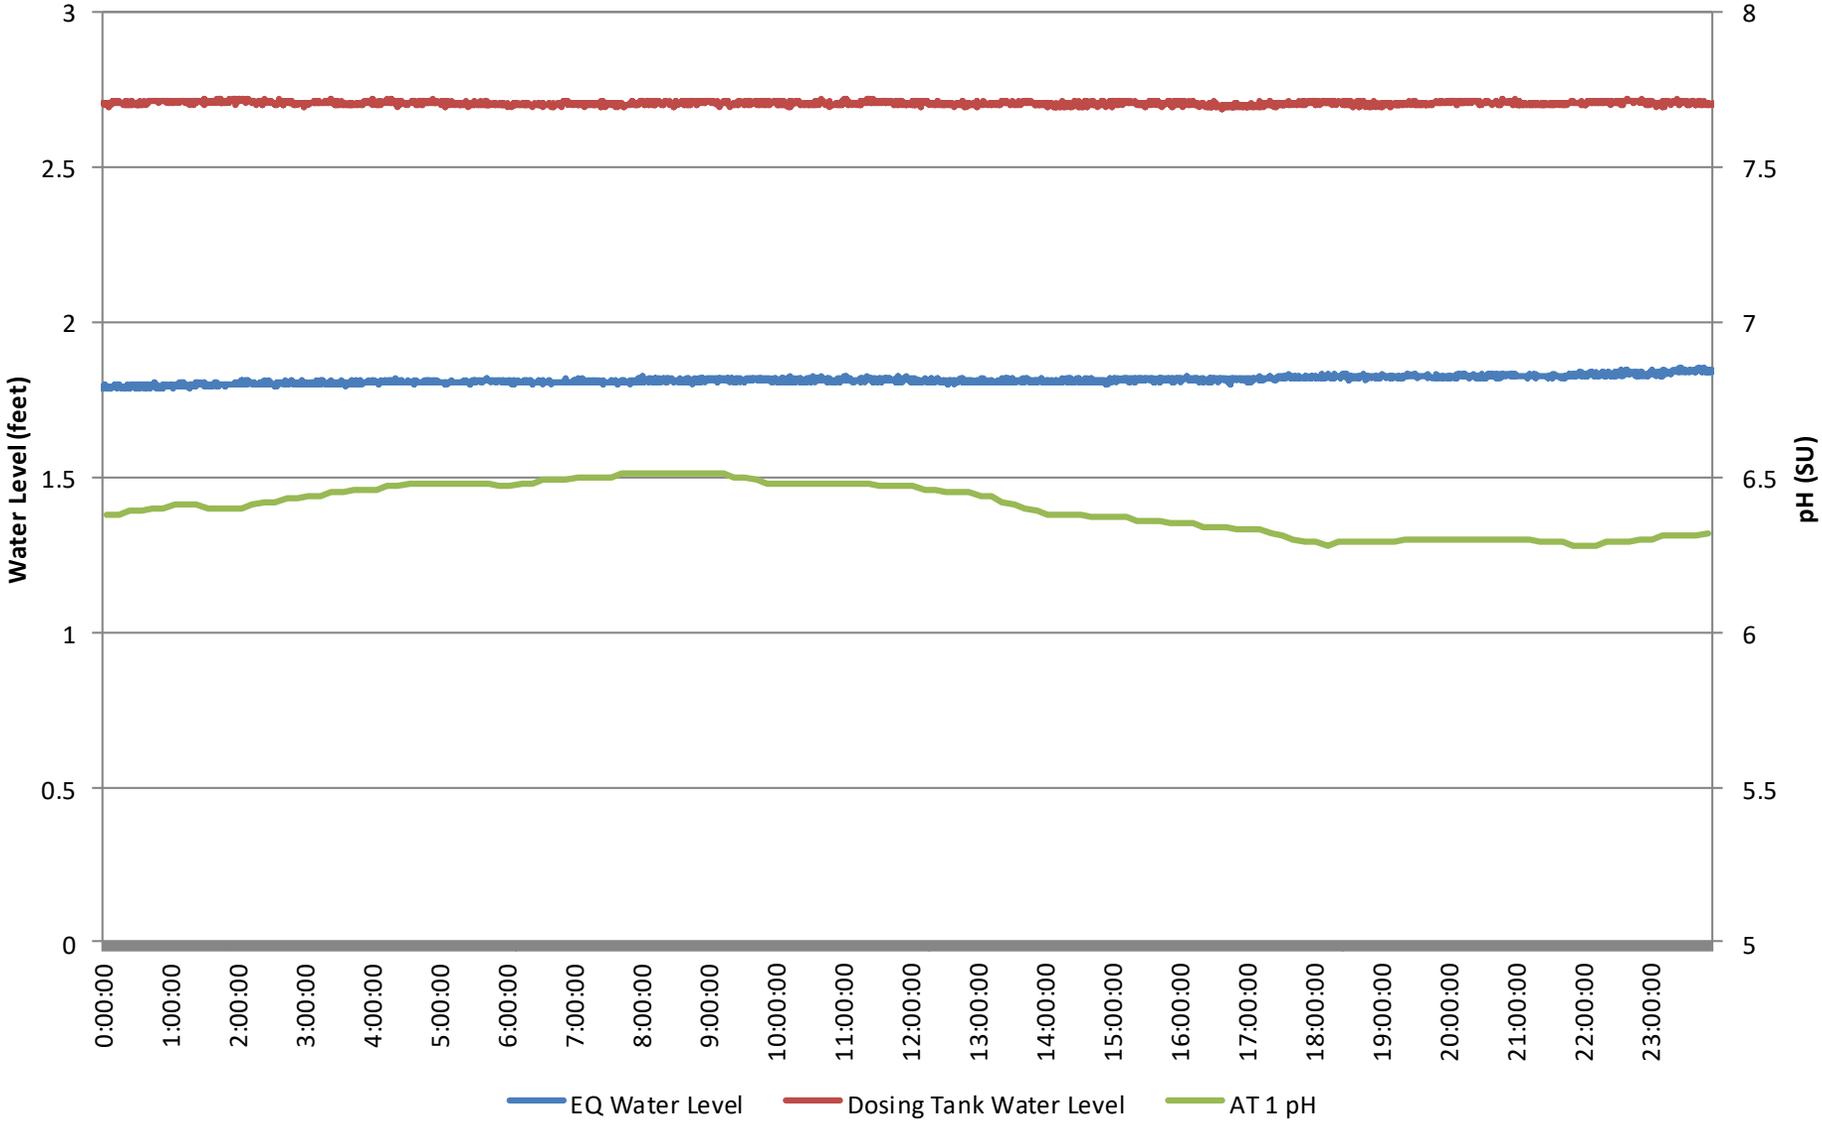

# Hardin Northern School District Flow and pH Study Monday, February 20, 2012 (No School)

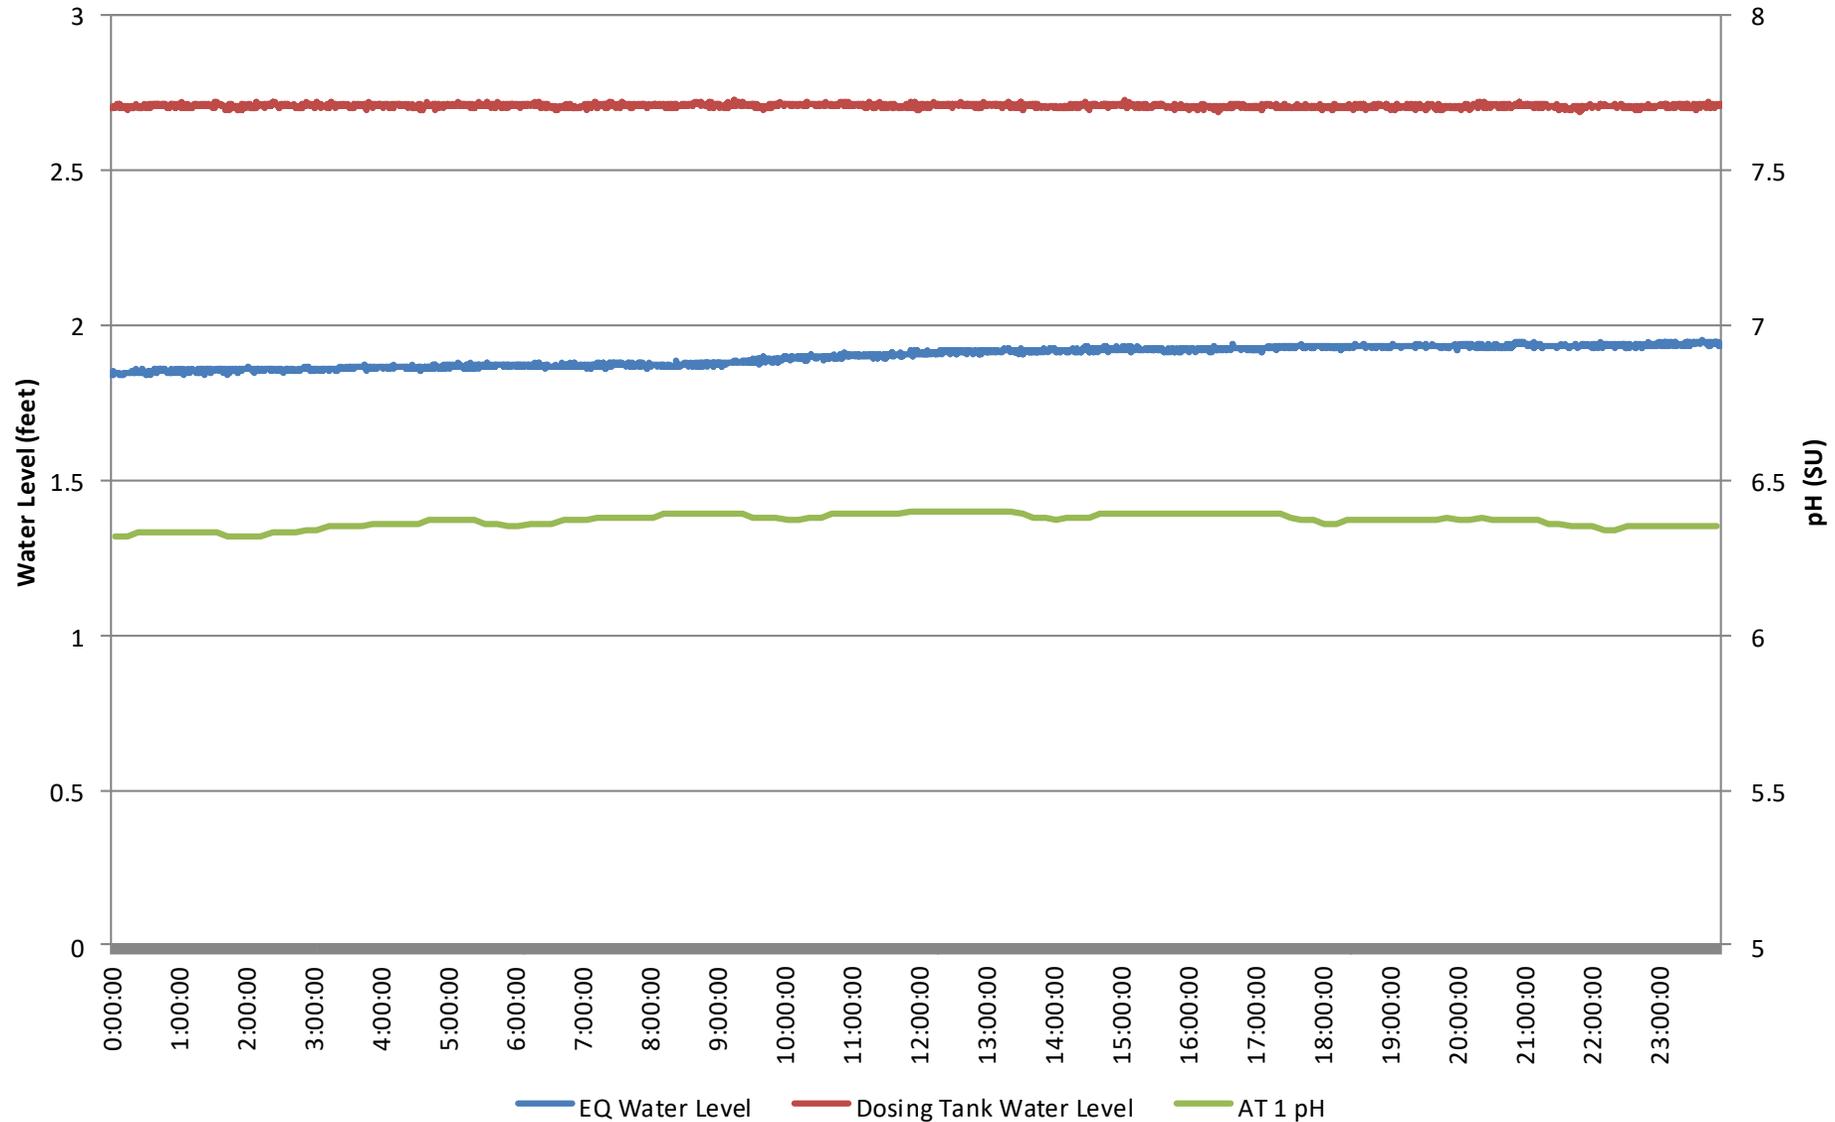

# Hardin Northern School District Flow and pH Study Tuesday, February 21, 2012 (partial day)

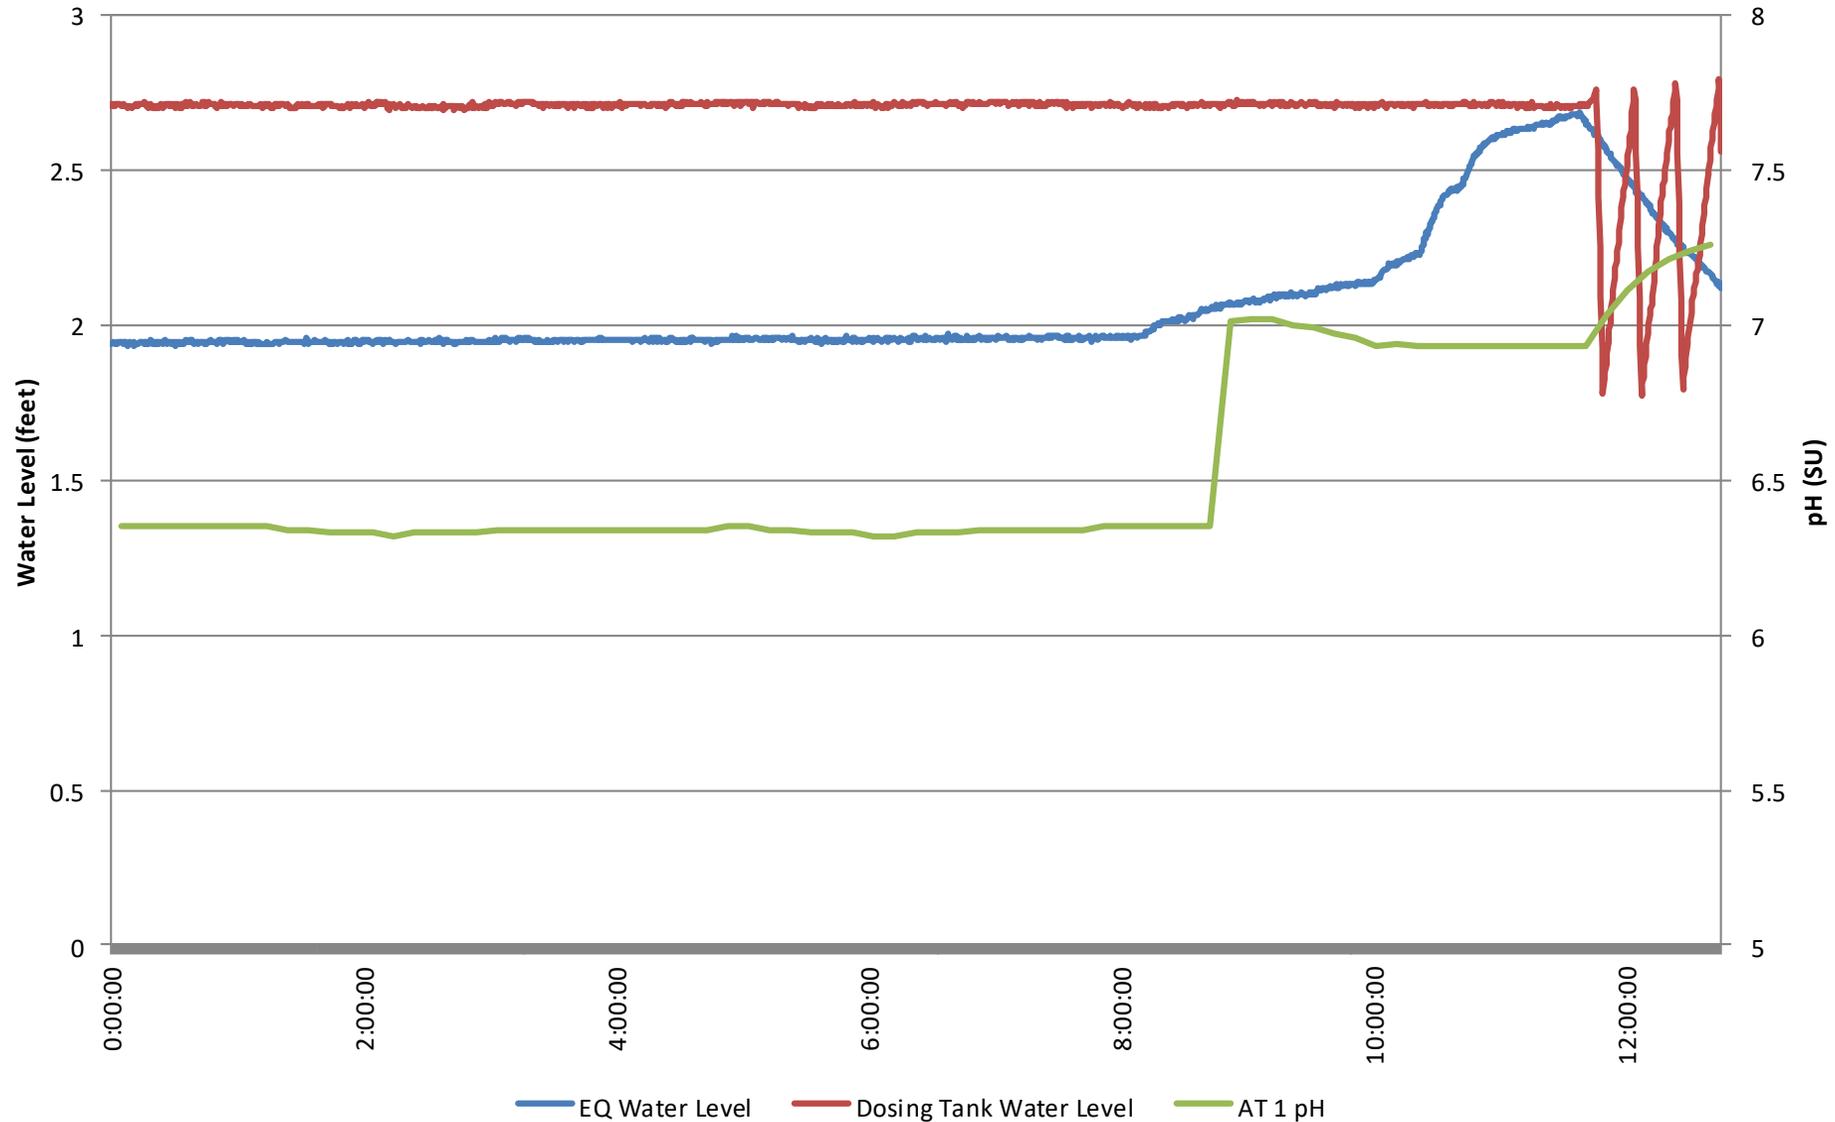

# Hardin Northern School District

## Compliance Plan

- **Decrease EQ basin effective depth**
  - More cycles over more of the day
- **Time blower cycles to be OFF when EQ pumps energize with 15 minute bump.**
  - Load the tank with carbon and mix it “anoxically”
- **Carefully watch pH/Conductivity**
  - Check pH/Conductivity prior to EQ pump cycle
  - Add sodium bicarbonate to maintain > 7 pH

# Hardin Northern School District

## On-going Compliance Plan

**Monitor Clarifier Effluent Ammonia**

**Monitor Spins**

**Monitor Settleometer**

**Make adjustments according to the data:**

- **Adjust air (blower cycles)**
- **Adjust wasting**
- **Adjust alkalinity**

# Alkalinity Problems?

Low alkalinity in drinking water (first example)

Low flow plumbing, high ammonia influent (new schools, old WWTPs)

High influent ammonia?

Village with 0.500 MGD Oxidation Ditch

Huge landfill pumps leachate to the Village 24/7

Leachate contains 600-1000 mg/L NH<sub>3</sub>-N

Combined influent is 100-250 mg/L NH<sub>3</sub>-N (25% leachate avg.)

Drips in alkalinity feed 24/7 and oxidizes ammonia to < 1 mg/L

No blanket in Clarifier: nitrate in effluent ~ 100 mg/L on average

# Conclusion

- Nitrification depends on 5 conditions:
  - Enough dissolved oxygen
  - Enough water temperature
  - Enough bacteria
  - Enough detention time
  - **Enough Alkalinity**
  - **Enough Process Control to know if there is enough**
  - **Measure... don't guess.**

# Questions?

Jon van Dommelen

Ohio EPA

Compliance Assistance Unit

[jon.vandommelen@epa.ohio.gov](mailto:jon.vandommelen@epa.ohio.gov)

(614) 580-5069