


NOTES	
■	PAD CONCRETE DESIGNED PER ASTM C-857 LOAD DESIGNATION A-0.3 (300 PSF) PARKWAY LOADING / 30,000 lb TRANSFORMER, USING 5,500 PSI CONCRETE AND ASTM A-706 GR. 60 STEEL REINFORCEMENT PER CALCS. #32085.
■	ALL PARTS TO BE STENCILED: MFG DATE / JOB NUMBER / PRODUCT ID / WEIGHT.

BILL OF MATERIALS			
ITEM	UNIT QTY	QTY	PART NUMBER
1	20.792 ft^3	20.792 ft^3	100006029
2	1	1	100002801
3	1	2	100006086
4	1	1	200040213


DESCRIPTION	
CONCRETE 5500 PSI SCC ED	
INSERT COIL THIN SLAB 4LEG 1 X 4 GALV CX-24	
STRUT C-CHANNEL CONCRETE INSERT 1-5/8 X 1-5/8 12GA W/ANCHORS N-3200 14IN GALV	
WELDED WIRE REINFORCEMENT EDISON & ANAHEIM STD.	

* FOR REBAR OPTION, USE PART NUMBER: 100017505

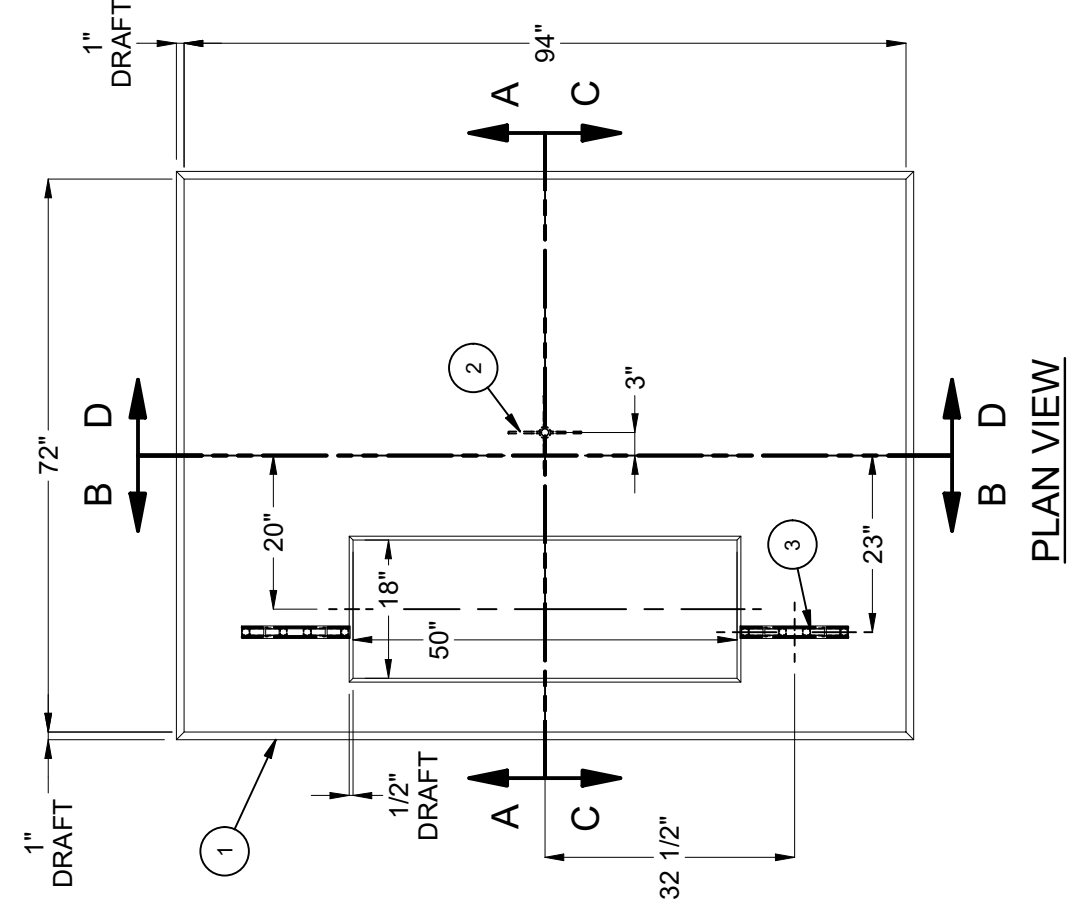


PLAN VIEW


LIFTING NOTES	
■	DEMOLDING: THIS CONCRETE PRODUCT IS DESIGNED TO BE LIFTED AT 2500 PSI WITH 1 LIFT CONNECTIONS EQUALLY LOADED TO 1 LIFTING POINTS AT A MINIMUM 90° SLING ANGLE, MEASURED FROM HORIZONTAL.
■	INSTALLATION: THIS CONCRETE PRODUCT IS DESIGNED TO BE LIFTED AT 5500 PSI WITH 1 LIFT CONNECTIONS EQUALLY LOADED TO 1 LIFTING POINTS AT A MINIMUM 90° SLING ANGLE, MEASURED FROM HORIZONTAL.
BURY DEPTH:	-0.3' - 0.3' to Top
WATER LEVEL:	Below Structure
DESIGN SPEC:	ACI 318,ASTM C857
REINFORCEMENT TYPE:	Rebar
APPROX. WEIGHT:	3184.64 Lbs
LOADING SPEC:	A-03 (300 psf)
LIFTING TYPE:	Insert

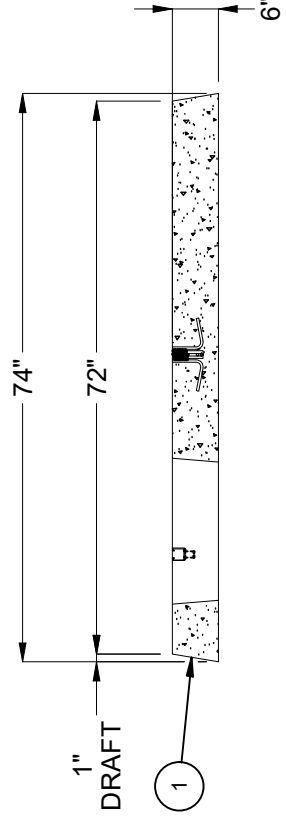


SECTION A-A

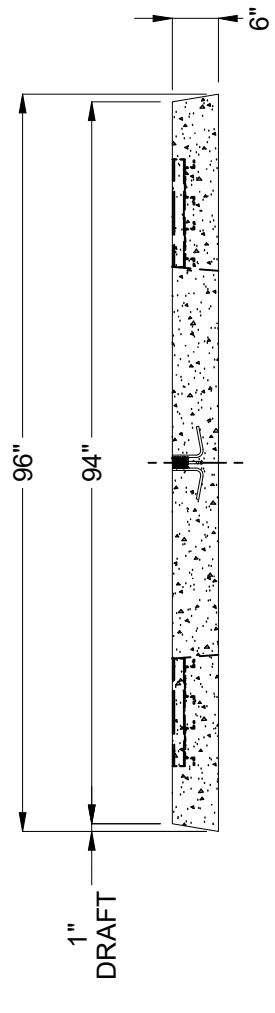

SECTION B-B



SECTION C-C



SECTION D-D



©2023 Jensen Precast. All rights reserved. All materials appearing as Jensen Precast documents and the like are proprietary work product and are protected under U.S. copyright and other laws. Unless in conjunction with business conducted with Jensen Precast, any use of Jensen Precast work product without express, written consent is prohibited, and recipient is prohibited from distributing any and all work product to non-approved third parties under penalty of civil action.

DESCRIPTION:	Pad 7294x6 Edison UGS SS504		
PART NUMBER:	100005496		
CREATED:	5/7/2020		
REVISED:	12/28/2023		
REVISION HISTORY			
REV	DESCRIPTION	DATE	APPROVED
B	REMOVED IDENCIA TAG	12/28/2023	

REV:	C-1
SHEET:	89
1 OF 1	

CASTING LAYOUT	J. Prado
DRAWN BY:	J. Prado
MODIFIED:	12/28/2023