

NOTES:

- STANDARDS. AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, 8TH EDITION, WITH 2022 CALTRANS AMENDMENTS, CITY OF LOS ANGELES BUREAU OF ENGINEERING STANDARD PLAN S-601, LATEST, MANUAL PART H, LADWP P 178, ASTM C-857. STRUCTURAL CALCS FOR BOX: #33524.
- MATERIAL. CONCRETE, F_c=5,500 PSI. MIX TO INCLUDE FLY ASH AND DCI. REINFORCEMENT PER ASTM A-706 OR A-615, F_y=60,000. A-615 REINFORCEMENT SHALL BE HAND TIED.
- LOADS. VERTICAL LIVE LOAD: AASHTO HL-93. LIVE LOAD SURCHARGE: PER LA BOE PART H, FIGURE H 374.2A. MINIMUM 80 PSF (TO BOTTOM OF VAULT) OR LADWP P 178 (104 PSF). SOIL LATERAL LOADS: 40 PCF (DRY), 81 PCF (SATURATED). SATURATED SOIL CONDITIONS 3'-0" BELOW GRADE. SOIL BEARING CAPACITY = 1,500 PSF. DESIGN SOIL DENSITY IS 120 PCF.
- LOADS NOT INCLUDED. DESIGN DOES NOT INCLUDE COOPER E-80 RAILROAD LOADS OR LATERAL OR SURCHARGE LOADS THAT ARE PRODUCED BY FOOTING OR FOUNDATIONS ADJACENT TO THE STRUCTURE. THIS SUBSTRUCTURE SHALL BE KEPT AT LEAST IN A 1:1 RATIO AWAY FROM ALL FOOTINGS AND FOUNDATIONS, UNLESS THE ENGINEER OF RECORD APPROVES IN WRITING.
- INSTALLATION. VAULT TO BE PLACED ON WELL COMPACTED SOIL WITH MIN. 6" DEPTH OF TAMPED CRUSHED AGGREGATE BASE FOR EASE OF INSTALLATION AND EVEN LOAD DISTRIBUTION USING A VIBRATORY PLATE COMPACTOR IN A MIN. OF TWO PASSES. BASE TO EXTEND 12" BEYOND THE STRUCTURE. BASE MATERIAL IN ACCORDANCE WITH SECTION 200-2.2 OF THE SSPWC (GREEN BOOK) PER LADWP SPECIFICATION NO. 104.
- INSTALLATION LIMITS. VAULT SHALL HAVE A MINIMUM COVER 1'-6" AND A MAXIMUM COVER OF 4'-0".
- EACH CONCRETE SECTION SHALL BE MARKED ON THE INSIDE & OUTSIDE WITH "JENSEN PRECAST", THE DESIGNATION "DWP/FA-CN", AND THE DATE OF THE POUR.
- EACH CONCRETE SECTION SHALL HAVE CAST-IN ON THE INSIDE "JENSEN", THE YEAR, AND THE DESIGNATION "FA-CN".
- EACH PIECE TO BE STENCILIED WITH ITS PART NO.
- NO SHARP OR ROUGH EDGES ON THE TERMINATORS ENTERING THE VAULT.
- K44-VN12-12TCOLA (200047596) VAULT NECK AND COVER, WITH APPROVED CAST IRON COVER TO BE USED WITH THIS VAULT.
- MINIMUM EXCAVATION SIZE: 10'-4" X 18'-6" X DEPTH REQ'D.
- ADDITIONAL SUBMITTAL, PERMIT AND CONSTRUCTION PLAN REVIEW WILL BE REQUIRED FOR EACH PROJECT LOCATION. SUBMIT TO CITY ENGINEERS FOR APPROVAL PRIOR TO START OF ANY CONSTRUCTION.
- ALL INSTALLATIONS SHALL COMPLY WITH ALL OTHER LOCAL GOVERNING CODES AND REGULATION INCLUDING CALIFORNIA PUBLIC UTILITIES COMMISSION REGULATIONS.

COAT EXTERIORS WITH METHANE-WATERPROOF COATING (VAPORLOCK).

**STOCKPILE - JENSEN PRECAST
CITY OF LOS ANGELES INSPECTION
REQUIRED WO# C0034604**


LIFTING NOTES

- FIELD INSTALLATION: PLANT DEMOLING: MINIMUM HANDLING CONCRETE STRENGTH F_c = 5500 PSI RIGGING EQUALIZER REQUIRED TO EQUALIZE LOAD TO 4 LIFTING POINTS WITH A SLING ANGLE BETWEEN 60° AND 90°

BURY DEPTH:	1.5' - 4.0' to Top
WATER LEVEL:	3.0'
DESIGN SPEC:	AASHTO LRFD
AGENCY:	LADWP
APPROX. WEIGHT:	92997.13 Lbs
LOADING SPEC:	AASHTO HL-93
AGENCY SPEC:	H-222 R9 COLA

BILL OF MATERIALS

ITEM	UNIT QTY	QTY	PART NUMBER	DESCRIPTION	MASS (lb)
1	1	1	100024409	Vault 96192x57 Rect. Bottom Section Terminators Sump LADWP H-222 COLA Ext. Coating - Tremco VaporLock-m	46030
2	1	1	100024410	Vault 96192x57 Rect. Top Section 48"x48"E Terminators Thinwall Knockout LADWP H-222 COLA Ext. Coating - Tremco VaporLock-m	42617
3	1	1	200016649	Vault Neck and Plug Cover Assembly 4848x12 30°C LADWP 1-802 G-1B COLA INSP R-1581 PI	3398
4	1	1	100012396	Riser 4848x6 LADWP COLA 1-802 G-1B	792
5	1	4	100009239	ROD THREADED COIL YELLOW DIP 3/4 X 10-1/2"	
6	1	8	100007010	HEX COIL NUT 3/4-4.5 ZINC - PLATED	
7	1	8	100007136	WASHER FLAT 3/4 REGULAR TYPE A ZINC	
8	1	2	100008122	PLUG PICKHOLE NEOPRENE RUBBER CI COVER ED/LA	
9	1	1	100009251	LADDER HOOKED GALV 12FT ED/LA I3382	
10	1	1	100007585	LADDER HANGER ASSEMBLY GALV	
11	1	3	100006061	STRUT SLOTTED C-CHANNEL 1-5/8 X 1-5/8 12GA BOLT-ON GALV 168IN	
12	1	2	100006065	STRUT SLOTTED C-CHANNEL 1-5/8 X 1-5/8 12GA BOLT-ON GALV 36IN	
13	1	39	100008101	SCREW BUTT HEAD CAP 1/2-12 2 304SS	
14	1	39	100007135	WASHER FLAT 1/2 TYPE A 304SS	
15	1,000 ul	1,000 ul	100005749	SEALANT JOINT BUTYL RUBBER ASTM C-990 AND M198 CS-102 1IN EQUIV X14.5FT PER BOX 118FT	

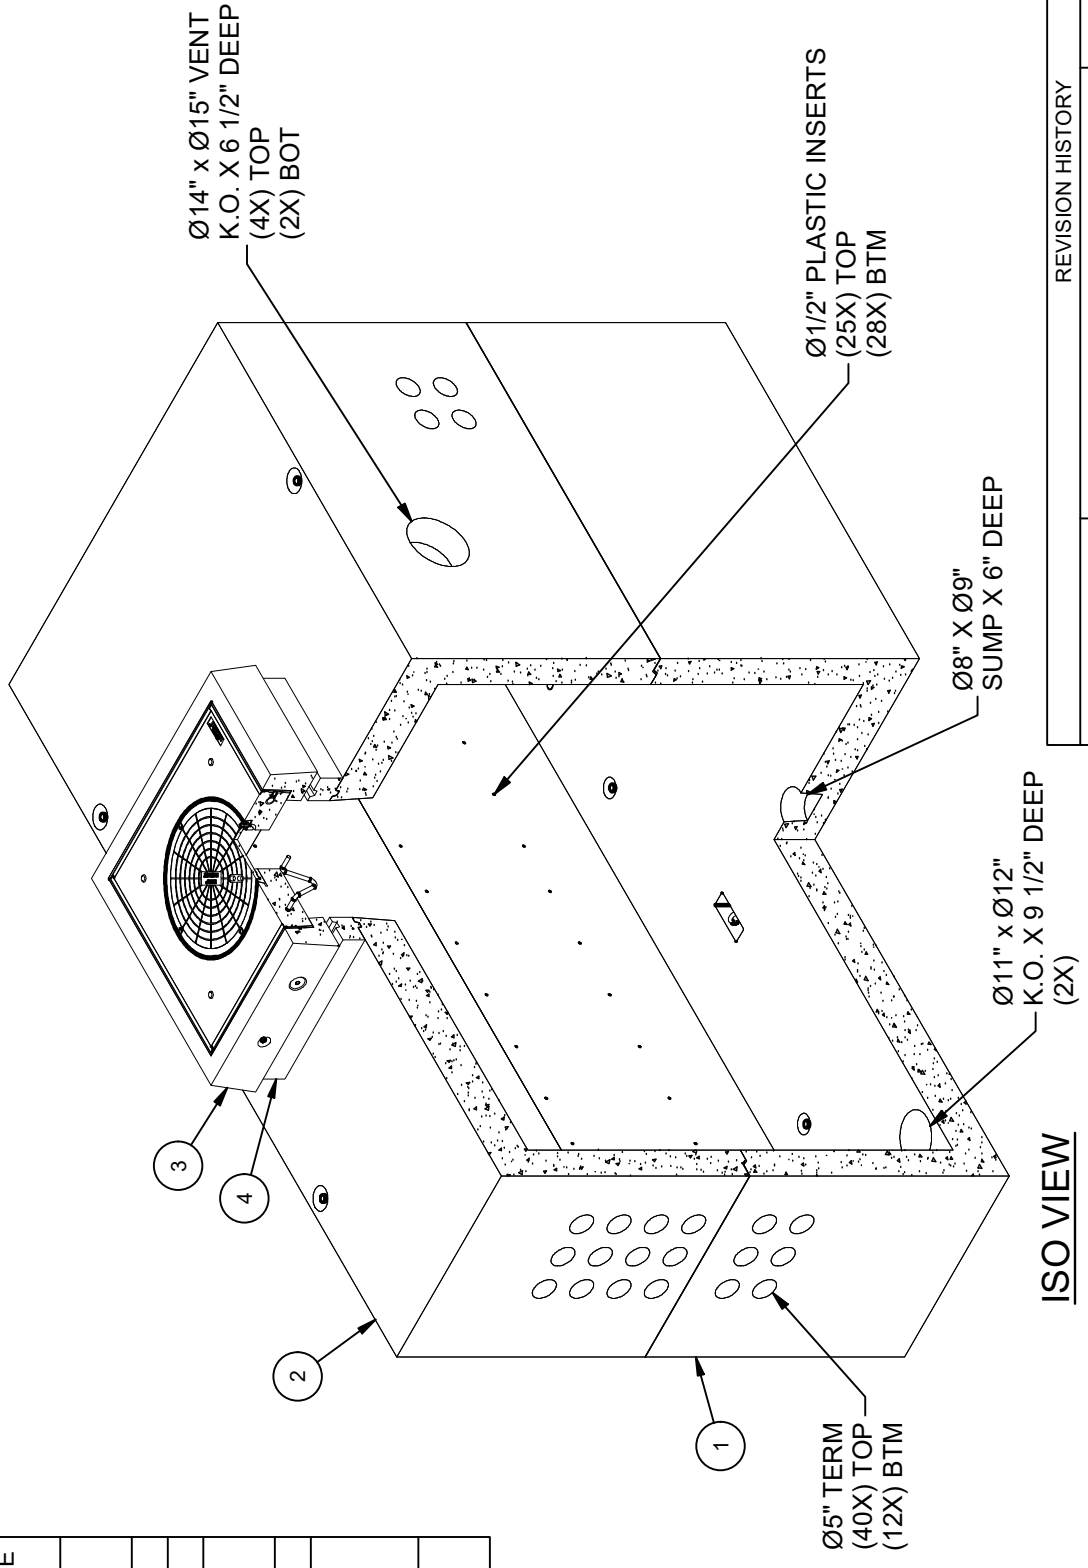

ISO VIEW

©2024 Jensen Precast. All rights reserved. All materials appearing as Jensen Precast documents and the like are proprietary work product and are protected under U.S. copyright and other laws. Unless in conjunction with business conducted with Jensen Precast, any use of Jensen Precast work product without express, written consent is prohibited, and recipient is prohibited from distributing any and all work product to non-approved third parties under penalty of civil action.

JENSEN PRECAST EST. 1968
WWW.JENSENPRECAST.COM

REVISION HISTORY

REV	DESCRIPTION	DATE	APPROVED
A-1	INITIAL RELEASE	6/3/2024	

DESCRIPTION: Vault Layout 96192x114 Knockout, Terminators Sump 30"x30"E LADWP H-222 R9 COLA Ext. Coating - Tremco VaporLock-m LAYOUT REVIEW

REV: A-153

SHEET: 1 OF 2

PART NUMBER: 200089173 DRAWN BY: M. Zaragoza

CREATED: 6/3/2024 MODIFIED: 6/3/2024

