

इंटरनेट

मानक

Disclosure to Promote the Right To Information

Whereas the Parliament of India has set out to provide a practical regime of right to information for citizens to secure access to information under the control of public authorities, in order to promote transparency and accountability in the working of every public authority, and whereas the attached publication of the Bureau of Indian Standards is of particular interest to the public, particularly disadvantaged communities and those engaged in the pursuit of education and knowledge, the attached public safety standard is made available to promote the timely dissemination of this information in an accurate manner to the public.

“जानने का अधिकार, जीने का अधिकार”

Mazdoor Kisan Shakti Sangathan


“The Right to Information, The Right to Live”

“पुराने को छोड़ नये के तरफ”

Jawaharlal Nehru

“Step Out From the Old to the New”


IS 9137 (1978): Code for acceptance test for centrifugal, mixed flow and axial pumps - Class C [MED 20: Mechanical Engineering]

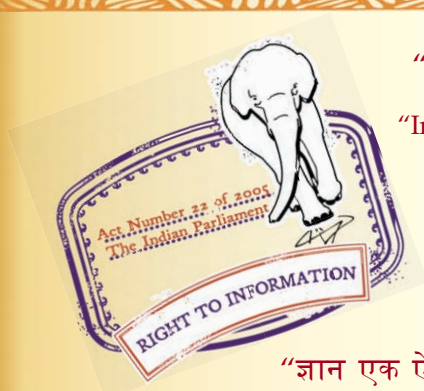

“ज्ञान से एक नये भारत का निर्माण”

Satyanarayan Gangaram Pitroda

“Invent a New India Using Knowledge”

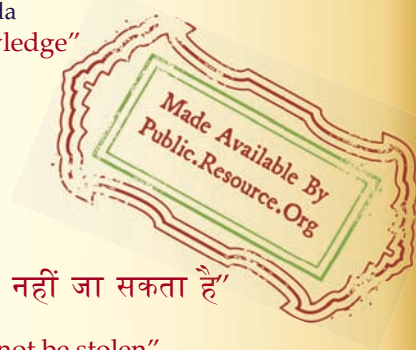

“ज्ञान एक ऐसा खजाना है जो कभी चुराया नहीं जा सकता है”

Bhartrhari—Nitiśatakam

“Knowledge is such a treasure which cannot be stolen”

Indian Standard

**CODE FOR ACCEPTANCE TESTS FOR
CENTRIFUGAL, MIXED FLOW AND
AXIAL PUMPS—CLASS C**

(Fifth Reprint JUNE 1997)

UDC 621.67 : 620.16 : 006.76

© Copyright 1980

BUREAU OF INDIAN STANDARDS
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002

AMENDMENT NO. 4 SEPTEMBER 1989
TO
IS I 9137 - 1978 CODE FOR ACCEPTANCE TESTS FOR CENTRIFUGAL
MIXED FLOW AND AXIAL PUMPS — CLASS C

(*Page 16, Fig. 3b*) — Substitute ' $P_2 > 0$ 'for' $P_2 < 0$ ' and ' $P_2 < 0$ 'for' $P_2 > 0$ '.

IS : 9137 - 1978 CODE FOR ACCEPTANCE TESTS FOR CENTRIFUGAL,
MIXED FLOW AND AXIAL PUMPS — CLASS C

(Page 9, clause 4.2.1) — Substitute the following for the existing clause:

"4.2.1 *Contractual Objects of the Tests* — The tests are intended to ascertain the programme of the pump and to compare this with the manufacturer's guarantee. However, attention is drawn to the fact that the NPSH test increase the cost of the test substantially. It shall, therefore, be specified by the purchaser in order/contract, if NPSH test is to be conducted (see also Appendix D).

Where a number of identical pumps are to be purchased, and if NPSH test is specified in the contract, one pump shall be tested as type test, for other tests the method of sampling of pumps as per IS : 10572-1983 'Methods of sampling pumps' shall be followed."

(Page 20, clause 7.1) — Substitute the following for the existing clause:

'7.1 **General** — When the contract specifies that NPSH test shall be conducted to verify whether NPSH required by the pump is equal to or less than the specified/guaranteed NPSH, one of the test methods as specified in 7.1.1 shall be adopted to conduct NPSH test.

In no case shall cavitation test be used to check that the pump shall be free from cavitation erosion during its service life.'

(Page 24, clause 9.2.1, third para after efficiency transiation) — Substitute the following for the existing matter:

'If n_{sp} exceeds 20 percent variation, it shall be necessary to apply corrections on efficiency as given in 5.8. The stipulation for H , Q , and NPSH shall remain according to 9.2.1 irrespective of n_{sp} variations.'

[Page 26, clause 9.6 (see also Amendment No. 1)] — Add the following examples in 9.6:

Example 3:

When pump fails to meet the guaranteed power input to the pump:

a) *Guaranteed duty of pump:*

Capacity	6 000 m ³ /h
Total head	41 m
Speed	553 rpm
Efficiency	85 percent
Power input to pump at duty point	788.6 kW

b) Readings corrected to 555 rpm read as follows:

<i>Rate of Flow</i>	<i>Head</i>	<i>Power Absorbed</i>	<i>Efficiency</i>
(m ³ /h)	(m)	(kW)	percent
0	50	—	—
2 000	49	562.17	47.5
4 000	47.5	704.37	73.5
6 000	43	836.90	84
8 000	36	881.73	89
9 000	32	891.75	88

c) Characteristic curves $Q^{v/s}$ H , $Q^{v/s}$ η , $Q^{v/s}$ P are drawn on graph (see Fig. 10C), $\Delta H = 2$ m, $\Delta Q = 600$ m³/h

Therefore:

$$\left(\frac{H_0 \times X_H}{\Delta H} \right)^2 + \left(\frac{Q_0 \times X_Q}{\Delta Q} \right)^2 = \left(\frac{41 \times 0.04}{2} \right)^2 + \left(\frac{6000 \times 0.07}{600} \right)^2$$

$$= 0.6724 + 0.49$$


$$= 1.1624$$

Hence the pump characteristics is within the acceptable limits.

d) The duty point (6 000 m³/h, 41 m) is connected to (0,0) and the intersection of this line with the characteristic curve is determined which being 6 200 m³/h, 42 m. This duty considered as the actual pump duty has an efficiency of 84.5 percent.

e) Permissible lower limit on guaranteed efficiency (0.95×0.85) = 0.8075, that is, 80.75 percent. Since actual pump efficiency is 84.5 percent this is also within acceptable limits.

f) The power input to the pump within the range denned in 9.4.1 by the tolerances $\pm X_Q$ and $\pm X_H$ is 836.9 to 852.4 kW. As agreed between the manufacturer and the purchaser the power should not exceed 828 kW. Since the power input within the range exceeds 828 kW, the pump fails to meet the power consumption.

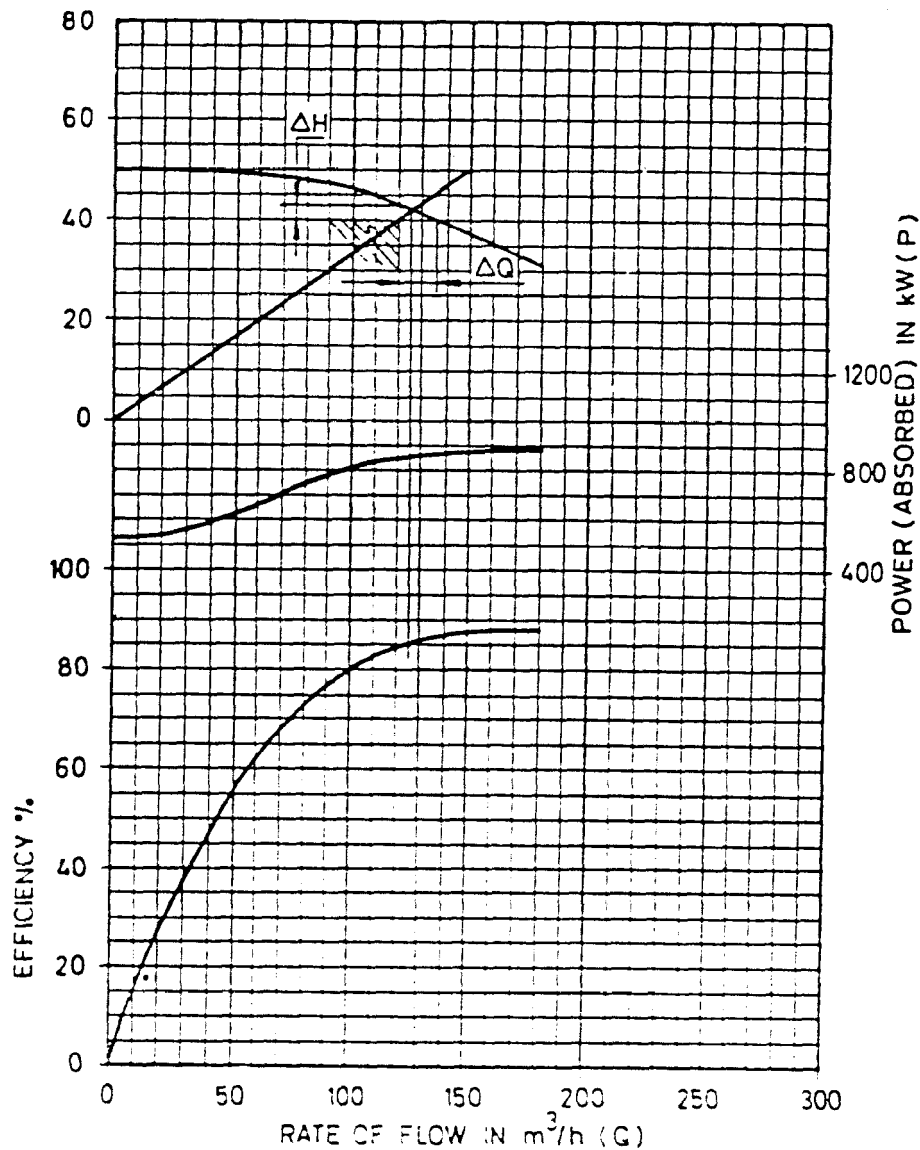

$$\Delta H = 2.0 \text{ m}$$

$$\Delta Q = 600 \text{ m}^3/\text{h}$$

Guaranteed Duty = 6 000 m³/h × 41 m × 728.6 kW at 555 rpm

Actual Duty = 6 200 m³/h × 42 m × 839.7 kW at 555 rpm

FIG. 10C CHARACTERISTIC CURVE FOR PUMP OF GUARANTEED DUTY OF 6 000 m³/h
DISCHARGE × m HEAD

Example 4:

5.1 ???

When pump fails to meet the guaranteed efficiency point;

a) *Guaranteed Duty of Pump*

Capacity 300 m³/h
Total head 7.5 m
Speed 1 480 rpm
Efficiency 54 percent
Power at duty point 11.35 kW

Rate of ???	Head	Power Absorbed	Efficiency'
(m ³ /h)	m	(kW)	percent
0	15	—	—
50	14.5	9.88	20
100	13.5	10.22	36
150	12.5	10.87	47
200	11.5	11.6	54
250	10.5	11.72	61
300	8.5	11.98	58
325	6.5	12.8	45

- c) Characteristic curve $Q^{v/s} H$, $Q^{v/s} H$, $Q^{v/s} P$ are drawn on graph (see Fig. 10D) $\Delta H = 1.0 \text{ m}$, $\Delta Q = 20 \text{ m}^3/\text{h}$

$$\text{Therefore } \left(\frac{H_o \times X_H}{\Delta H} \right)^2 + \left(\frac{Q_o \times X_Q}{\Delta Q} \right)^2 \\ = \left(\frac{7.5 \times 0.04}{1.0} \right)^2 + \left(\frac{300 \times 0.07}{20} \right)^2 \\ = 0.09 + 1.1025 = 1.1925$$

Hence, the pump characteristics is within acceptable limits.

- d) The duty point ($300 \text{ m}^3/\text{h}$, 7.5 m) is connected to ($0,0$) and the intersection of the line with the characteristic curve is determined which being ($317.5 \text{ m}^3/\text{h}$,

8.0 m). This duty considered as the actual pump duty has an efficiency of 50 percent.

- e) Permissible lower limit on guaranteed efficiency (0.54×0.95) = 0.513 , that is, 51.3 percent. Since the actual efficiency is 50 percent the pump fails to meet the guaranteed efficiency.
- f) The power input to the pump within the range defined in 9.4.1 by the tolerance $\pm X_Q$ and $\pm X_H$ is 11.98 kW to 13.35 kW. Since the power input as agreed between the manufacturer and the purchaser lies within this range, the power consumption is within acceptable limits.

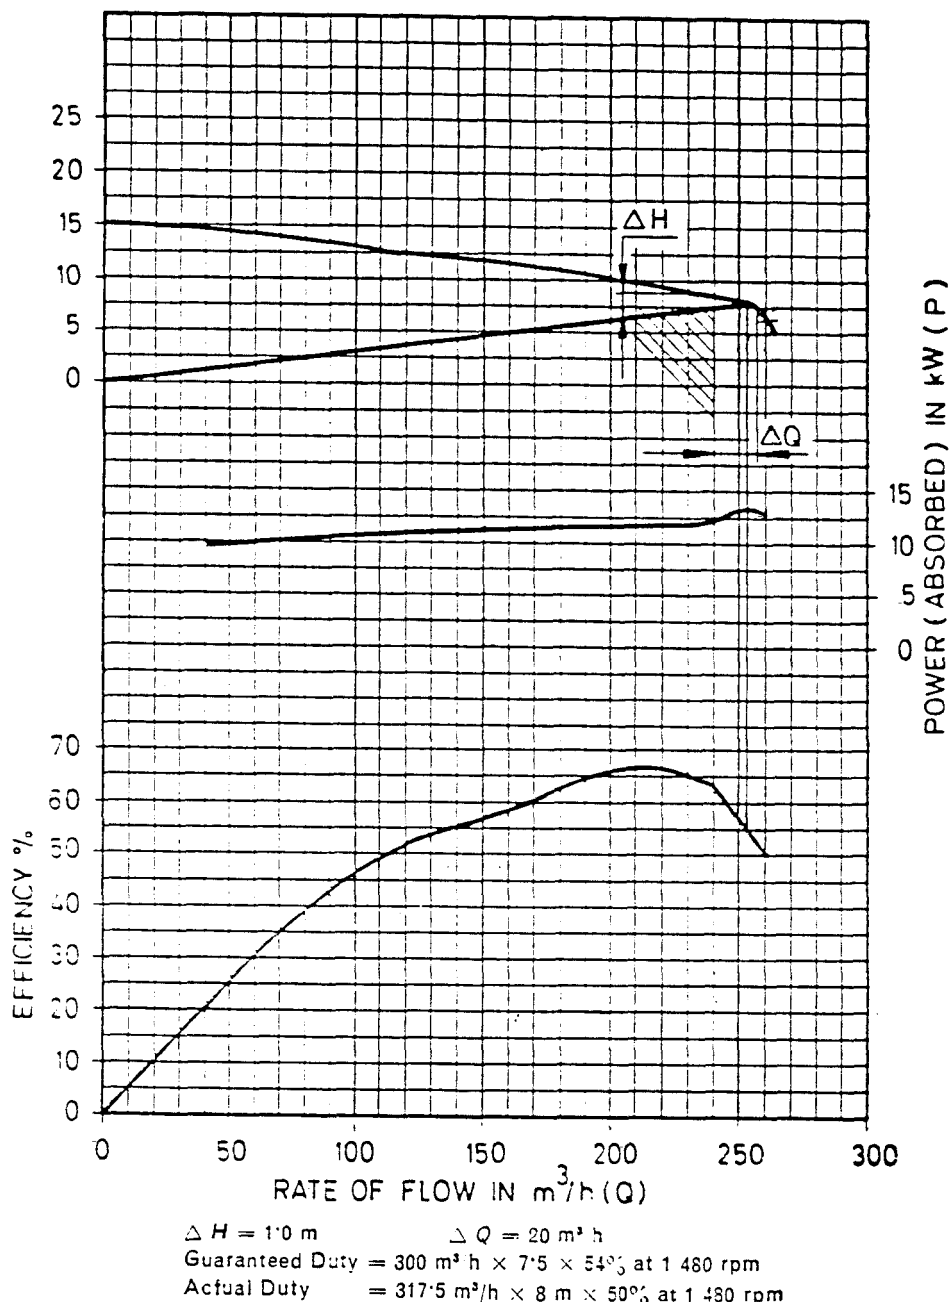


FIG. 10D CHARACTERISTIC CURVE FOR PUMP OF GUARANTEED DUTY OF $300 \text{ m}^3/\text{h}$
DISCHARGE $\times 7.5 \text{ m}$ HEAD

(EDO 35)

AMENDMENT NO. 2 JANUARY 1984
TO
IS : 9137 - 1978 CODE FOR ACCEPTANCE
TESTS FOR CENTRIFUGAL, MIXED FLOW
AND AXIAL PUMPS — CLASS C

Alterations

(*Page 14, clause 6.1.4, first para*) — Substitute the following for the existing para:

' **6.1.4 Notches, Weirs and Flumes** — The details pertaining to methods of measurement are given in IS : 6062-1971*, IS : 6063-1971† and IS : 9108-1979‡. '

(*Page 14, foot-note with ' * ' mark*) — Substitute the following for the existing foot-note:

' *Method of measurement of flow of water in open channels using standing wave flume-fall.

†Method of measurement of flow of water in open channels using standing wave flume-fall.

‡Liquid flow measurement in open channels using thin plate weirs. '

(EDO 35)

AMENDMENT NO. 1 OCTOBER 1981
TO
IS : 9137 - 1978 CODE FOR ACCEPTANCE TESTS FOR
CENTRIFUGAL, MIXED FLOW AND AXIAL PUMPS — CLASS C

Corrigendum

[Page 8, clause 3.2.3.12(b), last sentence] — Substitute the following for the existing sentence:

'But the vapour pressure of the liquid cannot be changed without increasing or decreasing the temperature of the liquid and this is always not feasible.'

Alteration

(Page 11, clause 5.8.2, last sentence) — Substitute the following for the existing sentence:

'The following formula for efficiency correction shall be applied:

$$\frac{1 - \eta_1}{1 - \eta_s} = \left(\frac{N_s}{N_1} \right)^n$$

where

η_1 = efficiency at actual test speed,

η_s = efficiency at specified speed,

N_s = specified speed,

N_1 = actual test speed, and

n = exponent established by test data, the value of the exponent is 0.17.'

Addendum

(Page 26, clause 9.5) — Add the following new clause after 9.5:

'9.6 The worked out examples indicating the application of the formula as given in 9.4.1 are given below:

Example 1:

a) Guaranteed duty of pump:

Capacity	1 000 m ³ /h
Head	50 m
Speed	1 480 rpm
Efficiency	80 percent

b) Readings corrected to 1 480 rpm read as follows:

Rate of Flow (m ³ /h)	Head (m)	Power Absorbed (kW)	Efficiency Percent
0	55	—	—
300	54	127.5	34.6
600	53.5	146	59.9
900	50	162	75.5
1 000	47.5	166	78
1 200	39	170	75

c) Characteristic curves $Q^v/s H$, $Q^v/s \eta$, $Q^v/s P$ are drawn from graph (see

Fig. 10A) $\Delta H = 2.5$ m, $\Delta Q = 100$ m³/h

Therefore

$$\begin{aligned} & \left(\frac{H_G \times X_H}{\Delta H} \right)^2 + \left(\frac{Q_G \times X_Q}{\Delta Q} \right)^2 \\ &= \left(\frac{50 \times 0.04}{2.5} \right)^2 + \left(\frac{1\,000 \times 0.07}{100} \right)^2 \\ &= 0.64 + 0.49 \\ &= 1.3 \end{aligned}$$

Hence, the pump characteristics is within the acceptable limits.

d) The duty point (1 000 m³/h, 50 m) is connected to (0, 0) and the intersection of this line with the characteristic curve is determined which being (970 m³/h, 48.5 m). This duty, considered as the actual pump duty has an efficiency of 77%.

e) Permissible lower limit on guaranteed efficiency $(0.95 \times 0.8) = 0.76$, that is, 76%. Since actual pump efficiency is 77% this is also within acceptable limits.

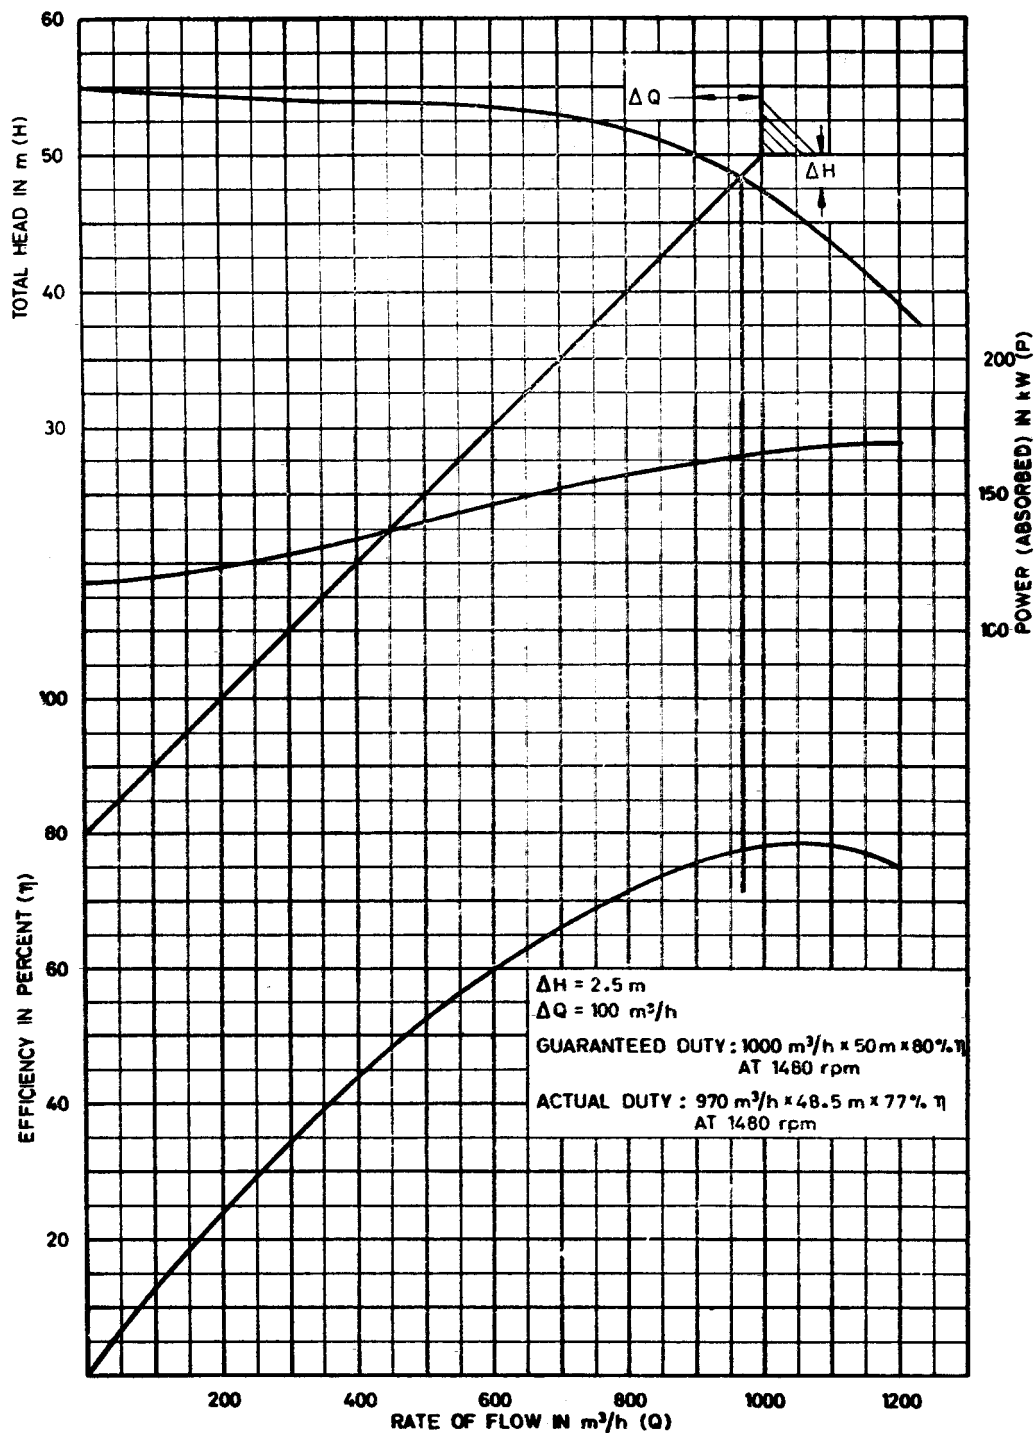


FIG. 10A CHARACTERISTIC CURVE FOR PUMP OF GUARANTEED DUTY OF 1 000 m³/h DISCHARGE × 50 m HEAD

Example 2:

a) Guaranteed duty of pump:

Capacity	200 m ³ /h
Head	25 m
Speed	1 480 rpm
Efficiency	70%

b) Readings when converted to 1 480 rpm read as follows:

Capacity (m ³ /h)	Head (m)	Power Absorbed (kW)	Efficiency Percent
0	26.5	—	—
50	27	15.5	23.8
100	26.5	16.4	44
150	25.5	17.3	60
200	23.5	18.2	70.2
250	21	19	75.2
300	17	19.6	70.9

c) Characteristic curves Q^v/sH , Q^v/sP , $Q^v/s\eta$ are drawn from graph (see

Fig. 10B) $\Delta H = 1.5$ m, $\Delta Q = 40$ m³/h

Therefore

$$\left(\frac{H_G \times X_H}{\Delta H} \right)^2 + \left(\frac{Q_G \times X_Q}{\Delta Q} \right)^2$$

$$= \left(\frac{25 \times 0.04}{1.5} \right)^2 + \left(\frac{200 \times 0.07}{40} \right)^2$$

$$= 0.444 4 + 0.122 5$$

$$= 0.566 9$$

Hence, the pump characteristic is not within acceptable limits,

d) The duty point (200 m³/h, 25 m) is connected to (0, 0) and the intersection of this line with the characteristic curve is determined from the graph which being (191 m³/h, 24 m). This duty considered as the actual pump duty has an efficiency of 68.5%.

e) Permissible lower limit on guaranteed efficiency is $0.95 \times 0.7 = 0.665$, that is, 66.5%. Since actual pump efficiency is 68.5%, this is within acceptable limits.

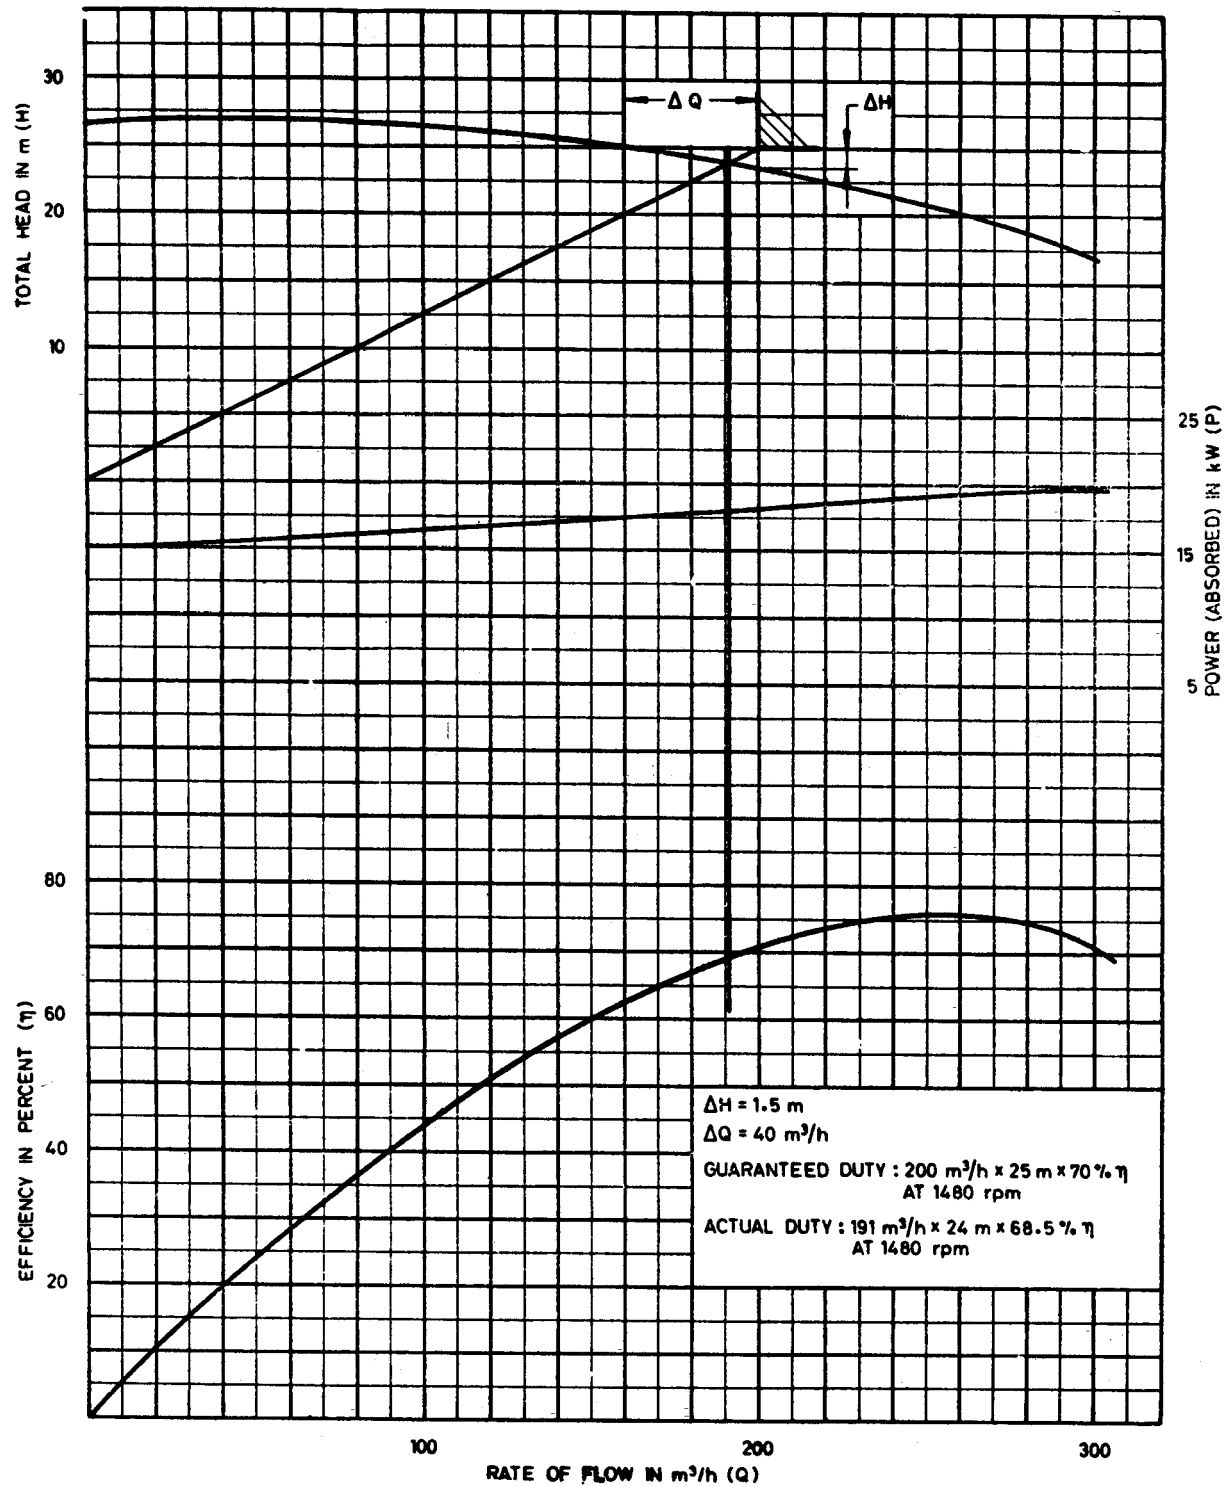


FIG. 10B CHARACTERISTIC CURVE FOR PUMP OF GUARANTEED DUTY
OF $200 \text{ m}^3/\text{h}$ DISCHARGE $\times$ 25 m HEAD

(EDO 35)

Indian Standard

CODE FOR ACCEPTANCE TESTS FOR CENTRIFUGAL, MIXED FLOW AND AXIAL PUMPS — CLASS C

Pumps Sectional Committee, EDC 35

Chairman

SHRI K. MUBAYI

Members

SHRI A. K. DASGUPTA (*Alternate to*
Shri K. Mubayi)
SHRI K. C. AGARWAL
DR S. BALAKRISHNAN
SHRI V. P. VENUGOPAL (*Alternate*)
SHRI S. BALAKRISHNAN
SHRI B. T. DEVANATHAN (*Alternate*)
CHIEF ELECTRICAL ENGINEER
SENIOR ELECTRICAL ENGINEER (M) (*Alternate*)
SHRI J. D. CRUZ
SHRI Y. D. MISRA (*Alternate*)
SHRI A. S. DANDEKAR
SHRI S. L. ABHYANKAR (*Alternate*)
SHRI M. DHARMAPANDIAN
GENERAL SUPERINTENDENT

SHRI GOVERDHAN N. GIDWANI
SHRI S. C. KAPUR (*Alternate*)
SHEI S. N. HUSSAIN
SHRI K. R. RANGANATHAN (*Alternate*)
DR K. R. ILANGO
SHRI P. VAIDYANATHAN (*Alternate*)
SHRI P. K. JOHN
SHRI B. KAPOOR
SHRI J. P. ROY (*Alternate*)
LT-COL G. L. MANWANI
LT-COL S. K. SINHA (*Alternate*)
SHRI B. P. MITTAL

SHRI P. M. NAIK
SHRI A. E. KABRA (*Alternate*)
SHRI J. S. NEGI
SHRI R. K. SRIVASTAVA (*Alternate*)
SHRI V. R. PHATAK
SHEI U. S. PRASAD
SHRI K. SANKARANARAYANAN
SHRI T. K. BHASKAR VERMA (*Alternate*)
SHRI K. SATHYANAEAYANA
SECRETARY
DEPUTY SECRETARY (*Alternate*)
SHEI R. N. TANDON
SHRI J. P. GUPTA (*Alternate*)
SHRI A. S. VERMA
WORKS MANAGER
SHRI S. CHANDRASEKHARAN,
Deputy Director (Mech Engg)

Representing

Mather and Piatt Ltd, Bombay

Ministry of Shipping and Transport
Southern Indian Engineering Manufacturers Association, Coimbatore

Tata Chemicals Limited, Mithapur

Ministry of Railways
Water Supply and Sewage Disposal Undertaking, New Delhi

Mechanical Engineers Association (I), Bombay

Department of Industries, Government of Tamil Nadu, Madras
Public Works, Workshops and Stores, Government of Tamil Nadu,
Madras
Directorate General of Supplies & Disposals, New Delhi

Best & Co Pvt Ltd, Madras

Neyveli Lignite Corporation Ltd, Neyveli

Bharat Heavy Electricals Ltd, Tiruchchirappalli
Johnston Pumps India Ltd, Calcutta

Ministry of Defence (R & D)

Indian Pumps Manufacturers Association, Calcutta; and Flowmore
Pvt Ltd, New Delhi
Government of Maharashtra, Bombay

Jyoti Limited, Vadodara

K. S. B. Pumps Ltd, Bombay
Indian Oil Corporation Ltd, Bombay
Directorate General of Technical Development, New Delhi

Kirloskar Brothers Ltd, Kirloskarvadi
Central Board of Irrigation and Power, New Delhi

Government of Uttar Pradesh, Lucknow

Bharat Pumps & Compressors Ltd, New Delhi
Vak Engineering Pvt Ltd, Madras
Director General, BIS (*Ex-officio Member*)

Secretary

SHRI S. C. KALRA
Deputy Director (Mech Engg), BIS

(Continued on page 2)

© Copyright 1980

BUREAU OF INDIAN STANDARDS

This publication is protected under the *Indian Copyright Act* (XIV of 1957) and reproduction in whole or in part by any means except with written permission of the publisher shall be deemed to be an infringement of copyright under the said Act.

(Continued from page 1)

Horizontal Spindle Pumps Subcommittee, EDG 35 : 2

Convener

SHRI P. S. NAZARE

Members

SHRI K. C. BHOTRA (*Alternate to*
Shri P. S. Nazare)
DR S. BALAKRISHNAN
SHRI V. P. VENUGOPAL (*Alternate*)
SHRI V. DEVRAJ
SHRI P. R. DHAMODARAN
SHRI R. RANGANATHAN (*Alternate*)
SHRI G. T. GURUSHAHNI
SHRI A. K. WADHAWAN (*Alternate*)
SHRI Y. D. MISHRA
SHRI B. P. MITTAL
SHRI M. P. GUPTA (*Alternate*)
SHRI K. MUBAYI
SHRI A. K. DASGUPTA (*Alternate*)
SHRI J. S. NEGI
SHRI R. K. SRIVASTAVA (*Alternate*)
SHRI S. C. PATEL
SHRI V. R. PATHAK
SHRI K. SANKARANARAYANAN
SHRI C. M. SHAH

Representing

Kirloskar Brothers Ltd, Kirloskarvadi

Southern India Engineering Manufacturers Association, Coimbatore

P. S. G. & Sons Charity Industrial Institute, Coimbatore
Dhandayuthapani Foundry Private Limited, Coimbatore

Su Motors Pvt Ltd, Bombay

Delhi Joint Water and Sewage Board, New Delhi
Flowmore Pvt Ltd, New Delhi

Mather and Piatt Ltd, Bombay

Jyoti Limited, Vadodara

Calama Industries Pvt Ltd, Bombay
K. S. B. Pumps Ltd, Bombay
Directorate General of Technical Development, New Delhi
Tata Chemicals Limited, Okhamandal

C O N T E N T S

	PAGE
1. SCOPE	4
2. SYMBOLS	4
3. DEFINITIONS	6
4. GUARANTEES AND PURPOSE OF THE TESTS	8
5. ORGANIZATION OF TESTS	9
6. PROCEDURE FOR MEASUREMENT OF RATE OF FLOW, HEAD, SPEED OF ROTATION AND POWER INPUT	13
7. CAVITATION TESTING	20
8. TESTS ON PUMPS FOR LIQUIDS OTHER THAN CLEAN COLD WATER	22
9. ANALYSIS OF TESTS	24
APPENDIX A GUARANTEES FOR MASS-PRODUCED PUMPS	26
APPENDIX B EFFECT OF PRE-SWIRL INDUCED BY THE PUMP	26
APPENDIX C FRICTION LOSSES	27
APPENDIX D COSTS AND REPETITION OF TESTS	30
APPENDIX E CONVERSION TO SI UNITS	31
APPENDIX F CHECK LIST	32
APPENDIX G PUMP TEST SHEET	32

Indian Standard

CODE FOR ACCEPTANCE TESTS FOR CENTRIFUGAL, MIXED FLOW AND AXIAL PUMPS — CLASS C

0. FOREWORD

0.1 This Indian Standard was adopted by the Indian Standards Institution on 18 December 1978, after the draft finalized by the Pumps Sectional Committee had been approved by the Mechanical Engineering Division Council.

0.2 This standard is one of a series of Indian Standards dealing with the acceptance tests for centrifugal, mixed flow and axial pumps. These standards would correspond to three classes of tests A, B and C; the use of Class A and B is restricted to special cases when there is a need to have the pump performance more precisely defined. The Class A is the most accurate whereas the Class C is the least accurate. It should be borne in mind that Class A and B test require more accurate apparatus and methods which increases the cost of such tests.

0.3 The standard arrangements and procedures described are those to be employed for testing a pump individually, without reference to its final installation conditions or the effect upon it of any associated fittings, these being the usual conditions in which a pump is tested at the manufacturer's works.

0.4 Pump performance may be affected by

conditions of the final site installation, and procedures are described for carrying out 'standard tests' on certain types of installations of which an overall performance is required.

0.5 The conditions in which the pumps are finally installed, however, often do not permit reliable test measurements, and recommendations are made concerning the procedure to be adopted where the layout precludes tests in conformity with the standards, or where the tests cover the pump and the plant ancillary to the pump itself.

0.6 This standard is based on ISO 2548-1973 'Centrifugal, mixed flow and axial pumps — Code for acceptance tests — Class C' issued by the International Organization for Standardization (ISO)

0.7 For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the result of a test, shall be rounded off in accordance with IS : 2-1960*. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

1. SCOPE

1.1 This standard lays down procedures for acceptance testing of pumps. It defines the terms and quantities that are used and established the methods of testing and the ways of measuring the quantities involved according to Class C so as to ascertain the performance of the pump and to compare them with the manufacturer's guarantee.

1.2 This standard applies to any size of pump

tested with clean, cold water and other liquids behaving as clean, cold water.

1.3 This standard does not cover the structural details of the pumps and the mechanical properties of their components.

2. SYMBOLS

2.1 List of Symbols Used in the Test Code—
As given in Table 1.

*Rules for rounding off numerical values (*revised*).

TABLE 1 SYMBOLS

(Clause 2.1)

REFERENCE NUMBER*	QUANTITY	SYMBOL	DIMENSIONS†	SI UNITS
	Mass	m	M	kg
	Length	l	L	m
	Time	t	T	s
	Temperature	θ	θ	°C
	Area	A	L^2	m^2
	Volume	V	L^3	m^3
	Angular velocity	ω	T^{-1}	rad/s
	Velocity	v	LT^{-1}	m/s
	Acceleration of free fall	g	LT^{-2}	m/s^2
	Speed of rotation	n	T^{-1}	s^{-1}
	Density	ρ	ML^{-3}	kg/m^3
	Pressure	p	$ML^{-1}T^{-2}$	N/m^2 ¶
	Viscosity (dynamic viscosity)	μ	$ML^{-1}T^{-1}$	$N\cdot s/m^2$
	Kinematic viscosity	ν	L^2T^{-1}	m^2/s
	Energy	E	ML^2T^{-2}	J
	Power (general term)	P	ML^2T^{-3}	W
	Reynolds number	Re	Pure number	
	Diameter	D	L	m
3.2.1.1	Mass rate of flow	$q_m^\ddagger$	MT^{-1}	kg/s
3.2.1.2	Volume rate of flow	$Q^\S$	L^3T^{-1}	m^3/s
3.2.3.2	Distance to reference plane	z	L	m
3.2.3.6	Inlet total head	H_1	L	m
3.2.3.7	Outlet total head	H_2	L	m
3.2.3.8	Pump total head	H	L	m
3.2.3.9	Specific energy	γ	L_2T^{-2}	J/kg
3.2.3.10	Loss of head at inlet	H_{J1}	L	m
3.2.3.11	Loss of head at inlet	H_{J2}	L	m
3.2.3.12	Net positive suction head	(NPSH)	L	m
	Atmospheric pressure (absolute)	P_b	$ML^{-1}T^{-2}$	N/m^2 ¶
	Vapour pressure (absolute)	P_v	$ML^{-1}T^{-2}$	N/m^2 ¶
3.2.1.1	Pump power output	P_u	ML^2T^{-3}	W
3.2.4.2	Pump power input	P	ML^2T^{-3}	W
3.2.4.3	Motor power input	P_{gr}	ML^2T^{-3}	W
3.2.5.1	Pump efficiency	η	Pure number	
3.2.5.2	Transmission efficiency	η_{int}	Pure number	
3.2.5.3	Motor efficiency	η_{mot}	Pure number	
3.2.5.4	Overall efficiency	η_{gr}	Pure number	
3.2.6	Type number	K	Pure number	
5.7.6	Friction factor	λ	Pure number	

*Where no number is given, reference may be made to various parts of IS : 1890-1961.

†M = Mass, L = Length, T = Time, θ = Temperature.‡An optional symbol for mass rate of flow is qm .§An optional symbol for volume rate of flow is qv .||An optional symbol for net positive suction head is H_H .

¶Also called pascal (symbol Pa).

2.2 Alphabetical Lists of Basic Letters and Subscripts — As given in Tables 2 and 3.

TABLE 2 LETTERS USED AS SYMBOLS

SYMBOL	QUANTITY	SI UNITS
A	Area	m^2
D	Diameter	m
E	Energy	J
g	Acceleration of free fall	m/s^2
H	Head	m
H_f	Losses in terms of head of liquid	m
K	Type number	Pure number
l	Length	m
m	Mass	kg
n	Speed of rotation	s^{-1}
(NPSH)	Net positive suction head	m
ρ	Pressure	N/m^2
P	Power	W
q	Mass rate of flow	kg/s
Q	Volume rate of flow	m^3/s
Re	Reynolds number	Pure number
t	Time	s
v	Velocity	m/s
V	Volume	m^3
γ	Specific energy	J/kg
z	Distance to reference plane	m
η	Efficiency	Pure number
θ	Temperature	$^{\circ}C$
μ	Dynamic viscosity	$N \cdot s/m^2$
ν	Kinematic viscosity	m^2/s
ρ	Density	kg/m^3
ω	Angular velocity	rad/s
λ	Friction factor	Pure number

TABLE 3 LETTERS AND FIGURES USED AS SUBSCRIPTS

SUBSCRIPT	MEANING
1	Inlet
2	Outlet
a	Available
b	Atmospheric
G	Guaranteed
gr	Unit (overall)
int	Intermediate
M	Manometric
mot	Motor
P	Pump
r	Required
S	Eye
sp	Specified*
t	Total
u	Useful
v	Vapour (pressure)

*This indication applies to the values of quantities relating to the guarantee point.

3. DEFINITIONS

3.1 General Definitions — In order to avoid any error of interpretation it has seemed preferable to reproduce here the definitions of quantities and units as given in various parts

of IS : 1890* and to supplement these definitions by some specific information on their use in this test code.

g = acceleration of free fall (see Note).

NOTE — For Class₂C test, the value of g is assumed to be $9.81 m/s^2$.

n = speed of rotation. The quotient of the number of rotations by the time,

ρ = density. The quotient of mass by volume.

p = pressure. The quotient of force by area. Unless otherwise specified, all pressures are gauge pressures, that is, measured with respect to the atmospheric pressure.

μ = viscosity (dynamic viscosity, sometimes called absolute viscosity), It is defined by the expression:

$$\tau = \mu \frac{u_o}{h}$$

where

u_o = the velocity of a flat plate moving in its own plane while keeping parallel to a fixed flat wall;

h = the distance from the flat plate to the fixed flat wall;

τ = the friction force of the fluid on the area unit of the flat plate during its motion.

NOTE — h should be small enough to obtain laminar flow of the fluid between the flat plate and the fixed flat wall.

ν = kinematic viscosity. The quotient of the viscosity (dynamic viscosity) by the density.

$$\nu = \frac{\mu}{\rho}$$

P = power. The quotient of the energy transferred during a time interval by the duration of this interval.

Re = Reynolds number. It is defined by the expression:

$$Re = \frac{vD}{\nu}$$

3.2 Definitions Peculiar to the Test Code —

This clause gives the definitions of concepts used in this test code, together with the associated symbols, if any have been allocated. Concepts, even though in current use, which are not strictly necessary to the application of this code are not here defined.

3.2.1 Flow Rates

3.2.1.1 q — In this test code, the mass rate of flow designates the external mass rate of flow of the pump, that is, the rate of flow discharged into the pipe from the outlet branch of the pump.

*Recommendations for quantities and units.

NOTE — Losses or abstractions inherent to the pump, that is,,

- a) discharge necessary for hydraulic balancing of axial thrust,
- b) coaling of bearings of the pump itself,
- c) water seal to the packing,
- d) leakage from the fittings, internal leakage, etc,

are not to be reckoned in the quantity delivered. On the contrary, if they are taken at a point before the flow measuring section, all derived quantities used for other purposes, such as:

- e) cooling of the motor bearings,
- f) cooling of a gear box (bearings, oil cooler), etc,

should be added to the measured rate of flow.

3.2.1.2 Q — The outlet volume rate of flow has the following value:

$$Q = \frac{q}{\rho_2}$$

In this test code, this symbol may also designate the volume rate of flow in a given section*; it is the quotient of the mass rate of flow in this section by the density. (The section may be designated by the proposed subscripts.)

3.2.2 Velocity of Flow (v) — The mean velocity of flow equal to the volume rate of flow divided by the pipe cross-section*:

$$v = \frac{Q}{A}$$

3.2.3 Head — The energy per unit weight of fluid.

3.2.3.1 Reference plane — The horizontal plane through the centre of the circle described by the external point of the entrance edges of the impeller blades; in the case of double inlet pumps the plane should be taken through the higher centre.

The manufacturer should indicate the position of this plane with respect to precise reference points on the pump.

3.2.3.2 z designates the difference between the level of the horizontal plane under consideration and the level of the reference plane. Its value is:

- a) positive, if the plane in question is above the reference plane;
- b) negative, if the plane in question is below the reference plane.

3.2.3.3 Gauge pressure (p) — The effective pressure, relative to atmospheric pressure. The head corresponding to this pressure is:

$$\frac{p}{\rho g}$$

*Attention is drawn to the fact that in this case Q may vary for different reasons across the circuit.

Its value is:

- a) positive if this pressure is greater than the atmospheric pressure:
- b) negative if this pressure is less than the atmospheric pressure.

3.2.3.4 Dynamic head — The kinetic energy per unit weight of the liquid in movement. It is expressed by:

$$\frac{v^2}{2g}$$

where v is the mean velocity of the liquid in the section considered.

3.2.3.5 Total head — In any section, the total head is given by:

$$z + \frac{p}{\rho g} + \frac{v^2}{2g}$$

This is related to atmosphere. The absolute total head in any section is given by:

$$z + \frac{p}{\rho g} + \frac{p_b}{\rho g} + \frac{v^2}{2g}$$

3.2.3.6 Inlet total head (H₁) — The total head in the inlet section of the pump:

$$H_1 = z_1 + \frac{p_1}{\rho g} + \frac{v_1^2}{2g}$$

3.2.3.7 Outlet total head (H₂) — The total head in the outlet section of the pump:

$$H_2 = z_2 + \frac{p_2}{\rho g} + \frac{v_2^2}{2g}$$

3.2.3.8 Pump total head (H) — The algebraic difference between the outlet total head, and the inlet total head:

$$H = H_2 - H_1 = z_2 - z_1 + \frac{p_2 - p_1}{\rho g} + \frac{v_2^2 - v_1^2}{2g}$$

If the compressibility of the pumped liquid is significant, ρ may be replaced by the mean value:

$$\rho_m = \frac{\rho_1 + \rho_2}{2}$$

3.2.3.9 Specific energy (γ) — The energy per unit mass of liquid. It is given by the equation:

$$\gamma = gH$$

3.2.3.10 Loss of total head at inlet (H_{1l}) — The difference between the total head of the liquid at the measuring point, or possibly of the liquid without velocity in the suction chamber, and the total head of the liquid in the inlet section of the pump.

3.2.3.11 Loss of total head on delivery (H_{2l}) — The difference between the total head of the liquid in the outlet section of the pump, and

the total head of the liquid at the measuring point.

3.2.3.12 Net positive suction head (NPSH) — Gauge reading in metres taken on the suction nozzle referred to the pump centre line, minus the vapour pressure in metres corresponding to the temperature of the liquid plus the velocity head at this point.

NPSH as well as inlet total head, is referred to the reference plane.

It is necessary to make a distinction between:

- a) the (NPSH) *required* at given flow and speed of rotation for a given pump; it is specified by the manufacturer. This is a function of pump design and varies from one design to another. For a cavitation free performance of a pump, it is necessary that available NPSH be higher than the required NPSH. The available NPSH represents the difference between the existing absolute suction head and the vapour pressure at the prevailing temperature. The required NPSH represents the minimum required margin between the suction head and the vapour pressure at a given capacity.
- b) the (NPSH) *available* for the same flow which is inferred from the installation. This is a function of a system comprising of suction head or lift, friction head, and the vapour pressure of the liquid being handled. By the physical altering of the installation, it is possible to control first two parameters of NPSH. But the vapour pressure of the liquid and this is always not feasible.
- c) the test (NPSH) — See 7.1.1.

Subscripts may be used to differentiate these quantities [for example (NPSH)_r when the required value is concerned and (NPSH)_a when available value is concerned].

3.2.4 Power

3.2.4.1 Pump power output (P_u) — The power transferred to the liquid at its passage through the pump:

$$P_u = qgH = g\dot{V}$$

3.2.4.2 Pump power input (P) — The power measured at the pump coupling.

3.2.4.3 Motor power input (P_{gr}) — The power absorbed by the pump driver.

3.2.5 Efficiency

3.2.5.1 Pump efficiency (η)

$$\eta = \frac{P_u}{P} = \frac{\text{Pump power output}}{\text{Pump power input}}$$

3.2.5.2 Transmission efficiency (η_{int}) (shafting, coupling, gears, etc):

$$\eta_{int} = \frac{\text{Pump power input}}{\text{Power at motor shaft}}$$

3.2.5.3 Motor efficiency (η_{mot})

$$\eta_{mot} = \frac{\text{Power at motor shaft}}{\text{Motor power input}}$$

3.2.5.4 Overall efficiency (η_{gr})

$$\eta_{gr} = \eta_{int} \eta_{mot} = \frac{\text{Pump power output}}{\text{Motor power input}}$$

3.2.6 Type Number K — The type number, a dimensionless quantity, is defined by the following formula*:

$$K = \frac{2 \pi n Q^{1/2}}{(gH)^{3/4}}$$

NOTE — Attention is drawn to the fact that in this Standard, the type number is based on the total head of a multistage pump, and not on the head per stage, and that it applies to the guaranteed flow rate, which is not in conformity with the common practice where K is calculated for the flow rate corresponding to the maximum efficiency.

4. GUARANTEES AND PURPOSE OF THE TESTS

4.1 Guarantees

4.1.1 Subjects of Guarantees — It shall be agreed in the contract which values are guaranteed by the manufacturer and under what conditions.

One or more of the following quantities are usually guaranteed:

- a) Outlet rate of flow of pump;
- b) Total head of pump;
- c) Power input or efficiency of pump or combined motor-pump unit (for example submersible pump or monoset pump; or separate pump and motor with overall efficiency guaranteed); and
- d) (NPSH).

Whichever of these quantities is guaranteed, it is necessary to specify the speed of rotation (or in some cases the electrical supply frequency and voltage for the motor-pump unit) and the chemical and physical properties of the liquid to be pumped (if other than clean cold water).

In this test code the guarantees only refer to the pump including the test arrangements as given in 5.7. In particular, the guarantees do not apply to:

- a) the test of the pipe and its fittings, such as valves, etc;

*This formula is the same as the basic formula

$$K = \frac{\omega Q^{1/2}}{y^{3/4}}$$

b) the general installation *in situ*;

if these parts do not belong to the test arrangements according to 5.7.

The pump manufacturer is responsible neither for the determination of the pump guarantee point, nor for the arrangement of the pump, nor for the installation *in situ*, the sole exception being when he has undertaken these tasks as part of the order.

4.1.2 Extent of Guarantees — The guarantee of the flow rate covers the flow rate at the agreed total head and speed of rotation, within the permissible tolerances above and below as given by 9.4.1.

The guarantee of the head covers the pump total head (H) at the agreed flow rate and speed of rotation, within the permissible tolerances above and below as given by 9.4.1.

The guarantee of the efficiency covers the minimum value of efficiency at the guaranteed point QH within the permissible tolerances as given by 9.4.2.

If the flow rate values and the efficiency stated are not guaranteed but are indicated on the basis of prior tests or are given in printed curves (for mass produced pumps) (see Appendix A).

For a combined motor-pump unit (for example submersible pump or monobloc pump; or separate pump and motor with overall efficiency guaranteed) the guarantee covers efficiency of the entire unit.

4.1.3 Implementation of Guarantees

4.1.3.1 Flow rate and total head values — The guarantee for flow rate and total head is fulfilled if, at the agreed speed of rotation, the value of the equation given in 9.4.1 is greater than or equal to 1.

4.1.3.2 Efficiency — The efficiency guarantee is fulfilled if, at the agreed speed of rotation, the conditions given in 9.4.2 have been achieved or exceeded.

4.1.3.3 Net positive suction head (NPSH) — When a test of (NPSH) is specified in the contract, the guarantees as defined in 4.1.3.1 and 4.1.3.2 shall be achieved under those conditions of (NPSH) that are specified. This does not necessarily ensure absence of cavitation (see 7).

4.1.3.4 Motor speed of rotation — If the driving motor is being supplied by the pump manufacturer, the speed of rotation named in 4.1.2 and 4.1.3 can be replaced by the frequency and the voltage.

4.2 Purpose of the Tests

4.2.1 Contractual Object of the Tests — The tests are intended to ascertain the performance of the pump and to compare this with the manufacturer's guarantee. When (NPSH)

also is to be guaranteed, it shall be specified in the contract whether (NPSH) is to be tested or not. Attention is drawn to the fact that a test of (NPSH) increase the costs of the tests. (See also Appendix D.)

Where a number of identical pumps are to be purchased, the number of pumps to be tested shall be agreed between the purchaser and manufacturer.

4.2.2 Range of Performance Test — The performance test of the pump shall be carried out to determine the performance of the pump with respect of the discharged rate of flow, total head, power absorbed, etc.

A check of the satisfactory running of the pump may be made from the point of view of cavitation, temperature of glands and bearings, axial thrust, and possible air or water leakage, provided the hydraulic test is carried out the specified speed of rotation.

NOTE—It is also possible to observe the amount of noise and vibration.

4.2.3 Liquid Used in Testing — The liquid used in testing shall be clean cold water in accordance with the recommendations of 8, unless otherwise specified in the contract.

5. ORGANIZATION OF TESTS

5.1 Place of Testing — Acceptance tests shall be carried out either at the manufacturer's works, or alternatively at a place to be mutually agreed between the manufacturer and the purchaser.

5.2 Time of Testing — The time of testing shall be mutually agreed by the manufacturer and the purchaser.

When tests are not carried out in the manufacturer's works, time should be allowed for preliminary adjustments by both the manufacturer and the installer.

5.3 Test Validity — It should be ascertained that conditions permit tests to be made in accordance with the provisions of this code.

5.4 Staff — Accurate measurements depend not only on the quality of the measuring instruments used but also on the ability and skill of the persons operating and reading the measuring devices during the tests. The staff entrusted with effecting the measurements must be selected just as carefully as the instruments to be used in the test.

Specialists with adequate experience in measuring operations in general shall be charged with operating and reading complicated measuring apparatus. Reading simple measuring devices may be entrusted to such helpers who—upon short prior instruction—can be assumed to effect the readings with proper care and the accuracy required.

A chief of tests shall be appointed, possessing adequate experience in measuring operations. Normally, when the test is carried out at the manufacturer's works, the chief of tests is a staff member of the manufacturing firm.

All persons charged with effecting the measurements are subordinated during the tests to the chief of tests, who conducts and supervises the measurements, reports on test conditions and the results of the tests and then drafts the test report. All questions arising in connection with the measurements and their execution are subject to his decision.

The parties concerned shall provide all assistance that the chief of tests considers necessary.

5.5 Test Programme — Only the guaranteed operational data shall form the basis of the test; other data determined by measurement during the tests shall have merely an indicative (informative) function and it shall be so stated if they are included in the programme.

5.6 Testing Apparatus — When the measuring procedure is being decided on, the measuring and recording apparatus required shall be specified at the same time.

The chief of tests shall be responsible for checking the correct installation of these apparatuses and their perfect functioning.

All of the measuring apparatus shall be covered by reports showing by calibration or by comparison that it complies with the requirements of 5.12. These reports shall be presented if required.

5.7 Test Arrangements

5.7.1 Standard Test Arrangements — Ideally, the flow through the inlet head measuring section should be such that:

- a) the velocity is uniform, and axial, across the section; and
- b) the static pressure across the section is uniform.

These are the conditions for the standard test arrangement, but they are impossible to achieve completely, and it is impracticable to check them for the class of test covered by this standard.

However, significant maldistribution and swirl can be avoided by keeping bends and combinations of bends, and divergences and discontinuities of cross-sectional area, from the proximity of the measuring section. In general, the importance of inlet flow conditions increases with the pump type number,

and for type numbers greater than 1.5 it is more meaningful to reproduce site conditions than it is to use a standard test arrangement. For such non-standard conditions an agreement shall be reached in the contract (see Appendix B).

5.7.1.1 Inlet pressure tapings — In general, the pressure tapping shall be placed in a section of equal diameter to, and concentric with, the inlet branch of the pump. It should under normal conditions be located two diameters upstream from the pump inlet flange. Moreover it shall never be placed:

- a) in a diverging section, or within four diameters of straight pipe downstream from the divergence;
- b) within the plane of a bend, either in the bend itself or within four diameters of straight pipe downstream from the bend. It may, however, be agreed to site a pressure tapping in this region at right angles to the plane of the bend; and
- c) within four diameters of straight pipe following a sudden contraction, or other discontinuity of cross-sectional area.

When interpretation of readings in non-standard conditions is being negotiated, consideration shall be given to:

- a) whether the value of inlet head itself is important (for example, for NPSH tests); and
- b) the ratio of inlet velocity head to the pump total head.

If this ratio is very small (less than 0.5%) and the value of inlet head itself is not important, readings from a tapping in the pump inlet flange may be used in the inlet total head equation given in 3.2.3.6 (for ratio >0.5%: 2 D upstream).

5.7.1.2 Outlet pressure tapings — Under normal conditions the outlet pressure tapping should be located two diameters downstream from the pump outlet flange.

For the pumps of type number equal to or less than 0.5, the outlet pressure tapping may be located directly at the pump outlet, provided it is at right angles to the plane of the volute or any other bend formed by the pump casing.

For the pumps of type number greater than 0.5, the straight parallel pipe shall be coaxial with the outlet pipe of the pump and have the same bore. The tapping shall be located in the pipe wall in a plane through the pipe axis at right angles to the plane of the volute or other bend formed by the pump casing.

5.7.2 Pumps Tested with Fittings — If specified in the contract, standard tests shall be

carried out on a combination of a pump and

- a) associated fittings at the final site installation; or
- b) an exact reproduction thereof; or
- c) fittings introduced for testing purposes and taken as forming part of the pump itself (see for examples 5.7.3, 5.7.4, etc).

Connections on the inlet and outlet sides of the whole combination shall be made in accordance with 5.7.1.

Measurements shall then be taken in accordance with 5.11.2 and 5.11.3.

5.7.3 Pumping Installation Under Submerged Conditions — Where a pump, or a combination of a pump and its fittings, is tested or installed in conditions where the standard pipe connection, on either inlet or outlet as described in 5.7.1, cannot be made owing to inaccessibility or submergence, measurements shall be taken in accordance with 6.2.2.3 and 6.2.3.3.

5.7.4 Borehole and Deep-Well Pumps — Borehole and deep-well pumps cannot usually be tested with their complete lengths of delivery main and, consequently, the loss of head in the portions omitted, and the power absorbed by any shafting therein, cannot be measured. Any thrust bearing would also be more lightly loaded during the test than it would be in the final installation (see 6.2.4.4).

5.7.5 Self-Priming Pumps — In principle the priming ability of self-priming pumps shall always be verified at the contractual static suction head with the attached inlet piping equivalent to that in the final installation. When the test cannot be carried out in the described manner, the test arrangement to be used shall be specified in the contract.

5.7.6 Friction Losses at Inlet and Outlet — The guarantees under 4.1 refer to the pump inlet and outlet flanges, and the pressure measuring points are in general at a distance from these flanges (5.7.1 to 5.7.5). It may be necessary to add to the measured pump total head the head losses due to friction (H_{j1} and H_{j2}) between the measuring points and the pump flanges.

Such a correction should be applied only if

$$H_{j1} + H_{j2} \geq 0.0005 H$$

If the pipe between the measuring points and the flanges is unobstructed, straight, and of constant circular cross section,

$$H_j = \lambda \frac{l}{D} \frac{v^2}{2g}$$

The value of λ should be derived from

$$\frac{1}{\sqrt{\lambda}} = -2 \log_{10} \left[\frac{2.51}{Re \sqrt{\lambda}} + \frac{k}{3.7 D} \right]$$

where

$$Re = \frac{vD}{\nu} \text{ (pure number)}$$

$$\frac{k}{D} = \frac{\text{pipe roughness}}{\text{pipe diameter}} \text{ (pure number)}$$

Appendix C gives guidance on how to check whether a correction needs to be made, and on how to calculate the correction if necessary. If the pipe is other than unobstructed, straight, and of constant circular cross section, the correction to be applied must be the subject of special agreement in the contract.

5.8 Speed of Rotation During Test

(see 4.2.2) — The difference between the specified speed of rotation and the test speed of rotation may be allowed as follows $\left(\frac{n - n_{sp}}{n_{sp}} \right)$

5.8.1 For flow rate and head: $\begin{matrix} +20\% \\ -50\% \end{matrix}$

5.8.2 For efficiency: $\pm 20\%$

For a combined motor-pump unit, the motor efficiency change between specified and test speeds, shall be established at the time of agreeing the contract. The lower speeds are also acceptable. The formula for efficiency correction shall be as specified in 13.10.4 of IS : 5120-1977*

5.8.3 For (NPSH) Tests — $\pm 20\%$ provided that the pump flow rate during the test lies within 50% and 120% of the flow rate corresponding to maximum efficiency.

NOTE — For tests conforming to the requirements of 7.1.1.1, the above-mentioned variation may always be allowed; for tests conforming to the requirements of 7.1.1.2, it may be allowed for pumps with type numbers less than or equal to 2. For pumps with type numbers greater than 2, agreement shall be reached between the parties concerned.

5.9 Control of Head — The test conditions may be obtained, among other methods, by throttling in either or both the inlet and outlet pipes. When throttling in the inlet pipe is used, due consideration shall be given to the possibility of cavitation or of air coming out of the water, which might affect the operation of the pump (see 7.1.2), the flow measuring device (see 6.1.3 — 4th paragraph) or both.

5.10 Execution of Tests — The duration of the test shall be sufficient to obtain consistent results, having regard to the degree of accuracy to be achieved.

Where multiple readings are taken to reduce the error margin (see 5.11), they shall be taken at equal intervals of time.

*Technical requirements for rotodynamic special purpose pumps (first revision).

Where, for special reasons, it is necessary to determine performance over a range of operating conditions, a sufficient number of observations shall be taken to establish the performance within the limits of error stated in 5.11.

All measurements shall be made under steady conditions of operation as defined in 5.11. If steady conditions are not achievable, agreement shall be made between the parties concerned on the matter.

If the driving power available during a test on a testing stand is insufficient, and if the test has to be carried out at greatly reduced speed of rotation, the guaranteed characteristics can be adjusted to such reduced speed of rotation in accordance with 5.8.1, 5.8.2, 5.8.3, 9.2.1 or 9.2.2, respectively.

To verify the guarantee point, three measurements shall be recorded, one as close as possible to the guarantee point, and one closely on each side of it.

The test records shall be kept with two copies (one for the purchaser and one for the manufacturer); all test records and recording strips shall be initialled by the chief of tests and the representatives of both parties.

The evaluation of the test results shall be made as far as possible while the tests are in progress and, in any case, before the installation and instrumentation are dismantled in order that suspect measurements can be repeated without delay (see also Appendix D).

5.11 Test Conditions — See also Appendices E and F.

5.11.1 Definitions — For the purpose of this standard the following definitions shall apply:

Oscillations — Short oscillation cycles about a mean value occurring during the time that a single observation is being made.

Variations — Those changes in value which take place between one reading and the next.

5.11.2 Permissible Oscillations in Readings and Use of Damping — Where the construction or operation of a pump is such that oscillations of great amplitude are present, measurements may be carried out by means of an instrument capable of providing an integration over at least one complete cycle of oscillation. The calibration of such an instrument shall comply with the provisions of the appropriate clauses.

Restricted damping may be introduced in measuring instruments and their connecting lines where necessary to reduce the amplitude of oscillations to within the values given in Table 4.

Where it is possible that damping will sig-

nificantly affect the accuracy of the readings, the tests shall be repeated using a symmetrical damping device, for example a symmetrical orifice or capillary tube.

TABLE 4 MAXIMUM PERMISSIBLE AMPLITUDE OF OSCILLATIONS AS A PERCENTAGE OF MEAN VALUE OF QUANTITY BEING MEASURED

MEASURED QUANTITY	MAXIMUM PERMISSIBLE AMPLITUDE OF OSCILLATIONS
Rate of flow Head Torque Power	± 6
Speed of rotation	± 2

NOTE 1 — Where a 6% change in flow would result in a calculated 12% change in head, the maximum permissible amplitude of the observed differential head shall be $\pm 12\%$.

NOTE 2 — In the case of inlet total pressure head and outlet total pressure head measurement, the permissible percentage oscillation shall be calculated on the pump total head.

5.11.3 Number of Sets of Observations

5.11.3.1 Steady conditions — In steady and well controlled test conditions, only one set of readings of individual quantities shall be recorded for the specified test condition. This set shall be recorded only after the observers have been satisfied that the oscillations and variations of the readings have settled down within the limits specified in Tables 4 and 5.

5.11.3.2 Unsteady conditions — In such cases where the unsteadiness of test conditions gives rise to doubts concerning the accuracy of the tests, the following procedure shall be followed:

Repeated sets of observations of the measured quantities shall be made at the guarantee point, only speed and temperature being allowed to be controlled. Throttle valve water level, gland, balance water, settings, etc, shall be left completely unaltered. The differences between these repeated readings of the same quantities will be a measure of the unsteadiness of the test conditions, which are at least partly influenced by the pump under test as well as the installation.

A minimum of three sets of observations shall be taken at the guarantee point, and the value of each separate measurement and of the efficiency derived from the measurements in each set shall be recorded. The percentage difference between the largest and smallest values of each quantity shall not be greater than that given in Table 5. It will be noted that a wider tolerance is permitted if the number of readings is increased up to the maximum requirement of nine readings.

These tolerances are designed to ensure that the errors due to scatter, taken together with the systematic error limits given in Table 6, will result in overall measurement errors not greater than those given in Table 7.

TABLE 5 LIMITS OF VARIATION BETWEEN REPEATED MEASUREMENTS OF THE SAME QUANTITY (BASED ON 95% CONFIDENCE LIMITS)

(Clauses 5.11.3.1 and 5.11.3.2)

NUMBER OF SETS OF OBSERVATIONS	MAXIMUM PERMISSIBLE DIFFERENCE BETWEEN LARGEST AND SMALLEST READINGS OF EACH QUANTITY %	
	Rate of flow Head Torque Power Efficiency	Speed of Rotation
3	1.8	1.0
5	3.5	2.0
7	4.5	2.7
9	5.8	3.3

The arithmetic mean of all the readings for each quantity shall be taken as the actual value for the purposes of the test.

If the values given in Table 5 cannot be reached, the cause shall be ascertained, the conditions rectified and a new complete set of observations made, i.e. all the readings in the original set shall be rejected. No reading or selection of readings in the set of observations may be rejected because it lies outside the limits.

In the case where the excessive variation is not due to procedure or instrumentation errors, and cannot therefore be eliminated, the limits of error may be calculated by statistical analysis.

5.12 Accuracy of Measurement — The limits of measurement errors laid down in this standard are those which refer to measurements taken and to quantities calculated therefrom; they apply to the maximum permissible discrepancies between measured and actual performances (see 9.4).

For the purpose of this standard, an "error" is defined as a value equal to twice the estimated standard deviation. It is assumed that there is a 95% probability that the estimated value of the true error will not exceed twice the estimated standard deviation.

This test code specifies the standard methods of measurement and instruments to be used for the determination of rate of flow, inlet total head, outlet total head, pump total head, speed of rotation and pump power input.

Any device or method which by calibration

or comparison has been demonstrated to be capable of measuring with systematic errors not exceeding the limits in Table 6 may be used. The devices or methods shall be agreed upon by both parties concerned.

TABLE 6 PERMISSIBLE SYSTEMATIC ERRORS OF MEASURING INSTRUMENTS

(Clause 5.11.3.2)

MEASURED QUANTITY	PERMISSIBLE LIMIT, %
Rate of flow Pump total head Pump power input	± 2.5
Electrical power input (for overall efficiency tests) Motor efficiency	± 2.0
Speed of rotation	± 1.4

If the recommendations concerning the systematic errors of instruments as given in Table 6, and those concerning the actual test procedure, are followed, it should be assumed that the overall limits of error will not exceed those given below.

TABLE 7 MAXIMUM PERMISSIBLE LIMITS OF OVERALL ERRORS

(Clause 5.11.3.2)

QUANTITY	PERMISSIBLE LIMIT, %
Rate of flow Pump total head Pump power input Electrical power input (for overall efficiency tests)	± 3.5
Speed of rotation	± 2.0
Overall efficiency (computed from the rate of flow, total head and electrical power)	± 4.5
Pump efficiency	± 5.0

6. PROCEDURE FOR MEASUREMENT OF RATE OF FLOW, HEAD, SPEED OF ROTATION AND POWER INPUT

6.0 The following methods, among others,, may be used.

6.1 Measurement of Flow Rate

6.1.1 Weighing Tank Method — This method is capable only of measuring the mean value of the flow rate during the period concerned.

It is subject to the errors of the weighing, of the time-measuring apparatus employed, of the time taken for the diversion of the flow into and from the weighing tank and those involved in the determination of density.

NOTE — In the case where two tanks are used alternately during the measuring period, the flow being diverted from one to the other, only the times of initial diversion into and final diversion from the measuring system shall be taken into account, not the times of the intermediate diversions from tank to tank.

6.1.2 Volumetric Tank Method — This method, as in the case of the weighing method, is only capable of measuring the mean value of the flow rate during the period concerned.

In every case a leakage test of the tank shall be carried out and correction made for leakage if necessary; where possible, initial calibration shall be carried out by weighing a liquid of known density into the measuring tank. Outdoor tanks shall be adequately sheltered so that the level and the level-measuring devices are not disturbed by wind or rain.

In the case of big outdoor tanks the method is in general subject to errors in measurement of levels which are not stationary and which may be non-uniform. In such a case the levels shall be simultaneously measured within stilling tubes, at not fewer than four widely separated positions within the tank.

Water levels may be measured with hook gauges, float gauges, piezometer or other instruments capable of maintaining the required accuracy.

6.1.3 Orifice Plates, Venturi Tubes and Nozzles — The measurement of flow rate may be carried out using devices designed and installed in accordance with IS : 2952 (Part I)-1964* for orifice plates and nozzles and IS : 4477 (Part I)-1967† for venturi tubes. Minimum straight lengths required upstream from the pressure difference device, especially, are given in IS : 2952 (Part I)-1964* in the case of orifice plates and nozzles, and in IS : 4477 (Part I)-1967† in the case of venturi tubes.

For the purpose of this standard the pump will be considered to cause a flow disturbance equivalent to a single 90° bend lying in the same plane as the pump volute or the last stage of a multistage pump or the outlet bend of the pump.

The characteristics of these devices are calculated using above Indian Standards and the calibration is not required.

Care shall be taken to ensure that neither cavitation nor air is present in the flow-measuring devices. Special care shall be taken to ensure that the indications of the device are not affected by air coming out of solution at the control valve. The presence of air can

usually be detected by operating the air vents on the measuring device.

Manometers used for differential pressure measurement shall be of the liquid column type and shall meet the requirements of 6.2.6.

6.1.4 Notches, Weirs and Flumes — Recommendations for the construction and installation of notches, weirs and flumes are given in IS : 1193-1959*, to which reference should be made.

For the purposes of this standard the smallest scale division of any instrument used for observing head shall be not greater than that corresponding to 1.5% of the flow.

6.2 Measurement of Head

6.2.1 Pressure Tappings and Instrument Connecting Lines — Static pressure tappings shall comply with the requirements shown in Fig. 1 and be free from burrs and irregularities and flush with, and normal to, the inner wall of the pipe.

The diameter of the pressure tappings shall be between 2 and 6 mm or equal to 1/10 of the pipe diameter, whichever is less. The length of a pressure tapping hole shall be not less than twice its diameter.

The bore of the pipe containing the tappings shall be clean, smooth and resistant to chemical reaction with the liquid being pumped. Any coating such as paint applied to the bore shall be intact. If the pipe is welded longitudinally, the tapping hole shall be displaced as far as possible from the weld.

Pipes connecting pressure tappings to possible damping devices (see 5.11.2) and to instruments shall be at least equal in bore to the bore of the pressure tappings. The system shall be free from leaks.

It is recommended that transparent tubing be used so as to allow determination of the amount of water or air in the tubing.

6.2.2 Inlet Total Head

6.2.2.1 Installation in accordance with 5.7.1.1 — These installations and the corresponding formulae are given in Fig. 2 and 3.


6.2.2.2 Installation in accordance with 5.7.2 — Where a pump is tested in combination with fittings forming part of the site or test installation, the provisions of 6.2.2.1 shall be applied to the inlet flange of the fittings and not to the inlet flange of the pump.

This procedure debits against the pump all head losses caused by fittings on the inlet side.

*Recommendations for methods of fluid flow by means of orifice plate and nozzles: Part I Incompressible fluids.


†Method of measurement of fluid flow by means of venturimeters: Part I Liquids.

*Methods of measurement of flow of water in open channels using notches, weirs and flumes.

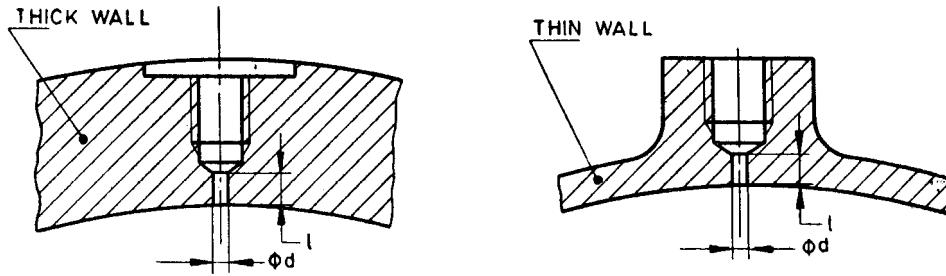


$l \geq 2d$ where $d = 2$ to 6 mm or 1/10 pipe diameter whichever value is the less.

FIG. 1 REQUIREMENTS FOR STATIC HEAD TAPPINGS

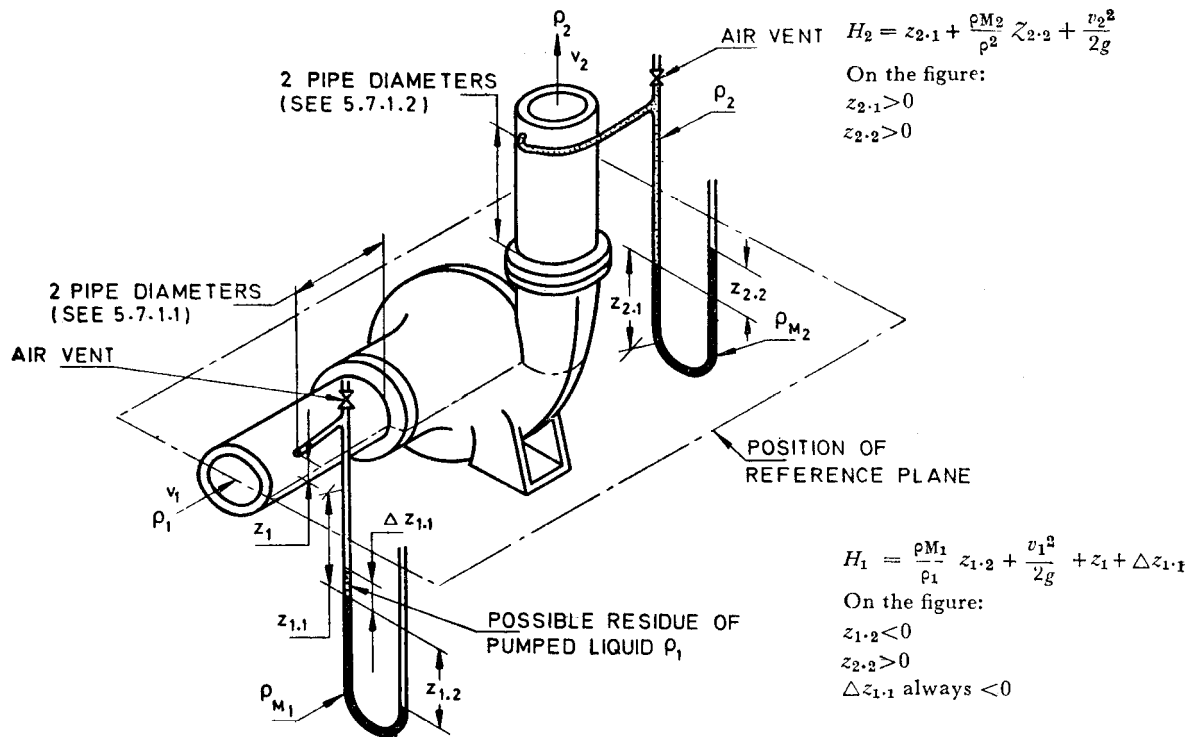


a) The pump inlet is under vacuum

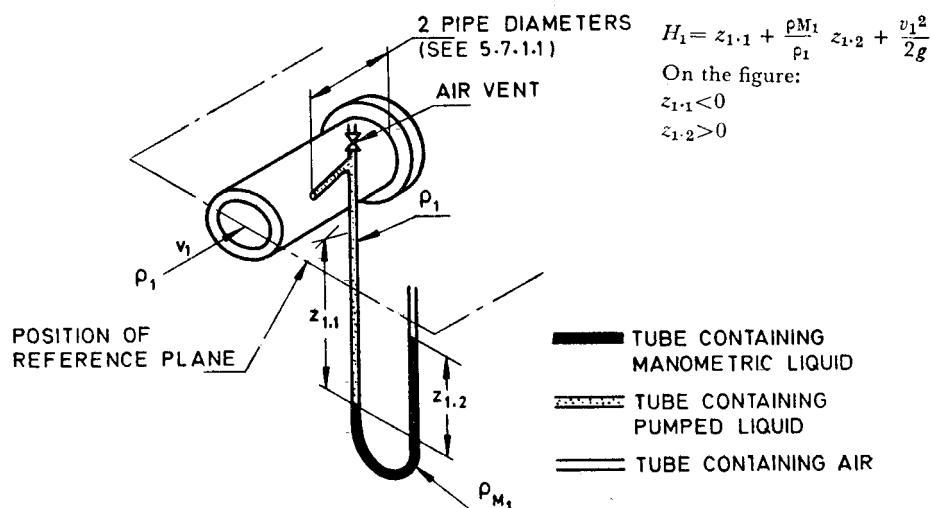

b) The pump inlet is under pressure

The drawings show the principle but no full technical details.

FIG. 2 TEST OF A CENTRIFUGAL PUMP BY MEANS OF LIQUID COLUMN GAUGES

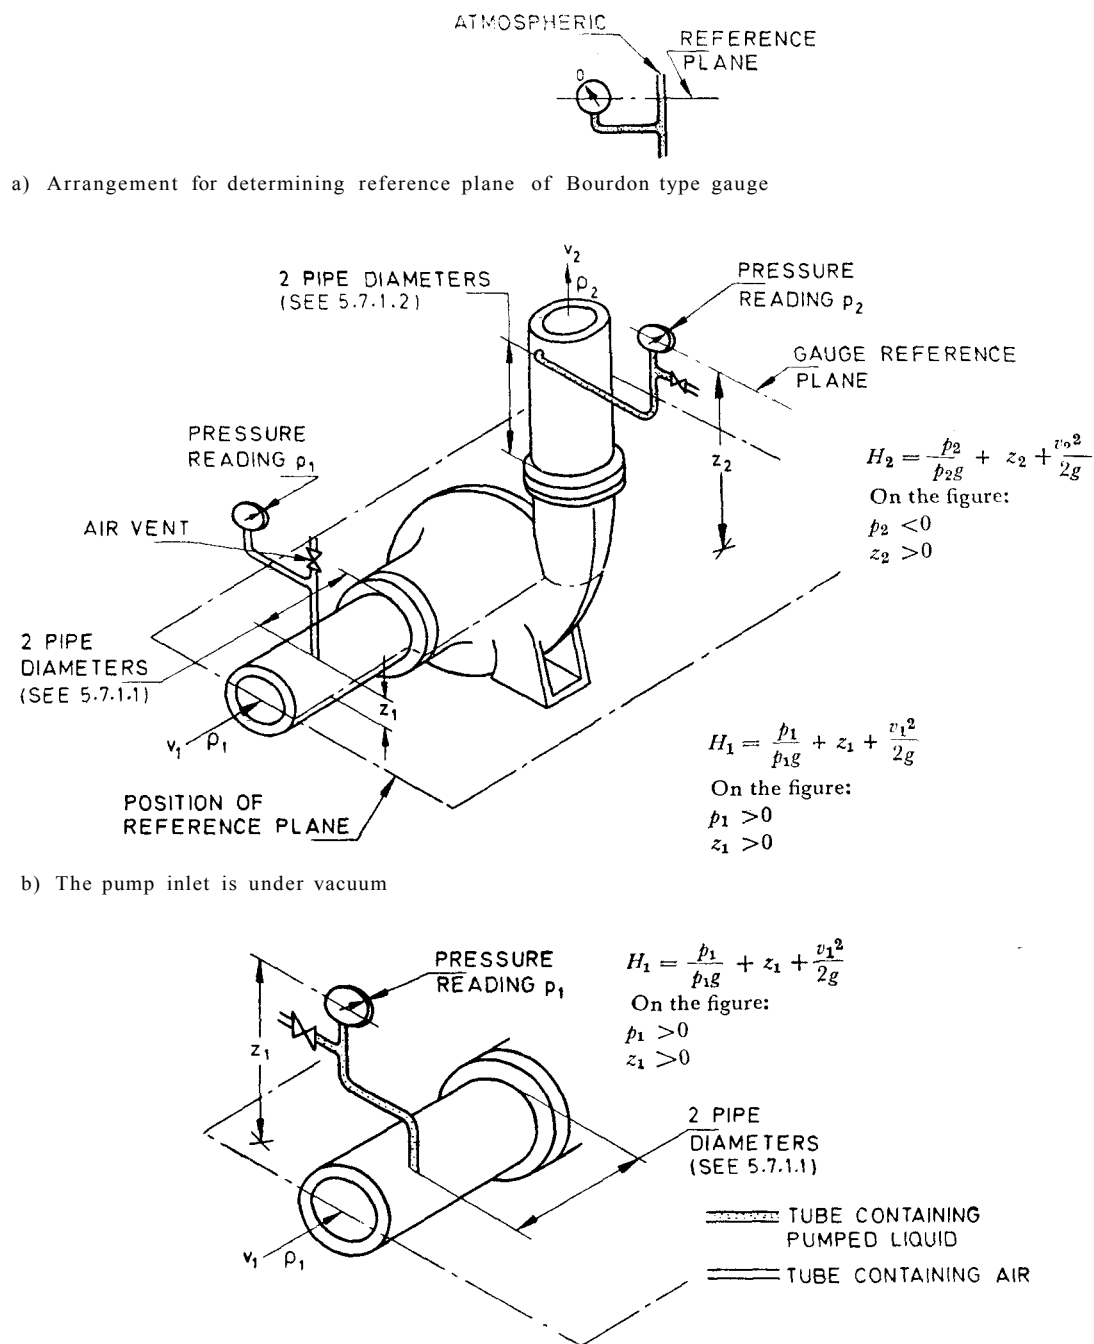

The drawings show the principle but no full technical details.

FIG. 3 TEST OF A CENTRIFUGAL PUMP BY MEANS OF BOURDON GAUGES

6.2.2.3 Installations in accordance with 5.7.3 and 5.7.4 — The inlet total head is equal to the positional head with respect to the reference plane of the still surface of the liquid in which the pump is tested or from which it draws, plus the pressure head equivalent to the gauge pressure on that surface.

This assumption debits against the pump all head losses caused by fittings on the inlet side.

6.2.3 Outlet Total Head

6.2.3.1 Installations in accordance with 5.7.1.2 — These installations and the corresponding formulae are given in Fig. 2 and 3.

6.2.3.2 Installations in accordance with 5.7.2 — Where a pump is tested in combination with fittings forming part of the site or test installation, the provisions of 6.2.3.1 shall be applied to the outlet flange of the fittings and not to the outlet flange of the pump.

This procedure debits against the pump all head losses caused by fittings on the outlet side.

6.2.3.3 Installations in accordance with 5.7.3 and 5.7.4 — These installations and the corresponding formulae are given in Fig. 4.

However, if the pump discharges into a sump with a free surface, the outlet total head is equal to the positional head of the still surface of the liquid into which the pump delivers, plus the gauge pressure head.

This assumption debits against the pump all head losses caused by fittings on the outlet side.

6.2.4 Total Inlet and Outlet Heads — Special Cases — It will prove necessary to permit exceptions from the above-mentioned standard arrangements in the following cases.

6.2.4.1 Pumps conforming to the final site installation — During the acceptance test, the pump shall be fitted with the pipe arrangements corresponding to the final arrangement at site. In this case the friction losses between the test point for measuring the inlet pressure and the inlet flange, as well as between the outlet flange and the test point for measuring the outlet pressure, shall be determined in accordance with the method mentioned in 5.7.6 and added to the sum of the differences of positional head, of pressure head and of velocity head.

6.2.4.2 Pumps with inaccessible ends — If the inlet or outlet or both sides of the pump are inaccessible, the procedure prescribed above shall be followed in measuring the pump's head. Under certain circumstances,

friction losses, such as mentioned in 5.7.6 and 6.2.4.1, shall be taken into account.

6.2.4.3 Submersible pumps — If the outlet flange of this type of pump is, for practical purposes, defined as placed at a certain distance from the pump proper, and is thus preceded by an outlet pipe length and a bend or bends being always parts of the installation, the measurement of outlet head shall be made in accordance with 5.7.2.

6.2.4.4 Deep-well pumps — In this case, friction losses between the pressure measuring points and the inlet or outlet flanges, respectively, that may have to be taken into account, shall be determined in accordance with the method given in 5.7.6 and Appendix C. Friction losses on suction are primarily caused by resistance to flow within the inlet strainer, the foot valve, and the inlet pipe. All of these head losses shall as far as possible be indicated at the time the contract is made by the pump manufacturer if he supplies such accessories, or by the purchaser if they are fitted by the latter. Should it prove impossible to submit such data the purchaser and the manufacturer, prior to the acceptance test, shall arrive at an agreement concerning the flow resistance data to be applied.

Friction losses at outlet result from resistance to flow within the column-pipe and the outlet bend.

Since deep-well pumps in general are not tested with the entire stand pipe attached, unless the acceptance test is performed at site, the pipe friction losses in regard to the pump total head shall be estimated and stated by the manufacturer to his purchaser.

Should it be considered necessary to verify the data indicated by an acceptance test at site, such a test shall be specified in the supply contract.


For tests on installations conforming to the requirements of 5.7.2, 5.7.3 and 5.7.4, the guarantees also apply to fittings.

6.2.5 Pump Total Head — The pump total head is calculated in accordance with the definition given in 3.2.3.8. However, in certain cases the pump total head may be measured using one differential pressure device.

This type of installation and the corresponding formulae are given in Fig. 5.

When this is deemed preferable, the pump total head may be replaced by an expression giving the increase in specific energy of the fluid conveyed by the pump ($\gamma = gH$, see 3.2.3.9).

The "specific energy" increase is obtained by multiplying both sides of the pump total head equation given above by g .

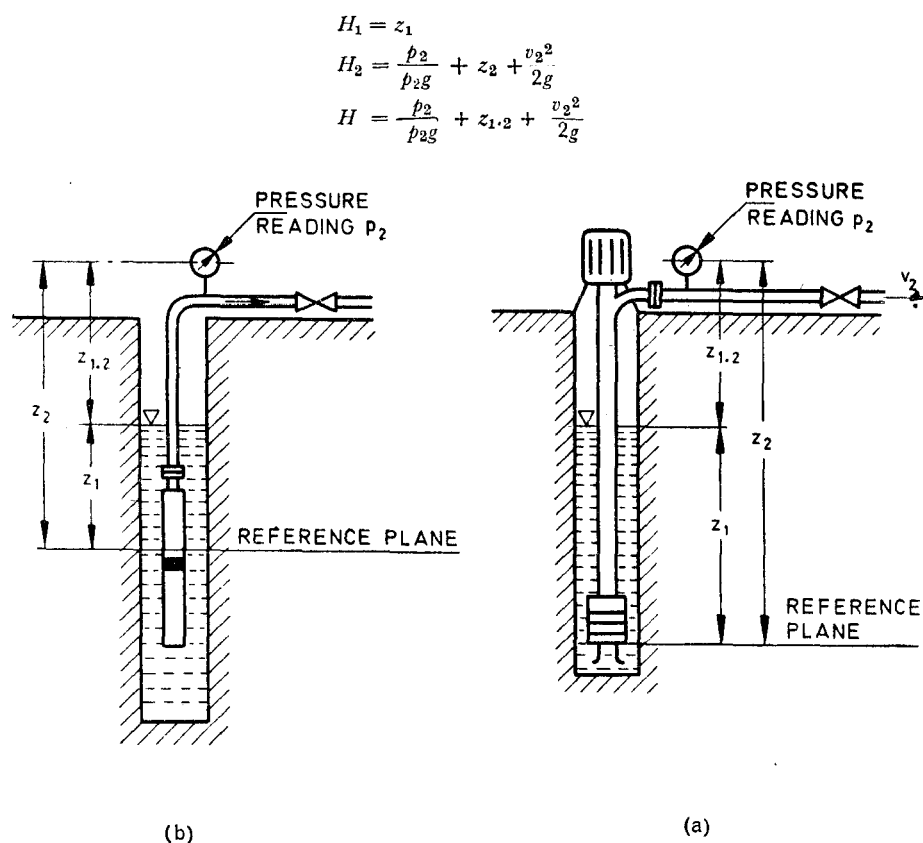

The drawings show the principle but no full technical details.

FIG. 4 MEASUREMENT OF PUMP TOTAL HEAD H FOR VARIOUS TYPES OF SUBMERGED PUMPS

6.2.6 Instruments for Pressure Measurement

6.2.6.1 Liquid column manometers — No calibration is required.

The minimum distance between two scale graduations shall be 1 mm.

If possible, the use of differential liquid columns less than 50 mm high shall be avoided. If this is impossible, attention shall be specially drawn to errors of measurement.

The length of the liquid column may be modified by using one manometric liquid in place of another.

For reading below 100 mm of liquid, the bore of manometer tubes shall be 6 mm at least for mercury and 10 mm for water and other liquids.

The cleanliness of the liquid in the manometer shall be maintained to avoid errors due to variation of surface tension.


The design of the manometers shall be such that parallax errors are minimized.

Water column manometers may be either open ended (for low pressure measurement only) or closed with the air in the column connecting both limbs compressed to the amount required to permit the differential head to be read on the scale.


The use of the liquid column manometer is shown diagrammatically in Figures 2 and 5, to which reference should be made.

Connections between the pipes where pressure is measured and the manometer shall be made as shown diagrammatically in Fig. 2.

It is essential that there is no break in continuity (for example, by air pockets through failure to vent properly) of the water between the pipe and the reading surface in the manometer.

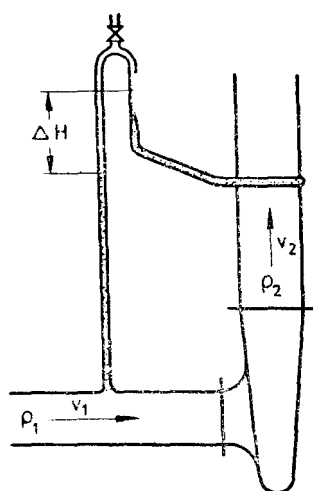

$$H = \Delta H + \frac{v_2^2 - v_1^2}{2g}$$

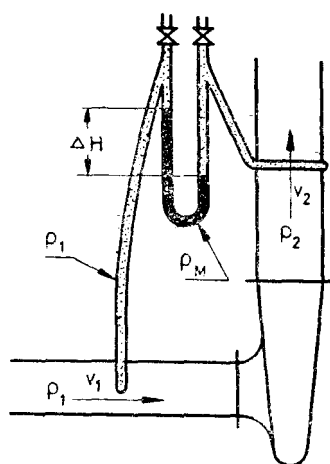

$$H = \frac{\rho_M - \rho_1}{\rho_1} \Delta H + \frac{v_2^2 - v_1^2}{2g}$$

This equation is valid for $\rho_1 = \rho_2$, which may be assumed for Class C tests.

FIG. 5 DIRECT MEASUREMENT OF PUMP TOTAL HEAD

6.2.6.2 Bourdon dial gauges — When this type of gauge is used for inlet and outlet pressure measurements, to ascertain pump total head, it is recommended that the difference between two consecutive scale graduations be within 1.5 and 3 mm for both measurements, and that this difference corresponds to not more than 5% of the pump total head.

6.3 Measurement of the Speed of Rotation — The speed of rotation shall be measured by counting revolutions for a measured interval of time, by a direct-indicating tachometer or, in the case of a pump driven by an ac motor, from observations of the mean

frequency and motor slip data either directly measured (for example, using a stroboscope) or supplied by the motor manufacturer.

Where the speed of rotation cannot be directly measured (for example, for immersed pumps), it is usually sufficient to establish the frequency and voltage.

6.4 Measurement of Pump Power Input —

The pump power input shall be derived from measurement of the speed of rotation and torque, or determined from measurements of the electrical power input to an electric motor of known efficiency, directly coupled to the pump.

6.4.1 Measurement of Torque — Torque shall be measured by a suitable dynamometer, capable of complying with the requirements of 5.11.

6.4.2 Electric Power Measurements — Where the electrical power input to an electric motor coupled directly to the pump is used as a means of determining the pump power input, the following conditions shall be observed:

- The motor shall be operated only at conditions where the efficiency is known with sufficient accuracy,
- Motor efficiency shall be determined in accordance with the recommendations of IS : 4889-1968*.

The electric power input to the driving motor shall be measured by the two-wattmeter method in the case of ac motors. This allows the use of two single-element wattmeters, or one double-element wattmeter or one single-element wattmeter and suitable switches.

In the case of a dc motor, either a wattmeter or an amperemeter and a voltmeter may be used.

The type and grade of accuracy of the indicating instruments for measuring electrical power shall be in accordance with IS : 1248-1968†.

Where the power input to an electric motor coupled to an intermediate gear, or the speed of rotation and torque measured by a dynamometer between gear and motor, are used as a means for determining the guaranteed pump power input, it shall be stated in the contract in what way the losses of the gear shall be determined.

*Methods of determination of efficiency of rotating electrical machines.

†Specification for direct acting electrical indicating instruments (first revision).

6.4.3 Pumps with Inaccessible Ends — In the case of combined motor-pump units (for example submersible pump or monobloc pump; or separate pump and motor with overall efficiency guaranteed), the power of the machine unit shall be measured at the motor terminals if accessible. When a submersible pump is involved, the measurement shall be effected at the incoming end of the cables; cable losses shall be taken into account and specified in the contract. The efficiency given shall be that of the combined unit proper, excluding the cable and the starter losses.

6.4.4 Deep-Well Pumps — In this case the power absorbed by the thrust bearing and the vertical shafting and bearings shall be taken into account.

Since deep-well pumps in general are not tested with the entire stand pipe attached, unless the acceptance test is performed at site, the thrust and vertical shaft bearing losses in regard to power and efficiency shall be estimated and stated by the manufacturer to his purchaser.

6.5 Measurement of Pumping Unit Efficiency — To determine the efficiency of a pumping unit, only the power input and output are measured, with the driver working under conditions specified in the contract. In this test, the proportion of losses between driving agent and pump is not established, nor any losses associated with intermediate machinery such as gear box or variable speed device.

7. CAVITATION TESTING

7.1 General — When the contract specifies a (NPSH), a test may be conducted to verify that the (NPSH) required by the pump is equal to or less than the specified (NPSH).

In no case shall the cavitation tests be used to check that the pump will be free from cavitation erosion during its service life.

7.1.1 Test Types — There are two distinct possible types of cavitation test:

- a) A check may be made simply to show that the pump is sufficiently free of cavitation at the specified duty and (NPSH). This type of test is described in 7.1.1.1; and
- b) In the other type, cavitation performance is explored more fully by reducing (NPSH) until measurable effects are noted. This type of test is described in 7.1.1.2.

7.1.1.1 A test at the specified flow rate and (NPSH). The pump characteristic can

be assumed to be free of the effects of cavitation if another test at a higher (NPSH) gives the same total head at the same rate of flow.

7.1.1.2 A safety margin to be agreed in the contract shall be added to the (NPSH) which causes a drop of $(3+x)\%$ in total head or efficiency at a given rate of flow, or in rate of flow or efficiency at a given total head. From this test the behaviour of the pump at various departures from the specified (NPSH) may be judged.

The value of x will be:

$$x = \frac{K}{2}$$

The resulting (NPSH) shall be equal to or less than the required (NPSH).

When negotiating the safety margin, account shall be taken of the type of pumps, of the number of stages, of the physical properties of the liquid to be pumped and of materials of construction and the operating conditions to be expected.

7.1.2 Methods of Varying the (NPSH) — The following methods may be used:

7.1.2.1 The pump is installed in a closed pipe loop (see Fig. 6) in which the pressure level or, by an alteration of temperatures, the vapour pressure may be varied without changing the pump head or rate of flow until cavitation occurs in the pump.

Cavitation in outlet and inlet regulating valves may make this test more difficult and special valves may be required.


Arrangements for cooling or heating the liquid in the loop may be needed in order to maintain the required temperature, and a gas separation tank may also be required. The tank shall be of sufficient size and so designed as to prevent the entrainment of gas in the pump inlet flow.

De-aeration of water used for a cavitation test is necessary if the pump is to be used in practice with de-aerated water.

Stilling screens may be needed if $\frac{Q}{A} > 0.25$ m/s, where A is the cross-sectional area of the tank.

7.1.2.2 The pump draws liquid through an unobstructed suction pipe from a sump in which the level of the free liquid surface may be adjusted (see Fig. 7).

7.1.2.3 The pressure of the liquid entering the pump is adjusted by means of a throttle valve installed in the inlet pipe at the lowest practical level (see Fig. 8).

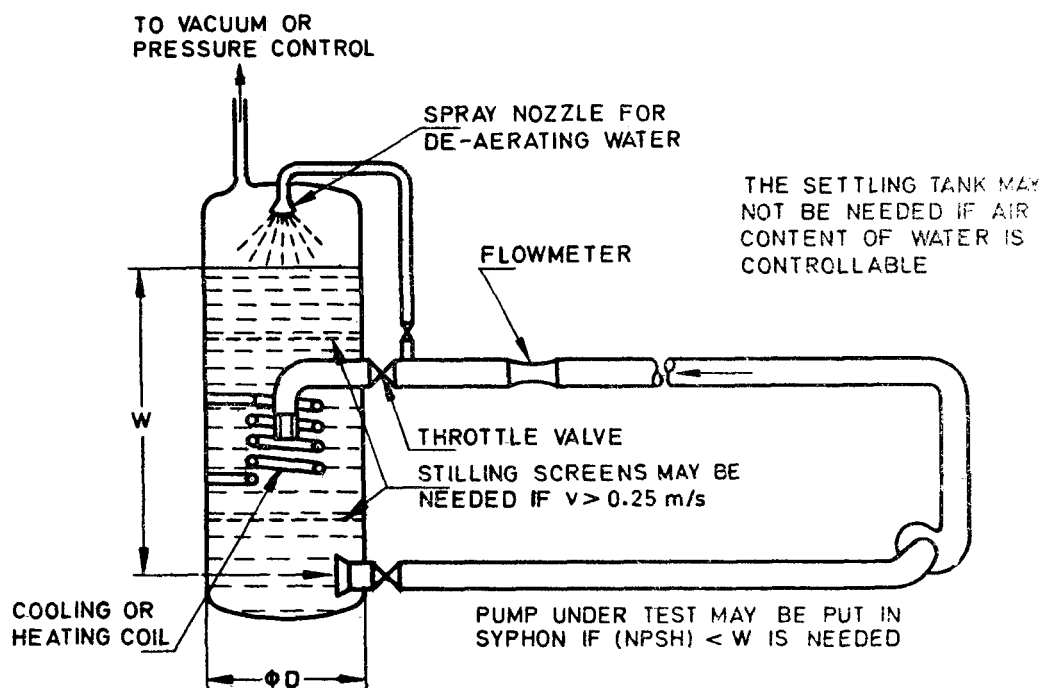


Pump under test may be put in syphon if $(NPSH) < W$ is needed.

NOTE — Cooling by means of a coil may be replaced by an injection of cool water above the liquid free surface and an extraction of heated water.


The drawing shows the principle but no full technical details.

FIG. 6 CAVITATION TESTS — VARIATION OF $(NPSH)$ BY MEANS OF A CLOSED LOOP
(see FIG. 1.2 AND 3)

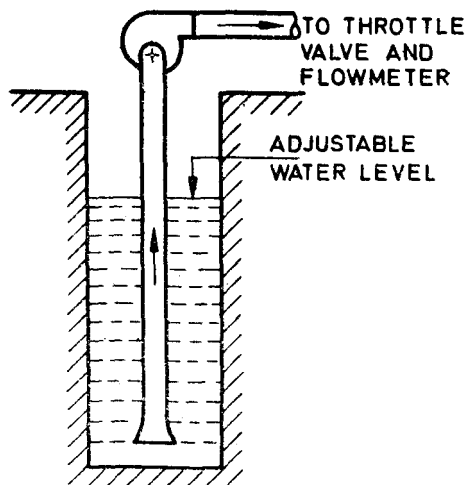

The drawing shows the principle but no full technical details.

FIG. 7 CAVITATION TESTS—VARIATION OF $(NPSH)$ BY CONTROL OF LIQUID LEVEL AT INLET (see FIG. 1 AND 2)

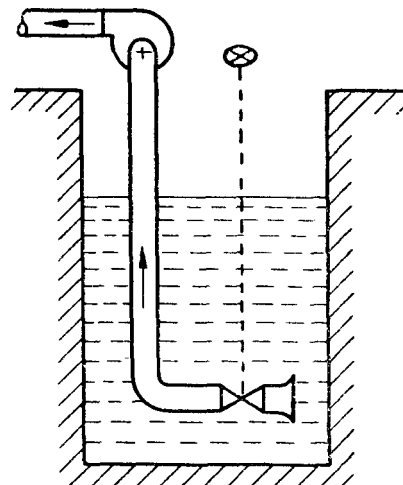

The drawing shows the principle but no full technical details.

FIG. 8 CAVITATION TESTS—VARIATION OF $(NPSH)$ BY MEANS OF A THROTTLE VALVE AT INLET (see FIG. 1 AND 2)

Cavitation in the flow through a throttle valve can sometimes be prevented by using two or more throttle devices connected in series or by arranging for the throttle valve to discharge directly into a closed vessel or a large diameter pipe interposed between the throttle and the pump inlet. Baffles and a means for extracting air from such a vessel may be needed, especially when the (NPSH) is low.

When the throttle valve is to be partially closed and it is situated at a distance less than 12 inlet diameters from the pump inlet flange, it is necessary to make sure that the pipe is full of liquid at the position of the inlet pressure tappings.

7.2 Determination of (NPSH) Required by the Pump — Tests described in 7.1.1.2 can be conducted by any of the methods indicated in Fig. 6 to 8. However, test as per Fig. 8 is more practicable and is recommended for normal commercial testing of industrial pumps. By this method the measured value of NPSH required by the pump is generally higher than what would be expected under simulated conditions (*see also* Fig. 9).

7.3 Limits of Error in Determination of Specified (NPSH) — The maximum limits of error concerning specified (NPSH) measurements shall be:

- a) 5.3% of the measured (NPSH), or
- b) 0.2 m,

whichever is the greater, provided that the measurements are made with a liquid column manometer.

The case of tests with liquids at high temperature or near their critical points should be studied with special care in the contract.

7.4 Measurement of Pump Head, Outlet Flow Rate, Speed of Rotation, Power Input (if necessary) and Vapour Pressure — The requirements of 6 regarding the measurement of head, outlet rate of flow, speed of rotation and power input shall also apply during cavitation tests. If the test conditions are so unsteady as to require repeated readings, variations of specified (NPSH) are permitted up to a maximum of:

- a) 1.5 times the values given for head in Table 5, or
- b) 0.2 m,

whichever is the greater.

Particular care is needed to ensure that in the flow measurement cavitation does not affect the accuracy of the flowmeter. It is also necessary to take care to avoid the ingress of air through joints and glands.

The vapour pressure of the test liquid entering the pump shall be determined with sufficient accuracy to comply with 7.3. When the vapour pressure is derived from standard data and the measurement of the temperature of the liquid entering the pump, the necessary accuracy of temperature measurement may have to be demonstrated.

The active element of a temperature-measuring probe shall be not less than 1/8 of the inlet pipe diameter from the well of the inlet pipe. If the immersion of the temperature-measuring element in the inlet flow is less than that required by the instrument manufacturer, then a calibration at that immersion depth, may be required.

Care shall be taken to ensure the temperature measuring probes inserted into the pump inlet pipe do not influence the measurements of inlet pressure.

8. TESTS ON PUMPS FOR LIQUIDS OTHER THAN CLEAN COLD WATER

The performance of a pump may vary substantially with the nature of the liquid being pumped. Although it is not possible to give general rules whereby performance with clean cold water can be used to predict performance with another liquid, it is often desirable for the parties to agree on empirical rules to suit the particular circumstances and test the pump with clean cold water.

8.1 Characteristics of 'Clean Cold Water' — The characteristics of the water corresponding to what is called in this standard 'clean cold water' shall be within the limits indicated in Table 8.

The total dissolved and free gas content of the water shall not exceed the saturation volume corresponding,

- a) for an open circuit, to the pressure and temperature in the pump sump; and
- b) for a closed loop, to those existing in the tank.

TABLE 8 SPECIFICATION OF 'CLEAN COLD WATER'

CHARACTERISTIC	UNIT	Max
Temperature	°C	40
Viscosity	m ² /s	1.75 × 10 ⁶
Mass density	kg/m ³	1 100
Non-absorbent free solid content	kg/m ³	2.5
Dissolved solid content	kg/m ³	50

Type of Installation	Open Sump	Open Sump	Open Sump	Open Sump	Closed Loop	Closed Loop	Closed Sump or Loop
Independent Variable	Inlet throttle valve	Outlet throttle valve	Water level	Inlet throttle valve	Pressure in the tank	Reference pressure	Temperature (vapour pressure)
Constant	Outlet throttle valve	Inlet throttle valve	Inlet and outlet throttle valves	Flow rate	Flow rate	Inlet and outlet throttle valves	
Quantities the Variation of which is Dependent on Control	Head, flow rate, (NISH), water level	Hend, flow rate, (NPSH), water level	Head, flow rate, (NPSH)	Outlet throttle valve (for constant flow rate), head (NPSH)	Head, (NPSH) outlet throttle valve (for constant flow rate, when head begins to drop)	Head, flow rate } after onset of cavitation (NPSH)	
Head Characteristic Curve							
(NPSH) Characteristic Curve							

FIG. 9 METHODS OF DETERMINING REQUIRED (NPSH) FOR $\Delta H/H = (N3 + x) \%$

8-2 Characteristics of Liquids for which Clean, Cold Water Tests are Acceptable — Pumps for liquids other than clean cold water may be tested for head, flow rate and efficiency with clean cold water if the liquid is within the specification in Table 9.

TABLE 9 CHARACTERISTICS OF LIQUIDS ACCEPTED AS 'CLEAN COLD WATER'

CHARACTERISTICS OF LIQUIDS	UNIT	Min	Max
Viscosity	m ² /s	No limit	10 × 10 ⁻⁶
Mass density	kg/m ³	450	2 000
Non-absorbent free solids content	kg/m ³	—	5.0

The total dissolved and free gas content of the liquid shall not exceed the saturation volume corresponding:

- for an open circuit, to the pressure and temperature in the pump sump, and
- for a closed loop, to those existing in the tank.

Tests on pumps for liquids other than those specified above shall be subject to special agreement.

In the absence of a special agreement, cavitation tests shall be carried out with clean cold water. Attention is drawn to the fact that the results may be affected by this procedure when the liquid to be pumped is not clean cold water.

9. ANALYSIS OF TESTS

9.1 Test Data Required for the Analysis — The quantities required to verify the characteristics guaranteed by the manufacturer are given in 4.1.

Methods for measuring these quantities are given in 6.

9.2 Translation of the Test Result to the Guarantee Basis — Such translation serves to determine whether the guarantee would have been fulfilled if the tests had been conducted under the same conditions as those on which the guarantee is based.

9.2.1 Translating of the Test Results into Data Based on the Specified Speed of Rotation or Frequency — All test data obtained at the speed of rotation n , in deviation from the specified speed of rotations n_{sp} , shall be translated to the basis of the specified speed of rotation n_{gy} .

If the deviations in speed of rotation from the specified speed of rotation n_{sp} do not exceed the permissible variations stated in 5.8, the measured data on the discharged flow rate Q , the total head H , the power input P , the net positive suction head NPSH and the efficiency η , can be translated as follows :

$$Q_{sp} = Q \left(\frac{n_{sp}}{n} \right)$$

$$H_{sp} = H \left(\frac{n_{sp}}{n} \right)^2$$

$$P_{sp} = P \left(\frac{n_{sp}}{n} \right)^3$$

$$(NPSH)_{sp} = (NPSH) \left(\frac{n_{sp}}{n} \right)^2$$

$$\eta_{sp} = \eta$$

If the deviations in speed of rotation from the specified speed of rotation n_{sp} exceed the permissible variations stated in 5.8, it will be necessary to stipulate the formula for translating the test results to the basis of the specified speed of rotation.

In the case of combined motor-pump units or where the guarantees are with respect to an agreed frequency and voltage instead of an agreed speed (see 4.1.3.4) the flow rate, pump total head, power input, and efficiency data are subject to the abovementioned translation laws, provided that n_{sp} is replaced by the frequency f_{sg} and n by the frequency f . Such translation, however, shall be restricted to the cases where the frequency during the acceptance test varies by no more than 1% from the frequency prescribed for the characteristics under guarantee. If the voltage used in the acceptance test is no more than 5% above or below the voltage on which the guaranteed characteristics are based, the other operational data require no change.

If the abovementioned tolerances, i. e., 1% for frequency and 5% for voltage, are exceeded, it will be necessary for the purchaser and the manufacturer to arrive at an agreement.

9.2.2 Tests made with (NPSH) different from that Guaranteed — Pump performance at a high (NPSH) cannot be accepted (after correction for speed of rotation within the permitted limits of 5.8.3) to indicate the performance at a lower NPSH.

Pump performance at a low NPSH can be accepted after correction for speed of rotation within the permitted limits of 5.8.3, to indicate the performance at a higher NPSH provided that the absence of cavitation has been checked in accordance with 7.1.1.1.

9.3 Measuring Inaccuracies — All measurements are inevitably subject to inaccuracies,

even if the measuring procedure and the instruments used, as well as the analysis directives, fully comply with prevailing acceptance rules. When comparing the test results with the guaranteed characteristics, these inaccuracies shall be given adequate consideration. The fact should be stressed that the term 'measuring inaccuracies' merely covers the errors that are unavoidable with all measurements, they refer in no way to the pump and the guaranteed characteristics. The maximum permissible limits of overall error for the quantities concerned for Class C measurements are defined in Table 7.

9.4 Verification of the Guarantee

9.4.1 Curves QH and $Q\eta$ — Guarantee points $Q_G H_G$ and $Q_G \eta_G$ are plotted on a graph and a continuous curve is then drawn through the measured points QH and another through the points Q/η of which Q , is measured and η is calculated.

If the test is made at a value of speed that is different from that specified as relevant to the particular guaranteed values, the test points shall be corrected to the specified speed of rotation in accordance with 9.2. Similarly, if the test is made at a value of frequency different from that relevant to the particular guaranteed values, the test shall be corrected to the specified frequency.

Tolerances $\pm X_Q$ and $\pm X_H$ respectively shall be applied to the guaranteed duty point QH . These tolerances include the maximum permissible limits of overall error e_Q and e_H (see Table 7) and the constructional tolerance.

In the absence of a specific agreement as to the values to be used, the following values may be taken:

$$X_Q = 0.07$$

$$X_H = 0.04$$

If the guarantee point lies at a vertical distance $\pm \Delta H$ and a horizontal distance $\pm \Delta Q$ from the test curve (see Fig. 10), the following shall be evaluated:

$$\left(\frac{H_G \cdot X_H}{\Delta H} \right)^2 + \left(\frac{Q_G \cdot X_Q}{\Delta Q} \right)^2 \geq 1$$

Thus, if the total amount is greater than or equal to 1, the guarantee condition will be deemed to have been met, and if the total amount is less than 1, the guarantee condition has not been achieved.

9.4.2 Efficiency — The efficiency shall be derived from the measured QH curve where it is intersected by the straight line passing through the specified duty point $Q_G H_G$ and the zero of the QH axes.

The efficiency at the point of intersection shall be at least 95% of that specified.

For combined motor-pump units this value is 95.5%.

These values result only from the measuring errors (see Table 7).

9.4.3 Pump Power Input — The pump power input within the range defined in 9.4.1 by the tolerances $\pm X_Q$ and $\pm X_H$, shall not exceed that agreed between the manufacturer and purchaser at the time of contract. This value applies to the conditions of use of the pump as specified in the contract.

Such an agreement may have to take into account different transmission losses and different gland and seal torques between works test and site operation.

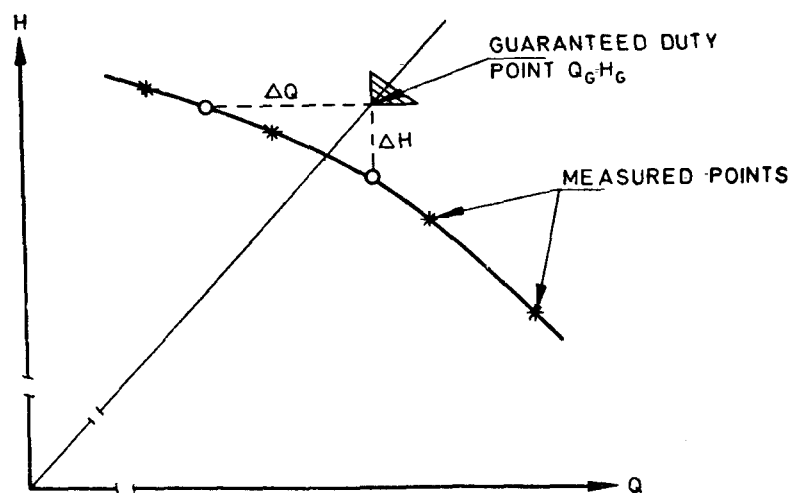


FIG. 10 CURVE QH FOR THE VERIFICATION OF THE GUARANTEE

9.5 Test Report — After scrutiny of the test results, the latter shall be summarized in a report, with as many copies as there are parties. The test report shall be signed either by the chief of tests alone or by him together with the representatives of the manufacturer and the purchaser.

The test report shall contain the following information (*see* Appendix G):

- a) Place and date of the acceptance test;
- b) Manufacturer's name, type of pump, serial number, and possibly year of construction;
- c) Guaranteed characteristics, operational conditions during the acceptance test;
- d) Specification of the pump's drive;
- e) Description of the test procedure and the measuring apparatus used including calibration data;

- f) Observed readings;
- g) Evaluation and analysis of test results;
- h) Conclusions:
 - 1) comparison of the test results with the guarantees,
 - 2) determination whether the guarantees covering certain specific areas were completely or only partly fulfilled or not fulfilled at all,
 - 3) recommendation whether the pump can be accepted or should be rejected and under what conditions,
 - 4) if the guarantees are not fully satisfied the final decision whether the pump can be accepted or not is up to the purchaser,
 - 5) statements arising out of action taken in connection with any special agreements that were made.

APPENDIX A

(*Clause 4.1.2*)

GUARANTEES FOR MASS-PRODUCED PUMPS

A-1. When, for mass-produced pumps, the manufacturer makes reference in his catalogue to this test code, the curves published in his catalogue shall be such that any pump corresponding to the curves gives for any chosen operation point, after Class C tests, results not

divergent from the values of the published curve by more than:

- $\pm 6\%$ for total head
- $\pm 8\%$ for rate of flow
- $\pm 8\%$ for power input

APPENDIX B

(*Clause 5.1.4*)

EFFECT OF PRE-SWIRL INDUCED BY THE PUMP

B-1. Errors in the measurement of pump inlet head can occur at part capacity due to pre-swirl. This can be detected and corrected on the following basis.

B-2. The differential head is measured between the specified inlet measuring section and another position further upstream where the

pre-swirl induced by the pump is known to be absent (for example the sump). This differential head should follow a quadratic law with flow; any departure from this law will show the amount by which an inlet head measurement must be corrected for the effect of pre-swirl induced by the pump (*see* Fig. 11 and 12).

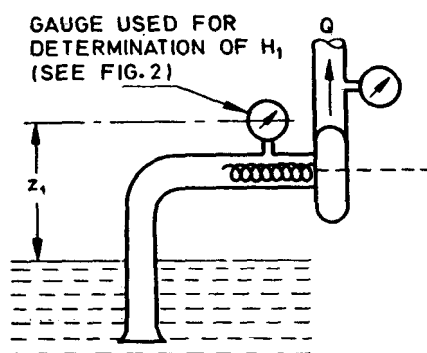


FIG. 11 EXAMPLE OF INSTALLATION WITH PRE-SWIRL

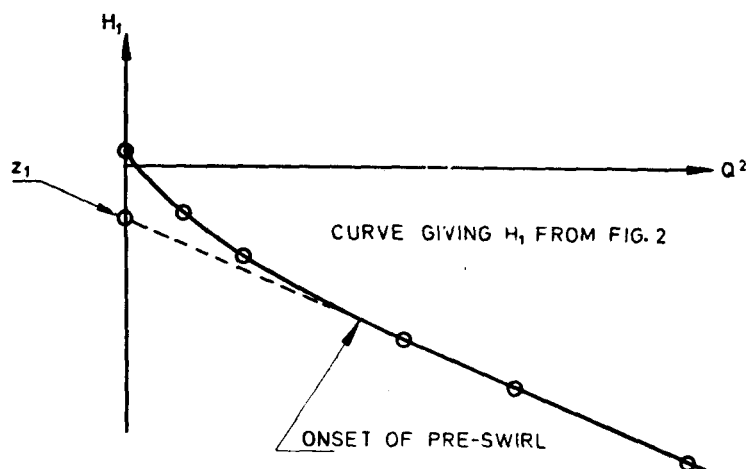


FIG. 12 CORRECTION OF MEASURED INLET HEAD

APPENDIX C

(*Clauses 5.7.6 and 6.2.4.4*)

FRICTION LOSSES

C-1. The formula given in 5.7.6 for calculating head loss due to friction involves a lengthy calculation, which would lead only in many cases to the conclusion that a correction need not be applied.

C-2. Figure 13 may be used as a preliminary check as to whether a calculation need be made. It applies to straight steel or wrought iron pipes of constant circular cross section, handling cold water. Outlet and inlet pipes are assumed of equal diameter, and measuring points 2 diameters upstream and downstream of the inlet and outlet flanges respectively (5.7.1).

C-3. If the pipes are of different diameters, the

diameter of the smaller pipe should be used. Then if "no correction" is indicated, the calculation need not be made.

C-3.1 If "correction" is indicated. Fig. 14, which applies only to steel or wrought-iron pipes handling cold water, may be used to determine the value of A.

C-4. In cases where pipes are of other material, or the liquid is not cold water, the graph by Moody, given in Fig. 15, may be used, or the formula for A given in 5.7.6 may, if preferred, be solved. For the pipe roughness k one may take the values given in Table 10 according to the "Mechanical Engineers Handbook, Edition 1958".



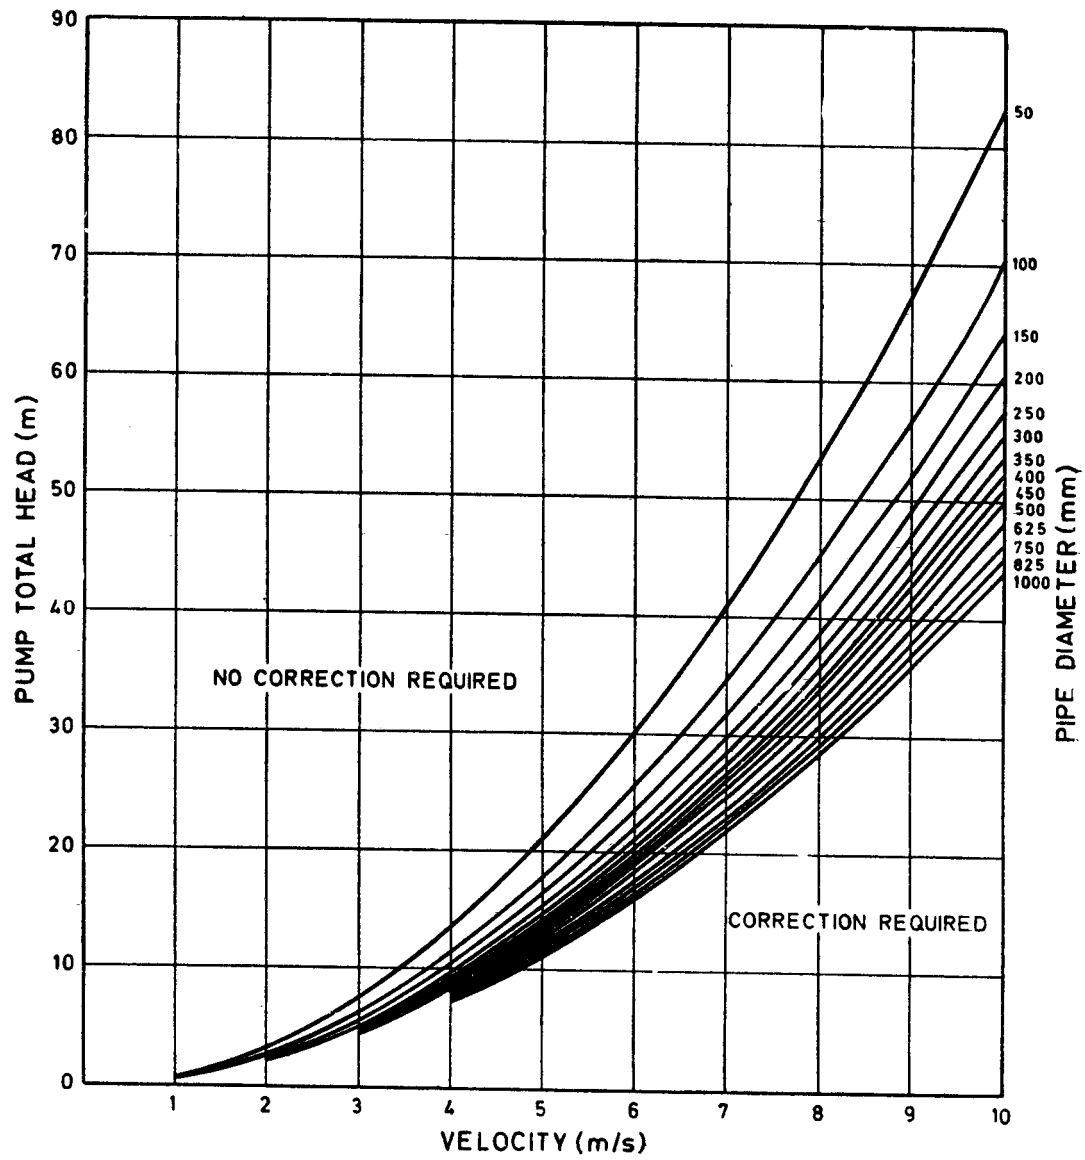


FIG 13 CHART SHOWING VELOCITIES ABOVE WHICH LOSS CORRECTIONS ARE REQUIRED

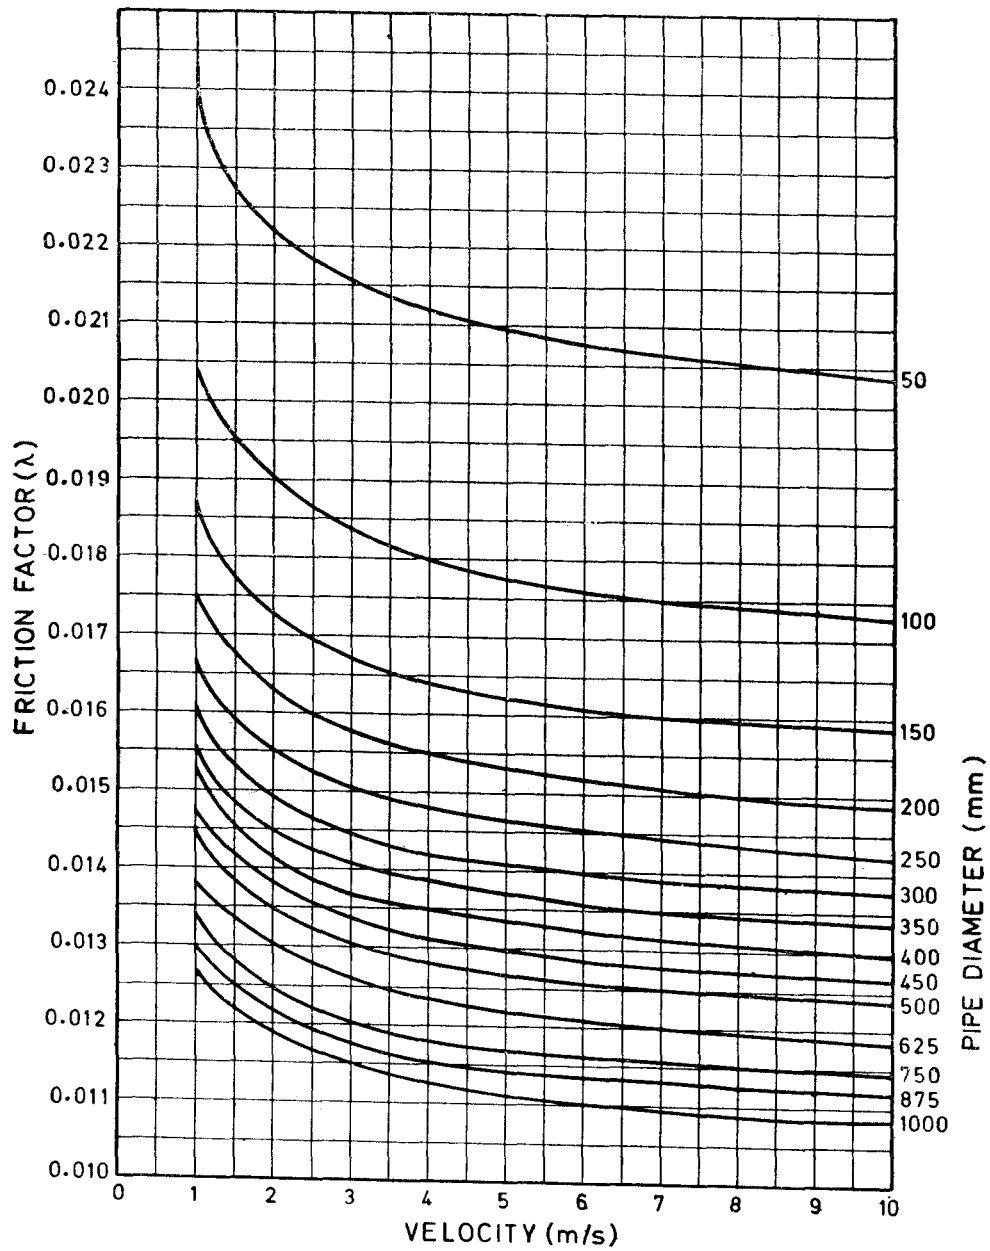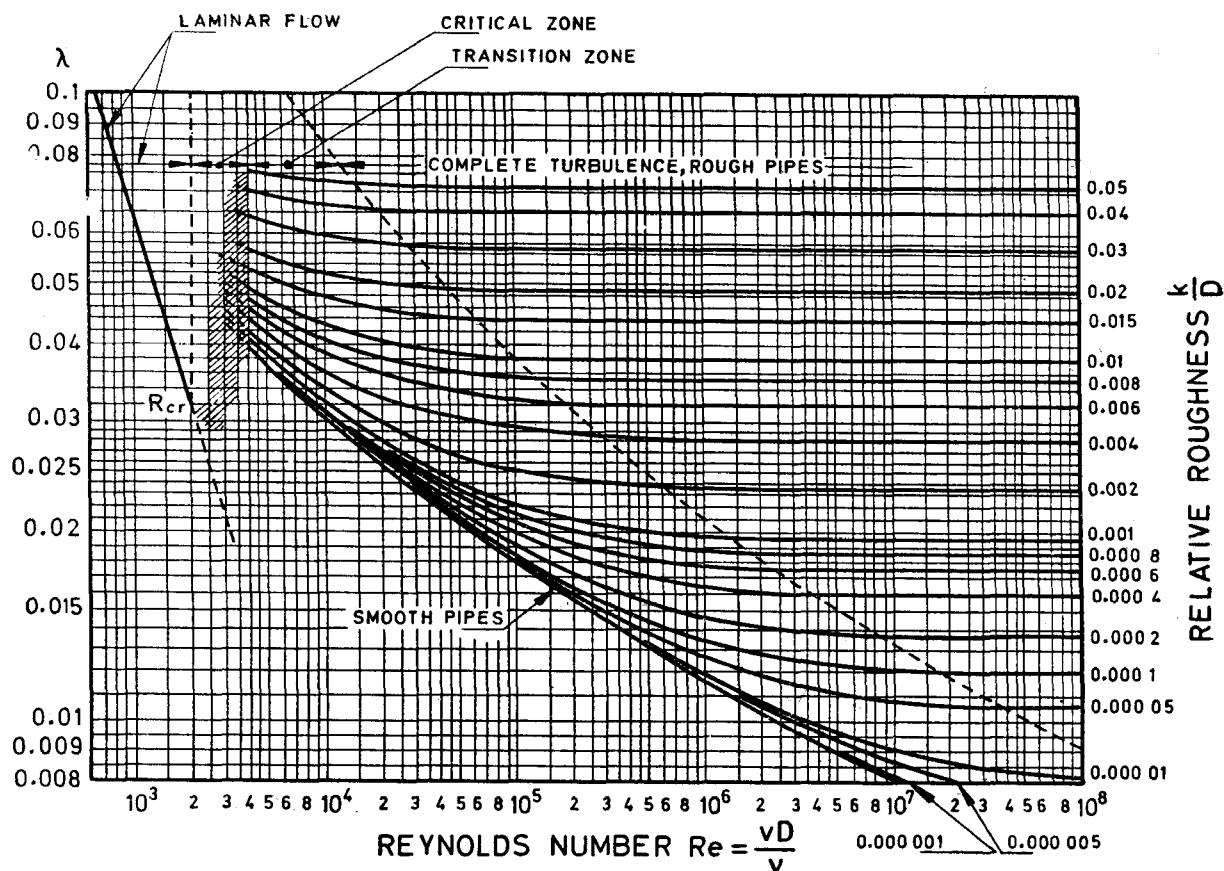

Surface roughness (K) = 5.186×10^{-5} m
 Kinematic viscosity (ν) = $1.022 \times 10^{-6} \text{ m}^2/\text{s}$

FIG. 14 FRICTION FACTOR CHART

FIG. 15 VALUES OF FRICTION FACTOR λ MOODY CHARTTABLE 10 ABSOLUTE ROUGHNESS k FOR PIPES

COMMERCIAL PIPE (NEW) MATERIAL	ABSOLUTE ROUGHNESS k OF THE SURFACE, mm
Glass, drawn brass, copper or lead	Smooth
Wrought iron, steel	0.05
Asphalted cast iron	0.12
Galvanized iron	0.15
Cast iron	0.25
Concrete	0.3 to 3.0
Riveted steel	1.0 to 10.0

APPENDIX D

(Clauses 4.2.1 and 5.10)

COSTS AND REPETITION OF TESTS

D-0. Matters of a purely commercial nature such as the cost of the tests are not included in the scope of this standard and should be made the subject of special agreements between the parties concerned.

D-1. COSTS OF ACCEPTANCE TESTS AND SPECIAL TESTS

D-1.1 It is recommended that the costs of acceptance tests and special tests be clearly stated in the contract.

D-2. REPETITION OF TESTS

D-2.1 In case of doubt as to the correctness or adequate accuracy of the measurement data obtained, both the manufacturer and purchaser are entitled to demand that the test be repeated. Should the new measurement fail to justify the doubts expressed, the party demanding the renewed test must assume the cost of repetition.

APPENDIX E*(Clause 5.11)***CONVERSION TO SI UNITS**

E-1. This Appendix gives factors for conversion to SI units of some of the quantities expressed in multiples or sub-multiples of SI units and in units other than SI units. The conversion factor is the number by which the value expressed in various units should be multiplied to find the corresponding value in SI units.

CONVERSION FACTORS

QUANTITY	SYMBOL OF SI UNIT	VARIOUS UNITS		CONVERSION FACTORS
		Name	Symbol	
Volume rate of flow	m ³ /s	litre per second	l/s	10 ⁻³
		cubic metre per hour	m ³ /h	1/3 600
		litre per hour	l/h	1.3 600 000
		litre per minute	l/min	1/60 000
		imperial gallon per minute	gal(UK)/min	0.000 075 77
		cubic foot per second	ft ³ /s	0.028 316 8
		gallon (US) per minute	gal (US)/min	0.000 063 09
		barrel (US) per hour (petroleum)	barrel (US)/h	0.000 044 16
Mass rate of flow	kg/s	ton per second	t/s	10 ³
		ton per hour	t/h	1/3.6
		kilogram per hour	kg/h	1/3 600
		pound per second	lb/s	0.453 592 37
Pressure	N/m ² (also known as pascal : Pa)	kilopond per square centimetre	kp/cm ²	} 98 066.5
		kilogram-force per square centimetre	kgf/cm ²	
		bar	bar	} 10 ⁵
		hectopieze	hpz	
		torr	torr	} 133.322
		conventional millimetre of mercury	mmHg	
		conventional millimetre of water	mmH ₂ O	9.806 65
		poundal per square foot	pdl/ft ²	1.488 16
		standard atmosphere	atm	101 325
		pound-force per square inch	lbf/in ² (psi)	6 894.76
Density	kg/m ³	kilogram per cubic decimetre	kg/dm ³	} 10 ³
		gram per cubic centimetre	g/cm ³	
		pound per cubic foot	lb/ft ³	
Power	W	kilowatt	kW	10 ³
		kilopond metre per second	kp.m/s	9.806 65
		I. T. kilocalorie per hour	kcalIT/h	1.163
		cheval vapour*	ch	735.5
		horse power*	hp	745.7
		British thermal unit per hour	Btu/h	0.293 071
		kilogram-force metre per second	kgf.m/s	9.806 65
Viscosity (dynamic viscosity)	N.s/m ² = kg/m.s	decapoise	daP	} 1
		poise	P	
		dyne second per square centimetre	dyn.s/cm ²	} 10 ⁻¹
		gram per second centimetre	g/s.cm	
		kilopond second per square metre	kp.s/m ²	9.806 65
		centipoise	cP	10 ⁻³
Kinematic viscosity	m ² /s	poundal second per square foot	pdl.s/ft ²	1.488 16
		stokes	St = cm ² /s	10 ⁻⁴
		centistokes	cSt	10 ⁻⁶
		square foot per second	ft ² /s	0.092 903 0

*No international symbol exists for this unit; the symbol shown is the most common.

APPENDIX F

(Clause 5.11)

CHECK LIST

F-1. The following is a check list of items where agreement is recommended between manufacturer and purchaser before the test. It should be noted that it will not always be necessary to agree upon all these items during the elaboration of the contract:

- 1) extent of guarantee:
 - a) pump without motor (*see 4.1.1*);
 - b) combined pump-motor unit (*see 4.1.1*);
 - c) guaranteed values [for example flow rate, total head, power input, efficiency, (NPSH), etc] (*see 4.1.1, 4.1.2, 4.1.3.3, 4.2.1 and 9.4.3*).
- 2) method of verification of guaranteed NPSH (*see 4.2.1 and 7.1.1*);
- 3) rotational speed deviations outside permissible tolerance (*see 5.8.3 and 9.2.1*);
- 4) voltage and frequency deviations outside permissible tolerance (*see 9.2.1*);
- 5) method of prediction of pump performance from a test using clean cold water (*see 8*);
- 6) liquid to be used for acceptance test (*see 4.2.3*);
- 7) inlet and transmission losses in vertical well pumps (*see 6.2.4.4 and 6.4.3*);
- 8) cable losses (*see 6.4.3*);
- 9) gear losses (*see 6.4.2*);
- 10) arrangement for proving priming ability of self-priming pumps (*see 5.7.5*);
- 11) time of tests (*see 5.2*);
- 12) location of tests (*see 5.1*);
- 13) test equipment (*see 5.6*);
- 14) test arrangement (*see 5.7.1 and 5.7.2*);
- 15) chief of tests when test is not carried out at manufacturer's works (*see 5.4*);
- 16) test costs (*see 4.2.1, Appendix D*);
- 17) number of pumps to be tested in a batch of identical pumps (*see 4.2.1*); and
- 18) any other aspect of pump behaviour to be checked during the test.

APPENDIX G

(Clause 9.5)

PUMP TEST SHEET

G-1. The pump test sheet illustrated in this Appendix is given for guidance for presenting pump test results and to assist in their interpretation. It does not purport to include all the information required from a pump test and modifications may be necessary depending on the type of pump, its application, and the mode of calculation.

PUMP TEST SHEET (Class C)				Sheet No.		Nature of Test									
Customer:															
Pump	Type		Maker's Order Number			Order NO.		Diameter of inlet: Diameter of outlet:							
Guaranteed values	Volume rate of flow (Q_G)		Speed of rotation (n_{sp})			Power input (P_G)									
	Total head (H_G)		Efficiency (τ, G)			Net positive suction head (NPSH)									
Pumped liquid	Temperature (t)					kinematic viscosity (ν)									
	Density (ρ)					degree of acidity (pH)									
Motor	Maker		Test certificate			Number of phases Voltage									
	Type		Power			Speed of rotation Current									
Measuring method		Rate of flow	Inlet head	Outlet head	(NPSH)	Torque	Power	Speed of rotation	Gear						
	Method used														
	Constant														
Test conditions	Room temperature		Barometric pressure			Head correction to reference plane		Inlet Outlet							
Results of measurement				Units	1	2	3	4	5	6	7	8	9	10	11
	Speed of rotation														
Flow rate	Time interval														
	Reading														
	Measured flow														
Head	Outlet head reading														
	Inlet head reading														
	Outlet head														
	Inlet head														
	$\Delta v^2/2g$														
	Difference of measuring position														
	Pump total head														
	$Vs^2/2g$														
	(NPSH)														
	Power (torque)	Useful power (P_u)													
Voltage															
Current															
Wattmeter reading 1															
Wattmeter reading 2															
Total of wattmeter readings															
Motor power input															
Motor efficiency															
Torque reading															
Gear efficiency															
Motor power output															
Pump power input															
Overall efficiency															
Pump efficiency															
Values referred to specified speed of rotation	Volume rate of flow														
	Total head														
	Power														
	(NPSH)														
Notes			Date	Chief of tests	Representatives										
					of the customer					of the manufacturer					

Bureau of Indian Standards

BIS is a statutory institution established under the *Bureau of Indian Standards Act, 1986* to promote harmonious development of the activities of standardization, marking and quality certification of goods and attending to connected matters in the country.

Copyright

BIS has the copyright of all its publications. No part of these publications may be reproduced in any form without the prior permission in writing of BIS. This does not preclude the free use, in the course of implementing the standard, of necessary details, such as symbols and sizes, type or grade designations. Enquiries relating to copyright be addressed to the Director (Publication), BIS.

Review of Indian Standards

Amendments are issued to standards as the need arises on the basis of comments. Standards are also reviewed periodically; a standard along with amendments is reaffirmed when such review indicates that no changes are needed; if the review indicates that changes are needed, it is taken up for revision. Users of Indian Standards should ascertain that they are in possession of the latest amendments or edition by referring to the latest issue of 'BIS Handbook' and 'Standards Monthly Additions'

Amendments Issued Since Publication

Amend No.	Date of Issue	Text Affected

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, New Delhi 110002
Telephones: 323 01 31, 323 33 75, 323 94 02

Telegrams: Manaksanstha
(Common to all offices)

Regional Offices:

Central : Manak Bhavan, 9 Bahadur Shah Zafar Marg
NEW DELHI 110002

Telephone
323 76 17, 323 38 41

Eastern : 1/14 C.I.T. Scheme VII M, V.I.P. Road, Maniktola
CALCUTTA 700054

{ 337 84 99, 337 85 61
337 86 26, 337 91 20

Northern : SCO 335-336, Sector 34-A, CHANDIGARH 160022

{ 60 38 43
60 20 25

Southern : C.I.T. Campus, IV Cross Road, CHENNAI 600113

{ 235 02 16, 235 04 42
235 15 19, 235 23 15

Western : Manakalaya, E9 MIDC, Marol, Andheri (East)
MUMBAI 400093

{ 832 92 95, 832 78 58
832 78 91, 832 78 92

Branches : AHMADABAD. BANGALORE. BHOPAL. BHUBANESHWAR.
COIMBATORE. FARIDABAD. GKAZIABAD. GUWAHATI.
HYDERABAD. JAIPUR. KANPUR. LUCKNOW. NAGPUR.
PATNA. PUNE. THIRUVANANTHAPURAM.