



Cross Section A-A

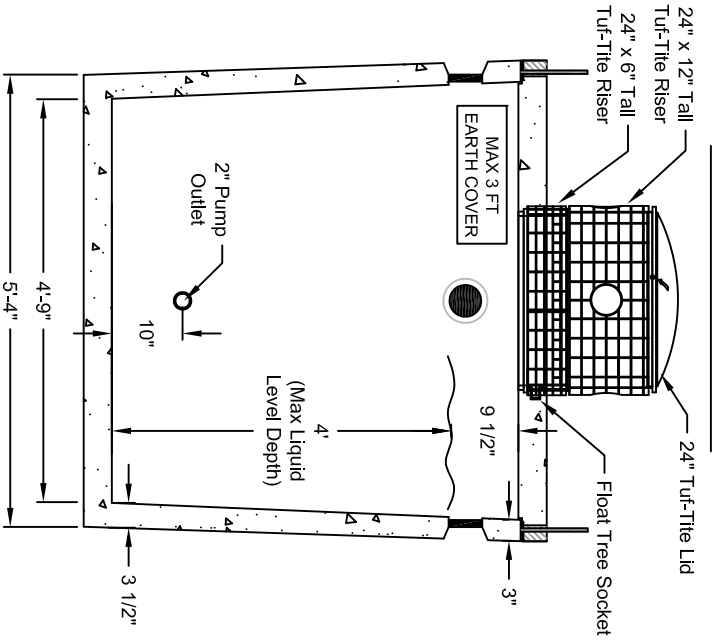

Cross Section B-B

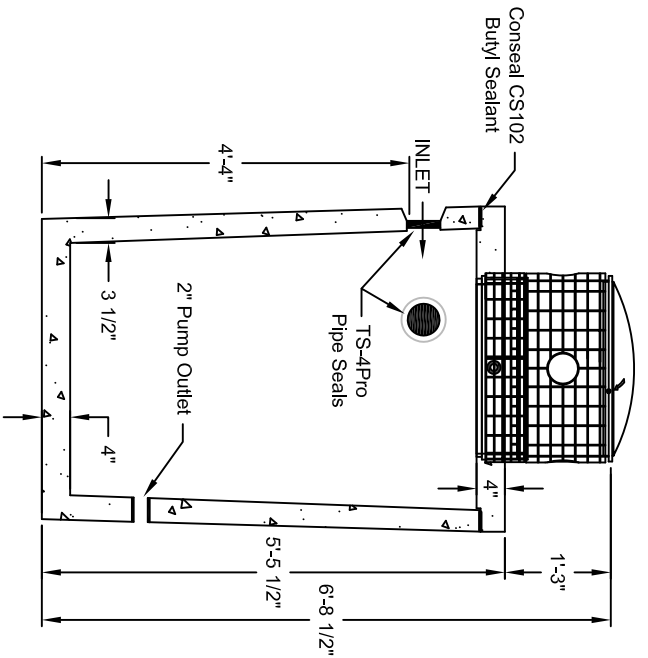


SPECIFICATIONS

TANK: Manufactured per 2013 Montana Circular DEC-4 Chapter 5 design standards for septic tanks, 2 EA 9500 lb. wire rope tank lift anchors, 1 EA 24" dia. x 6" tall Tuf-Tile access riser cast into tank lid, 3 EA Tuf-Tile TS-4Pro pipe seals cast in for inlet and outlet pipe penetrations, 2" Sch40 PVC coupler cast into tank wall for pump outlet connection, 1" PVC float tree socket, ConSeal CS-102 1" butyl rubber sealant to seal tank lid.

STANDARD COMPONENTS: 1 EA 24" dia. x 12" tall Tuf-Tile access riser extension, 1 EA 24" Tuf-Tile lid, SS screws, $\frac{5}{16}$ " butyl sealant to seal between access risers.

NOTE 1): Tank must be installed per Billings Precast's 'Tank Installation Guide' or warranty will be VOID.

NOTE 2): Tank shall not be placed in a traffic area (ie. parking lot, driveway, etc.) - Warranty will be VOID if driven on.

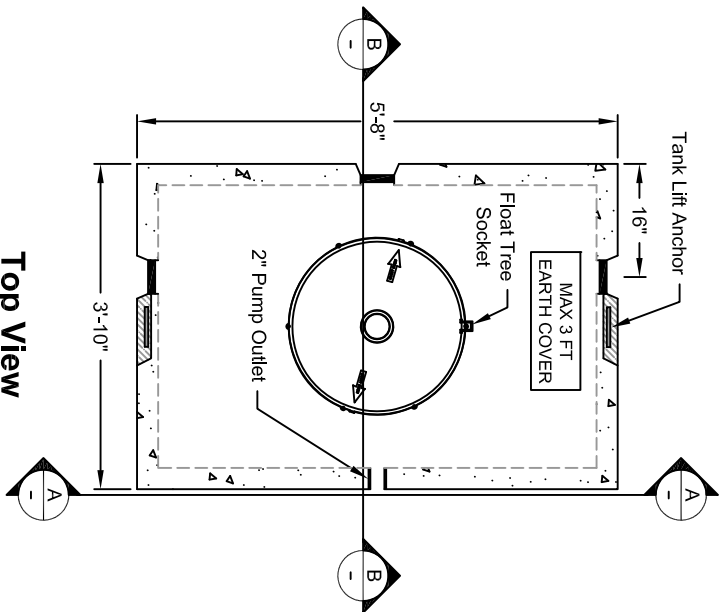

WEIGHTS: Tank - 4050 lb.; Lid - 900 lb. [Total Assembled - 5000 lb.]

Top View



5815 Interstate Ave
Billings, MT 59101
Phone (406) 656-6098
Fax (406) 656-4942
www.billingsprecast.com

Drawing No.

DT05S

**500 Gallon Single Piece Dosing Tank
- One Compartment / Non-Traffic Rated -**

DATE: 2/10/2021

SCALE: NONE

REV: ---

CAD: WDB

Sheet:

1