



Cross Section A--A

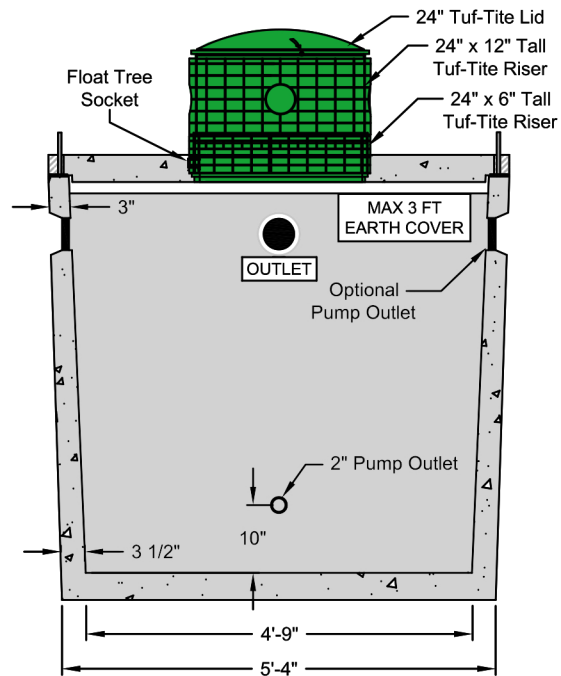

Cross Section B--B

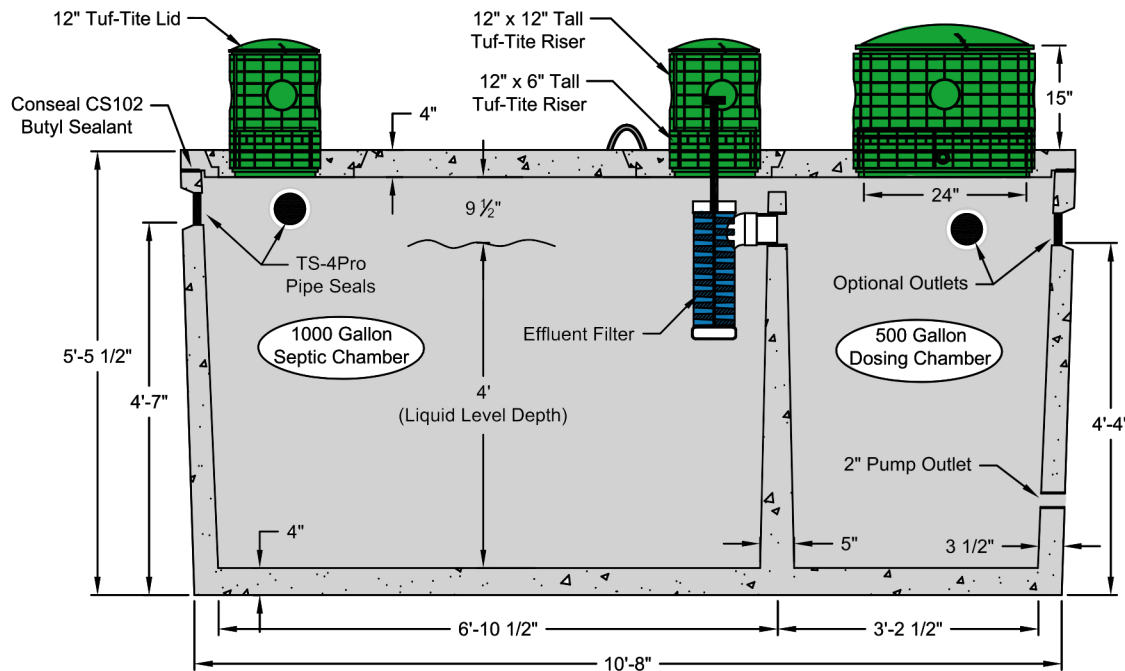


SPECIFICATIONS

TANK: Manufactured per 2013 Montana Circular DEQ-4 Chapter 5 design standards for septic tanks, 2 EA 9500 lb. wire rope tank lift anchors, 1 EA 24" dia. x 6" tall Tuf-Tite access riser cast into tank lid, 2 EA 12" dia. x 6" tall Tuf-Tite access risers cast into 20" dia. cleanout access lids, 6 EA Tuf-Tite TS-4Pro pipe seals cast in for inlet and outlet pipe penetrations, 4" Sch40 PVC slip coupler cast into compartment wall for septic chamber outlet, 1" PVC float tree socket, 2" Sch40 PVC coupler cast into tank wall for pump outlet connection, ConSeal CS-102 1" butyl rubber sealant to seal tank lid.

STANDARD COMPONENTS: 1 EA 24" dia. x 12" tall and 2 EA 12" dia. x 12" tall Tuf-Tite access riser extensions, 1 EA 24" dia. and 2 EA 12" dia. Tuf-Tite lids, SS screws, $\frac{5}{16}$ " butyl sealant to seal between access risers, Tuf-Tite EF-6 Combo (1500 GPD) effluent filter with $\frac{1}{2}$ " dia. PVC handle extension.

NOTE 1): Tank must be installed per Billings Precast's 'Tank Installation Guide' or warranty will be VOID.

NOTE 2): Tank shall not be placed in a traffic area (ie. parking lot, driveway, etc.) - Warranty will be VOID if driven on.

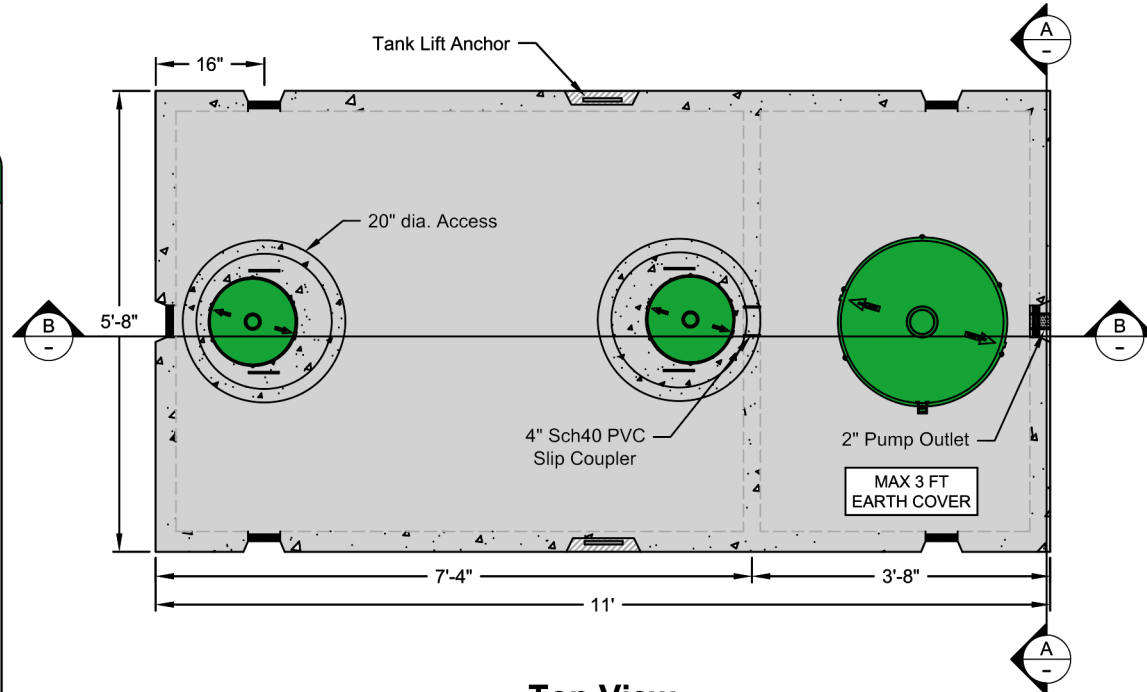

Top View

WEIGHTS: Tank - 10,300 lb.; Lid - 2850 lb. [Total Assembled - 13,150 lb.]



5815 Interstate Ave
Billings, MT 59101
Phone (406) 656-6098
Fax (406) 656-4942
www.billingsprecast.com

SDC15S

**1000 / 500 Gallon Combination Septic / Dosing Tank
- Single Piece Tank / Non-Traffic Rated -**

Drawing No.

DATE: 2/8/2021

SCALE: NONE

REV: ---

CAD: WDB

Sheet: 1