



Cross Section A--A

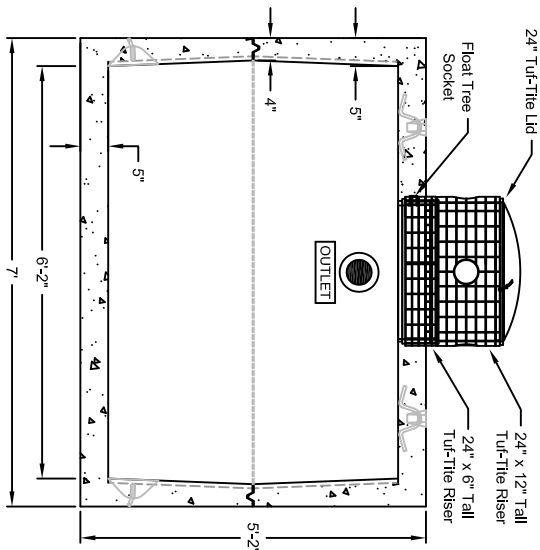

Cross Section B--B

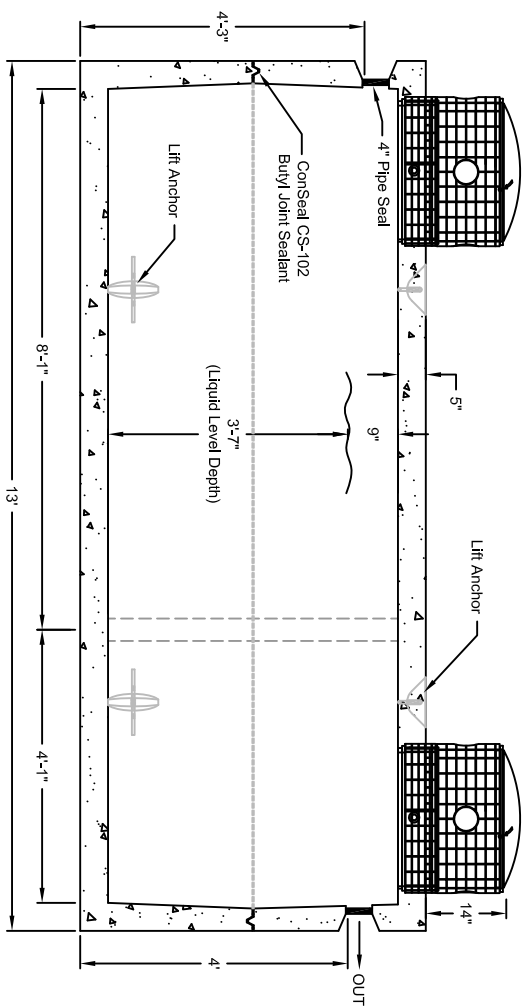

SPECIFICATIONS


TANK: Manufactured per 2013 Montana Circular DEQ-4 Chapter 5 design standards for septic tanks, 2 EA 24" dia. x 6" tall TuF-Tile access risers cast into top of tank, 2 EA TS-4Pro rubber pipe seals for 4" Sch40 PVC inlet and outlet pipe penetrations.

APPURTENANCES: 2 EA 24" dia. x 12" tall TuF-Tile riser extensions, 2 EA 24" dia. TuF-Tile lids, SS screws, $\frac{5}{16}$ " dia. butyl sealant to seal between access risers, ConSeal CS-102 1 $\frac{1}{4}$ " butyl mastic joint sealant to seal center tank joint.

NOTE 1): Tank must be installed per Billings Precast's "Tank Installation Guide" or warranty will be VOID.

NOTE 2): Tank shall not be placed in a traffic area (ie. parking lot, driveway, etc.) - Warranty will be VOID if driven on.

Top View

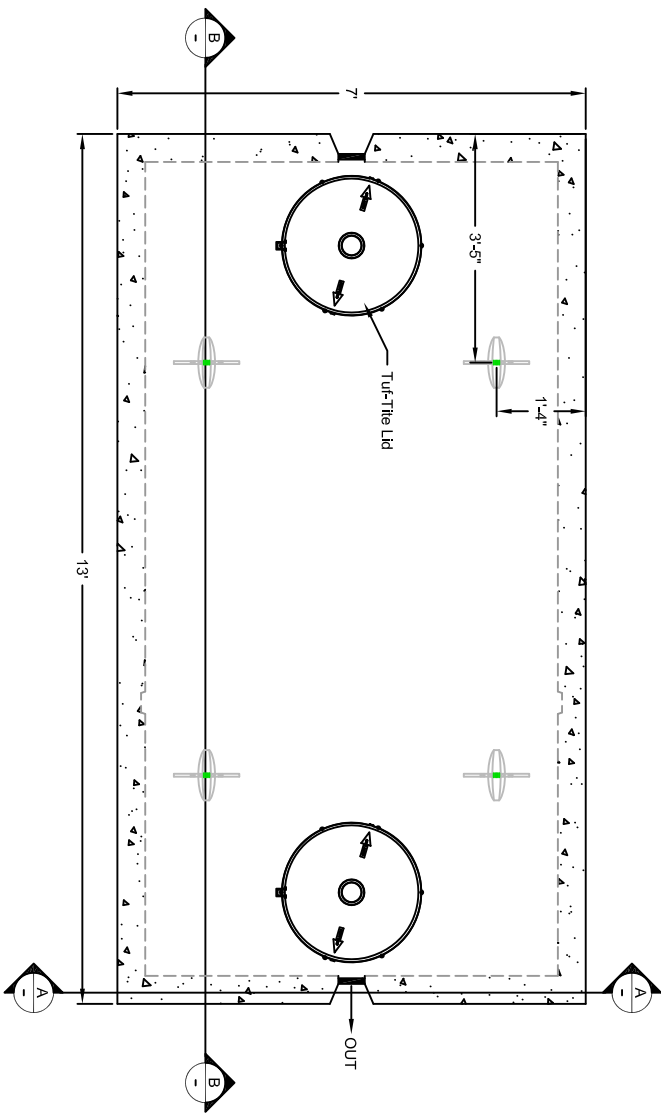

WEIGHTS: Tank Bottom - 10,445 lb.; Tank Top Half - 10,085 lb.



5815 Interstate Ave
Billings, MT 59101
Phone (406) 656-6098
Fax (406) 656-4942
www.billingsprecast.com

ST20

2000 Gallon Two Piece Septic Tank
- One Compartment / Non-Traffic Rated -

Drawing No.

DATE: 2/11/2021

SCALE: NONE

REV: ---

CAD: ---

WDB

Sheet:

1