



Cross Section A--A

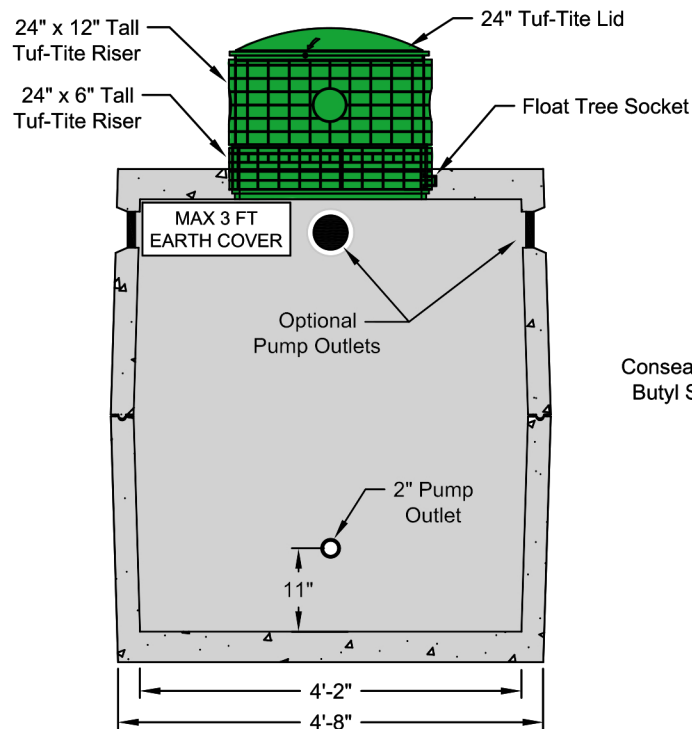

Cross Section B--B

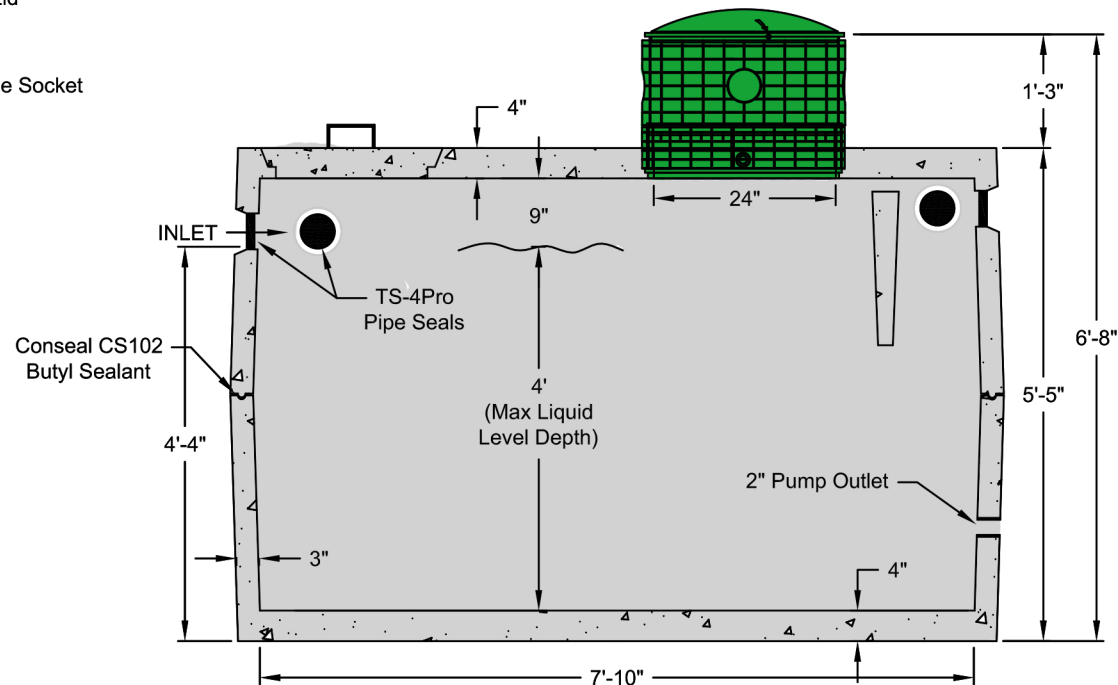

5815 Interstate Ave
Billings, MT 59101
Phone (406) 656-6098
Fax (406) 656-4942
www.billingsprecast.com


SPECIFICATIONS

TANK: Manufactured per 2013 Montana Circular DEQ-4 Chapter 5 design standards for septic tanks, 1 EA 24" dia. x 6" tall Tuf-Tite access riser cast into top of tank, 6 EA Tuf-Tite TS-4Pro pipe seals cast in for inlet and outlet pipe penetrations, 2" Sch40 PVC coupler cast into tank wall for pump outlet connection, 1" PVC float tree socket.

STANDARD COMPONENTS: 1 EA 24" dia. x 12" tall Tuf-Tite access riser extension, 1 EA 24" Tuf-Tite lid, SS screws, $\frac{5}{16}$ " butyl sealant to seal between access risers, ConSeal CS-102 1" butyl rubber sealant to seal tank joint.

NOTE 1): Tank must be installed per Billings Precast's 'Tank Installation Guide' or warranty will be VOID.

NOTE 2): Tank shall not be placed in a traffic area (ie. parking lot, driveway, etc.) - Warranty will be VOID if driven on.

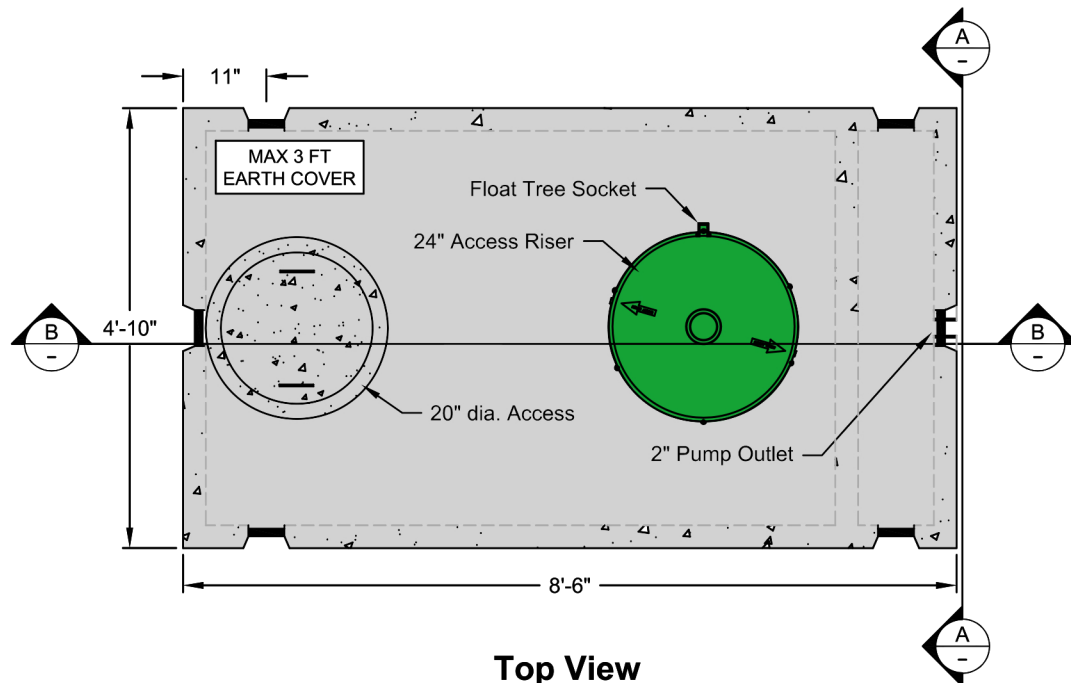

Top View

WEIGHTS: Tank Bottom - 4000 lb.; Tank Top - 3850 lb.; Total All - 7900 lb.

DT10

1000 Gallon Two Piece Dosing Tank
- One Compartment / Non-Traffic Rated -

Drawing No.

DATE: 2/10/2021

SCALE: NONE

REV: ---

CAD: WDB

Sheet: 1