


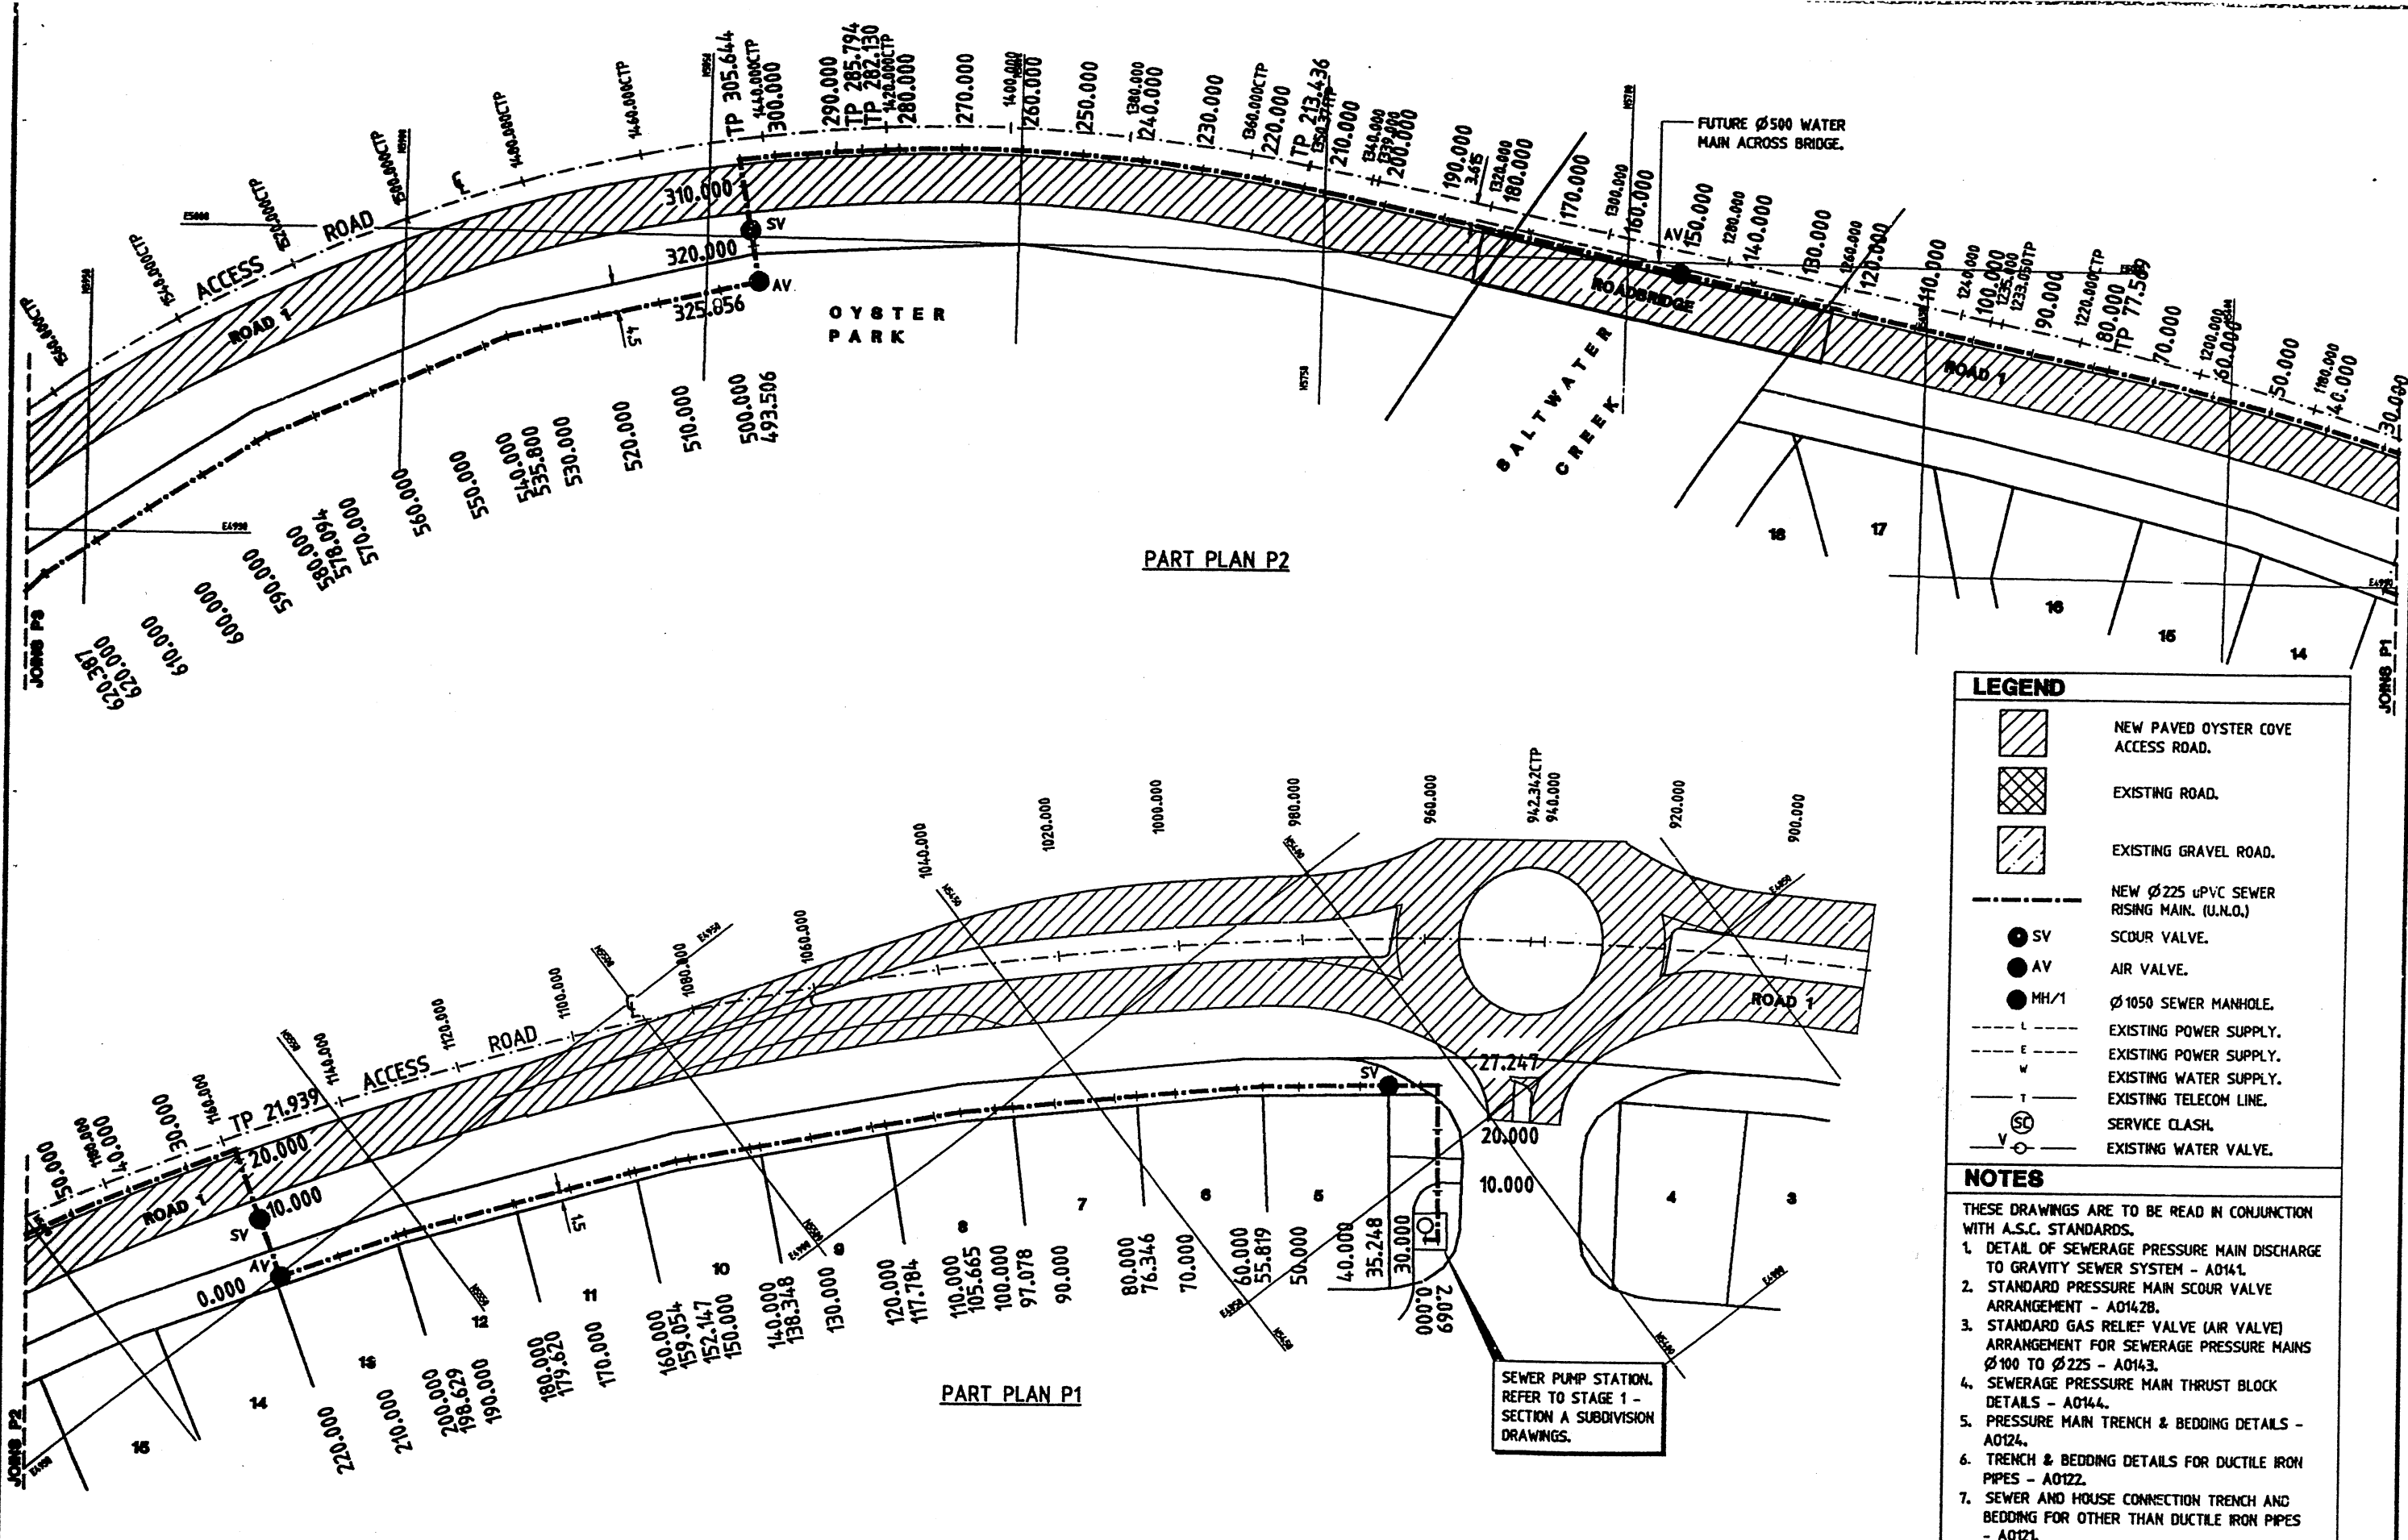

LEGEND

- NEW PAVED OYSTER COVE ACCESS ROAD.
- EXISTING ROAD.
- EXISTING GRAVEL ROAD.
- NEW Ø225 uPVC SEWER RISING MAIN. (U.N.O.)
- SV SCOUR VALVE.
- AV AIR VALVE.
- MH/1 Ø1050 SEWER MANHOLE.
- EXISTING POWER SUPPLY.
- EXISTING POWER SUPPLY.
- EXISTING WATER SUPPLY.
- EXISTING TELECOM LINE.
- SERVICE CLASH.
- EXISTING WATER VALVE.

NOTES

THESE DRAWINGS ARE TO BE READ IN CONJUNCTION WITH A.S.C. STANDARDS.

1. DETAIL OF SEWERAGE PRESSURE MAIN DISCHARGE TO GRAVITY SEWER SYSTEM - A0141.
2. STANDARD PRESSURE MAIN SCOUR VALVE ARRANGEMENT - A0142B.
3. STANDARD GAS RELIEF VALVE (AIR VALVE) ARRANGEMENT FOR SEWERAGE PRESSURE MAINS Ø100 TO Ø225 - A0143.
4. SEWERAGE PRESSURE MAIN THRUST BLOCK DETAILS - A0144.
5. PRESSURE MAIN TRENCH & BEDDING DETAILS - A0124.
6. TRENCH & BEDDING DETAILS FOR DUCTILE IRON PIPES - A0122.
7. SEWER AND HOUSE CONNECTION TRENCH AND BEDDING FOR OTHER THAN DUCTILE IRON PIPES - A0121.

THIS DRAWING HAS BEEN CO-ORDINATED WITH CLIENT DOCUMENTATION FROM: ☐ SURVEY ☐ GEOTECH ☐ CIVIL ☐ MECHANICAL ☐ ELECTRICAL ☐ ARCHITECTURAL ☐ STRUCTURAL AT: ☐ TENDER STAGE ☐ APPROVAL DATE: _____ BY: ☐ CONSTRUCTION STAGE ☐ APPROVAL DATE: _____		SURVEYOR JOHN MARENDY & ASSOCIATES CLIENT VANWELL PTY. LTD.		PROJECT OYSTER COVE EXTERNAL SEWER CIVIL ENGINEERING WORKS		Weathered Howe 121 SCHUMACHER STREET SYDNEY, N.S.W. 2000 PHONE: (02) 955 5555 FAX: (02) 955 5556 GPO BOX 999 SYDNEY, N.S.W. 2000 PHONE: (02) 955 5555 FAX: (02) 955 5556 A.C.A. 900 000 000		TITLE LAYOUT PLAN SHEET 1 OF 4 APPROVED: REVISION: DESIGNED: DVA DRAWN: B.M. DATE: FEB 1995		DRAWING NUMBER G3423E-C-02 REVISION A SCALE	
---	--	--	--	--	--	---	--	--	--	---	--

SCALE 1:500

DATE: 31.3.95 D.V.A.

BY: DVA

APPROVED: DVA

DATE: FEB 1995