


CORPORATION STOP

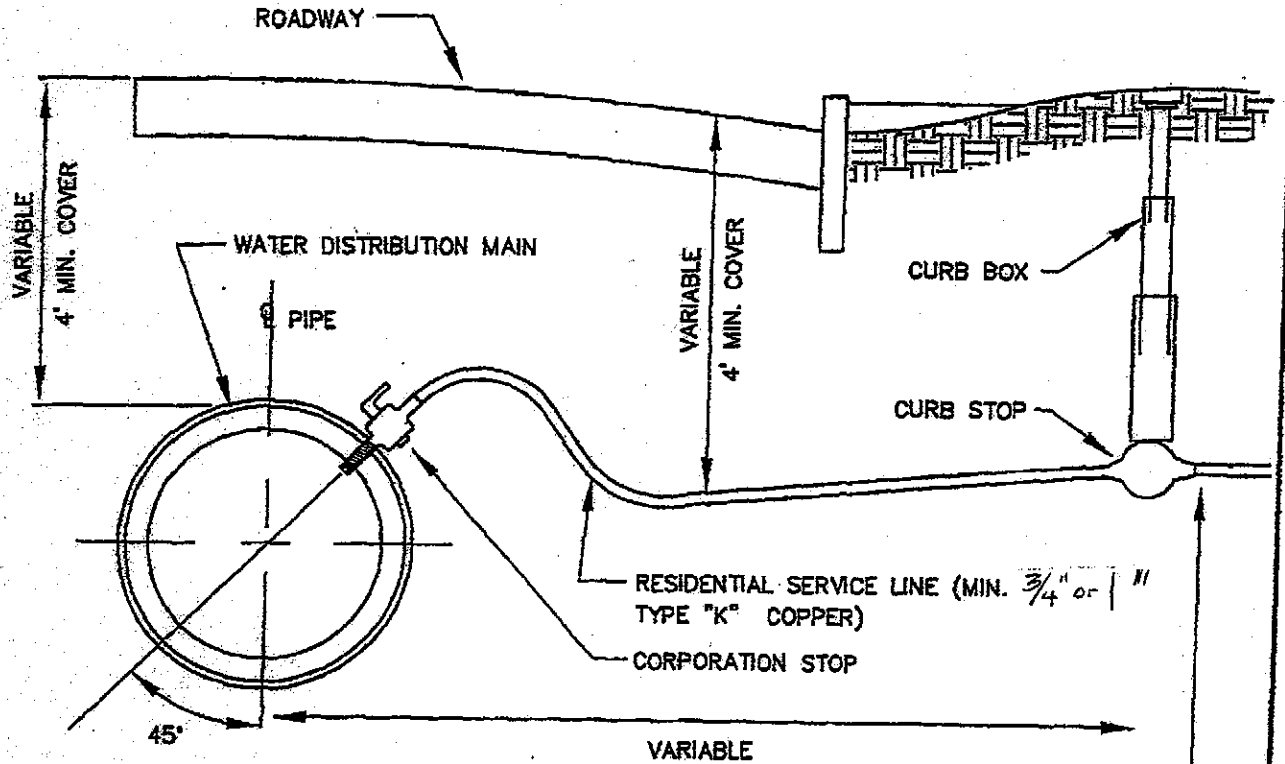

- NOTE:
1. CORPORATION STOP MANUFACTURED BY A.Y. McDONALD SERIES # 4701BQ OR APPROVED EQUAL. CUSTOMER TO CONNECT AT THIS POINT
 2. THE WATER SERVICE LINE FROM THE CORPORATION STOP TO THE CURB STOP MUST BE ONE CONTINUOUS LENGTH OF PIPE WITH NO COUPLINGS OR FITTINGS.
 3. COMMERCIAL SERVICE LINES SHALL BE A MINIMUM OF 1" DIAMETER AND MUST HAVE APPROVAL OF THE ENGINEER.
 4. PROVIDE DOUBLE STRAP SADDLES FOR ^{3/4"}1" CORPORATION STOP CONNECTIONS.

SCHWENKSVILLE BOROUGH AUTHORITY			
DWG. BY: BEM	CKD. BY: LPB	CORPORATION STOP	
DATE: 12-2004	SCALE: NONE		
REVISION	DATE		
# 1	7/13/06	CONSTRUCTION DETAIL NO. W-4	

S:\m\desa\0171080045.DWG Jun 13, 2006 9:16am bmmorison