


CORPORATION STOP

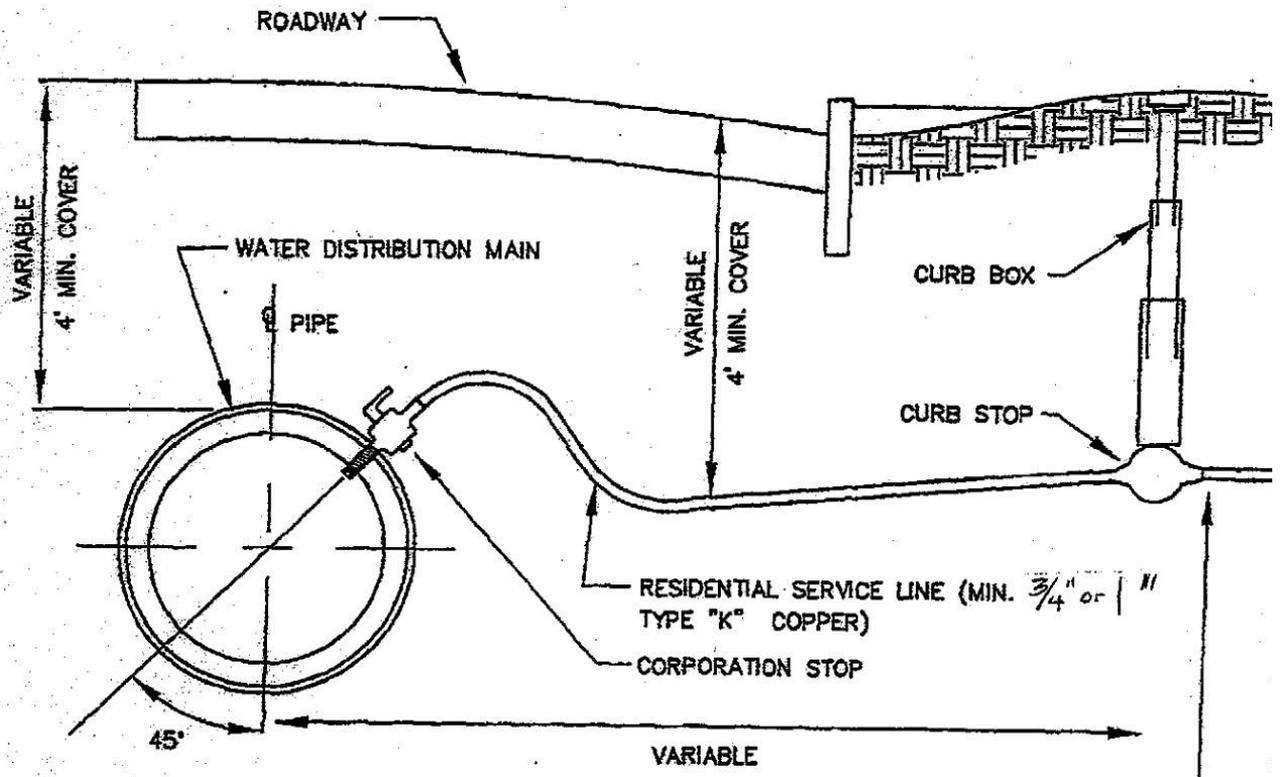

- NOTE:**
1. CORPORATION STOP MANUFACTURED BY MUELLER OR FORD
 2. THE WATER SERVICE LINE FROM THE CORPORATION STOP TO THE CURB STOP MUST BE ON CONTINUOUS LENGTH OF PIPE WITH NO COUPLINGS OR FITTINGS. THE SERVICE MUST BE EMBEDDED W/SCREENINGS, THEN BACKFILL WITH 2A or 2B
 3. COMMERCIAL SERVICE LINES SHALL BE A MINIMUM OF 1" DIAMETER AND MUST HAVE APPROVAL OF THE ENGINEER
 4. SADDLES MUST BE APPROVED BY SBA- FULL CIRCLE STAINLESS CLAMP W TAP
- CUSTOMER TO CONNECT AT THIS POINT, TO METER PIT OR HOME

SCHWENKSVILLE BOROUGH AUTHORITY	
CORPORATION STOP	08/2019
W-4	