


CORPORATION STOP

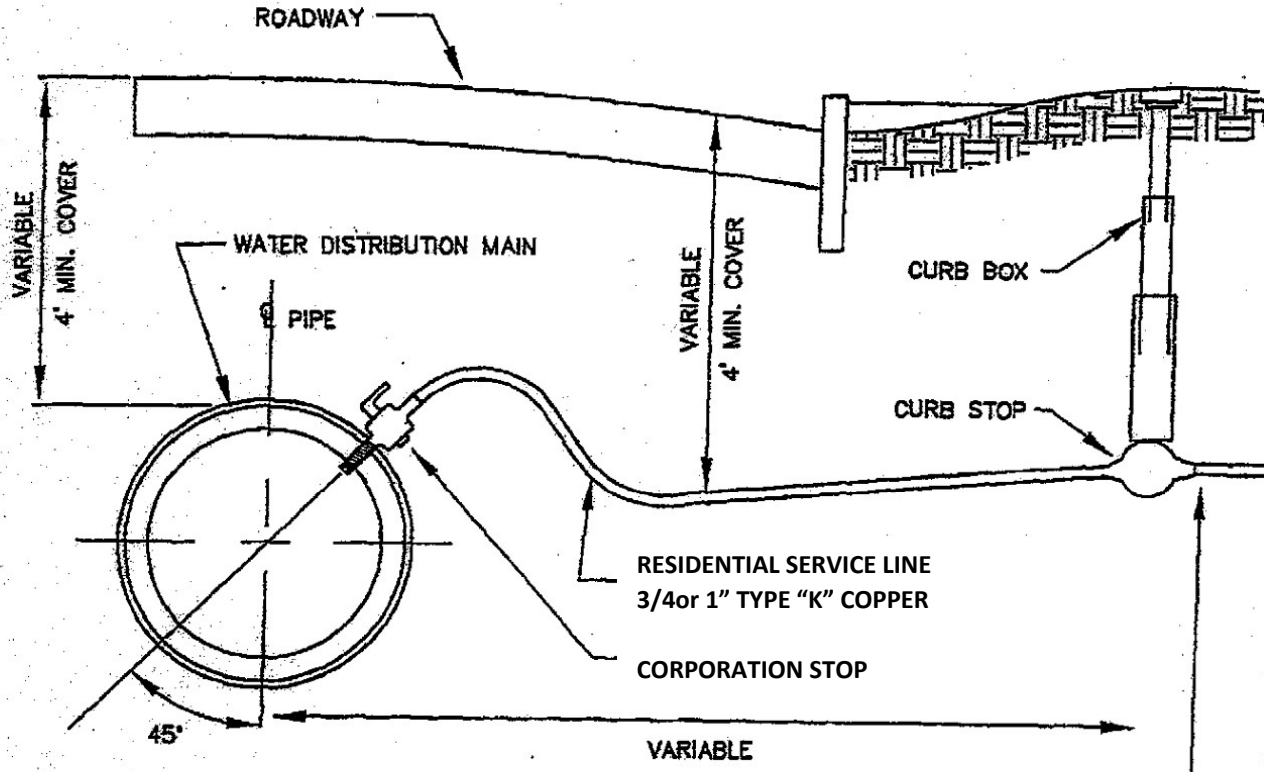

RESIDENT TO CONNECT AT THIS POINT, TO METER PIT OR INTO BUILDING

- NOTE:**
1. CORPORATION STOP MANUFACTURED BY MUELLER OR FORD
 2. THE WATER SERVICE LINE FROM THE CORPORATION STOP TO THE CURB STOP MUST BE ONE CONTINUOUS LENGTH OF COPPER WITH NO COUPLINGS OR FITTINGS. THE SERVICE MUST BE EMBEDDED W/SCREENINGS, THEN BACKFILL WITH 2A STONE, TO TOP OF TRENCH
 3. COMMERCIAL SERVICE LINES SHALL BE A MINIMUM OF 1" DIAMETER AND MUST HAVE APPROVAL OF THE ENGINEER
 4. SADDLES MUST BE APPROVED BY SBA- FULL CIRCLE STAINLESS CLAMP W TAP

SCHWENKSVILLE BOROUGH AUTHORITY

CORPORATION STOP

08/2019

W-4