


Green Valley Villas West Condominiums, Green Valley, AZ 85622
SPECIFICATION: TMATN60FB

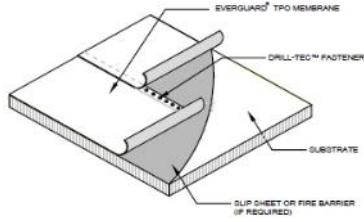

| COMPONENT | TYPE | REQUIRED | ATTACHMENT | RATE OF APPLICATION |
|---------------------|--|----------|---|--|
| DECK | Plywood | 1/2" | Per Code | N/A |
| SINGLE PLY MEMBRANE | EverGuard® TPO FB Ultra 60 mil White ASTM D6878 Size: 10ft SRI: 94 | 1 ply | Fastened with: Drill-Tec™ #14 Fastener Drill-Tec™ 2 3/8 in. Barbed XHD Plate | 10' sheets fastened 6" o.c. in the 6" laps and sealed with a 1.5" heat weld. Half sheets are required at the perimeter, see Perimeter Half Sheet Table in Spec Manual. |
| FLASHING MEMBRANE | EverGuard® TPO 60 mil White ASTM D6878 SRI: 94 | 1 ply | Adhered with: EverGuard® #1121 Bonding Adhesive | 50-60 sq ft of installed membrane per gallon. Adhesive is applied to both substrate surface and the underside of the membrane. Maximum flashing height is 54". |
| GUARANTEE | EverGuard® Diamond Pledge™ NDL Roof Guarantee | 20 years | | Guarantee fee applicable |

This Cut Spec specification shall not waive, supersede or alter the requirements and recommendations found in the most current Application & Specification Manual(s) referenced above, printed technical bulletins or specific correspondence drafted for this project by Field Services or Technical Services Manager. Each roof has unique requirements. This specification is a graphic representation of products and their installation. To properly assess specific roofing needs, code compliance, system configurations and warranty eligibility, contact Contractor Services. Note: Your Field Services or Technical Services Managers are the only employees who can approve any deviation from GAF's published specification manual(s). Always review the appropriate Application & Specification Manual which may contain information that is important for a successful installation. Application & Specification Manuals and specimen copies of guarantee/warranty documents are available at www.gaf.com. Any fastening pattern listed above is provided solely as a courtesy and recommends that the uplift resistance requirements be verified by a design professional. Standard industry practices must be followed for cold storage roofing design, building envelope specifications provided by the designer for sealing of all penetrations and edges must be followed. Adhesion testing must be performed when using low rise foam adhesives to attach insulation or membrane directly to decks or existing roof materials. Any wet or damaged existing decking shall be removed and replaced prior to reroofing.

This system shall be installed by a GAF Master or Master Select Contractor.

All GAF® and EverGuard® accessories shall be used where applicable. GAF® Perimeter Edge Metal shall be used where conditions exist. EverGuard Extreme® accessories are required for TPO systems with 25 year guarantees and greater.

ais@gaf.com

Architectural Information Services

1-800-522-9224