



Tank Information			
ZONE	REV	DESCRIPTION	DATE

Mar 2015

FINAL APPROVED DRAWING
 BY: _____
 DATE: _____

Standard 2" NPT
 Openings for fill,
 dispensing, vents,
 gauges, etc.

6" Primary E
 Vents

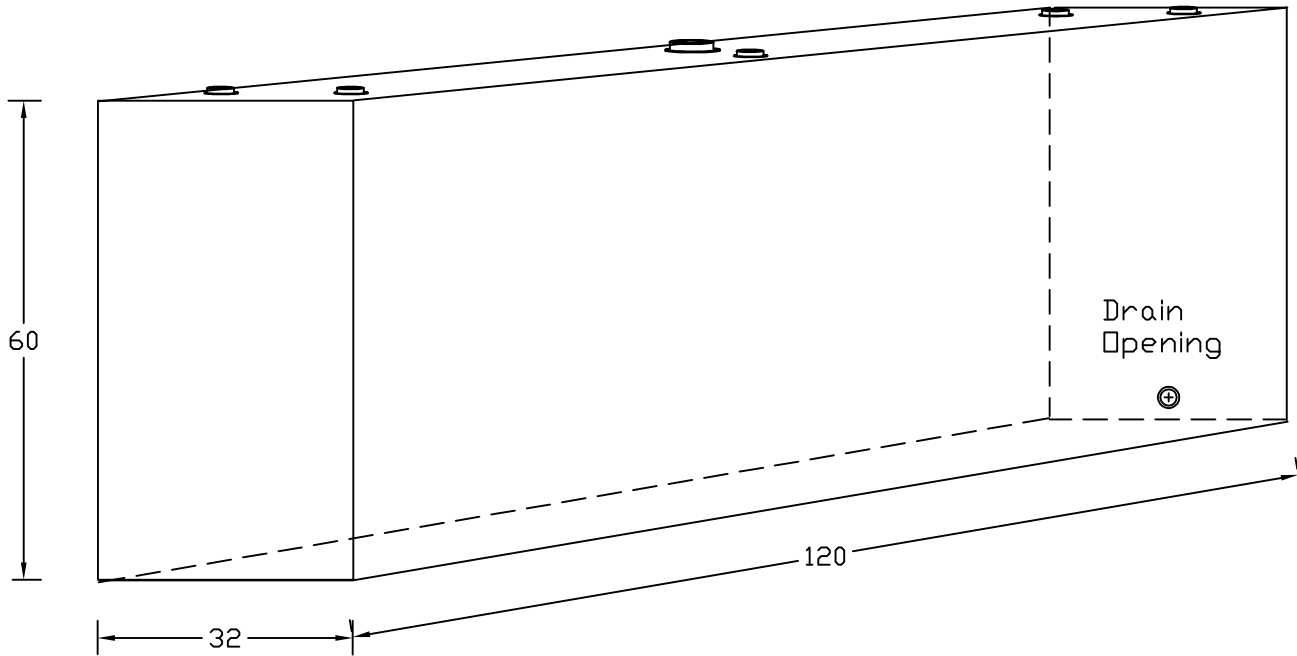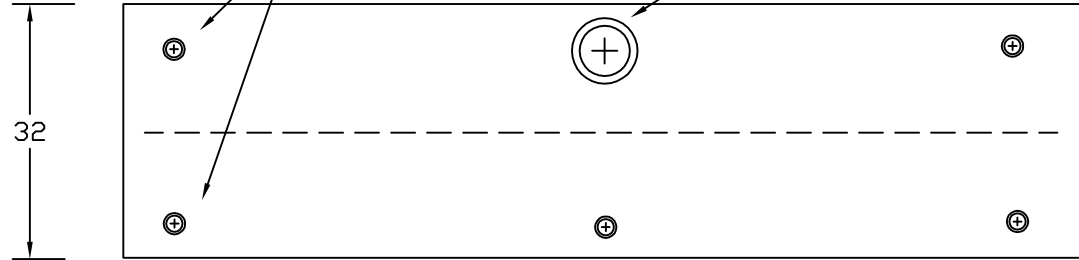

 Pee Dee Tank	1000LT		
	1000 Gallon aboveground rectangular singlewall tank, Standard Openings, red oxide coating		
1333 North Douglas St Florence, SC 29501 Telephone (843) 669-3381 Fax (843) 664-9118	UL 142 Listed	For Stationery Use Only	REV
	SCALE	M Moran	SHEET