


Tank Information			
ZONE	REV	DESCRIPTION	DATE

April
2015

FINAL APPROVED DRAWING
BY: _____
DATE: _____

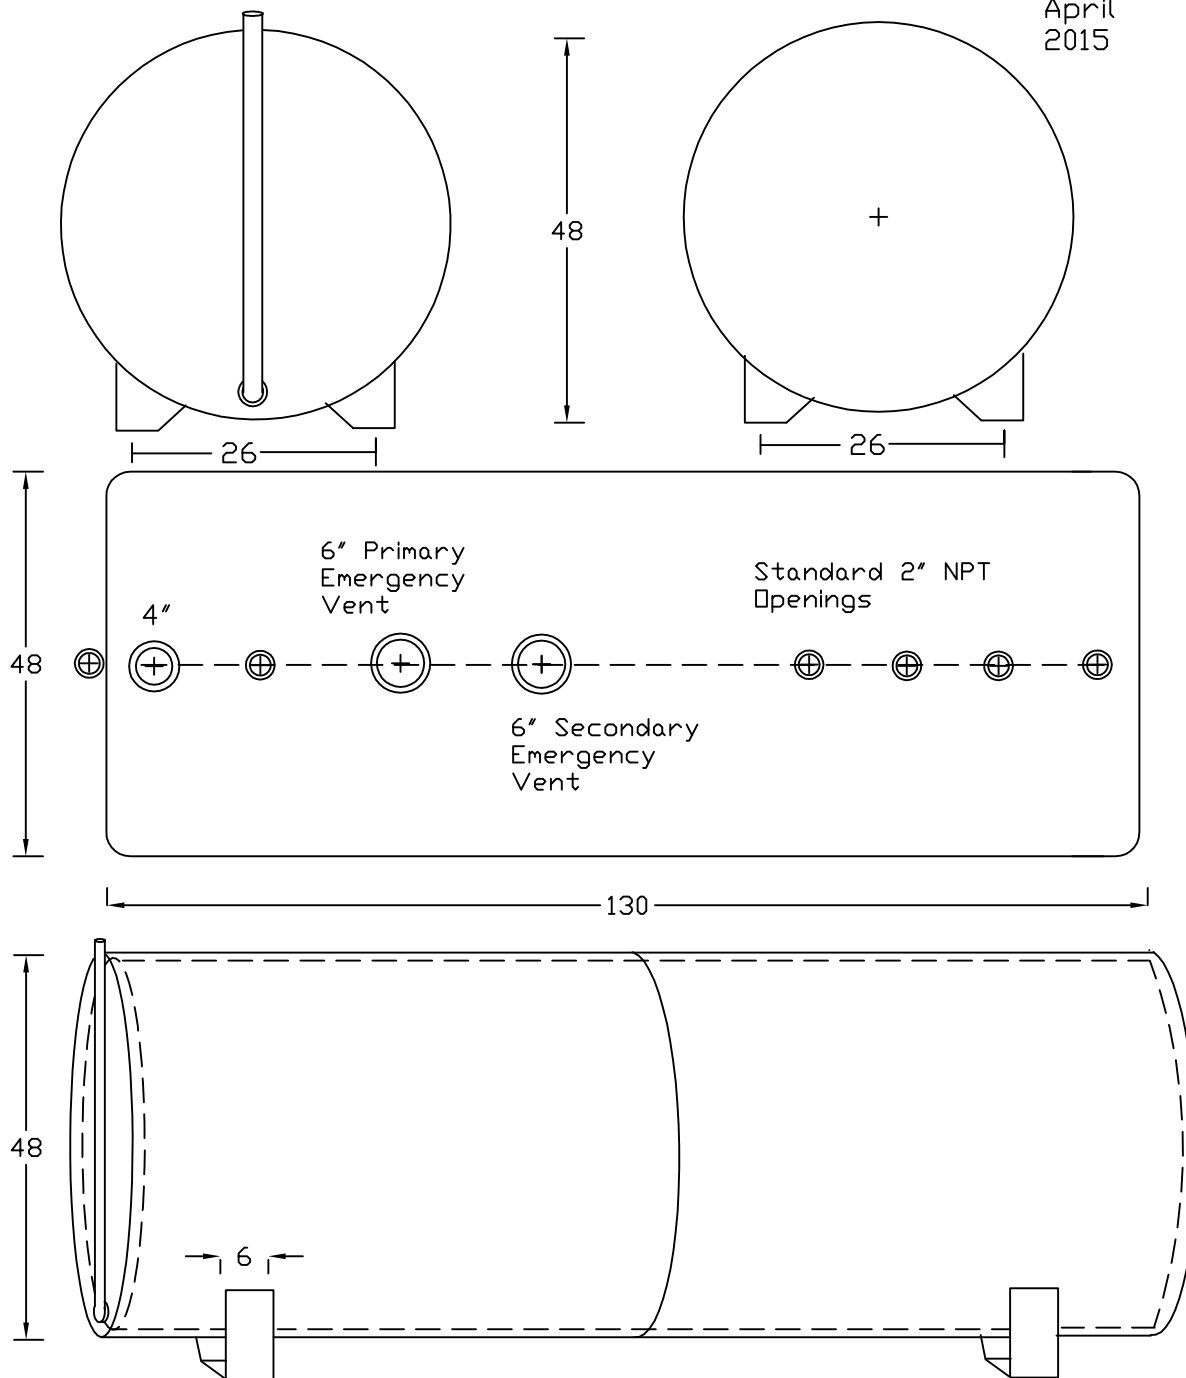

 Pee Dee Tank	1000PDHDW		
	1000 Gallon Double Wall tank with PDH feet, Monitoring Pipe, 6" Emergency Vent Openings, Standard NPT Openings top.		
1333 North Douglas St Florence, SC 29501 Telephone (843) 669-3381 Fax (843) 664-9118	UL142 Listed	For Stationery Use Only	REV
	SCALE	M Moran	SHEET