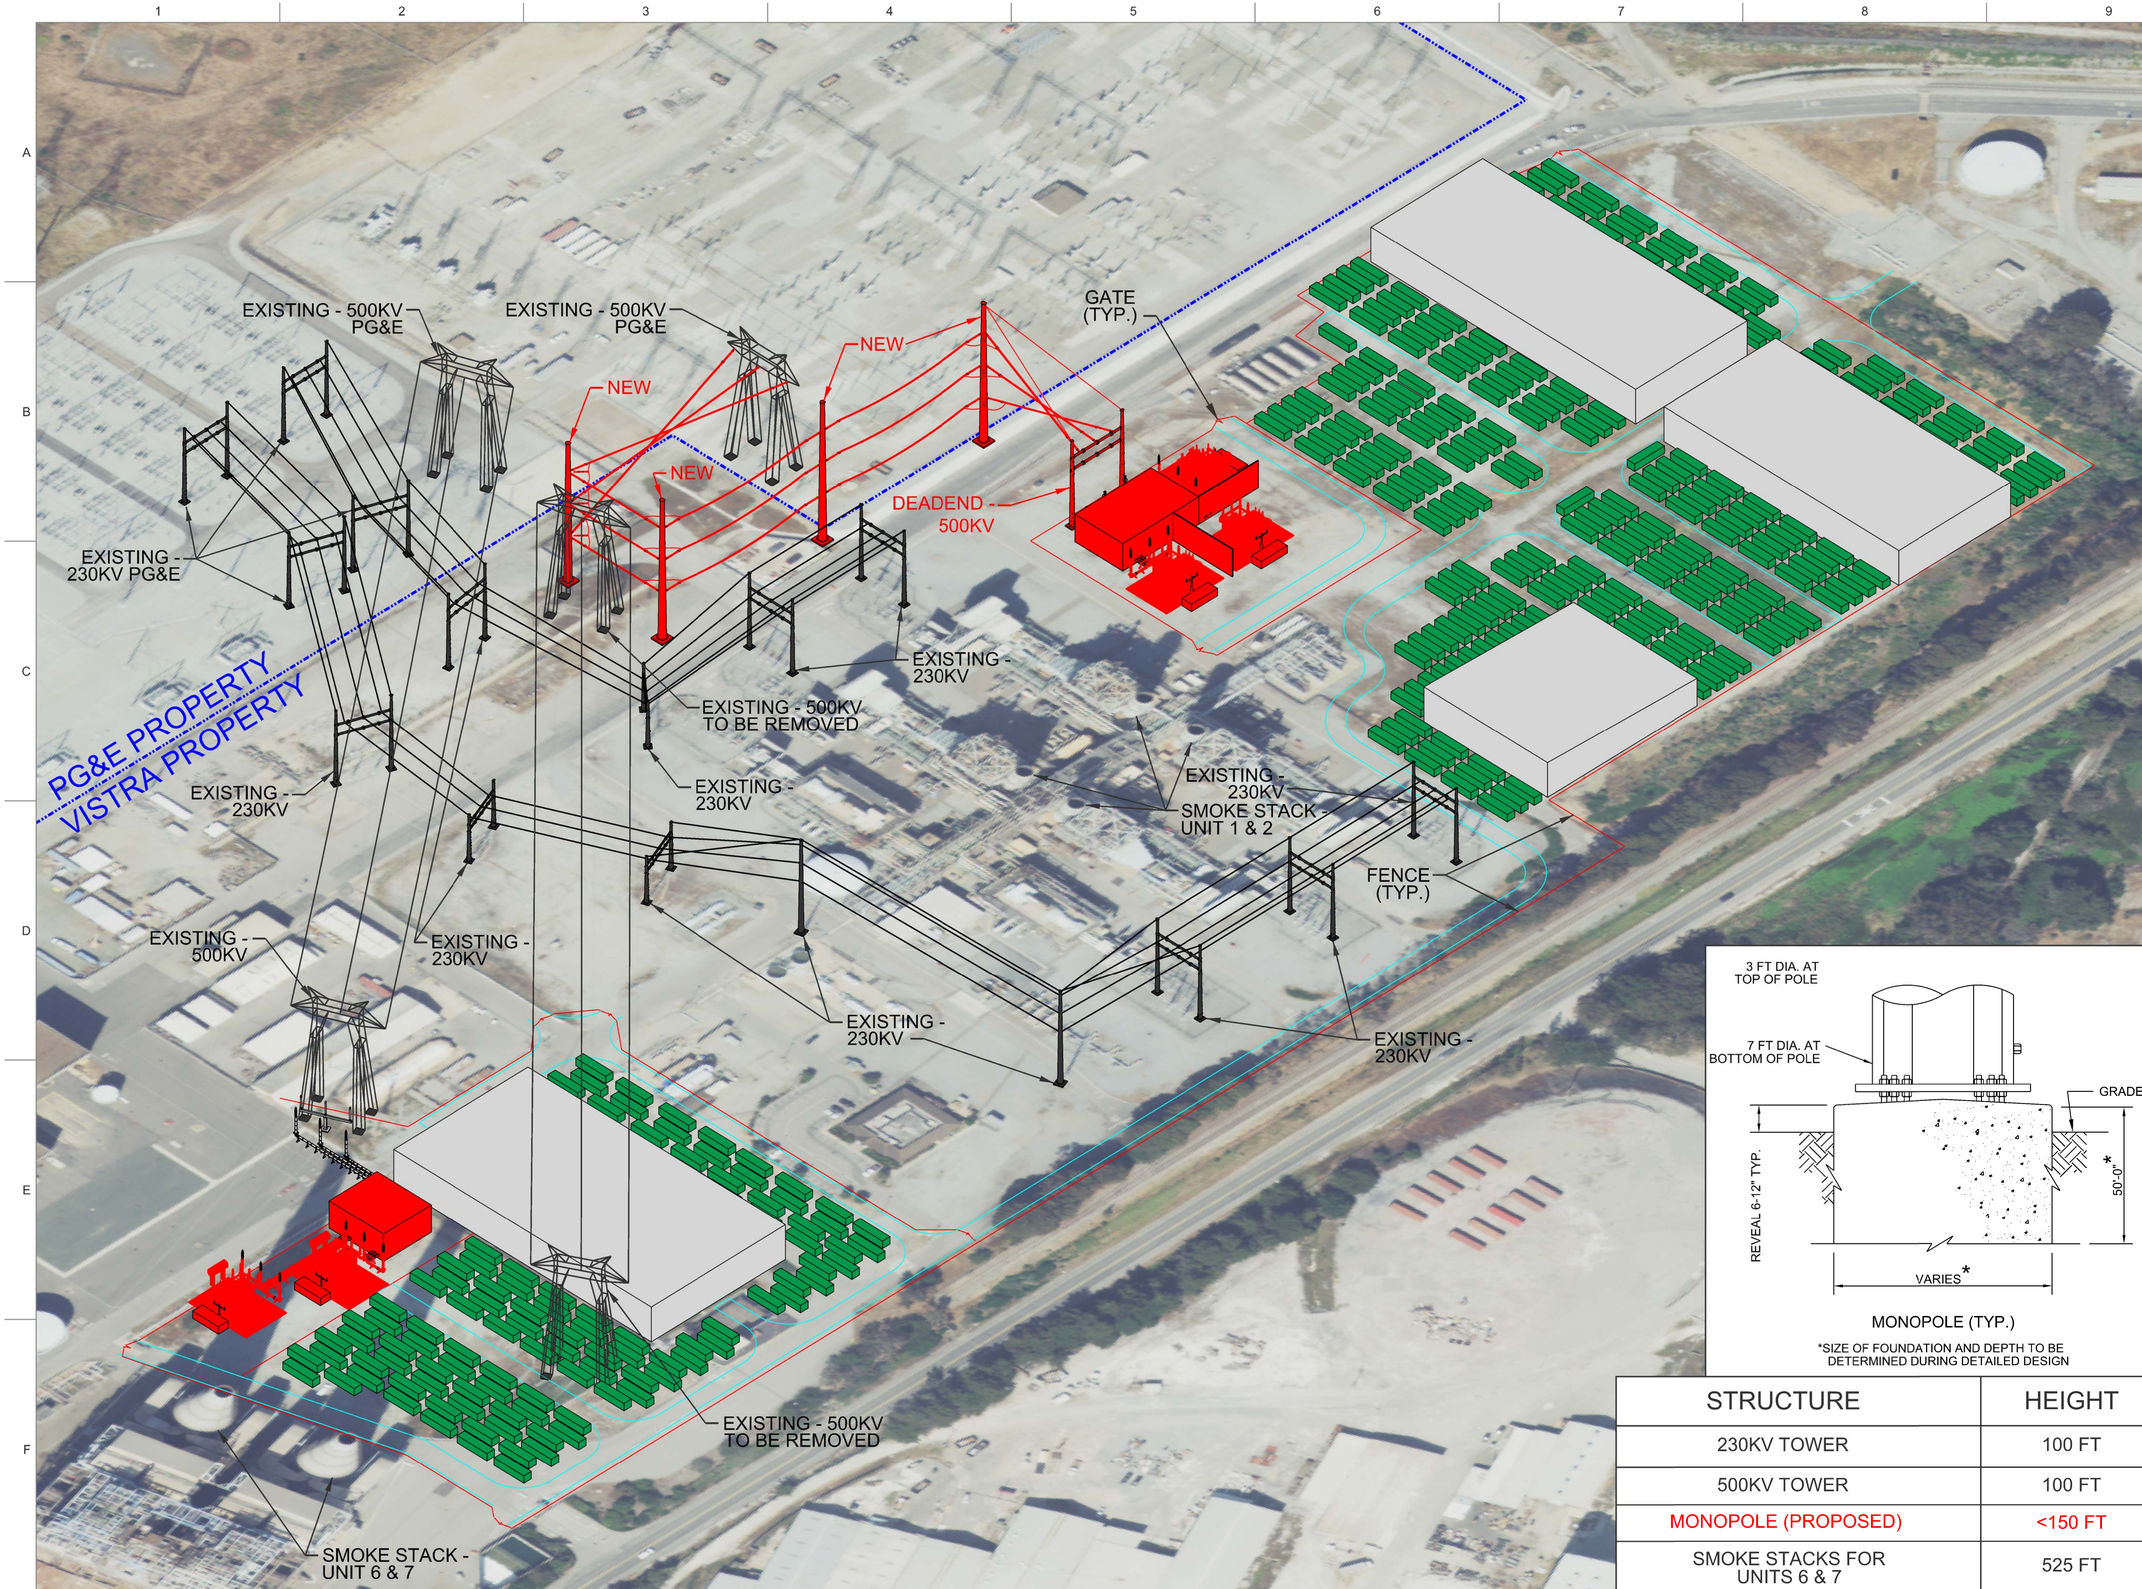

MONOPOLE (TYP.)

*SIZE OF FOUNDATION AND DEPTH TO BE DETERMINED DURING DETAILED DESIGN

STRUCTURE	HEIGHT
230KV TOWER	100 FT
500KV TOWER	100 FT
MONOPOLE (PROPOSED)	<150 FT
SMOKE STACKS FOR UNITS 6 & 7	525 FT
SMOKE STACKS FOR UNITS 1 & 2	145 FT
DEAD-END STRUCTURE HEIGHT SAME AS TOWER HEIGHT	

CONCEPTUAL SKETCH

NOT FOR CONSTRUCTION

RELEASE INFORMATION

NO	DATE	DESCRIPTION
0	06-17-19	PHASE II - CONCEPTUAL LAYOUT - BESS FACILITY

HOLD INFORMATION

NO

NOTES

NO

VISTRA ENERGY

SCALE: SCALE AS SHOWN

PROJECT:

PREPARED BY:	M.QUINTOS	DATE:	06-17-2019
REVIEWED BY:	B. CLEARY	DATE:	06-17-2019
APPROVED BY:	S&L	DATE:	

Sargent & Lundy Engineers, Ltd.

ANY MODIFICATION OR ADDITION TO THIS DRAWING BY ANY ORGANIZATION OTHER THAN SARGENT & LUNDY IS NOT THE RESPONSIBILITY OF SARGENT & LUNDY

MOSS LANDING BESS
1100MW /4400MWh FACILITY
PHASE II - OVERALL ISO VIEW

DRAWING NUMBER	REVISION
VST-P1-1203B	0