


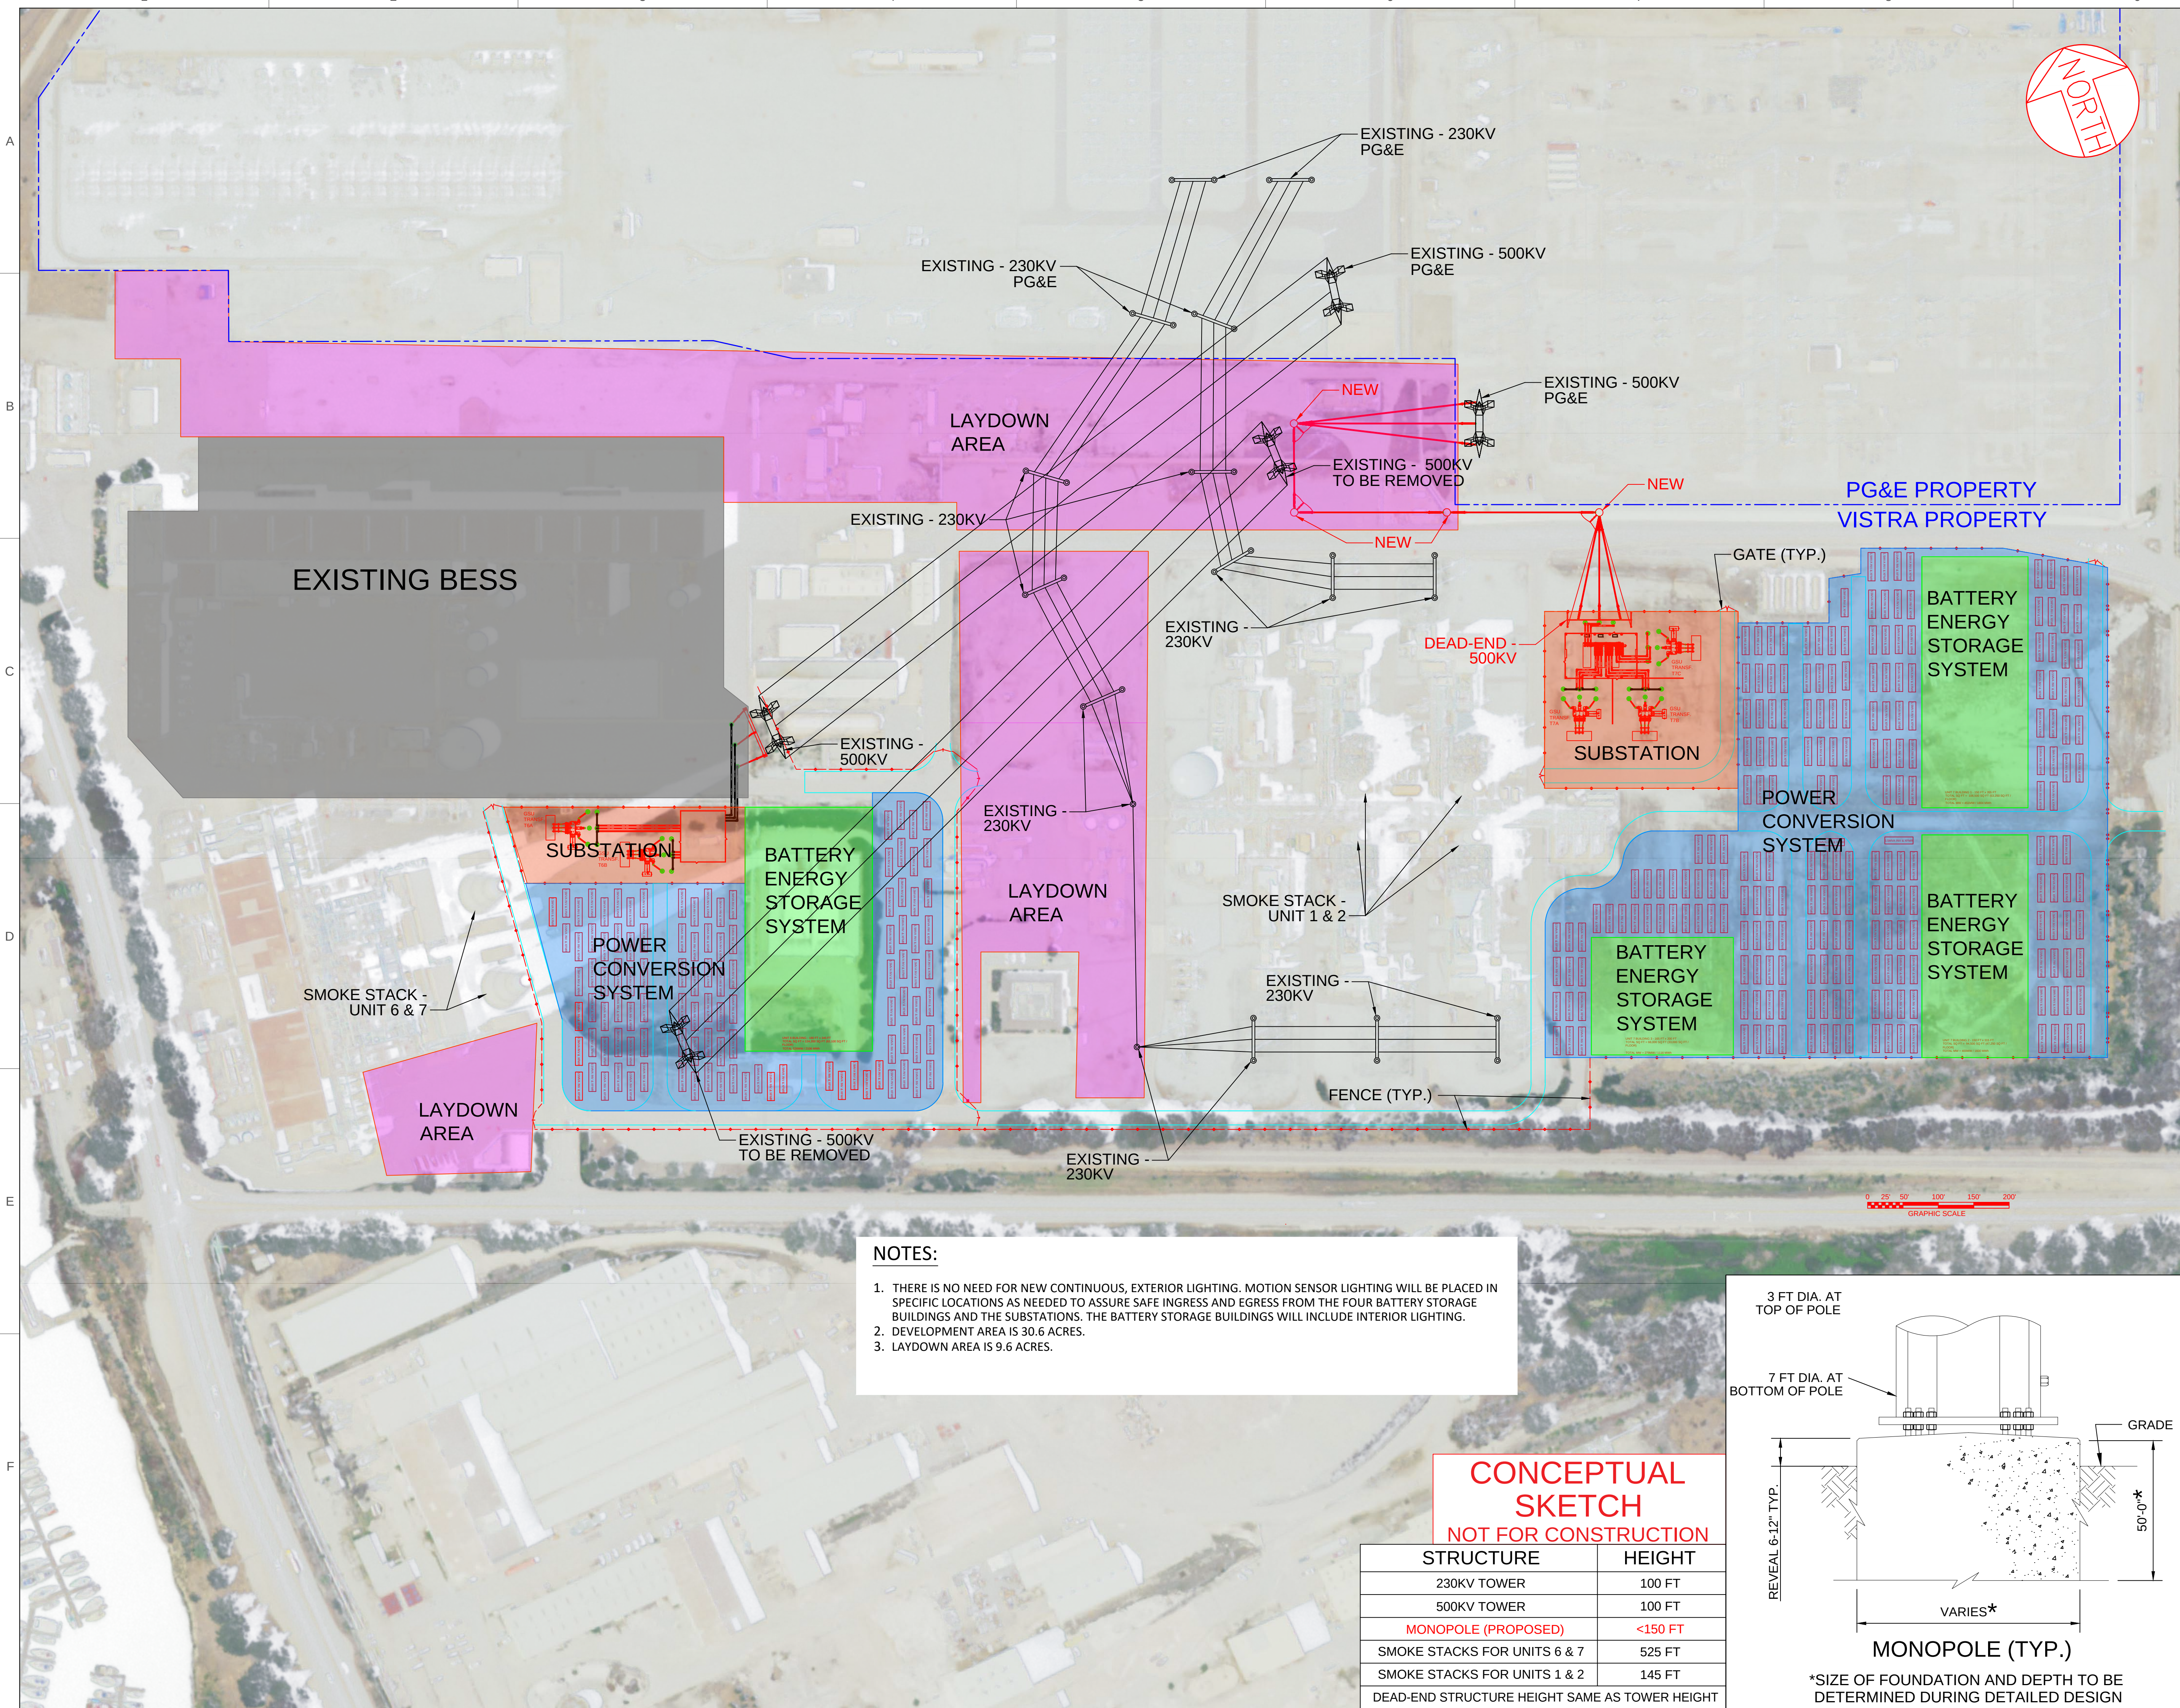



NOTES:

1. THERE IS NO NEED FOR NEW CONTINUOUS, EXTERIOR LIGHTING. MOTION SENSOR LIGHTING WILL BE PLACED IN SPECIFIC LOCATIONS AS NEEDED TO ASSURE SAFE INGRESS AND EGRESS FROM THE FOUR BATTERY STORAGE BUILDINGS AND THE SUBSTATIONS. THE BATTERY STORAGE BUILDINGS WILL INCLUDE INTERIOR LIGHTING.
2. DEVELOPMENT AREA IS 30.6 ACRES.
3. LAYDOWN AREA IS 9.6 ACRES.

CONCEPTUAL SKETCH
NOT FOR CONSTRUCTION

STRUCTURE	HEIGHT
230KV TOWER	100 FT
500KV TOWER	100 FT
MONOPOLE (PROPOSED)	<150 FT
SMOKE STACKS FOR UNITS 6 & 7	525 FT
SMOKE STACKS FOR UNITS 1 & 2	145 FT
DEAD-END STRUCTURE HEIGHT SAME AS TOWER HEIGHT	

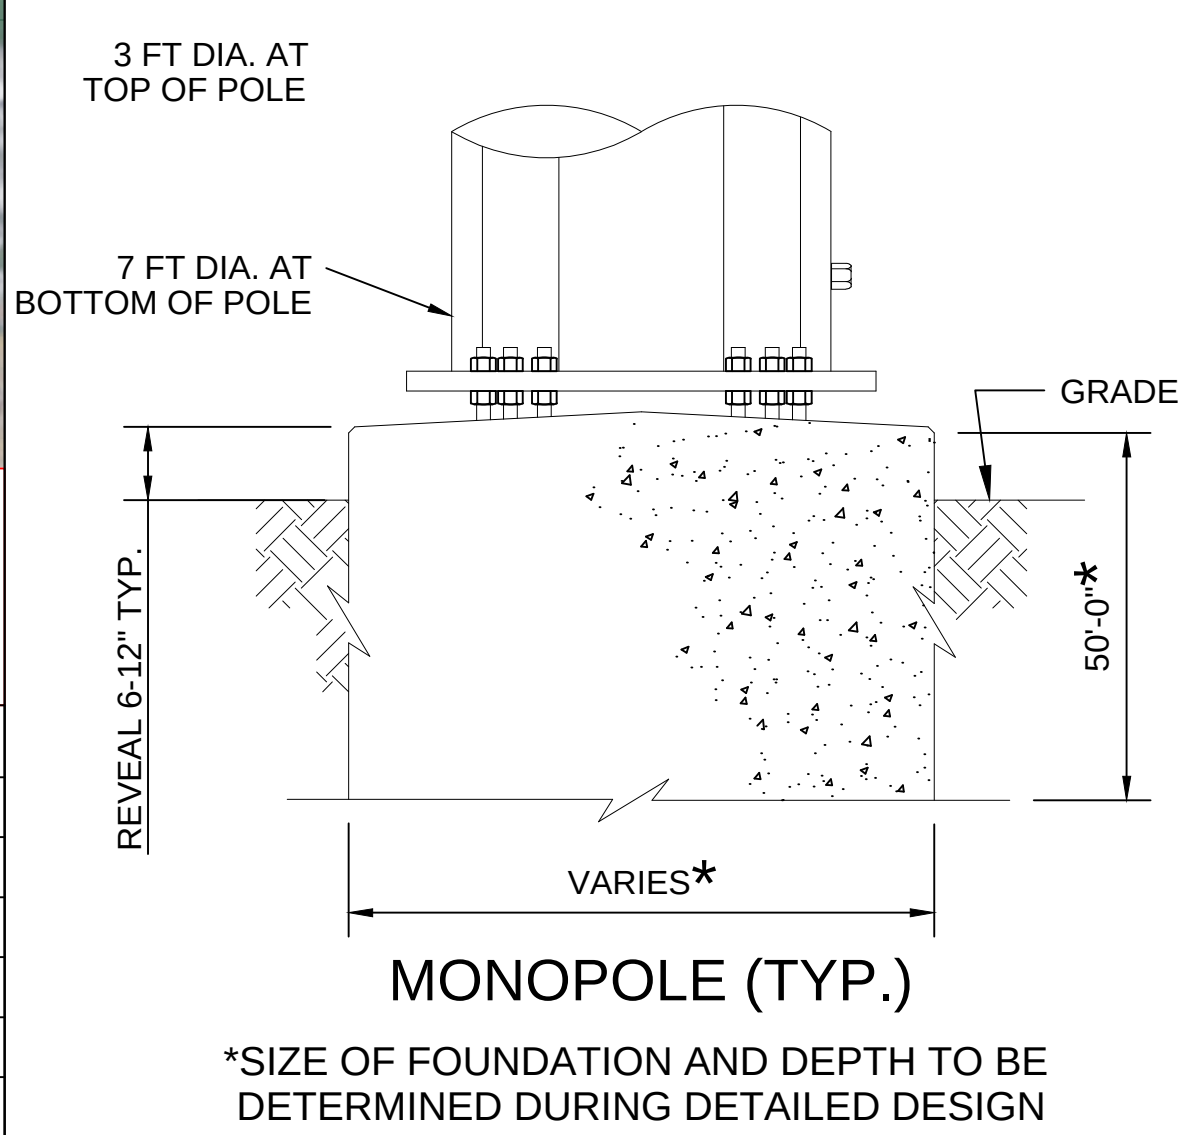

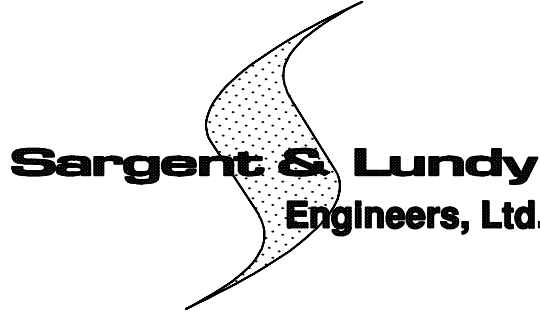RELEASE INFORMATION		
NO	DATE	DESCRIPTION
0	05-29-19	PHASE II - CONCEPTUAL LAYOUT - BESS FACILITY
1	09-06-19	ADD ADDITIONAL INFORMATION
2	10-04-2019	ADD MONOPOLE FOUNDATION DETAIL
3	10/23/2019	ADD ADDITION INFORMATION TO MONOPOLE FOUNDATION DETAIL
HOLD INFORMATION		
NO		
NOTES		
NO		
		
SCALE: SCALE AS SHOWN		
PROJECT:		
PREPARED BY:	M.QUINTOS	DATE: 06-17-2020
REVIEWED BY:	B. CLEARY	DATE: 06-17-2020
APPROVED BY:	S&L	DATE:
		
ANY MODIFICATION OR ADDITION TO THIS DRAWING BY ANY ORGANIZATION OTHER THAN SARGENT & LUNDY IS NOT THE RESPONSIBILITY OF SARGENT & LUNDY		
MOSS LANDING BESS 1100MW /4400MWh FACILITY PHASE II GENERAL ARRANGEMENT		
VST-P1-1201		3
DRAWING NUMBER		REVISION