

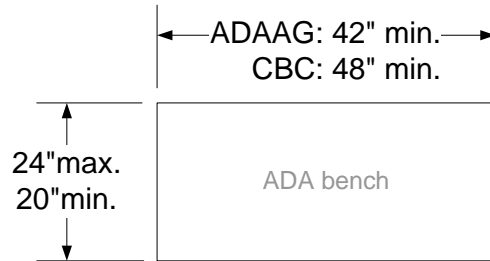


ADA COMPLIANT LOCKER ROOM BENCHES


Accessible benches MUST have full width back support to be fully compliant

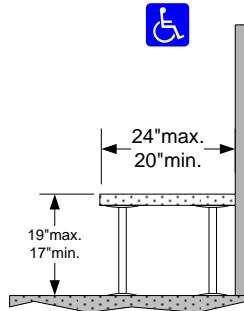

SEAT SIZE

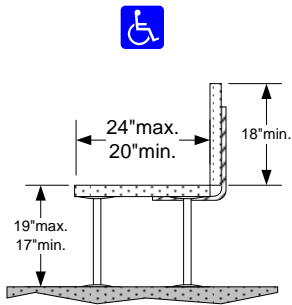

NOT ADA COMPLIANT
(no back support)

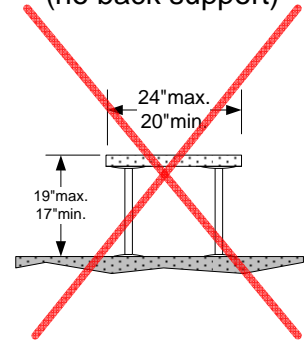

Specific Code requirements for BENCHES

2004 ADAAG	2016 CBC	Minimum Requirements
903.2	11B-305.2:	30"x48" clear floor space at SIDE approach
903.3	11B-903.3:	Bench width to be 42" (48" per CBC) min. and depth to be 20" min. - 24" max.
903.3	11B-904.2:	Back support to be full width of seat x 18"H min.
903.4	11B-905.5:	Seat ht. to be min. 17" – max. 19" above finished floor
903.5	11B-903.6:	Seat shall support at least 250 pounds

Job: ADA Benches
 Dwg: Bench Compliance
 Versn: 1 Date: 10/26/2017
 By: Chris Bruce

© 2017 Copyright includes layout, design, and other intellectual property. The drawings, specifications and other data herein provided shall not be copied, published or otherwise further disseminated without prior written permission of InnerSpace Engineering Corporation.

INNER SPACE
 ENGINEERING CORPORATION
 SPACE SAVING & PRODUCTIVITY SOLUTIONS
 WWW.INNERSPACEENGINEERING.COM
 3390-B De La Cruz Blvd. Santa Clara, CA 95054
 PHONE: 408.980.8020 FAX: 408.819.9468