


Technical Bulletin 76

Copyright 2023 by Air Options, Inc.

120 VAC From 240/480 VAC

by Brian S. Elliott

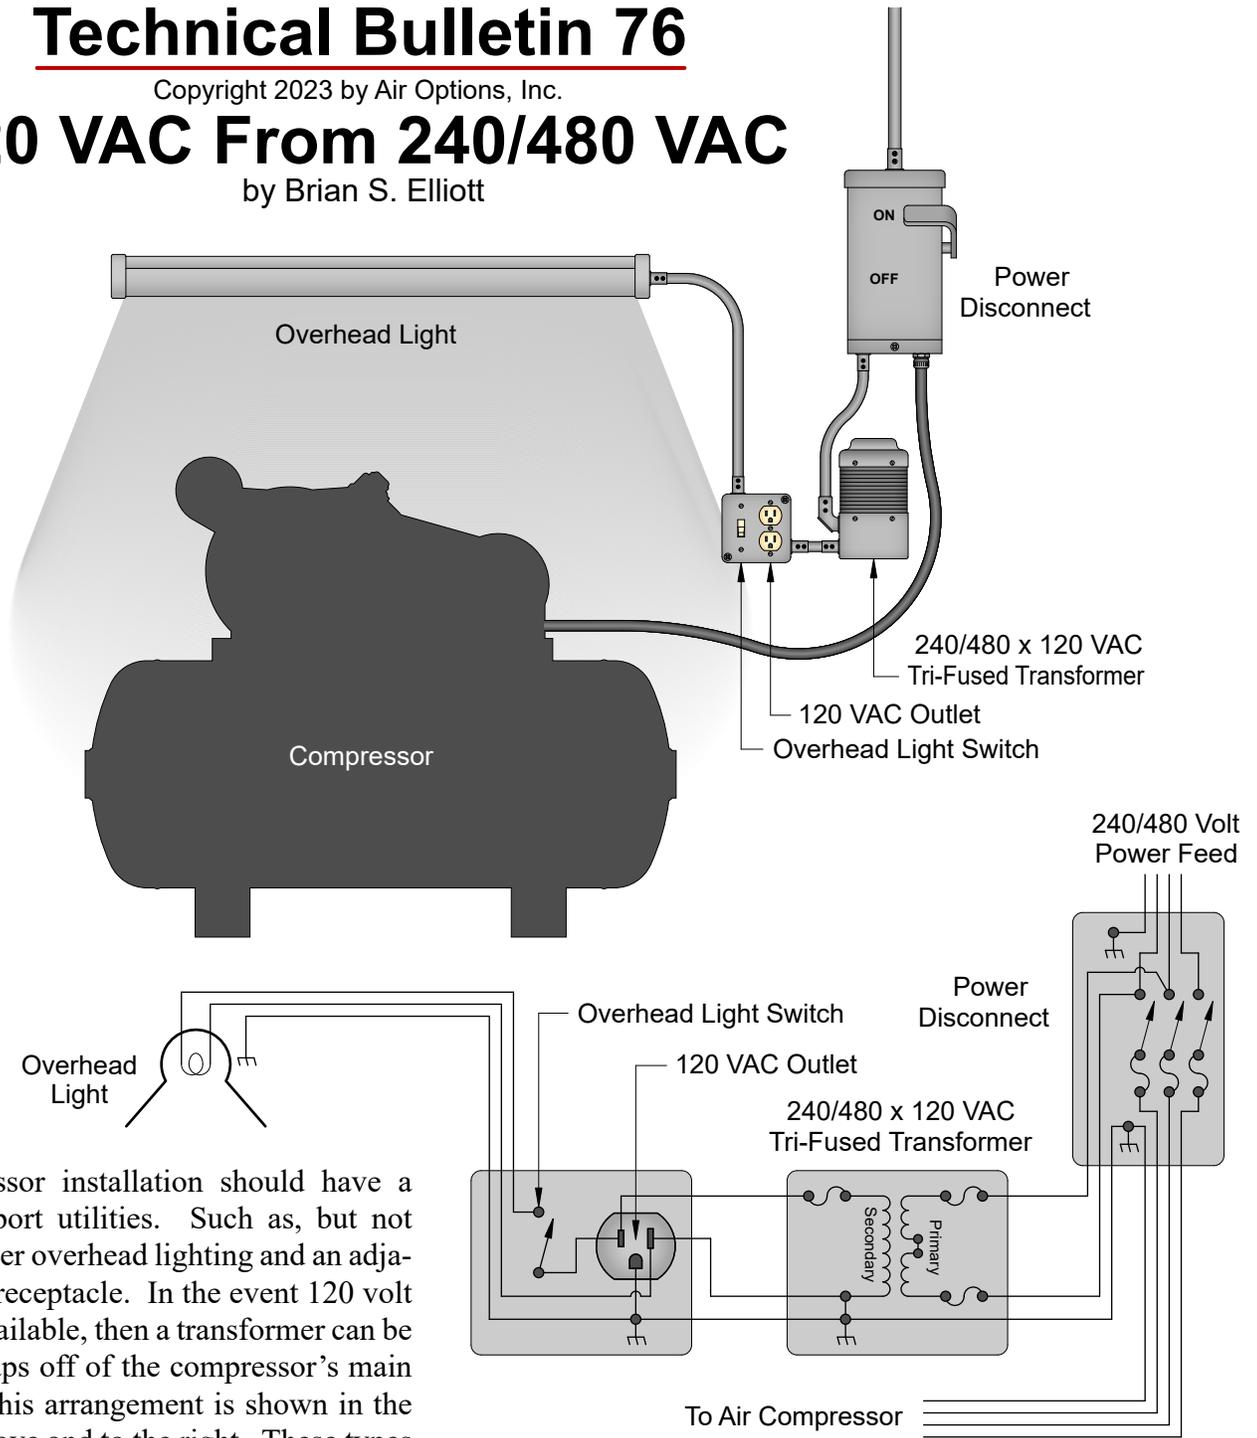

Every compressor installation should have a few basic support utilities. Such as, but not limited to, proper overhead lighting and an adjacent 120 VAC receptacle. In the event 120 volt service isn't available, then a transformer can be added which taps off of the compressor's main power feed. This arrangement is shown in the illustrations above and to the right. These types of transformers are readily available throughout the industrial control industry. The selected transformer should be fused and sized so that it will carry any electrical load that may be required for routine maintenance.

Air Options, Inc.
P.O. Box 35984
Houston, Texas 77235-5984
Ph.: 713-721-9619
E-Mail: Info@Air-Options.com

JTDryers.com

A complete bound copy of Air Options Technical Bulletins can be purchased on our web site at: JTDryers.com/jt-order-now



AIR-OPTIONS, INC.

Advanced Technologies for Compressed Air