



IN THE EVENT CONFLICTS ARE DISCOVERED BETWEEN THE ORIGINAL SIGNED AND SEALED DOCUMENTS PREPARED BY THE ARCHITECTS AND/OR THEIR CONSULTANTS, AND ANY COPY OF THE DOCUMENTS TRANSMITTED BY MAIL, FAX, ELECTRONICALLY OR OTHERWISE, THE ORIGINAL SIGNED AND SEALED DOCUMENTS SHALL GOVERN.

PROJECT # 2020-190
DATE: 4 NOV 2021
REVISIONS
DATE: 07 FEB 2022 ADDRESS COMMENTS
DATE: 19 APR 2022 ADDRESS COMMENTS
DATE: 16 JUN 2022 BUILDING COMMENTS

NEW MULTI FAMILY DEVELOPMENT:
JETTY VIEW TOWNHOMES
4th AVE WARRENTON, OREGON

SHEET
A2.4

GENERAL NOTES:


- GENERAL NOTES APPLY TO ALL DRAWINGS.
- DIMENSIONS ARE TO FACE OF FRAMING, STRUCTURAL SHEATHING, EXTERIOR SHEATHING OR GRID LINES. DIMENSIONS STATED AS 'CLEAR' ARE TO FACE OF FINISH, UNLESS OTHERWISE NOTED.
- SEE ELEVATIONS FOR DESCRIPTION OF EXTERIOR WALL MATERIALS.
- DRAWINGS ARE DIAGRAMMATIC ONLY AND SHOULD NOT BE SCALED. NOTIFY ARCHITECT IMMEDIATELY OF ANY DISCREPANCIES OR QUESTIONABLE DIMENSIONS PRIOR TO PROCEEDING WITH AREA OF REQUIRED WORK.
- ALL BEAMS AND HEADERS SHALL HAVE ONE 2X BEARING AND ONE 2X KING POST AT EACH END UNLESS OTHERWISE NOTED ON PLAN.
- ALL WALLS SEPARATING CONDITIONED SPACES FROM UNCONDITIONED SPACES SHALL BE THERMALLY INSULATED.
- ALL THERMALLY INSULATED WALLS TO BE 2x6 FRAMING WITH R-23 BATT INSULATION.
- PROVIDE SOLID 2X BLOCKING FOR TOWEL BARS, CABINETS, COUNTERS W/ KNEE SPACES, DOOR STOPS AND DRAPERIES WHERE REQUIRED.
- ATTIC VENTILATION REQUIREMENTS PER 806.1
- CRAWL SPACE VENTILATION REQUIREMENTS PER 409.1

PLAN LEGEND:

- 2x6 WOOD STUD WALL @ 16" O.C. (R-23 BATT AT EXTERIOR)
- 2x4 WOOD STUD WALL @ 16" O.C.
- RATED WALL ASSEMBLY
- HOSE BIBB
- DOWNSPOUT, OVERSIZE WHERE VALLEYS ABOVE OCCUR
- ELECTRICAL PANEL

PLAN NOTES:

- CONCRETE STEM WALL PER STRUCTURAL
- TRASH/RECYCLE BINS
- 8 X 16 FOUNDATION VENTS - LOCATE 12" CLEAR (MIN) FROM HOLD DOWNS AND ANCHOR BOLTS
- 4" GARAGE FLOOR SLAB, SLOPE TO DRAIN 3" FALL FROM FRONT TO GARAGE DOOR OPENING
- CONCRETE STEPS, MAX 8" RISE AND 10" TREAD
- FOUNDATION WALL ADJACENT TO CONCRETE DECK
- CONCRETE DECK
- BLOCK OUT FOUNDATION WALL FOR FURNACE DUCTING
- ELECTRIC SLIDE IN RANGE WITH EXHAUST HOOD ABOVE
- EQUAL STAIR RISERS, NOT TO EXCEED 8" RISE, RUN 9" PROVIDE, ENSURE HANDRAIL ONE SIDE
- CLOSET ROD AND SHELF
- ELECTRIC WATER HEATER, 50 GALLON, PROVIDE SEISMIC STRAPPING
- WASHER AND DRYER WITH 16" DEEP SHELF ABOVE
- FRIDGE WITH ICE MAKER
- CRAWLSPACE ACCESS HATCH 18" x 24"
- GUARD RAIL AT 36"
- ATTIC ACCESS HATCH 22 X 30
- FIRE PLACE FLUE TO ROOF
- GREEN BOARD GYP AT WALLS IN BATHROOMS.
- PROVIDE BLOCKED OUT AREA FOR DUCT RUNS WITHIN TRUSSES UNDER INSULATION
- SOFFIT CEILING DOWN OVER TUB, DUCT ROUTING ABOVE
- SLOPED CONCRETE DECK OVER WOOD FLOOR JOISTS
- COORDINATE SIZE AND CONFIGURATION OF FIREPLACE, PRIOR TO LOCATING WINDOWS, FIREPLACE TO BE CENTERED BETWEEN WINDOWS, FIELD VERIFY
- GAS FIREPLACE, DIRECT VENT SIDE WALL, VERIFY
- GAS FIREPLACE CORNER PLACEMENT, VENT TO ROOF ABOVE, VERIFY REQUIRED CLEARANCES AND LOCATION OF WINDOW
- PROVIDE LAMINATE SHELVES AT PANTRY (6) EQUALLY SPACED
- HANDRAILS SHALL OCCUR ON ONE SIDE AND SHALL NOT PROJECT MORE THAN 4 1/2", HANDRAILS SHALL HAVE A DISTANCE OF 1 1/2" FROM THE WALL, HANDRAILS SHALL HAVE AN OUTSIDE DIAMETER OF NOT LESS THAN 1 1/2" AND NOT GREATER THAN 2". HANDRAILS SHALL RUN THE FULL LENGTH OF THE FLIGHT FROM A POINT DIRECTLY ABOVE THE TOP RISER OF THE FLIGHT TO A POINT DIRECTLY ABOVE THE LOWEST RISER OF THE FLIGHT. HANDRAIL ENDS SHALL BE RETURNED OR SHALL TERMINATE IN NEWEL POSTS OR SAFETY TERMINALS.

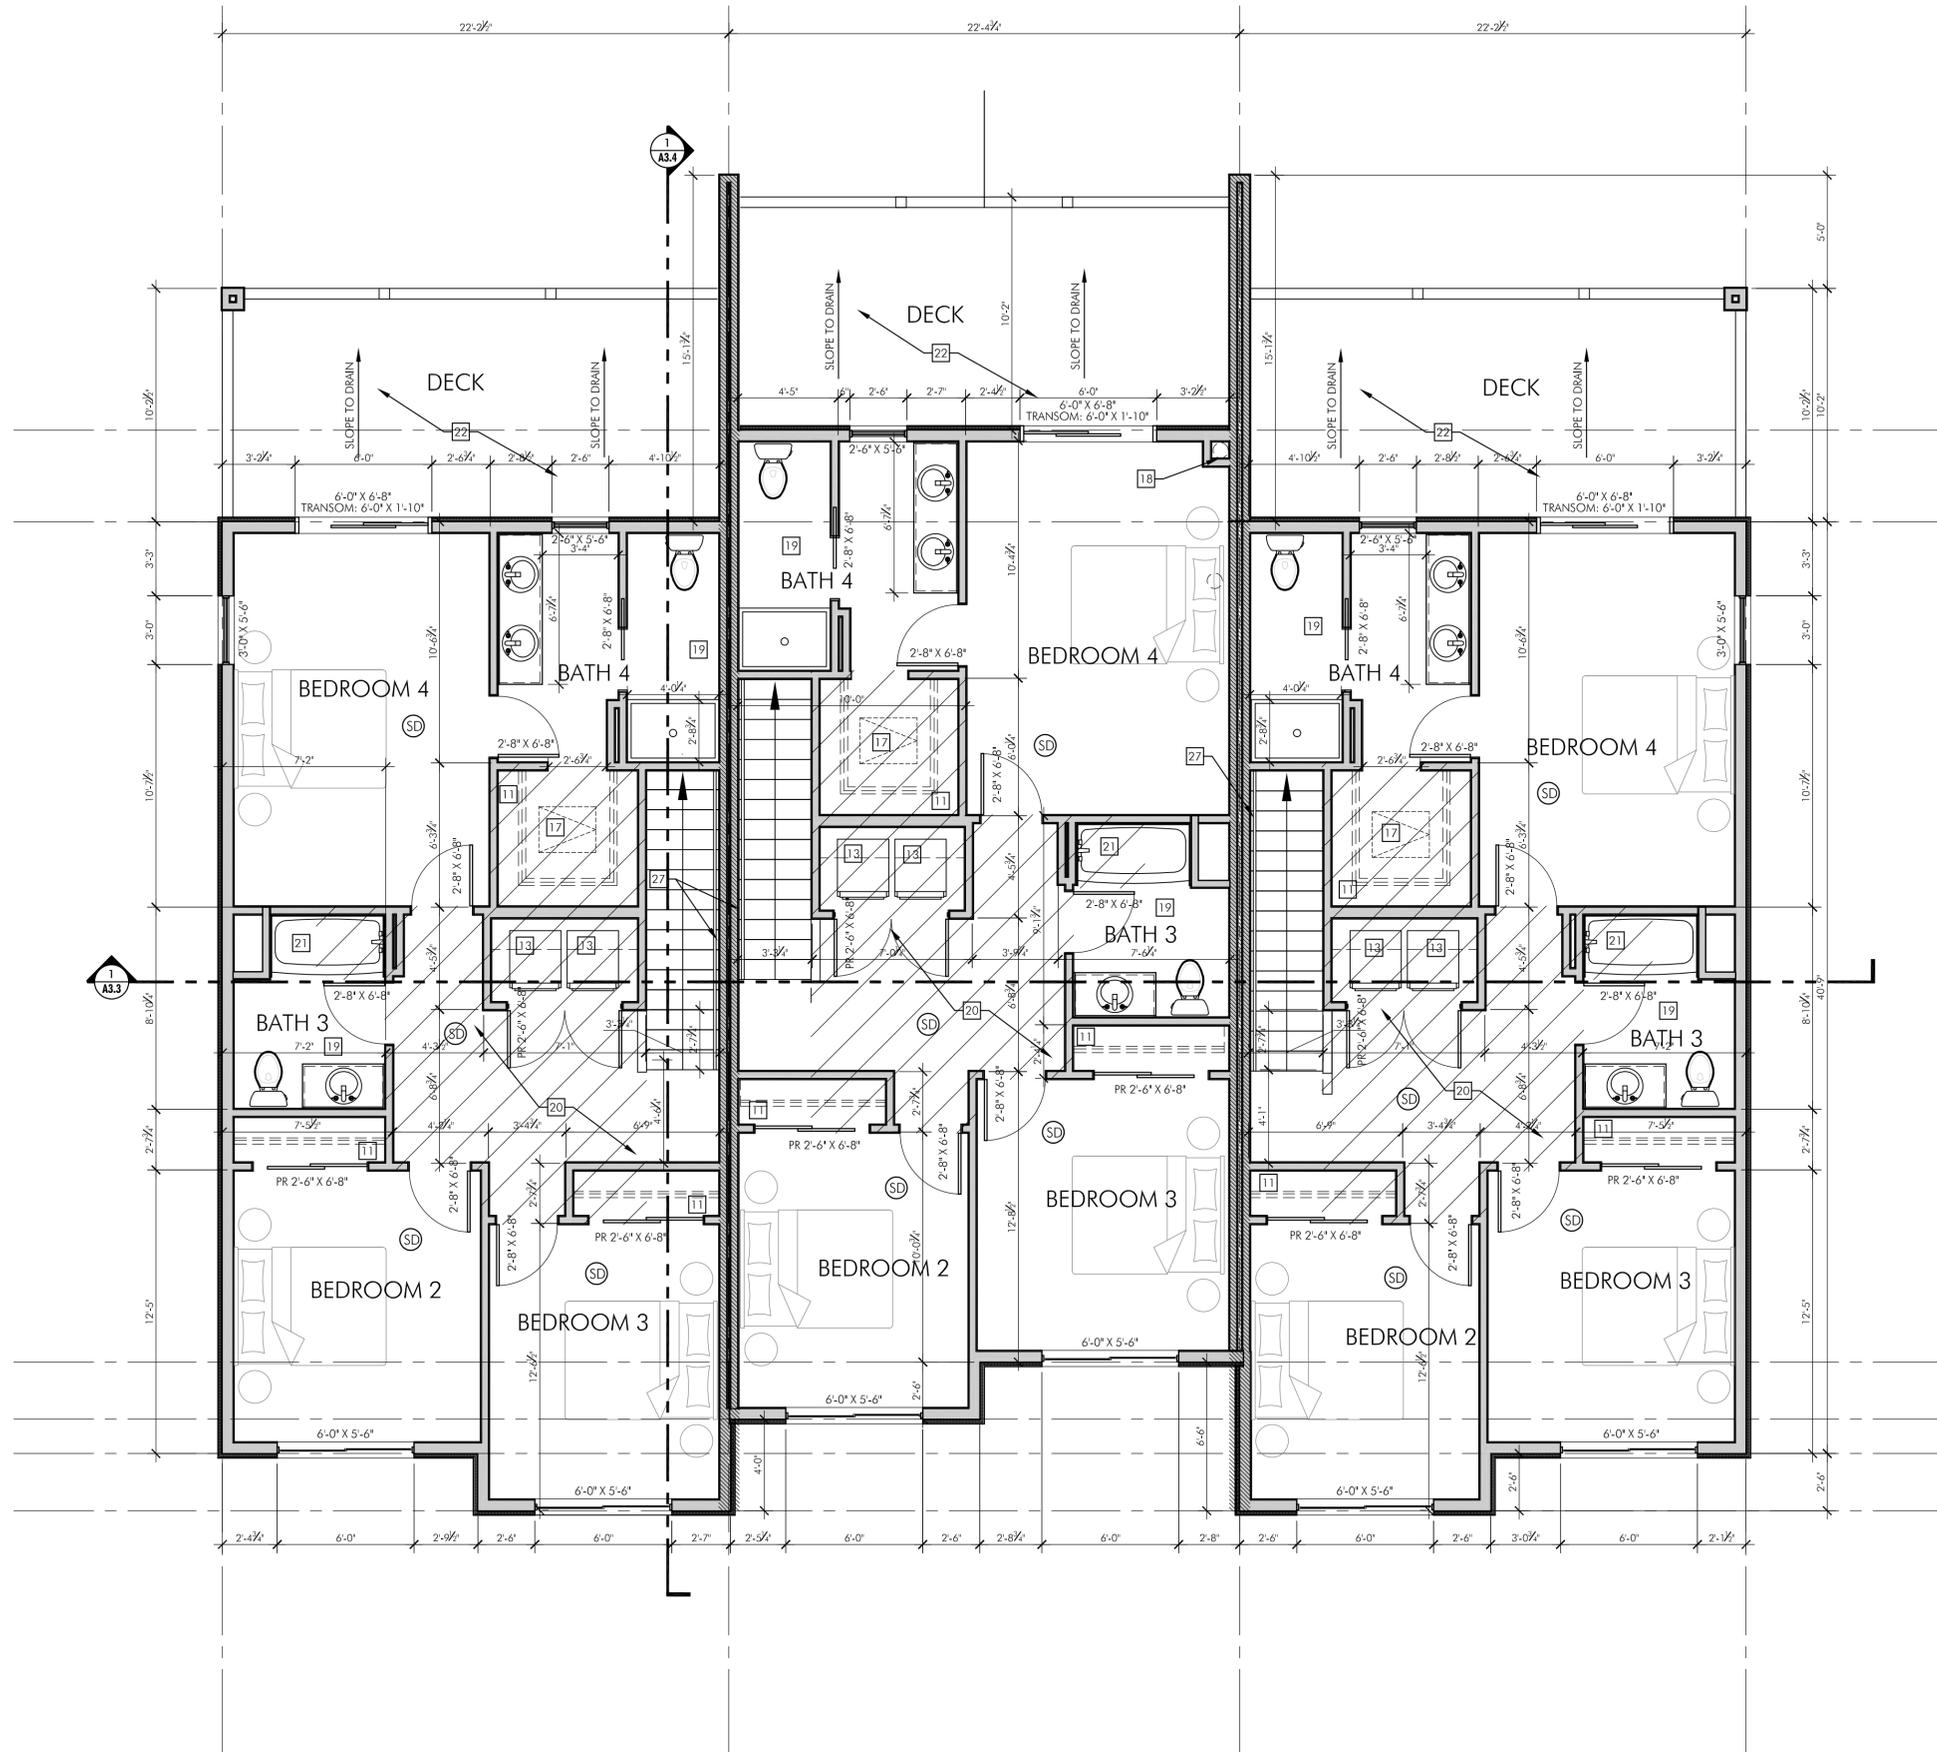

1 THIRD FLOOR PLAN
1/4" = 1'-0"

