


10/11/21 THIS IS THE SYSTEM WE ARE USING

VELOCITY WATER WORKS
Elevating the Standard

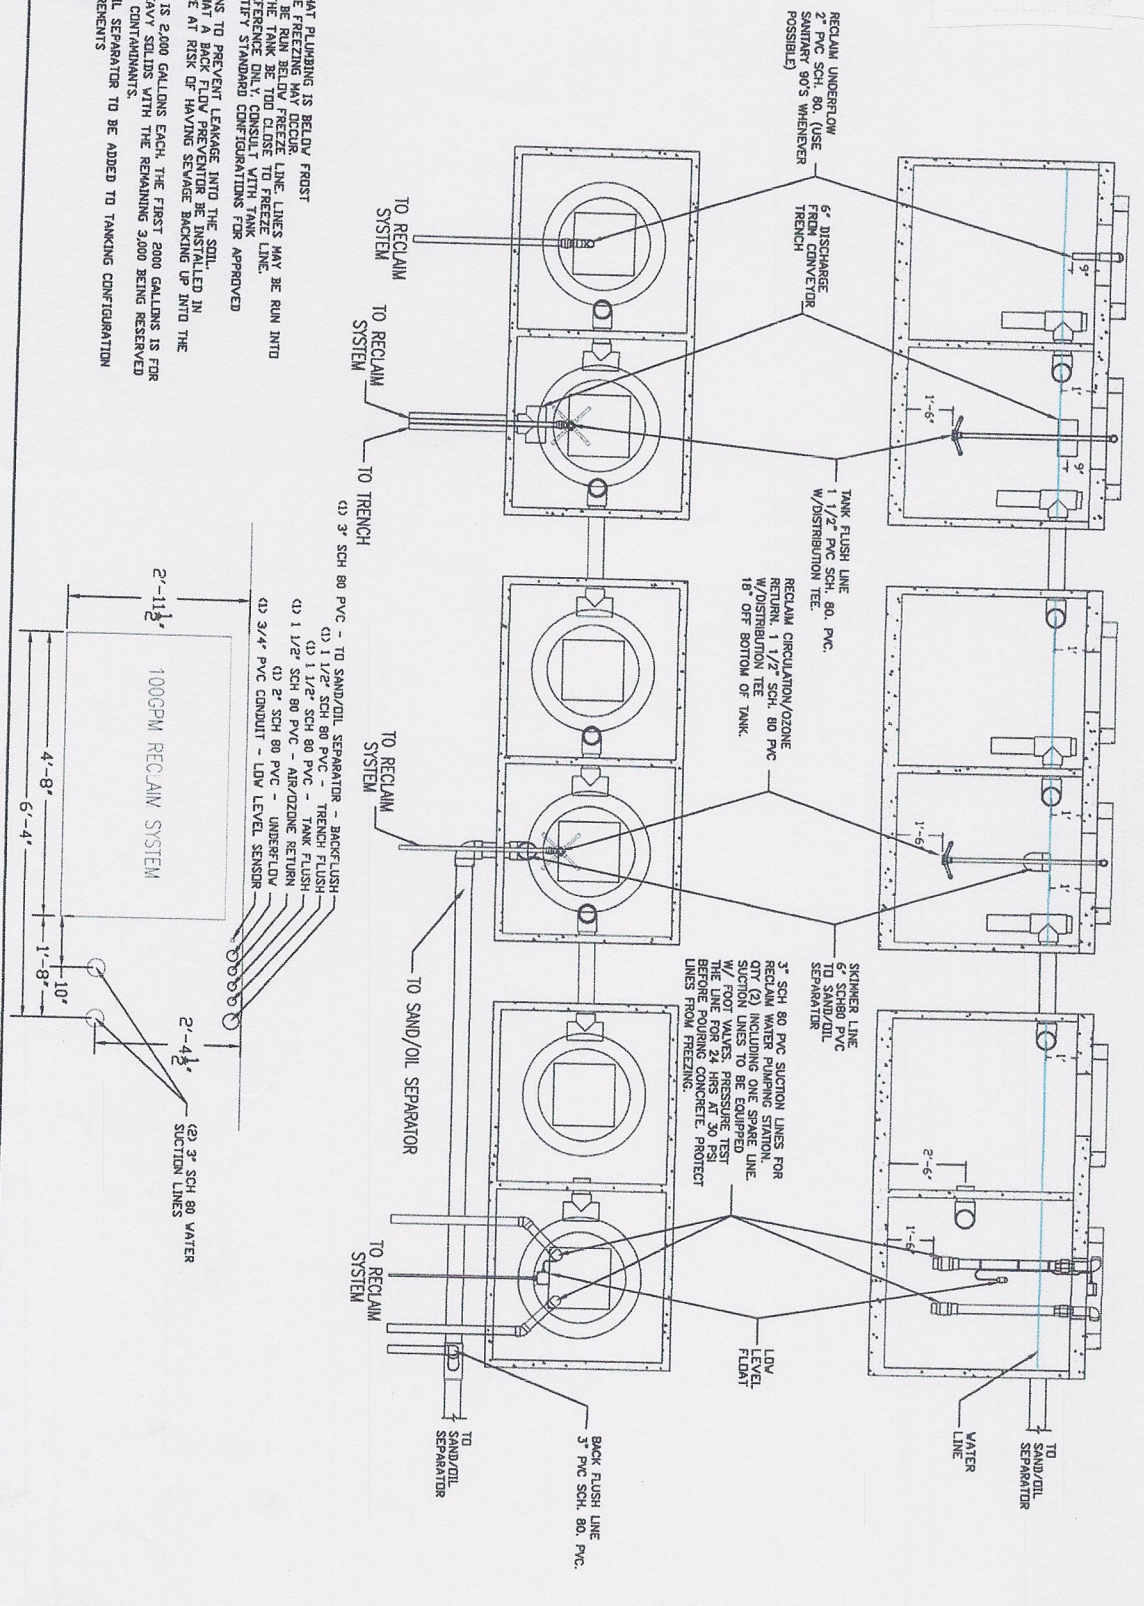

- NOTES**
1. POSITION TANKS SO THAT PLUMBING IS BELOW FROST
 2. PLUMBING LINES WHERE FREEZING MAY OCCUR, SHOULD BE RUN BELOW FREEZE LINE. LINES MAY BE RUN INTO THE TOP OF THE TANK AND CLOSE TO FREEZE LINE.
 3. DRAWINGS ARE FOR REFERENCE ONLY. FIELD CONDITIONS MAY REQUIRE MODIFICATIONS TO IDENTIFY STANDARD CONFIGURATIONS FOR APPROVED MANUFACTURERS TO PREVENT LEAKAGE INTO THE SOIL.
 4. IT IS RECOMMENDED THAT A BACK FLOW PREVENTER BE INSTALLED IN APPLICATIONS THAT ARE AT RISK OF HAVING SEWAGE BACKING UP INTO THE RECLAIM SYSTEM.
 5. APPROX. TANK VOLUME IS 2,000 GALLONS EACH. THE FIRST 2,000 GALLONS IS FOR THE SEPARATION OF HEAVY SOLIDS WITH THE REMAINING 3,000 BEING RESERVED FOR SETTING OF FINE CONTAMINANTS.
 6. AN ADDITIONAL SAND/OIL SEPARATOR TO BE ADDED TO TANKING CONFIGURATION PER CITY/STATE REQUIREMENTS

PROJECT #: VIR-6000TK		SHEET #: VIR-6000TK-01	
DATE: 07/08/21	DRAWN: J.DYAK	6,000 GALLON WATER STORAGE 100 GPM WATER CIRCULATION CAPACITY VELOCITY RECLAIM TANKING	
DATE: 	CHECKED: 	VELOCITY WATER WORKS 530 HANCOCK DR. APPLETON, WI 54913	
DATE: 	APPROVED: 	SCALE: NTS	
DATE: 	DATE: 	PAPER: 24"x36"	
DATE: 	DATE: 	DESCRIPTION: HARD COPY IS INTENDED TO BE 24"x36" WHEN PRINTED SCALE(S) ARE NOT ACCURATE FOR ANY OTHER SIZE.	