

UL-U905; CONT


4/29/24, 2:43 PM
 BXUV/U905 | UL Product IQ
 ATLAS ROOFING CORP — EnergyShield® Ply
 HUNTER PANELS, A DIVISION OF CARLISLE CONSTRUCTION MATERIALS, LLC — "X6i NB", "X6i PY"
 RMAX, A BUSINESS UNIT OF SIMA CORPORATION — "Thermashield-ST", "ECOBASEL", "ThermaBase-CT", "ECOMAKI FR Ply", "ECOMAKI Ply"
 * Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.
 Last Updated on 2023-04-14


The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL Solutions' Follow - Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL Solutions' Follow - Up Service. Always look for the Mark on the product.
 UL Solutions permits the reproduction of the material contained in Product IQ subject to the following conditions: 1. The Guide Information, Assemblies, Connections, Designs, Systems, and/or Certifications (Items) must be presented in their entirety and in a non-misleading manner, without any misquotation of the data (or drawings). 2. The statement "Reprinted from Product IQ with permission from UL Solutions" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "©2024 UL LLC."

https://iq.ulprospector.com/en/profile?e=15133

2/2


UL-WJ-4013

		F Rating — 2 Hr T Rating — 3/4 Hr		W-J-4013
ANSI/UL1479 (ASTM E814)		CAN/ULC S115		
F Rating — 2 Hr		F Rating — 2 Hr		
T Rating — 3/4 Hr		FT Rating — 3/4 Hr		
		FH Rating — 2 Hr		
		FTH Rating — 3/4 Hr		

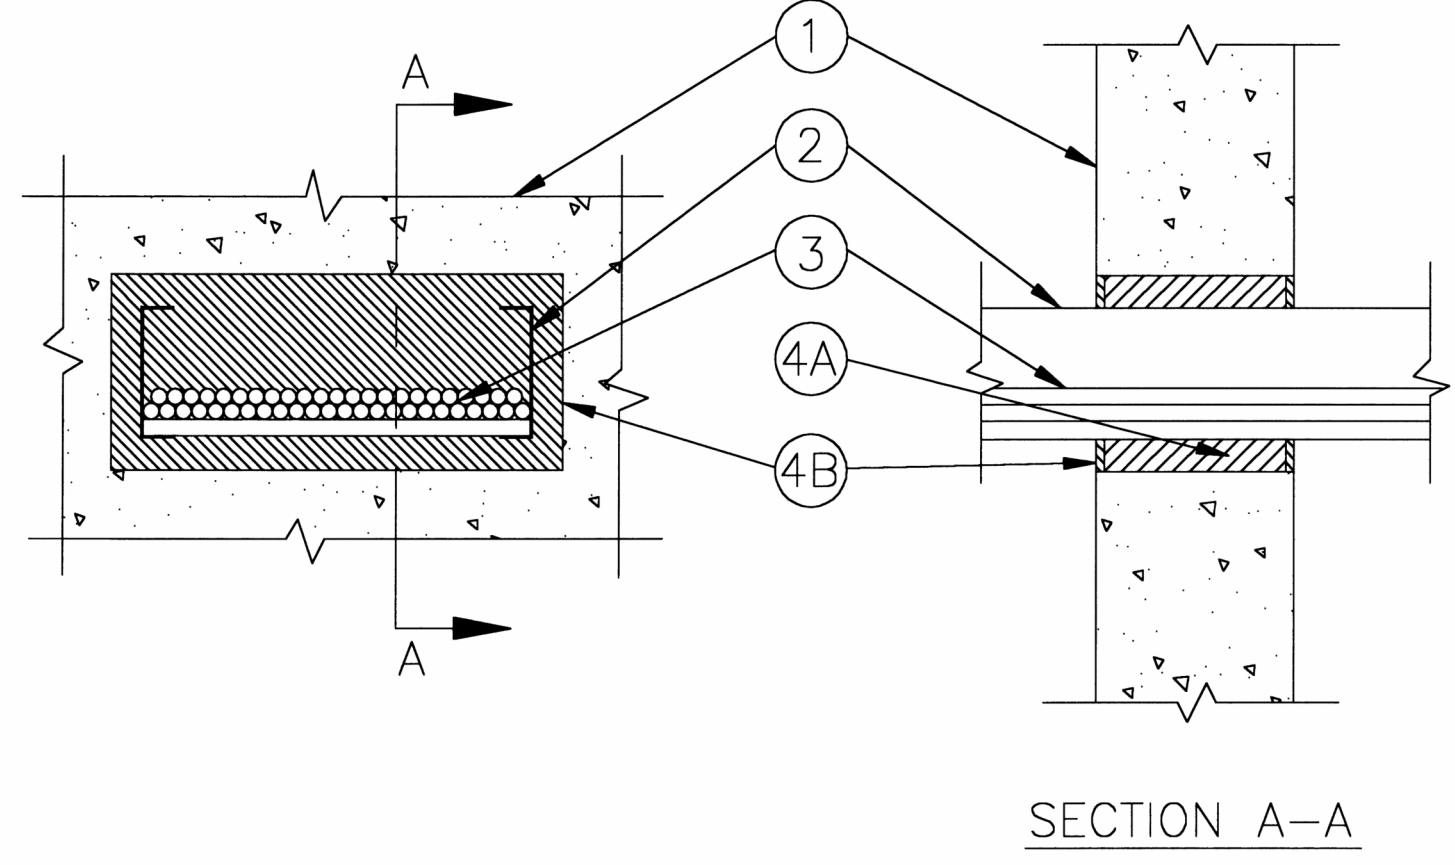

SECTION A-A

- Wall Assembly** — Min 6-1/8 in. (156 mm) thick normal weight or lightweight (100-150 pcf or 1600-2400 kg/m³) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks**. The opening shall be sized to be 2 in. (51 mm) wider and 2 in. (51 mm) higher than the width and depth of the cable tray.
 See **Concrete Blocks (CAZT)** category in the Fire Resistance Directory for names of manufacturers.
- Cable Tray** — Max 12 in. (305 mm) wide by max 4 in. (102 mm) deep open-ladder cable tray with channel-shaped side rails formed of min 0.058 in. (1.5 mm) thick steel or aluminum with 1 in. (25 mm) wide by 1 in. (25 mm) deep rungs spaced 9 in. (229 mm) OC. One cable tray to be installed in the opening. The annular space between the cable tray and the periphery of the opening shall be 1 in. (25 mm). Cable tray to be rigidly supported on both sides of wall assembly.


 Underwriters Laboratories Inc.®
 09/16 (1)

Continued ...

W-J-4013

- Cables** — Aggregate cross-sectional area of cables in cable tray to be max 45 percent of the cross-sectional area of the cable tray based on a max 3 in. (76 mm) cable loading depth within the cable tray. Any combination of the following types and sizes of cables may be used:
 - 1/C 750 kcmil (or smaller) copper conductor aluminum clad or steel clad TEK cable with cross-linked polyethylene (XLPE) insulation.
 - 3/C 350 kcmil (or smaller) copper conductor PVC jacketed aluminum clad or steel clad TEK cable with XLPE insulation.
 - 4/C No. 14 AWG (or smaller) copper conductor PVC aluminum clad or steel clad TEK cable with XLPE insulation.
 - Max 25 pair No. 20 AWG (or smaller) copper conductor cable with PVC jacketed cable with PVC insulation.
 - 1/C 400 kcmil (or smaller) aluminum or copper conductor cable with XLPE insulation.
 - 4/C No. 6 AWG (or smaller) copper conductor cable with PVC jacketed cable with XLPE insulation.
- Firestop System** — The firestop system shall consist of the following:
 - Packing Material** — Min 4-3/8 in. (111 mm) thickness of min 4 pcf (64 kg/m³) mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from both surfaces of wall as required to accommodate the required thickness of fill material (Items B1 and B2).
 - Fill, Void or Cavity Material* — Sealant** — Min 1/8 in. (3.2 mm) thickness of fill material brushed or sprayed on each side of wall assembly, completely covering mineral wool insulation and overlapping a min 1/2 in. (13 mm) onto concrete. At point contact location between penetrant and periphery of the opening, a min 1/2 in. (13 mm) overlap of fill material shall be applied onto penetrant and concrete on both surfaces of the wall.
 Passive Fire Protection Partners — 3500SI, 5100SP
 - Fill, Void or Cavity Material* — Sealant** — As an alternative to Item B1, min 1/4 in. (6 mm) thickness of fill material applied within annulus, flush with both surfaces of wall. Sealant to be forced into interstices of cables to max extent possible.
 Passive Fire Protection Partners — 3600EX, 4100NS, 4800DW

* Bearing the UL Classification Mark
 + Bearing the UL Listing Mark


 Underwriters Laboratories Inc.®
 09/16 (2)

RATED ASSEMBLY GENERAL NOTES

- REFER TO SPECIFICATION SECTION 01 4000 - QUALITY REQUIREMENTS FOR SPECIFIC PROJECT REQUIREMENTS.
- PARTIAL LISTINGS PROVIDED FOR ATTACHMENT REFERENCE ONLY. REFER TO FULL UL LISTING FOR COMPLETE ASSEMBLY REQUIREMENTS.
- DETAILS SHOWN ARE TYPICAL DETAILS. FIELD CONDITIONS MAY VARY AND MAY REQUIRE APPROVAL OF AN ALTERNATE DETAIL. FIELD CONDITIONS AND DIMENSIONS NEED TO BE VERIFIED FOR COMPLIANCE WITH THE DETAILS, INCLUDING BUT NOT LIMITED TO THE FOLLOWING: MINIMUM AND MAXIMUM WIDTH OF JOINTS, TYPE AND THICKNESS OF FIRE-RATED CONSTRUCTION.
- MINIMUM RATING OF THE FIRE STOP ASSEMBLY SHALL MEET OR EXCEED THE HIGHEST RATING OF THE ADJACENT CONSTRUCTION.
- MANUFACTURER'S ENGINEERING JUDGMENT DRAWING SHALL BE ISSUED IF ALTERNATE DETAILS MATCHING THE FIELD CONDITIONS ARE NOT AVAILABLE. DRAWINGS SHALL FOLLOW THE INTERNATIONAL FIRESTOP COUNCIL (IFCI) GUIDELINES FOR EVALUATION OF FIRESTOP SYSTEMS. ENGINEERING JUDGMENTS:
- REFERENCES: 2013 UNDERWRITER'S LABORATORIES FIRE RESISTANCE DIRECTORY VOL 1 & 2, NFPA 101 LIFE SAFETY CODE, NFPA 70 - NATIONAL ELECTRIC CODE, AND ALL GOVERNING LOCAL AND REGIONAL BUILDING CODES.
- FIRESTOP SYSTEM INSTALLATION MUST MEET REQUIREMENTS OF ASTM E 814 (UL 1479) TESTED ASSEMBLIES THAT PROVIDE A FIRE RATING EQUAL TO THAT OF CONSTRUCTION BEING PENETRATED.
- ALL RATED THROUGH-PENETRATION ASSEMBLIES SHALL BE PROMINENTLY LABELED WITH THE FOLLOWING INFORMATION: "ATTENTION: FIRE RATED ASSEMBLY"; "UL SYSTEM#"; "HOUR RATING (F-RATING) AND INSTALLATION DATE (DAY-MONTH-YEAR)". EXAMPLE: 01 JAN, 2024. FOR OUTLET BOXES REQUIRING PROTECTION, USE ONLY WALL OPENING PROTECTIVE MATERIALS, CATEGORY "CLIV" AS CLASSIFIED BY UNDERWRITER'S LABORATORIES, FIRE RESISTANT DIRECTORY-VOLUME 1.

INCLINE ARCHITECTS
 747 SOUTH TEMPLE ST., STE #105
 SALT LAKE CITY, UTAH 84102

STAMP

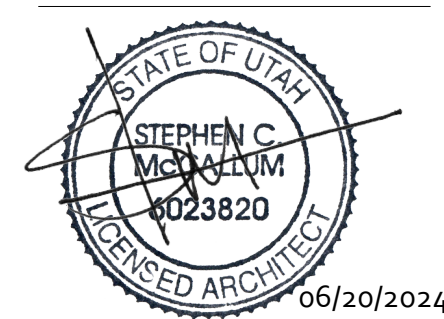

06/20/2024

OWNER
 INTERMOUNTAIN HEALTH
 36 SOUTH STATE STREET, 21ST FLOOR
 SALT LAKE CITY, UTAH 84111

ARCHITECT
 INCLINE ARCHITECTS
 747 SOUTH TEMPLE ST., STE 105
 SALT LAKE CITY, UTAH 84102

CIVIL ENGINEER
 GREAT BASIN ENGINEERING
 5746 S 1475 E, #200
 OGDEN, UTAH 84403

STRUCTURAL ENGINEER
 STRUCTURAL DESIGN STUDIO
 225 EMURRAY HOLLADAY RD, #110
 SALT LAKE CITY, UTAH 84117


MECHANICAL/PLUMBING ENGINEER
 VBFA
 181 S 600 S, #200
 MURRAY, UTAH 84107


ELECTRICAL ENGINEER
 BNA CONSULTING
 4225 LAKE PARK BLVD, SUITE 2157
 WEST VALLEY CITY, UTAH 84120

INTERMOUNTAIN HEALTH
UTAH DIALYSIS CENTER
 2511 S WEST TEMPLE
 SOUTH SALT LAKE, UTAH 84115



UL-WJ-8047


		System No. W-J-8047		WJ 8047
ANSI/UL1479 (ASTM E814)		CAN/ULC S115		
F Rating — 2 Hr		F Rating — 2 Hr		
T Rating — 0 Hr		FT Rating — 0 Hr		
L Rating At Ambient — 5 CFM/sq ft (See Item 6B)		FH Rating — 2 Hr		
L Rating At 400 F — 2 CFM/sq ft (See Item 6B)		FTH Rating — 0 Hr		
		L Rating At Ambient — 5 CFM/sq ft (See Item 6B)		
		L Rating At 400 F — 2 CFM/sq ft (See Item 6B)		

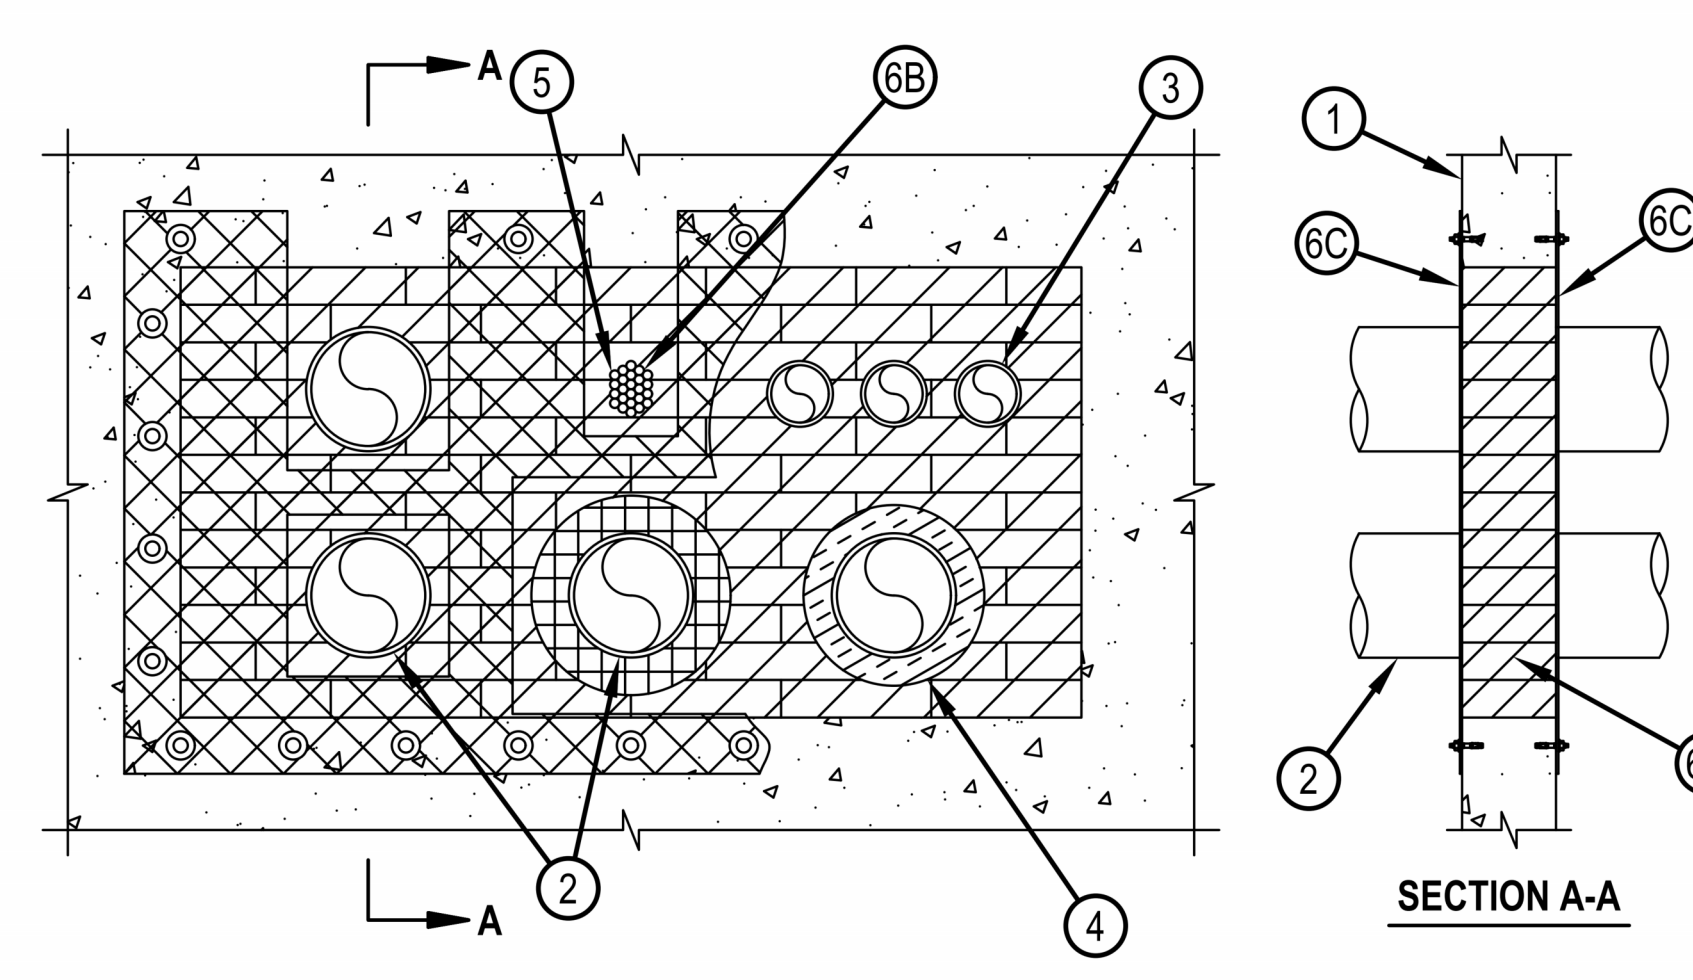

SECTION A-A

System tested with a pressure differential of 2.5 Pa between the exposed and the unexposed surfaces with the higher pressure on the exposed side.


- Wall Assembly** — Min 6 in. (152 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete. Wall may also be constructed of any UL Classified Concrete Blocks*. Maximum area of opening 1152 in² (7432 cm²) with maximum dimension of 48 in. (1219 mm).
- Metallic Penetrants** — One or more metal pipes, conduits or tubing may be installed within the through opening. The space between pipes, conduits or tubing shall be min 1 in. (25 mm) to max 26 in. (660 mm). The space between pipes, conduits or tubing and periphery of opening shall be min 0 in. (point contact) to max 26 in. (660 mm). Pipe, conduit or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipes, conduits or tubing may be used:
 - Steel Pipe — Nom 6 in. (152 mm) diam (or smaller) Schedule 5 (or heavier) steel pipe.
 - Iron Pipe — Nom 6 in. (152 mm) diam (or smaller) cast or ductile iron pipe.
 - Conduit — Nom 6 in. (152 mm) diam (or smaller) rigid steel conduit, nom 4 in. (102 mm) diam (or smaller) electrical metallic tubing (EMT) or nom 1 in. (25 mm) diam (or smaller) flexible steel conduit.
 - Copper Pipe or Tube — Nom 4 in. (102 mm) diam (or smaller) Regular (or heavier) copper pipe or Type L (or heavier) copper tube.

 Hilti Firestop Systems
 Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. June 8, 2022
 Page: 1 of 3

System No. W-J-8047

WJ 8047

- Non-Metallic Penetrants** — One or more non-metallic penetrants may be installed within the through opening. Penetrants to be rigidly supported on both sides of wall assembly. The following types and sizes of non-metallic penetrants may be used:
 - Polyvinyl Chloride (CPVC) Pipe — Max 2 in. (51 mm) diam (or smaller) SDR 13.5 CPVC pipe for use in closed (process or supply). The space between pipes or conduits shall be min 1-1/2 in. (38 mm) to max 26 in. (660 mm). The space between pipes or conduits and periphery of opening shall be min 1-1/2 in. (38 mm) to max 26 in. (660 mm).
 - Rigid Nonmetallic Conduit (RNC)* — Nom 2 in. (51 mm) diam (or smaller) Schedule 40 PVC conduit installed in accordance with the National Electrical Code (NFPA No. 70). The space between pipes or conduits shall be min 1-1/2 in. (38 mm) to max 26 in. (660 mm). The space between pipes or conduits and periphery of opening shall be min 1-1/2 in. (38 mm) to max 26 in. (660 mm).
 - Optical Fiber/Communication Cable Raceways* — Nom 2 in. (51 mm) diam (or smaller) optical fiber raceway, formed from polyvinyl chloride (PVC). Raceway to be installed in accordance with the National Electrical Code (NFPA No. 70). The annular space between the raceway and the periphery of the opening shall be minimum 2 in. (51 mm) to max 26 in. (660 mm). The minimum space between adjacent penetrants shall be 3-1/2 in. (89 mm).
 See Optical Fiber/Communication Cable Raceways (QAZM) category in the Electrical Construction Materials Directory for names of manufacturers.
- Pipe Insulation** — (Optional) — Pipe insulation may be installed on one or more of the metallic pipes or tubes (Items 2A, 2B and 2D). When pipe insulation is used, min space between insulated metallic penetrant and bare metallic pipes, conduits and tubing shall be min 1-1/2 in. (38 mm) and min space to periphery of opening shall be 1 in. (25 mm). The following types of pipe insulations may be used:
 - Pipe and Equipment Covering Materials* — Max 1-1/2 in. (38 mm) thick hollow cylindrical heavy density (min 3.5 pcf or 56 kg/m³) glass fiber units jacketed on the outside with an all service jacket. Longitudinal joints sealed with metal fasteners or factory-applied self-sealing lap tape. Transverse joints secured with metal fasteners or with butt tape supplied with the product.
 - Pipe and Equipment Covering Materials (BRGU) category in the Building Materials Directory for names of manufacturers. Any pipe covering meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.
 - Pipe and Equipment Covering Materials* — Max 1-1/2 or 2 in. (38 or 51 mm) thick hollow cylindrical calcium silicate, min 10 or 14 pcf (160 or 224 kg/m³) respectively, units sized to the outside diam of the pipe or tube. Pipe insulation secured with stainless steel bands or with min No. 18 AWG stainless steel wire spaced max 6 in. (152 mm) from each face of wall and spaced max 12 in. (305 mm) OC.
 - Tube Insulation-Plastics+ — Max 3/4 in. (19 mm) thick acrylonitrile butadiene/polyvinyl chloride (AB/PVC) flexible foam furnished in the form of tubing. This pipe insulation may be installed on metallic pipes or tubes (Items 2A, 2B and 2D) not exceeding nom 2 in. (51 mm) diam. See Plastics+ (QMFZZ) category in the Plastics Recognized Component Directory for names of manufacturers. Any Recognized Component tube insulation material meeting the above specifications and having a UL 94 Flammability Classification of 94-5VA may be used.
- Cables** — (Optional) — Maximum eight 3 in. (76 mm) diam (or smaller) tight bundle of cables installed within the opening and rigidly supported on both surfaces of wall. The space between the cables and periphery of the opening shall be min 1-3/16 in. (30 mm) to 26 in. (660 mm). The space between cables bundles and/or other penetrants shall be min 1-1/2 in. (38 mm) to max 26 in. (660 mm). Any combination of the following types and sizes of cables may be used:
 - 1/C 750 kcmil (or smaller) power cable with EPR polyvinyl chloride (PVC) insulation and jacket.
 - 300 pair - No. 24 AWG telephone cable with PVC insulation and jacket.
 - 24 fiber optic cable with PVC outer and subunit jacket.
 - 3/C No. 12 AWG copper conductor Metal Clad+ cable with PVC insulation.
 - 7/C No. 12 AWG with polyvinyl chloride (PVC) insulation and jacket.
 - F Type R GU59 coaxial cable with PVC outer jacket.
 - 4 pair 22 AWG Cat 5 or Cat 6 data cable.


 Hilti Firestop Systems
 Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. June 8, 2022
 Page: 2 of 3

System No. W-J-8047

WJ 8047

- Firestop System** — The firestop system shall consist of the following:
 - Fill, Void or Cavity Material* — Fire Blocks** — Fire block installed with 5 in. (127 mm) dimension projecting through and centered in opening. Blocks firmly packed to completely fill the area of the opening. In concrete block walls, fire block to be installed to full thickness of wall unless wall is solid filled. Either one or a combination of the block types specified below may be used.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CFS-BL Firestop Block
 - Fill, Void or Cavity Material*** — Fill material to be forced into interstices of cables, and in any voids/openings between blocks, around penetrants, and between blocks and periphery of opening to the maximum extent possible on both surfaces of wall.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-ONE MAX Intumescent Sealant, CP618 Firestop Putty Stick, CP 660 Firestop Foam or CP 620 Fire Foam. Note: CP 618, CP 620, and CP 660 not suitable for use with CPVC (Item 3A). (Note: L Ratings apply only when FS-ONE MAX Intumescent Sealant is used.)
 - Wire Mesh** — When the annular space exceeds 4 in. (102 mm) between penetrants and/or to the periphery of the opening, max 2 by 2 in. (51 by 51 mm) wire fencing shall be used to keep the blocks in place. The wire fencing shall be fabricated from min No. 16 SWG (0.060 in. or 1.5 mm) galv steel wire. The wire is cut to fit the contour of the penetrating item with a min 3 in. (76 mm) lap beyond the periphery of the opening. Wire fencing secured to both surfaces of wall by means of 1/4 in. diam by 1 in. long steel concrete anchors and 1/4 in. by 1-1/2 in. diam fender washers spaced max 8 in. (203 mm) OC. The joints within the wire mesh shall overlap a min of 2 in. (51 mm) and be secured together by means of No. 16 AWG steel wire spaced 8 in. (203 mm) OC.

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.
 + Bearing the UL Listing Mark

 Hilti Firestop Systems
 Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. June 8, 2022
 Page: 3 of 3

INCLINE: 23-028
 OWNER: 10017411

20 JUN 2024

BID SET

RATED ASSEMBLIES

A0.43