

ADDENDUM #1

Date Issued:	Jan 19, 2026
Project:	Intermountain Health Layton Hospital Pathology Lab and Locker Room Remodel 201 W Layton Parkway Layton, Utah 84041
Addendum Number:	1

The Contractors submitting proposals on the above-captioned project shall be governed by the following addendum, changes and explanations to the drawings and specifications and shall submit their bids in accordance therewith.


Item Number	General Items Description
1	<p>Question 1: It has come to our attention that the Siemens fire alarm devices are no longer being made. Will there be added testing required for different modules for the new devices.</p> <p>Response 1: That is correct. The current modules supporting the system at Layton Hospital are now listed as obsolete. This will require the procurement of a newer model module, Siemens to update the software to work with that new model, and retest of a portion of the entire system. We would ask that all bidders consider the costs associated with this process.</p>
2	<p>Question 2: Sheet M223. Does the relocated VAV VR-A2-85 need mechanical piping? Size?</p> <p>Response 2: The relocated VAV VR-A2-85 is cooling only and requires no mechanical piping.</p>
3	<p>Question 3: Drawing EP101 indicates (2) "HC" designations for ADA push button rough in. There is no detail provided for this scope. Should we just include a stub to accessible ceiling? What is "LX" on the electrical ceiling demo sheet?</p> <p>Response 3: They will need to provide a rough in and push plates for that door. Drawings to be updated to show the push plate detail. See attached Electrical Addendum #1.</p>
4	<p>Question 4: This panel is being called to be removed. It appears to be serving the existing grossing table. Do these parts need to be returned to the hospital? Also will the new grossing table need a panel for it? Re: Sheets A121 note 2.19 EDP101</p> <p>Response 4: Yes, the LX panel and components to be returned to owner. They will not be needed for new grossing table connection.</p>
5	The ICRA level for this project has been changed to Level 5. This requires the containment to extend to deck if ceiling tiles are being removed.
6	This project will not be phased. The entire area of the project will be available for the duration of the project.

Item Number	General Items Description
7	The existing direct exhaust vent currently used for the fume hood within the pathology space will be available to use for project ventilation under the assumption that the minimum negative pressure is achieved.

Sheet Number	Drawings
Architectural Drawings	
G002	ICRA portion updated to reflect Level 5. Drawing index updated to remove sheet A111.
A111	Sheet removed from set as this project will not be phased.
A121	Added note: "NOTE: RELOCATE MEN'S LOCKER ROOM TO STAFF BREAK ROOM LOCKERS FOR THE DURATION OF CONSTRUCTION."
Electrical Drawings	
EE501	Detail added.

Attachments:

G002, A121, Electrical Addendum #1

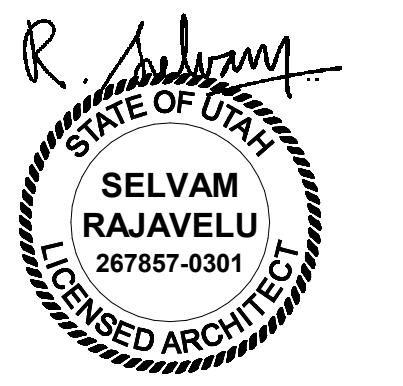
INTERIM LIFE SAFETY MEASURES

IMPLEMENTATION OF INTERIM LIFE SAFETY MEASURES (ILSM) IS REQUIRED IN OR ADJACENT TO ALL CONSTRUCTION AREAS AND THROUGHOUT CONSTRUCTION AREAS WITH EXISTING LSC DEFICIENCIES. ILSM APPLY TO ALL PERSONNEL, INCLUDING CONSTRUCTION WORKERS, MUST BE IMPLEMENTED UPON PROJECT DEVELOPMENT, AND CONTINUOUSLY ENFORCED THROUGH PROJECT COMPLETION. ILSM ARE INTENDED TO PROVIDE A LEVEL OF LIFE SAFETY COMPARABLE TO THAT DESCRIBED IN CHAPTERS 7 THROUGH 7.3 AND THE APPROPRIATE OCCUPANCY CHAPTERS OF THE LSC. EACH ITEM LISTED BELOW IS A CRITICAL ELEMENT OF THE ILSM. PROCEDURES, EXCEPT AS STATED BELOW, FREQUENCIES FOR INSPECTION, TESTING, TRAINING, AND ILSM CONSIST OF THE FOLLOWING ACTIONS:

- ENSURING EXITS PROVIDE FREE AND UNOBSTRUCTED EGRESS. PERSONNEL SHALL RECEIVE TRAINING IF ALTERNATIVE EXITS MUST BE DESIGNATED. BUILDINGS OR AREAS UNDER CONSTRUCTION MUST MAINTAIN ESCAPE FACILITIES FOR CONSTRUCTION WORKERS AT ALL TIMES. MEANS OF EGRESS IN CONSTRUCTION AREAS MUST BE INSPECTED DAILY.
- ENSURING FREE AND UNOBSTRUCTED ACCESS TO EMERGENCY DEPARTMENTS/ SERVICES AND FOR EMERGENCY FORCES.
- ENSURE FIRE ALARM, DETECTION, AND SUPPRESSION SYSTEMS ARE NOT IMPAIRED. A TEMPORARY, BUT EQUIVALENT, SYSTEM SHALL BE PROVIDED WHEN ANY FIRE SYSTEM IS IMPAIRED. TEMPORARY SYSTEM MUST BE INSPECTED AND TESTED MONTHLY.
- ENSURING TEMPORARY CONSTRUCTION PARTITIONS ARE SMOKE TIGHT AND BUILT OF NONCOM OR LIMITED COMBUSTIBLE MATERIALS THAT WILL NOT CONTRIBUTE TO THE DEVELOPMENT OR SPREAD OF FIRE.
- PROVIDING ADDITIONAL FIRE-FIGHTING EQUIPMENT AND USE TRAINING OF PERSONNEL.
- PROHIBITING SMOKING IN ACCORDANCE WITH MA.I.3.15 AND IN OR ADJACENT TO ALL CONSTRUCTION AREAS.
- DEVELOPING AND ENFORCING STORAGE, HOUSEKEEPING, AND DEBRIS REMOVAL PRACTICES THAT REDUCE THE FLAMMABLE AND COMBUSTIBLE FIRE LOAD OF THE BUILDING TO THE LOWEST LEVEL NECESSARY FOR DAILY OPERATIONS.
- CONDUCTING A MINIMUM OF TWO FIRE DRILLS PER SHIFT PER QUARTER.
- INCREASING HAZARD SURVEILLANCE OF BUILDINGS, GROUNDS, AND EQUIPMENT WITH SPECIAL ATTENTION TO EXCAVATIONS, CONSTRUCTION AREAS CONSTRUCTION STORAGE, AND FIELD OFFICES.
- TRAINING PERSONNEL WHEN STRUCTURAL OR COMPARTMENT FEATURES OF FIRE SAFETY ARE COMPROMISED.
- CONDUCTING ORGANIZATION WIDE SAFETY EDUCATION PROGRAMS TO ENSURE AWARENESS OF ANY LSC DEFICIENCIES, CONSTRUCTION HAZARDS, AND THESE ILSM.

PROJECT DESCRIPTION

THIS PROJECT INCLUDES THE FOLLOWING SCOPE OF WORK:

- EXPANDING THE EXISTING PATHOLOGY LAB ON LEVEL 2 INTO THE EXISTING MEN'S LOCKER ROOM TO ACCOMMODATE A NEW VENTED CROSSING TABLE.
- EXPANDING THE MEN'S LOCKER ROOM INTO THE EXISTING BODY HOLDING ROOM.
- NEW FINISHES AND CASEWORK IN BOTH AREAS.

APPROVALS

Approvers Name, Title	Date

INFECTION CONTROL RISK ASSESSMENT
CONSTRUCTION ACTIVITY TYPE

Type D:
Major demolition and construction activities.
Includes, but not limited to:
• Removal or replacement of building system component(s).
• Removal/installation of drywall partitions.
• Invasive large-scale new building construction.
• Renovation work in two or more rooms.

INFECTION CONTROL RISK GROUP

High:

- Laboratory

CONSTRUCTION CLASS

Construction Activity Type:

IC Risk Group	Type A	Type B	Type C	Type D
Lowest	Class I	Class II	Class III	Class IV
Medium	Class I	Class II	Class III	Class V
High	Class I	Class II	Class IV	Class V
Highest	Class III	Class IV	Class V	Class V

INFECTION CONTROL PROTOCOLS

During Construction (Class V):

- Construct and contain critical barriers meeting NFPA 241 requirements. If drywall is removed, it must extend to the ceiling, or if ceiling tile is removed, to the deck above, and all penetrations through the barrier shall meet the appropriate fire rating requirements.
- All (plastic or hard) barrier construction activities must be completed in a manner that prevents dust release. Plastic barriers must be effectively affixed to ground using conductive tape, zip ties, or duct tape. Apply tape that will not leave a residue to any gaps between barrier, ceiling, and floor.
- Seal all penetrations in containment barriers, anteroom barriers, including floors and ceiling using approved materials (UL schedule firestop if applicable for barrier type).
- Remove or isolate return air diffusers to avoid dust entering the HVAC system.
- Remove or isolate the supply air diffusers to avoid positive pressurization of the space.
- Maintain negative pressurization of the entire workspace using HEPA exhaust air systems directed outdoors. Exhaust discharged directly to the outdoors that is 25 feet or greater from entrances, anterooms and windows does not require HEPA filtering.
- If exhaust is directed indoors, then the system must be HEPA filtered.
- Prior to start of work, HEPA filtration must be verified by particulate measurement and must not alter or change airflow/pressure relationships in other areas.
- Exhaust into shared or recirculating HVAC systems, or other shared exhaust systems (bathroom exhaust) is not acceptable.
- Install device on exterior of work containment to continually monitor negative pressurization. To assure proper pressure is continuously maintained, it is recommended that the device(s) have a visual pressure indicator.
- Contain work area in the interior of the barrier.
- Nonporous/smooth and cleanable containers (with a hard lid) must be used to transport trash and debris from the construction areas. These containers must be damp-wiped cleaned and free of visible dust/debris before leaving the contained work area.
- Work areas must be clean and free of visible dust before leaving the work area anteroom.
- Install an adhesive (dust collection) mat at entrance of contained work area based on facility policy. Adhesive mats must be changed routinely and when visibly soiled.
- Consider collection of particulate data during work to monitor and ensure that contaminants do not enter the occupied spaces. Routine collection of particulate samples may be used to verify HEPA filtration efficiency.

Upon Completion (Class V):


- Work Area Cleaning:
 - Clean work areas including all environmental surfaces, high horizontal surfaces, and flooring materials.
 - Check oil supply and return air registers for dust accumulation on upper surfaces as well as air diffuser surfaces.
- Removal of Critical Barriers:
 - Critical barriers must remain in place during all work involving drywall removal, creation of dust and activities beyond simple touch-up work. The barrier may NOT be removed until a work area cleaning has been performed.
 - All (plastic or hard) barrier removal activities must be completed in a manner that prevents dust release. Use the following precautions when removing critical barriers:
 - Completely remove screws and painter tape.
 - If dust will be generated during screw removal, use hand-held HEPA vacuum.
 - Drywall cutting is prohibited during removal process.
 - Check all stud tracks with HEPA vacuum before removing outer hard barrier.
 - Use a plastic barrier to enclose area if dust could be generated.
- Negative Air Requirements:
 - The use of negative air must be designed to remove contaminants from the work area.
 - Leave negative air devices must remain operational at all times and in place for a period after completion of dust creating activities to remove contaminants from the work area and before removal of critical barriers.
- HVAC systems:
 - Upon removal of critical barriers, remove isolation of HVAC system in areas where work is being performed.
 - Verify that HVAC systems are clean and operational.
 - Verify the HVAC systems meets original airflow and air exchange design specifications.

DEFERRED SUBMITTALS

THE CONTRACTOR SHALL SUBMIT THE FOLLOWING TO THE BUILDING OFFICIAL FOR REVIEW WITH AN ACCOMPANYING LETTER FROM THE ARCHITECT STATE THAT THE CONTENTS OF THE SUBMITTAL ARE IN CONFORMANCE WITH THE DESIGN. WORK RELATED TO THE DEFERRED SUBMITTAL IS NOT TO COMMENCE UNTIL THE BUILDING OFFICIAL HAS APPROVED THE SUBMITTAL.

- DETAILS AND ENGINEERING CALCULATIONS FOR ALL NONSTRUCTURAL COMPONENTS THAT ARE PERMANENTLY ATTACHED TO STRUCTURES AND THEIR SUPPORTS AND ATTACHMENTS. THESE SHALL BE DESIGNED AND CONSTRUCTED TO RESIST THE EFFECTS OF EARTHQUAKE MOTIONS IN ACCORDANCE WITH ASCE 7-05, REFERENCE IBC SECTION 1613.1. THIS INCLUDES:
 - ELECTRICAL SYSTEMS
 - MECHANICAL SYSTEMS
 - PLUMBING SYSTEMS
 - DECORATIVE ARCHITECTURAL COMPONENTS.

- DETAILS AND ENGINEERING CALCULATIONS FOR THE FIRE SPRINKLER AND FIRE DETECTION SYSTEMS, WHICH ARE TO BE DESIGN-BUILD BY THE CONTRACTOR TO COMPLY WITH NFPA 13 AND SHALL INCLUDE:
 - FIRE ALARM PLANS (INCLUDING CO DETECTOR LOCATIONS)
 - AUTOMATIC FIRE SPRINKLER PLANS
 - HOOD FIRE SUPPRESSION
 - CLASS K FIRE EXTINGUISHER LOCATION(S)

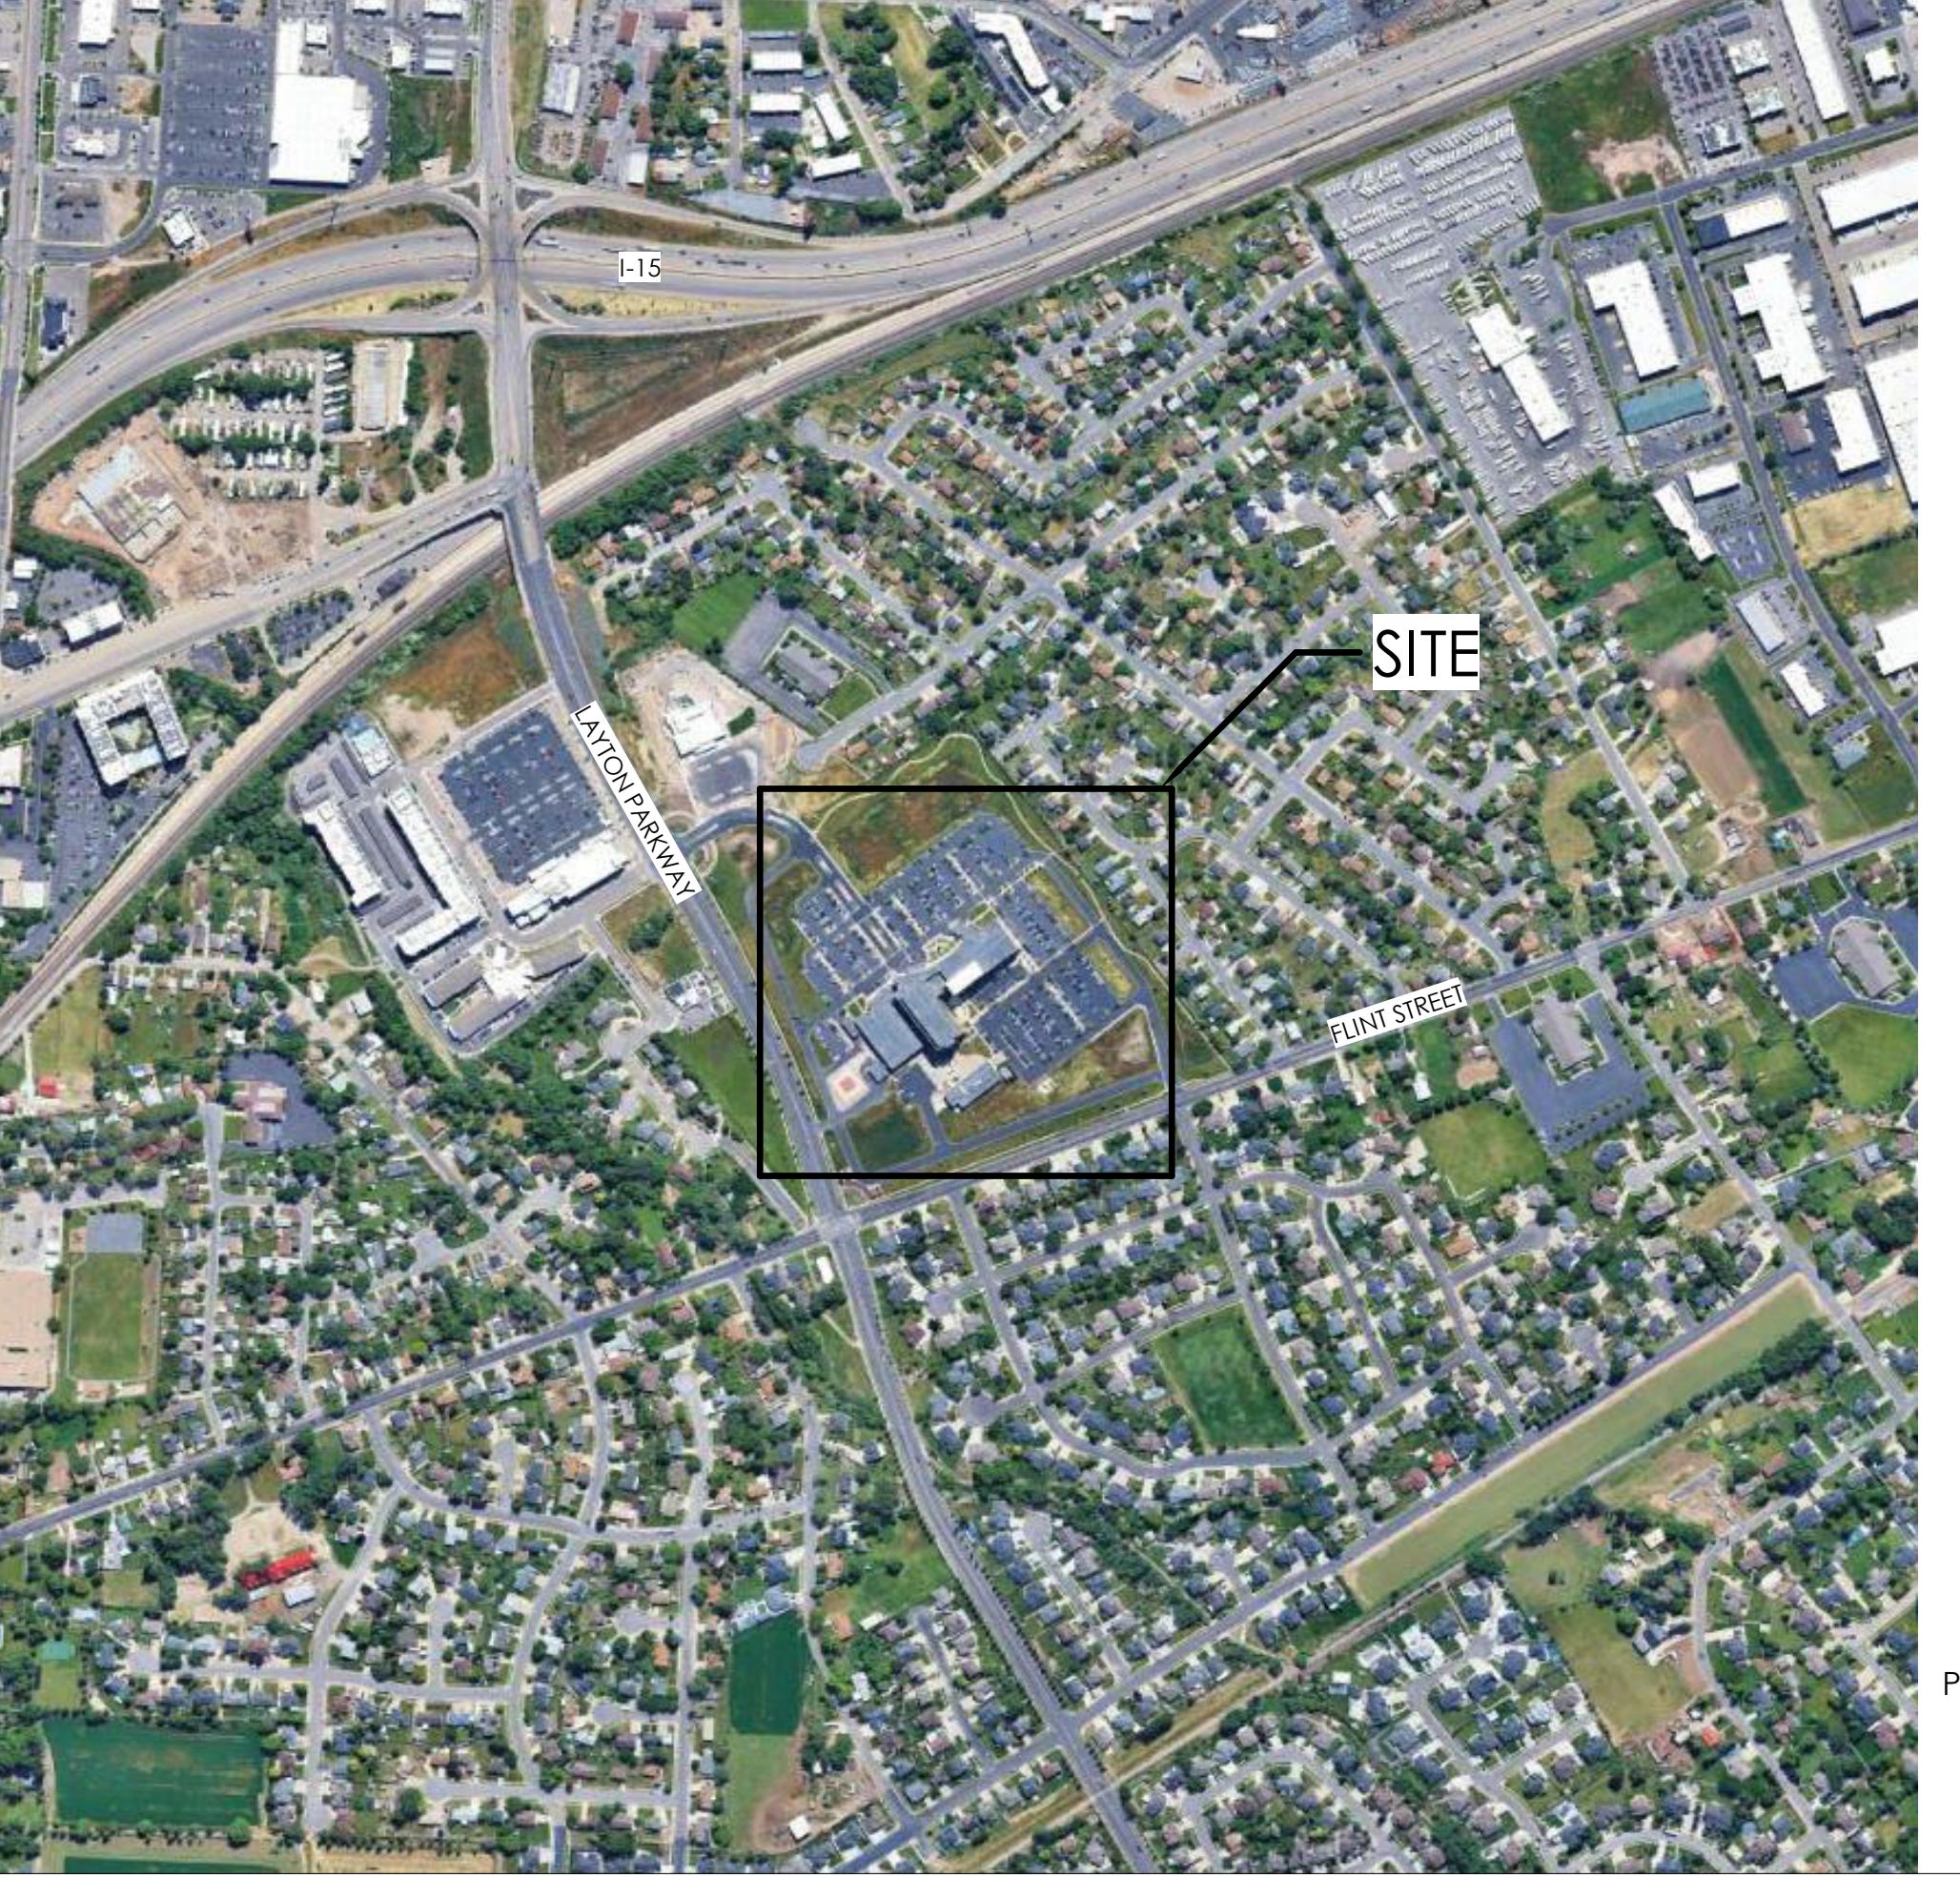VICINITY MAP

DRAWING INDEX
GENERAL

G001 Cover Sheet
G002 General Information
G003 General Information
G004 American National Standard Institute Requirements
G005 General Legend & Notes
G121 Code Compliance Plan Level 2 - Overall

ARCHITECTURAL

A121 Demolition Floor Plan Level 2 - Enlarged
A122 Demolition Ceiling Plan Level 2 - Enlarged
A123 Floor Plan Level 2 - Enlarged
A124 Dimension Floor Plan Level 2 - Enlarged
A125 FF&E Plan Level 2 - Enlarged
A126 Reflected Ceiling Plan Level 2 - Enlarged
A127 Finish Plan Level 2 - Enlarged

A251 Interior Elevations

A501A Wall Types
A502A Wall Details
A503A Ceiling Details
A504A Door & Window Details
A505A Cabinet Legend & Details
A505B Cabinet Details
A601A Door & Finish Schedule

MECHANICAL

M001 HVAC Title Sheet
M120 Mechanical Zoning Plan Level 2 - Enlarged
M123 Mechanical Plan Level 2 - Enlarged
M223 Mechanical Piping Plan Level 2 - Enlarged
M501 Mechanical Details & Schedules

PLUMBING

P001 Plumbing Title Sheet
P113 Plumbing Plan Level 1 - Enlarged
P123 Plumbing Plan Level 2 - Enlarged
P501 Plumbing Details & Schedules

ELECTRICAL

EE001 Electrical Cover Sheet
EE002 Telecom Schedules and Notes
EE004 Auxiliary Schedules and Notes
EE050 Electrical Details
EE701 Typical Mounting Details

ED110 Level 2 Ceiling Demolition Plan

EDP101 Level 2 Electrical Demolition Plan

EP100 Level 2 Overall Power Plan

EP101 Level 2 Power Plan

EP551 Telecom Details

EP650 Telecom Conduit & Cable Riser Diagram

EL101 Level 2 Lighting Plan

EL601 Interior Lighting Fixture Schedule


EY101 Level 2 Auxiliary Plan

EY650 Auxiliary Details & Risers

DEFINITIONS

THE CONTRACTOR SHALL SUBMIT THE FOLLOWING TO THE BUILDING OFFICIAL FOR REVIEW WITH AN ACCOMPANYING LETTER FROM THE ARCHITECT STATE THAT THE CONTENTS OF THE SUBMITTAL ARE IN CONFORMANCE WITH THE DESIGN. WORK RELATED TO THE DEFERRED SUBMITTAL IS NOT TO COMMENCE UNTIL THE BUILDING OFFICIAL HAS APPROVED THE SUBMITTAL.

- GENERAL: BASIC CONTRACT DEFINITIONS ARE INCLUDED IN THE CONDITIONS OF THE CONTRACT.
- "APPROVED": WHEN USED TO CONVEY ARCHITECT'S ACTION ON CONTRACTOR'S SUBMITTALS, APPLICATIONS AND REQUESTS. "APPROVED" IS LIMITED TO ARCHITECT'S DUTIES AND RESPONSIBILITIES AS STATED IN THE CONDITIONS OF THE CONTRACT.
- "DIRECTED": A COMMAND OR INSTRUCTION BY ARCHITECT. OTHER TERMS INCLUDING "REQUESTED," "AUTHORIZED," "SELECTED," "REQUIRED" AND "PERMITTED" HAVE THE SAME MEANING AS "DIRECTED."
- "INDICATED": REQUIREMENTS EXPRESSED BY GRAPHIC REPRESENTATIONS OR IN WRITTEN FORM ON DRAWINGS, IN SPECIFICATIONS, AND IN OTHER CONTRACT DOCUMENTS. OTHER TERMS INCLUDING "SHOWN," "NOTED," "SCHEDULED," AND "SPECIFIED" HAVE THE SAME MEANING AS "INDICATED."
- "REGULATIONS": LAWS, ORDINANCES, STATUTES, AND FULFUL ORDERS ISSUED BY AUTHORITIES OF GOVERNMENT, STATE, COUNTY, CITY, TOWNSHIP, AND VILLAGES AND AGREEMENTS WITHIN THE CONSTRUCTION INDUSTRY THAT CONTROL PERFORMANCE OF THE WORK.
- "FURNISHED": SUPPLIED AND DELIVERED TO PROJECT SITE, READY FOR UNLOADING, UNPACKING, ASSEMBLY, INSTALLATION, AND SIMILAR OPERATIONS.
- "INSTALL": UNLOAD, TEMPORARILY STORE, UNPACK, ASSEMBLE, ERECT, PLACE, ANCHOR, APPLY, WIRE TO DIMENSIONS, FINISH, CURE, PROTECT, CLEAN, AND SIMILAR OPERATIONS AT THE CONSTRUCTION SITE.
- "PROVIDE": DESIGN AND INSTALL, COMPLETE AND READY FOR THE INTENDED USE.
- "PROJECT SITE": SPACE AVAILABLE FOR PERFORMING CONSTRUCTION ACTIVITIES. THE EXTENT OF PROJECT SITE IS SHOWN ON DRAWINGS AND MAY OR MAY NOT BE IDENTICAL WITH THE DESCRIPTION OF THE LAND ON WHICH PROJECT IS TO BE BUILT.

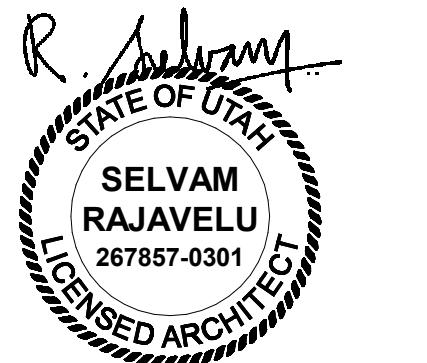

Intermountain Health
Layton Hospital
Pathology and Locker Room Remodel

201 W Layton Parkway
Layton, Utah 84041

KEYED NOTES

01.01 LINE OF TRANSITION BETWEEN DIFFERENT FLOOR FINISHES.
01.03 DASHED LINE INDICATES FLOOR TO CEILING DUST PROOF CONSTRUCTION BARRIER TO PREVENT DUST AND DIRT MIGRATION AND TO SEPARATE AREAS OCCUPIED BY THE OWNER FROM FUMES AND NOISE. CONSTRUCTION BARRIER TO SPAN FROM FINISHED FLOOR TO CEILING ABOVE, PRE-FABRICATED RIGID (ICRA) BARRIER, 1/2" AS SWALLOW LIP, 1/2" THICK, 3/16" X 3/16" X 3/16" 20 GA. MTL STUDS, 1/4" O.C. MINIMUM, 5/8" X 5/8" X 1/2" GYPSUM BOARD, BOTH SIDES WOULD BE ACCEPTABLE. TAPE & SEAL ALL JOINTS AND OPENINGS. SEAL JOINTS AT PERIMETER. PAINT WALL ON EXISTING CORRIDOR SIDE. ICRA PARTITION TO BE EQUIPPED WITH A 4'x8' LOCKABLE MAN DOOR WITH STICKY MAT ON BOTTOM. DOOR COULD BE SWINGING OR SLIDING. DETERMINE EXACT LOCATION OF CONSTRUCTION BARRIER. OTHER ICRA PERMITS MAY BE REQUIRED. COORDINATE WITH FACILITIES AND INFECTION PREVENTION.

02.01 WALL EXISTING TO REMAIN. PROTECT WALL FROM DAMAGE DURING CONSTRUCTION.

02.02 WALL EXISTING INDICATED WITH DASHED LINE TO BE REMOVED.

02.03 WALL FINISH (WALL COVERING, WALL PROTECTION SHEET, WANSBOT, CORNER GUARD, ACOUSTICAL PANELS, ETC.) EXISTING TO REMAIN. PROTECT WALL FINISH FROM DAMAGE DURING CONSTRUCTION.

02.04 WALL FINISH EXISTING INDICATED IN THIS AREA TO BE REMOVED.

02.05 DOOR, EXISTING TO REMAIN. PROTECT DOOR FROM DAMAGE DURING CONSTRUCTION.

02.06 DOOR AND DOOR FRAME, EXISTING INDICATED WITH DASHED LINE TO BE REMOVED. DOOR FRAME SHALL BE REMOVED UNLESS NOTED OTHERWISE.

02.07 CABINET (AND COUNTERTOP, WHERE OCCURS), EXISTING TO REMAIN. PROTECT CABINET AND COUNTERTOP FROM DAMAGE DURING CONSTRUCTION.

02.08 CABINET EXISTING INDICATED WITH DASHED LINE BELOW COUNTERTOP TO BE REMOVED.

02.11 FLOOR COVERING, EXISTING TO REMAIN. PROTECT FLOOR COVERING FROM DAMAGE DURING CONSTRUCTION.

02.12 FLOOR COVERING, EXISTING INDICATED IN THIS AREA TO BE REMOVED. COORDINATE WITH REMOVAL WITH FINISH FLOOR PLANS FOR NEW FLOOR COVERING LOCATIONS AND TRANSITION LINE BETWEEN EXISTING AND NEW FLOOR COVERINGS.

02.19 PANEL, EXISTING INDICATED WITH DASHED LINE TO BE REMOVED. INFILL WALL AS REQUIRED.

02.20 EQUIPMENT, EXISTING INDICATED WITH DASHED LINE TO BE RELOCATED BY OWNER.

02.21 HOOD, EXISTING INDICATED WITH DASHED LINE TO BE REMOVED AND RETURNED TO OWNER. CAP VENT ABOVE CEILING GRID. SEE MECHANICAL DRAWINGS.

02.22 HOOD, EXISTING INDICATED WITH DASHED LINE TO BE REMOVED AND RETURNED TO OWNER. PREPARE VENT ABOVE FOR NEW CROSSING TABLE. SEE MECHANICAL DRAWINGS.


02.24 LOCKER AND BASE CABINET, EXISTING INDICATED WITH DASHED LINE TO BE REMOVED AND RELOCATED. SEE NEW FLOOR PLAN FOR NEW LOCATION OF LOCKER AND BASE CABINET.

02.25 LOCKER AND BASE CABINET, EXISTING TO REMAIN. PROTECT FROM DAMAGE DURING CONSTRUCTION.

02.26 BENCH, EXISTING INDICATED WITH DASHED LINE TO BE REMOVED.

02.27 BENCH, EXISTING TO REMAIN. PROTECT BENCH FROM DAMAGE DURING CONSTRUCTION.

02.28 CARD READER, EXISTING TO BE REMOVED. REPAIR WALL AND PAINT TO MATCH EXISTING.

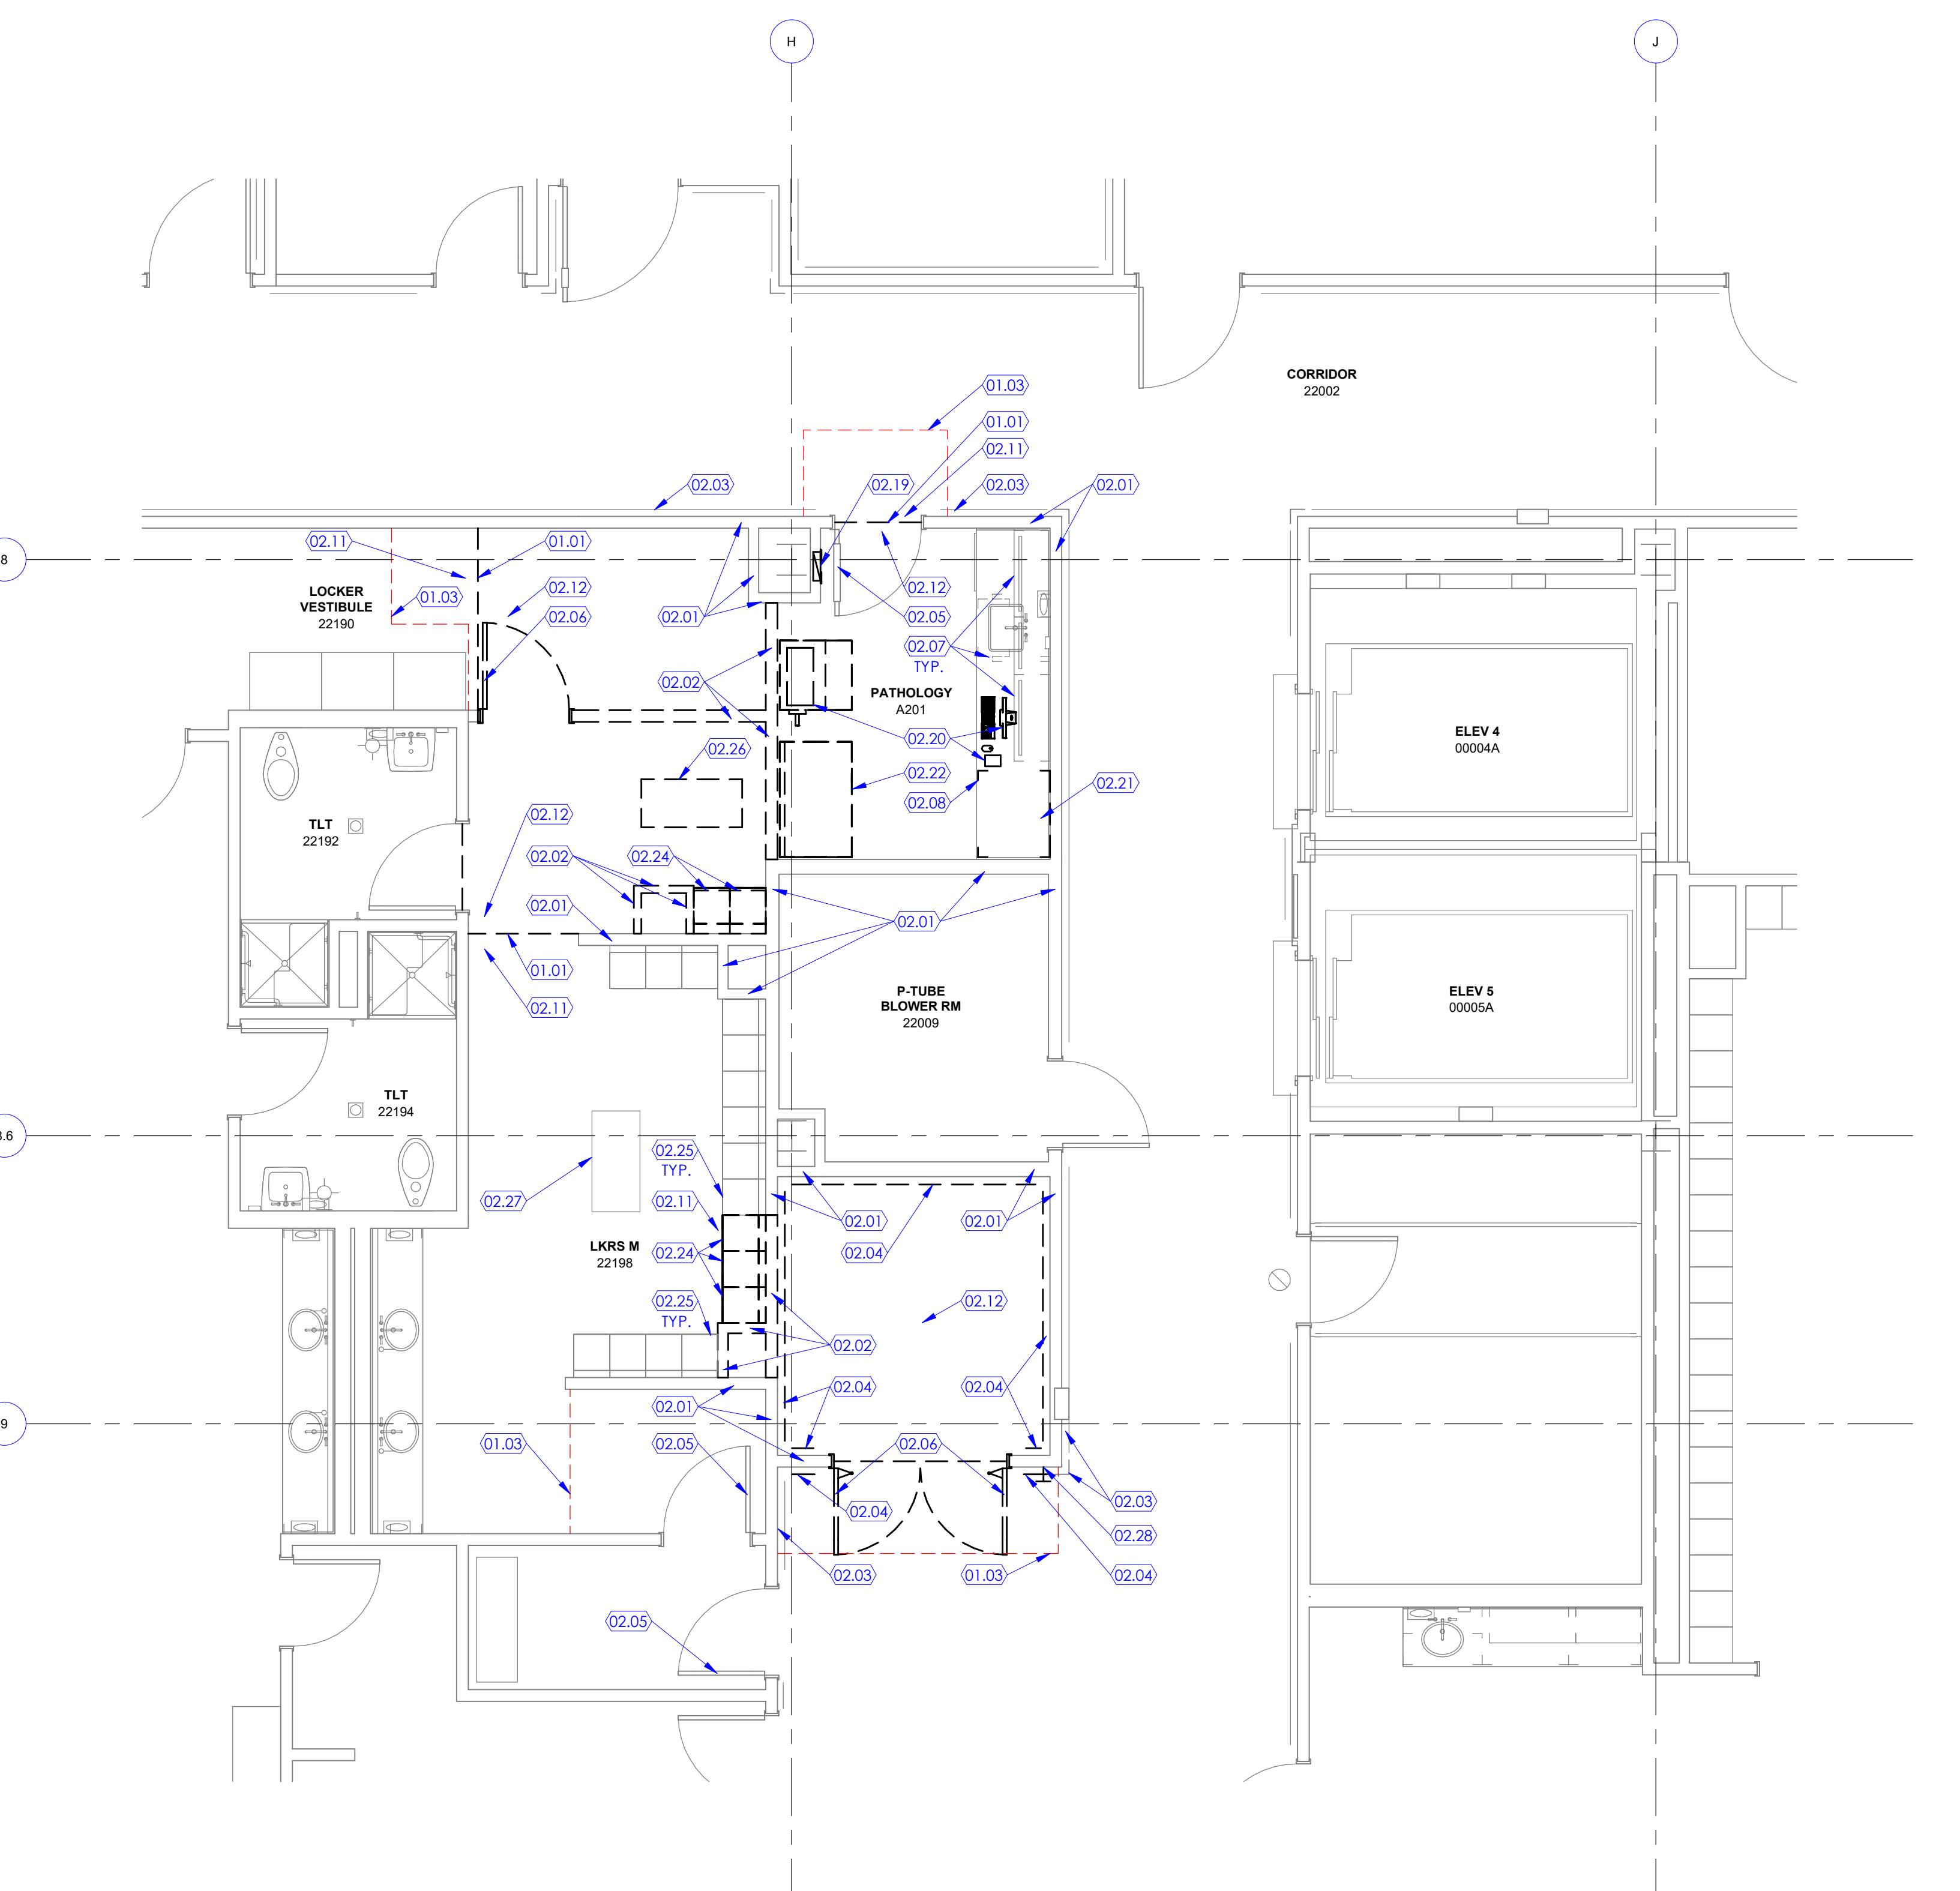

GENERAL NOTES

A. SEE SHEET G003 AND G005 FOR SYMBOLS, GENERAL NOTES AND LEGEND.
B. SEE SHEET A505A FOR CABINET LEGEND.
C. SEE SHEET A601A FOR DOOR SCHEDULE.
D. SEE SHEET A601A FOR FINISH SCHEDULE AND GENERAL NOTES.

Demolition
Floor Plan
Level 2 -
Enlarged

A121

Electrical Addendum #1

Date: January 19, 2026
To: Ashley Sudbury
Company: NJRA
Job: IH Layton Pathology & Locker
Room Remodel
Job No: 250484
Cc:

From: Josh Barsdorf
Email: Joshua.barsdorf@speceng.com
Phone: 801-358-3447
Re:

This Addendum shall be considered part of the Contract Documents and Project Manual for the above mentioned project as though it had been issued at the same time and shall be incorporated integrally therewith. Where provisions of the following supplementary data differ from those of the original Contract Documents and Project Manual, the Addendum shall govern and take precedence.

Electrical Addendum

Drawings

1. EE501:
 - a. Added typical single door rough-in detail showing ADA push plate rough in.

END OF ADDENDUM

Attachments < EE501 >

SALT LAKE CITY

324 S. State Street, Suite 400

Salt Lake City, UT 84111

phone: 801-328-5151

800-678-7077


www.spectrum-engineers.com

PHOENIX

1501 W. Fountainhead Parkway, Suite 330


Tempe, AZ 85282

phone: 480-621-3444

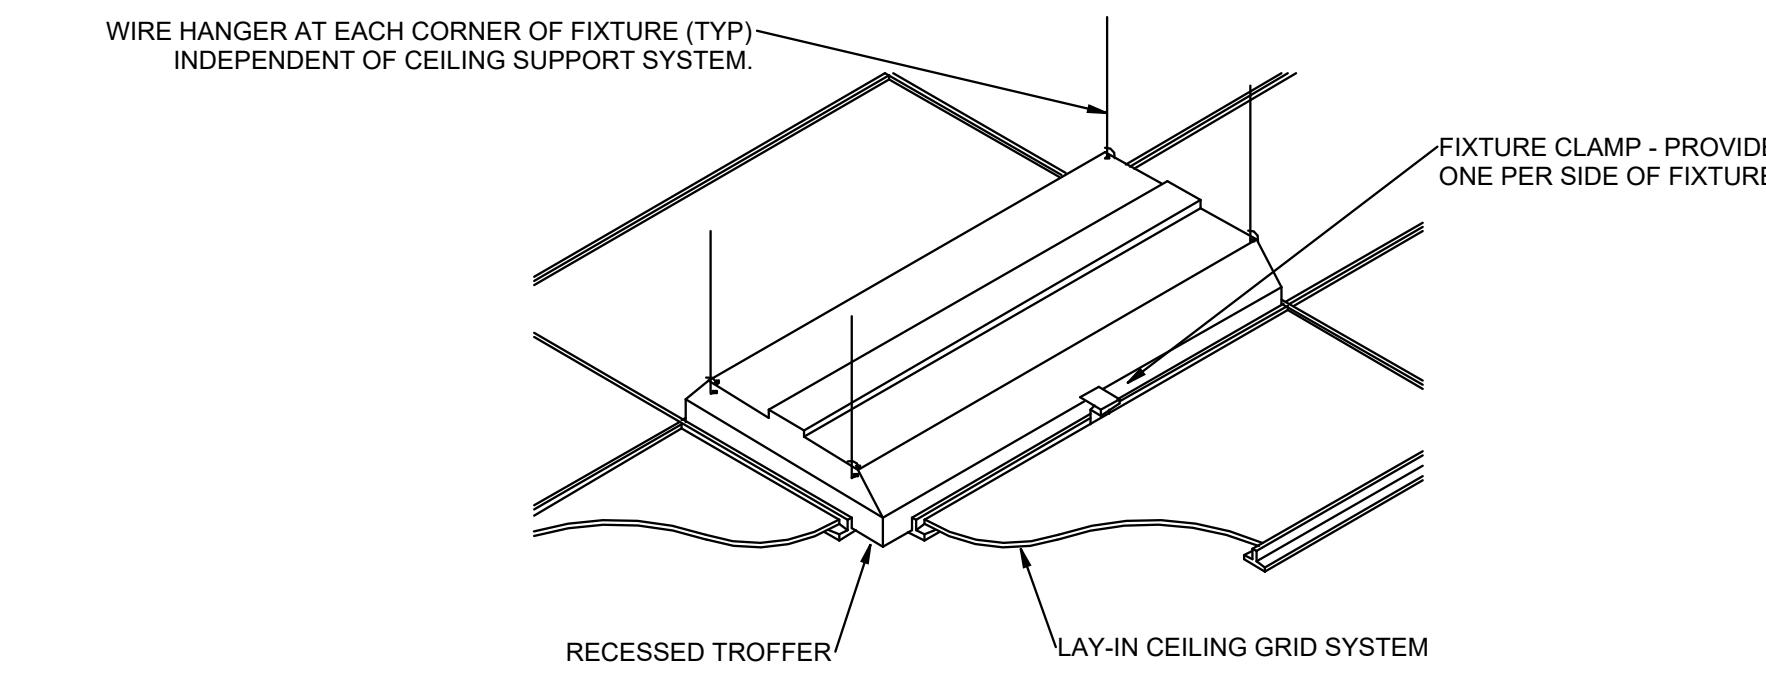


7 RECESSED FIXTURE MOUNTING DETAIL

SCALE: NTS

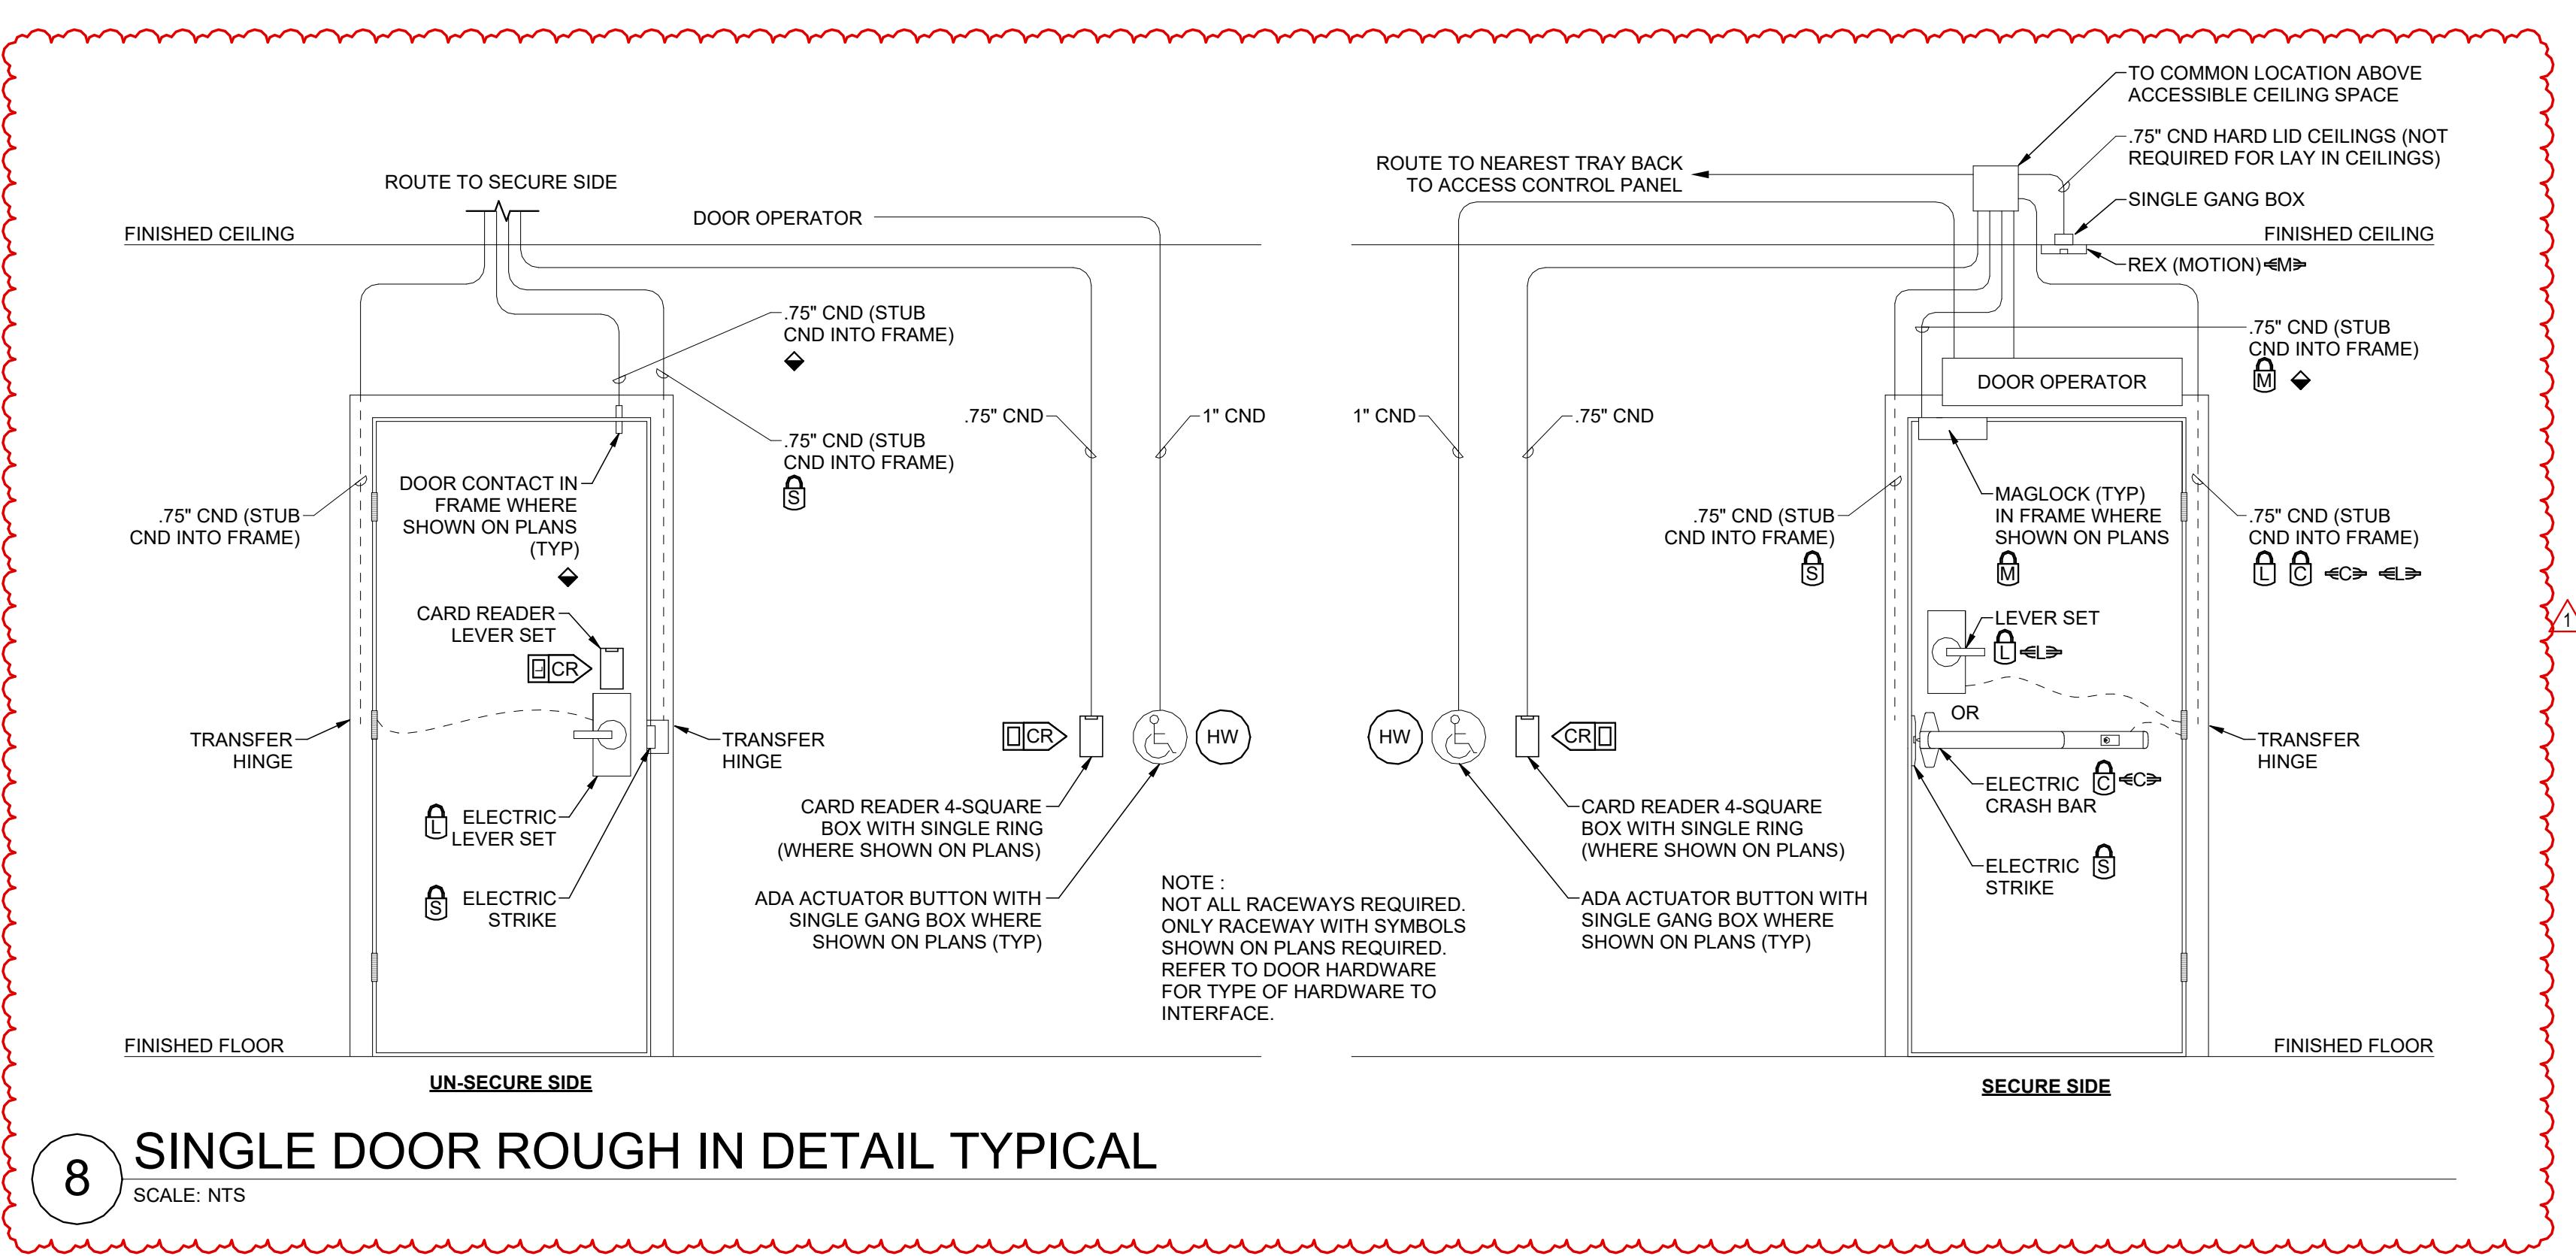


8 SINGLE DOOR ROUGH IN DETAIL TYPICAL

SCALE: NTS

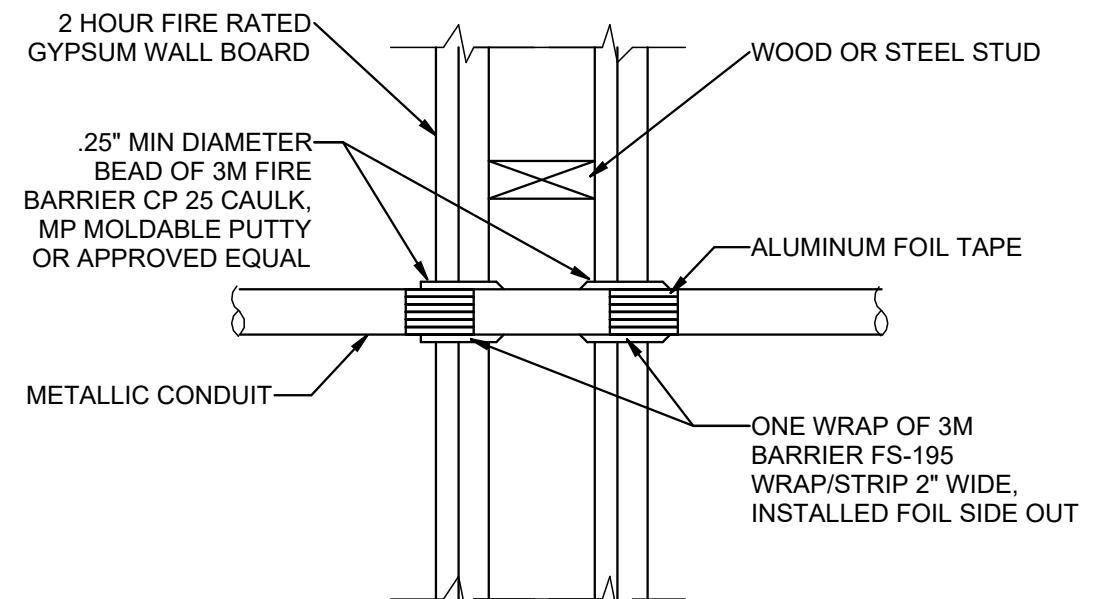


4 FIRE STOP FOR METAL CONDUIT THROUGH GYPSUM WALL BOARD

SCALE: NTS

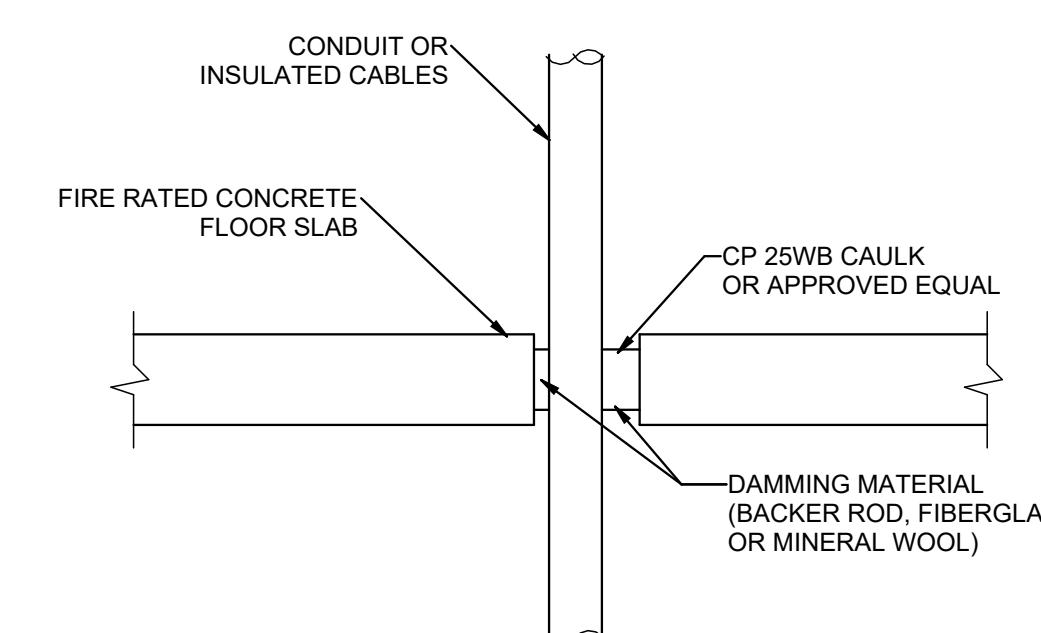


5 TYPICAL FIRE STOP FOR CABLES/CONDUIT THROUGH CONCRETE FLOORING

SCALE: NTS

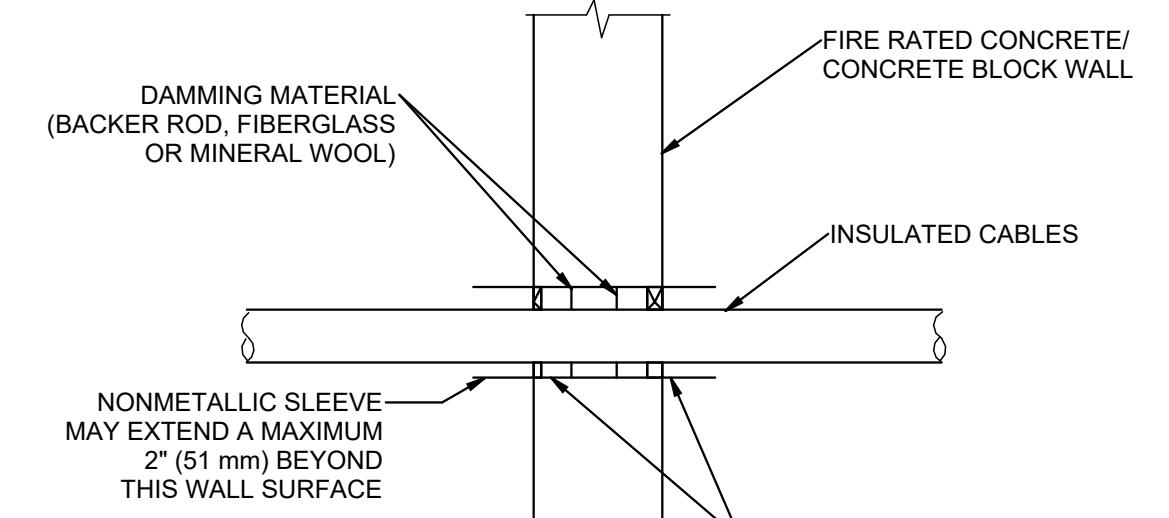


6 TYPICAL FIRE STOP FOR CABLES/CONDUIT THROUGH CONCRETE WALLS

SCALE: NTS

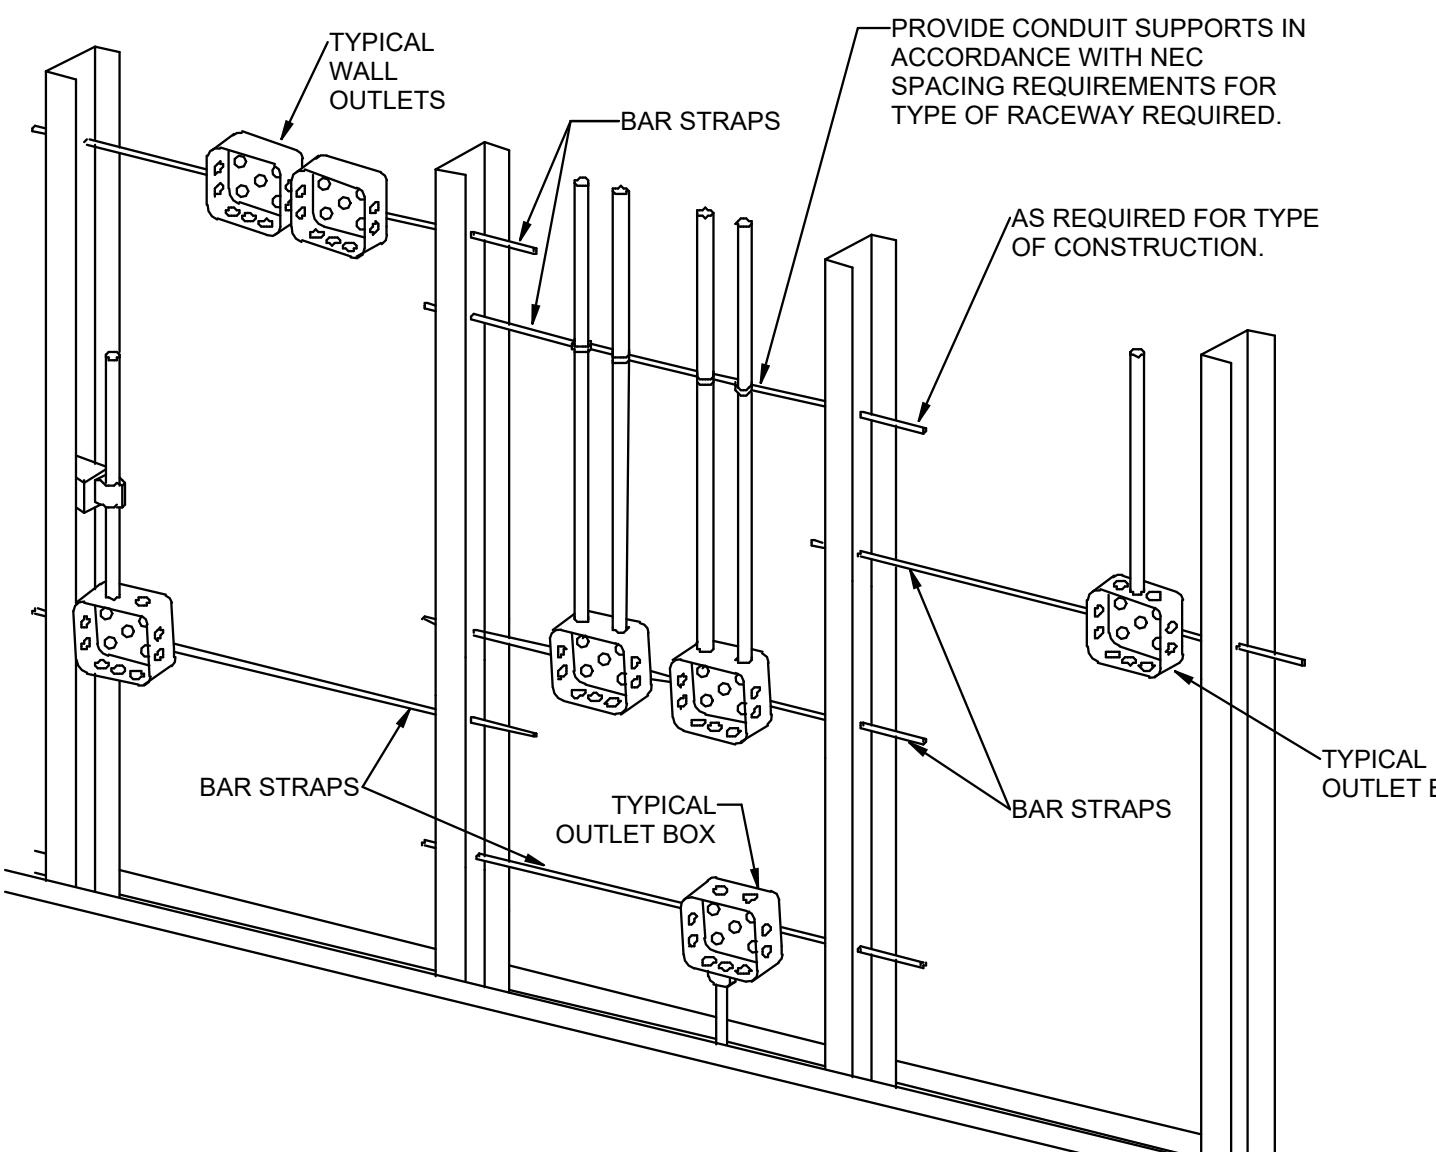


1 TYPICAL ROUGH-IN REQUIREMENTS DETAIL

SCALE: NTS

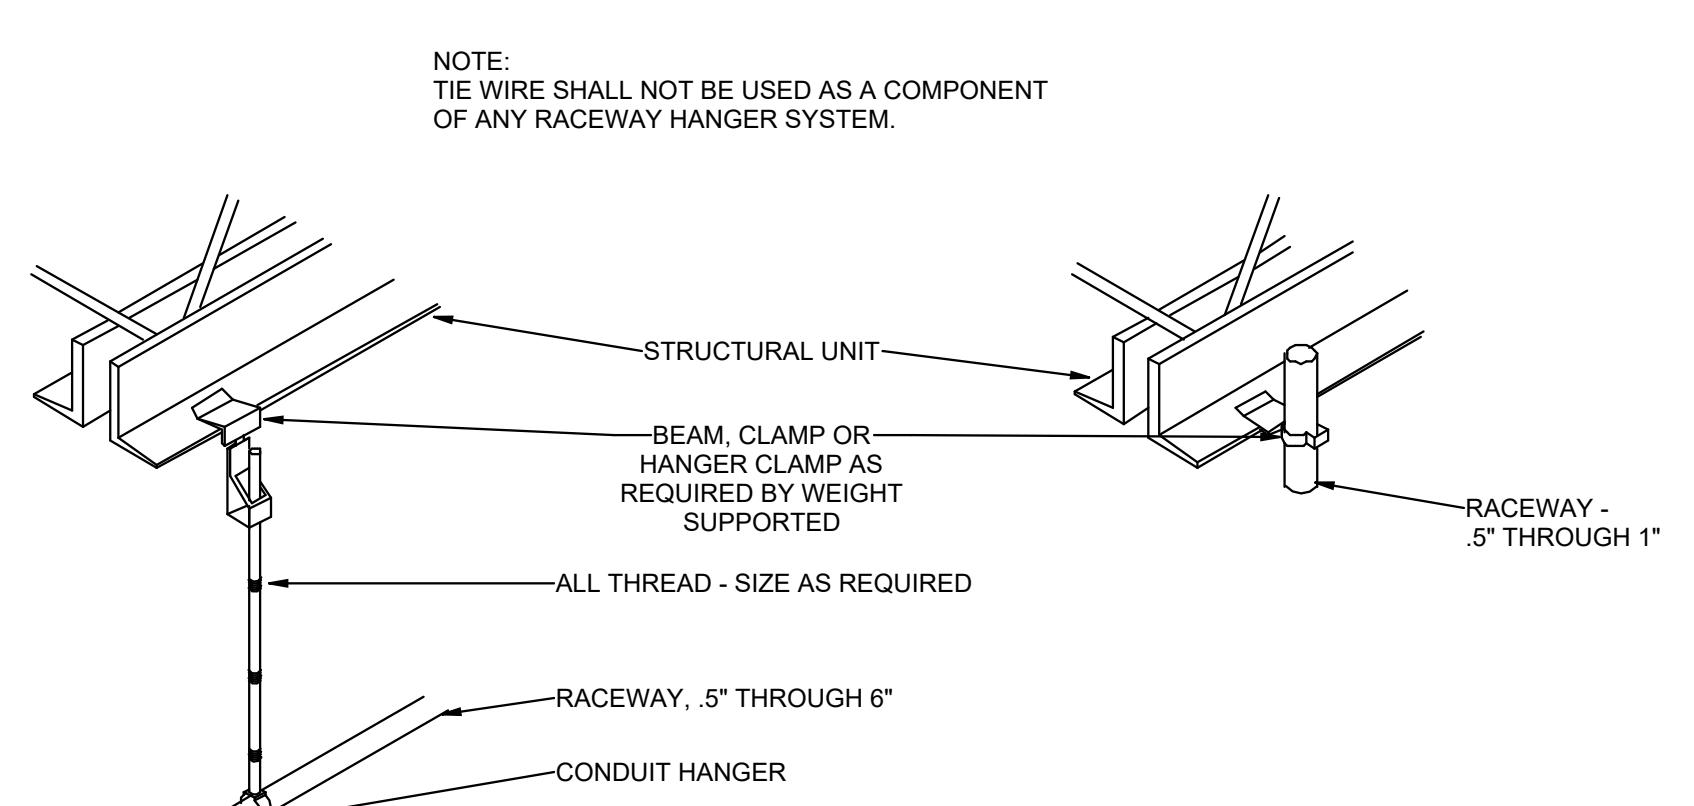

2 TYPICAL RACEWAY SUPPORT METHODS DETAIL

SCALE: NTS

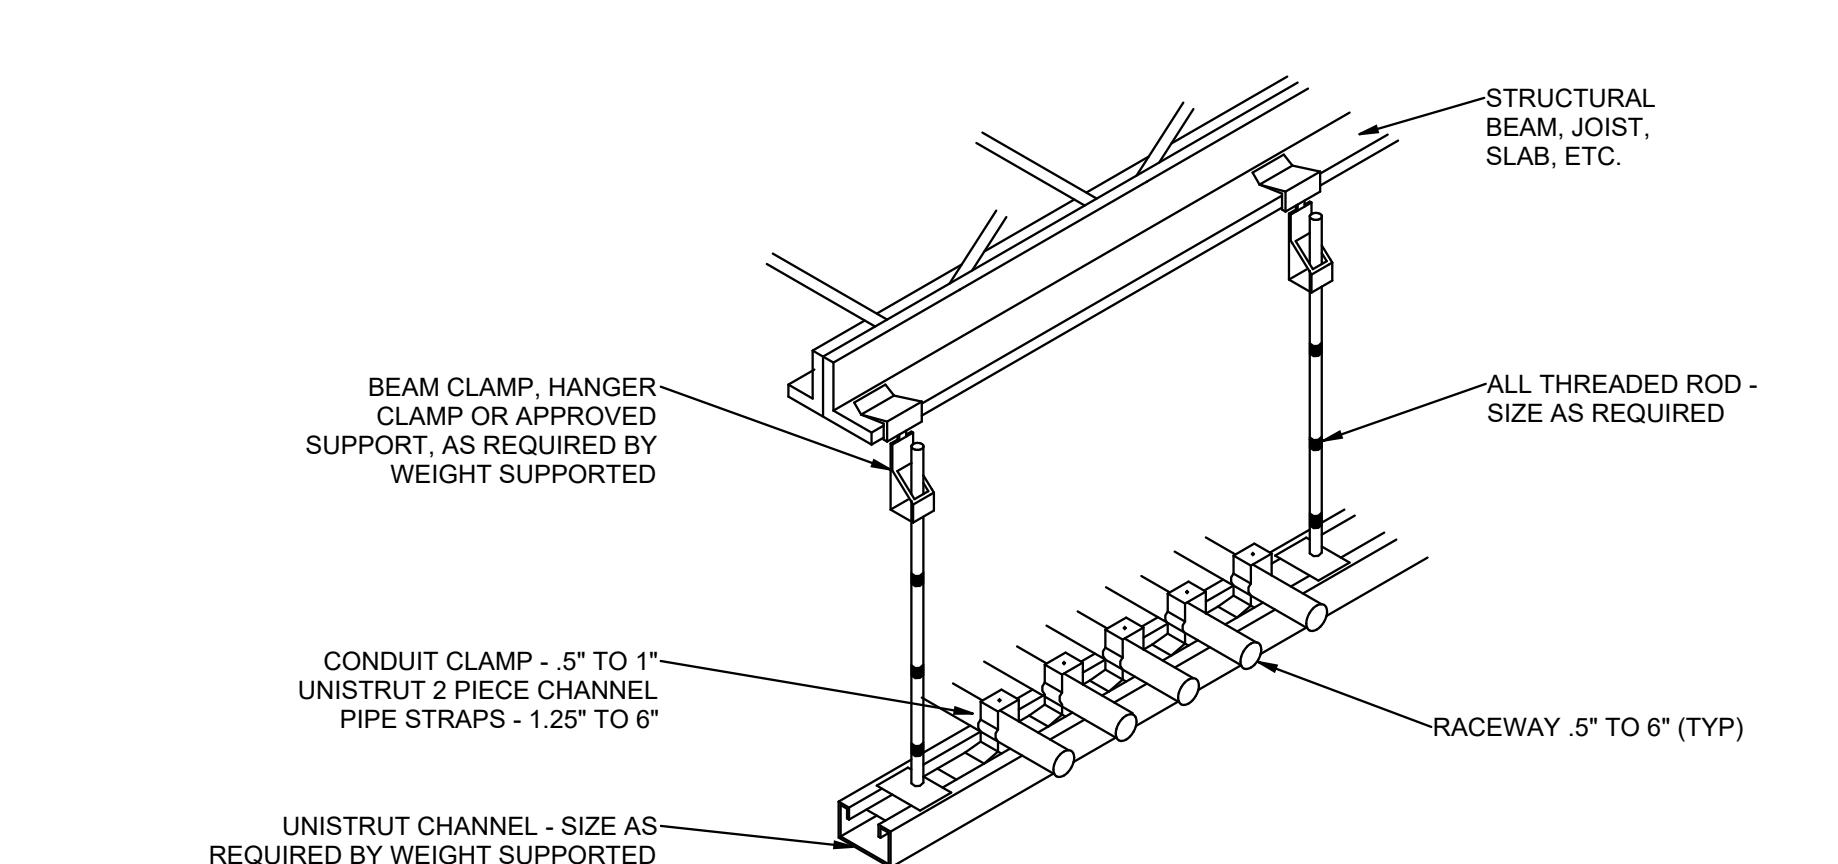

3 TYPICAL CONDUIT RACK DETAIL

SCALE: NTS