




KEYED NOTES

09.06 ACCENT SHEET FLOORING TO BE CENTERED BELOW SURGICAL TABLE LOCATION.

FLOOR PATTERN LEGEND

- MATERIAL REPRESENTATION OF FLOOR COVERINGS:**
- F1 - SHEET VINYL - SANDRIFT (LIGHT)
 - F2 - SHEET VINYL - FLAX (MEDIUM)
 - F3 - SHEET VINYL - BEDROCK (DARK)
 - F4 - CARPET (WAITING)
 - F5 - CARPET (ADMIN)
 - F6 - PORCELAIN TILE
 - F7 - PROTECTIVE FLOOR COATING

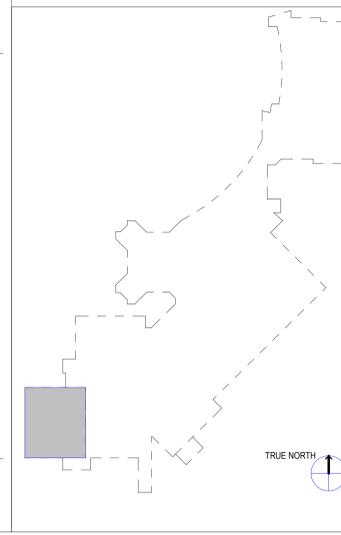

NJRA Architects, Inc.
5272 S. College Drive, Suite 104
Murray, Utah 84123
801.364.9259
www.njraarchitects.com

INTERMOUNTAIN HEALTHCARE CAMPUS RECONFIGURATION - ASC
1350N 500 E
Logan, UT 84341



Project Manager	TERRI SDOBROOK
Project Designer	ERIC MEUB
Project Architect	FRANK PENROSE
Landscape Architect	ARCOSTO
Civil Engineer	GREAT BASIN
Structural Engineer	REAVELY
Mechanical Engineer	VAN BOERUM & FRANK
Electrical Engineer	SPECTRUM
Plumbing Engineer	VAN BOERUM & FRANK
Interior Designer	RUBY THORP
Equipment Planner	ROBERT GRIESCHE
Wayfinding	

MARK	DATE	DESCRIPTION

Project Number	10173823
Original Issue	11/6/20




Sheet Name
Floor Pattern Plan Level 4


Sheet Number
A148A

Project Status
100% Construction Documents


11/6/2020 10:47:51 AM B:\My Documents\19222\011 UH - ASC - 19 - Central Station_NJRA.mxd

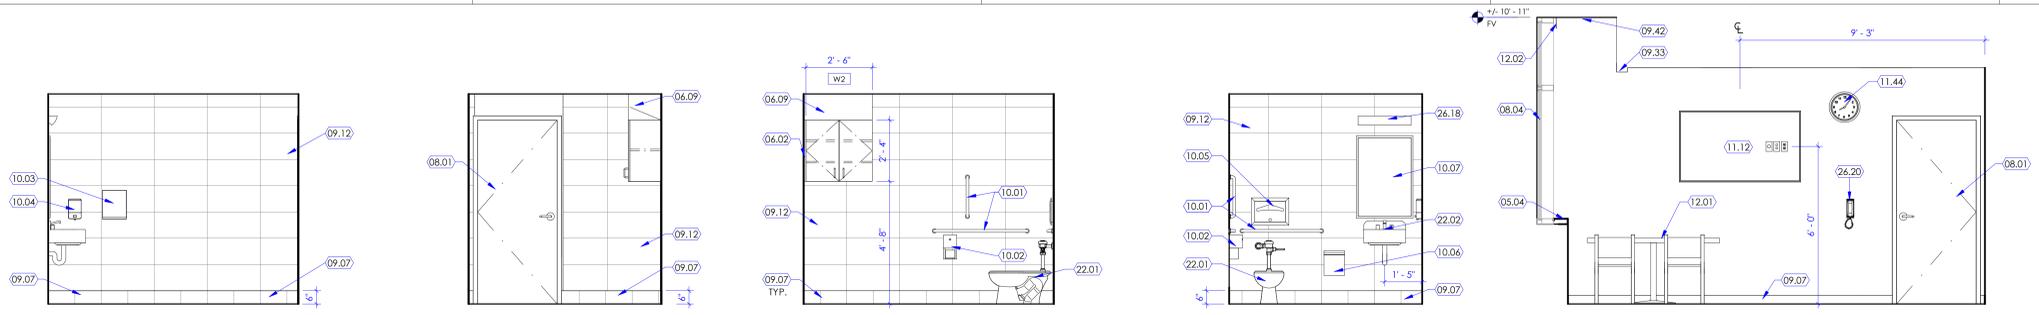


1 Staff Toilet - North SCALE: 3/8" = 1'-0"
 2 Staff Toilet - East SCALE: 3/8" = 1'-0"
 3 Staff Toilet - South SCALE: 3/8" = 1'-0"
 4 Staff Toilet - West SCALE: 3/8" = 1'-0"
 5 Staff Break Room - North SCALE: 3/8" = 1'-0"

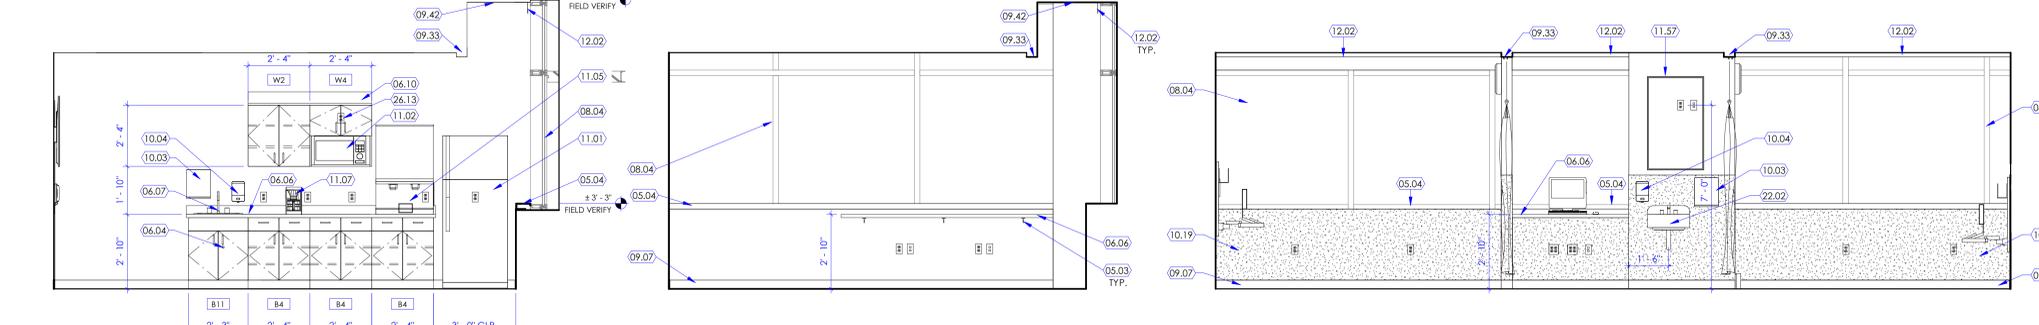


6 Staff Break Room - East SCALE: 3/8" = 1'-0"
 7 Staff Break Room - South SCALE: 3/8" = 1'-0"
 8 PACU - South SCALE: 3/8" = 1'-0"

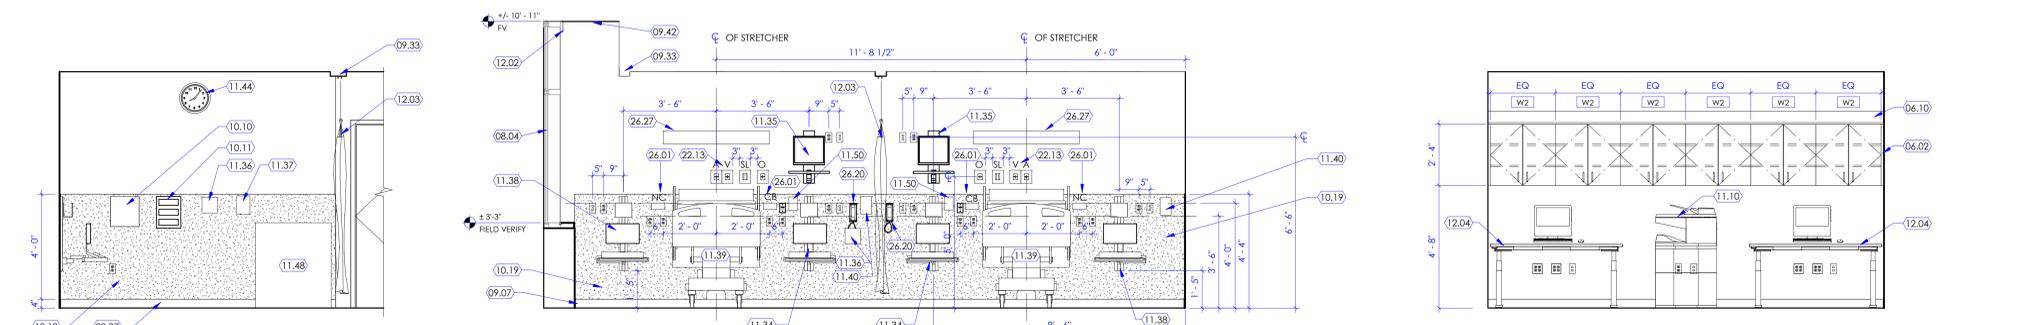

9 PACU 4 - North SCALE: 3/8" = 1'-0"
 10 PACU 3 & 4 - West SCALE: 3/8" = 1'-0"
 11 Control Desk - North SCALE: 3/8" = 1'-0"

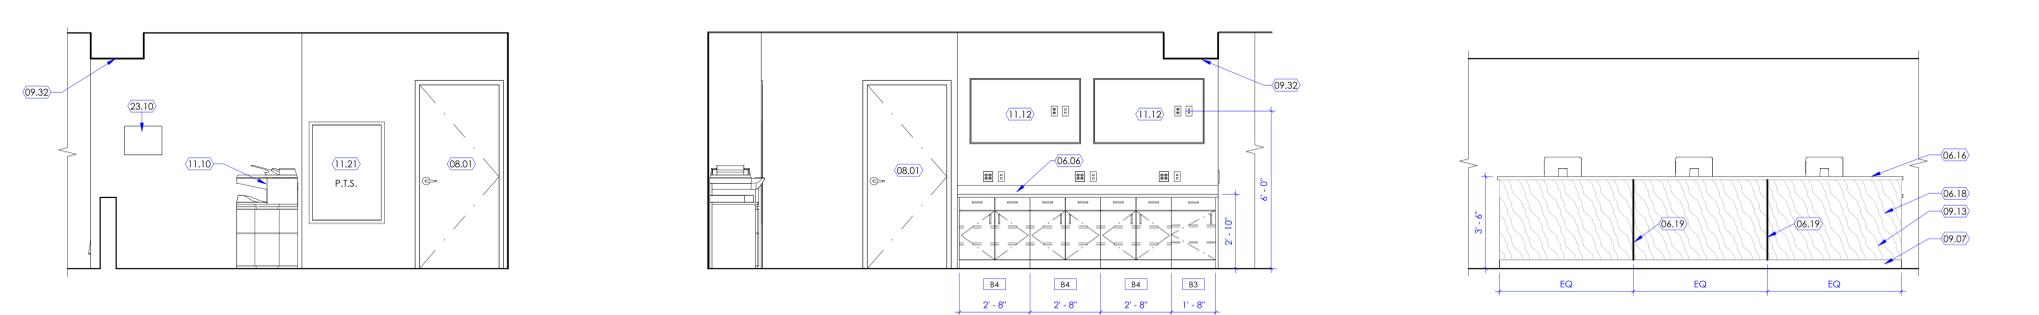

12 Nurse Station - North SCALE: 3/8" = 1'-0"
 13 Nurse Station - East SCALE: 3/8" = 1'-0"
 14 Nurse Station Island - East SCALE: 3/8" = 1'-0"

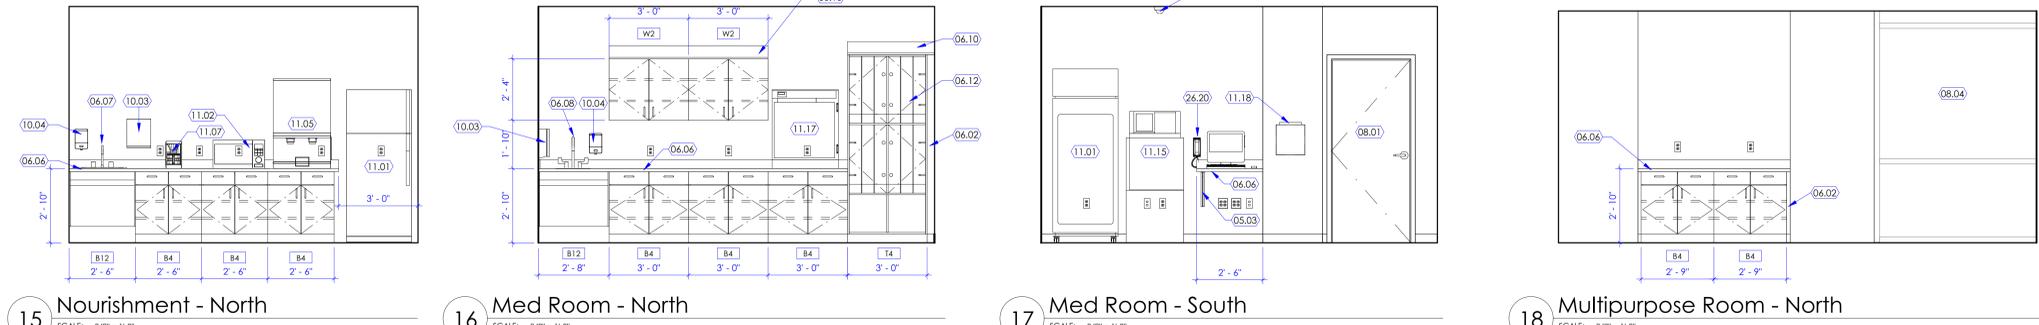

15 Nourishment - North SCALE: 3/8" = 1'-0"
 16 Med Room - North SCALE: 3/8" = 1'-0"
 17 Med Room - South SCALE: 3/8" = 1'-0"
 18 Multipurpose Room - North SCALE: 3/8" = 1'-0"

KEYED NOTES

05.03 IN-WALL STEEL ANGLE COUNTERTOP SUPPORT AT 3'-0" (MAX) O.C. SEE DETAIL S/A505B. PAINT TO MATCH WALL COLOR. PROVIDE 16 GA STUDS AT COUNTERTOP SUPPORT. TYPICAL.

05.04 0.09 INCH THICK EXTRUDED ALUMINUM SILL EXTENDER. COLOR AND FINISH TO MATCH EXISTING WINDOW MULLION. ATTACHED TO MULLION VIA CONTINUOUS ALUMINUM Z CLIP. SEE DETAIL S/A505A. PROVIDE SLOPED SILL AT PREP/RECOVERY BAYS. SEE DETAIL S/A506A.

06.02 PLASTIC LAMINATE WRAPPED FILLER PANEL. PROVIDE FILLER PANEL BETWEEN CABINETS AND BETWEEN CABINET AND WALL. TYPICAL. FILLER PANEL TO MATCH PROFILE AND FINISH OF ADJACENT CABINETS.

06.04 LOCK. PROVIDE KEYPAD LOCK FOR THIS CABINET DOOR (OR DRAWER WHERE OCCURS). PROVIDE REQUIRED HARDWARE FOR THE LOCK SYSTEM.

06.06 SOLID SURFACE COUNTERTOP WITH FULL BULLNOSE EDGE AND INTEGRAL BACKSPASH. SEE DETAIL S/A505B. PROVIDE INTEGRAL SIDE SPLASH WHERE COUNTER ABUTS PERPENDICULAR WALL/CABINET.

06.07 STAINLESS STEEL SINK. SEE PLUMBING DRAWINGS.

06.08 SOLID SURFACE INTEGRAL SINK. BASIS OF DESIGN: SAMSUNG STARON A3181 SINK. COLOR "BRIGHT WHITE" BW10. ALSO SEE PLUMBING DWGS.

06.09 P-LAM CLOSER PANEL TO CEILING ABOVE. SEE DETAIL 2/A505B.

06.10 P-LAM SLOPED DUST TOP. SEE DETAILS 1/A505B AND 2/A505B.

06.12 IV CABINET. SEE DETAIL 4/A505C.

06.16 SOLID SURFACE TRANSACTION COUNTER WITH FULL BULLNOSE EDGE. SEE FINISH SCHEDULE. SEE DETAIL 7/A505A.

06.18 3/4" THICK PLASTIC LAMINATE FACED PANEL SYSTEM. ATTACH TO GYPSUM BOARD WALL USING BROOKLYN HARDWARE. CONTINUOUS ALUMINUM PANEL CLIP SYSTEM OR APPROVED EQUAL. SEE DETAILS ON SHEET A505C.

06.19 3/16" REVEAL. TYPICAL. SEE DETAIL 7/A505C.

08.01 NEW DOOR AND DOOR FRAME. SEE DOOR SCHEDULE.

08.04 EXISTING WINDOW/CURTAIN WALL TO REMAIN. PROTECT DURING CONSTRUCTION.

09.07 WALL BASE AS SCHEDULED. SEE FINISH FLOOR PLANS AND FINISH SCHEDULE FOR MATERIAL, SIZE, COLOR, ETC.

09.12 WALL TILE AS SCHEDULED. SEE FINISH FLOOR PLAN AND FINISH SCHEDULE FOR MATERIAL TYPE, SIZE, COLOR, ETC. INSTALL 5/8 INCH THICK CEMENT BACKER BOARD BEHIND WALL TILE.

09.13 PARTIAL HEIGHT WALL WITH SOLID SURFACE TRANSACTION TOP. SEE WALL TYPES AND FINISH SCHEDULE.

09.32 GYPSUM BOARD SOFFIT. SEE DETAIL 9/A503A. SEE M/E/P DRAWINGS FOR LIGHTS AND DIFFUSERS.

09.33 GYPSUM BOARD HEADER. SEE DETAIL 6/A503A.

09.42 GYPSUM BOARD SOFFIT AT WINDOW. SEE DETAIL 14/A503A.

10.01 GRAB BAR. PROVIDE GRAB BARS REQUIRED FOR WATER CLOSET, SHOWER, ETC. SEE RELEVANT DETAILS 1/G003 AND 1/G004 FOR MOUNTING HEIGHT, LOCATION, ETC. PROVIDE TYPE 2 BACKING PER DETAIL S/A505A.

10.02 TOILET PAPER DISPENSER, OFCI. SEE SHEET G003 FOR MOUNTING HEIGHT.

10.03 PAPER TOWEL DISPENSER, OFCI. SEE SHEET G003 FOR MOUNTING HEIGHT.

10.04 SOAP DISPENSER, OFCI. SEE SHEET G003 FOR MOUNTING HEIGHT.

10.05 TOILET SEAT COVER DISPENSER. SEE SPECIFICATIONS. SEE SHEET G003 FOR MOUNTING HEIGHT.

10.06 SANITARY NAPKIN DISPOSAL. SEE SPECIFICATIONS.

10.07 MIRROR, 2'-0" WIDE X 3'-0" HIGH. TYPICAL. SEE SPECIFICATIONS. MOUNT MIRROR SUCH THAT THE REFLECTIVE SURFACE OF MIRROR IS NO MORE THAN 40 INCHES AFT. SEE SHEET G003.

10.10 SHARPS DISPOSAL, OFCI. SEE SHEET G003 FOR MOUNTING HEIGHT.

10.11 GLOVES DISPENSER, OFCI. SEE SHEET G003 FOR MOUNTING HEIGHT.

10.19 0.06 INCH THICK WALL PROTECTION WAINGSCOT. TOP OF WAINGSCOT TO ALIGN WITH TOP OF CORNER GUARD WHERE OCCURS. SEE FINISH PLAN AND SCHEDULE.

11.01 REFRIGERATOR, OFCI. SEE ELECTRICAL DRAWINGS.

11.02 MICROWAVE, OFCI. SEE ELECTRICAL DRAWINGS. FOR MICROWAVE IN WALL CABINET PROVIDE OUTLET IN THE CABINET ABOVE WITH A GROMMET OPENING AT THE BASE OF THIS CABINET.

11.05 ICE AND WATER DISPENSER. OWNER FURNISHED CONTRACTOR INSTALLED. SEE PLUMBING DRAWINGS. CAREFULLY CUT AROUND BACKSPASH BEHIND TO ACCOMMODATE FOR WASHER BOX. BOTTOM OF WALL BOX TO BE ONE INCH ABOVE COUNTERTOP. ALSO SEE ELECTRICAL DRAWINGS FOR POWER.

11.07 COFFEE POT, OFCI. COFFEE POT TO BE PLUMBED. SEE PLUMBING DRAWINGS. ALSO SEE ELECTRICAL DRAWINGS.

11.10 PRINTER/COPPER, OFCI. SEE ELECTRICAL DRAWINGS FOR POWER AND DATA.

11.12 WALL MOUNTED MONITOR/REVISION OFCI. SEE ELECTRICAL DRAWINGS. PROVIDE 3'-0" X 2'-0" H X 1/8 GA SHEET METAL BACKING. COORDINATE LOCATION OF OUTLETS WITH MONITOR MOUNTING BRACKET.

11.15 AUTOMATED MEDICATION DISPENSER/COMMENCEL, OFCI. SEE ELECTRICAL DRAWINGS FOR POWER AND DATA. PROVIDE 2" CAMERA ABOVE OMNICELL. SEE CEILING PLAN AND ELECTRICAL DRAWINGS.

11.17 COUNTER MOUNTED WARMING CABINET, OFCI.

11.18 WASTE DISPOSAL WALL MOUNTED, OFCI.

11.21 PNEUMATIC TUBE STATION (PTS). PROVIDED AND INSTALLED BY GENERAL CONTRACTOR. CONTRACTOR TO USE SWISSLOG AS THE SUB-CONTRACTOR FOR PTS. (INTERMOUNTAIN HEALTHCARE STANDARD). CONTRACTOR TO FRAME AND FINISH AROUND PTS. ALSO SEE ELECTRICAL DRAWINGS FOR POWER AND DATA REQUIREMENTS. COORDINATE SIZE AND LOCATION OF REQUIRED CORE DRILLS WITH SWISSLOG AND DEPARTMENT/AREA BELOW.

11.34 NURSE CHARTING STATION. SEE DETAIL 13/A502A. ALSO SEE ELECTRICAL DRAWINGS FOR POWER AND DATA.

11.35 PHYSIOLOGICAL MONITOR. SEE DETAIL 13/A502A. ALSO SEE ELECTRICAL DRAWINGS FOR POWER AND DATA.

11.36 EMESIS BAG DISPENSER, OFCI.

11.37 WIPES DISPENSER, OFCI.

11.38 ANESTHESIA WORKSTATION. SEE DETAIL 13/A502A. ALSO SEE ELECTRICAL DRAWINGS FOR POWER AND DATA.

11.39 STRETCHER/BED, OFCI.

11.40 WALL MOUNTED THERMOMETER, OFCI.

11.44 WALL MOUNTED ANALOG CLOCK, OFCI.

11.48 PROCEDURE CART OPHI.

11.50 WALL MOUNTED BARCODE SCANNER, OFCI. PROVIDE TYPE 1 BACKING PER DETAIL S/A502A.

11.57 WALL MOUNTED PATIENT TRACKING MONITOR, OFCI. SEE ELECTRICAL DRAWINGS. PROVIDE 2'-0" X 4'-0" H X 1/8 GA SHEET METAL BACKING. COORDINATE LOCATION OF OUTLETS WITH MONITOR MOUNTING BRACKET.

12.01 FURNITURE, TO BE PROVIDED AND INSTALLED BY OWNERS VENDOR (MIDWEST - MWCI). COORDINATE WITH MIDWEST FOR LOCATION OF ELECTRICAL AND DATA OUTLETS SUCH THAT THEY ARE NOT BEHIND PEDESTALS.

12.02 RECESSED ROLLER WINDOW SHADE. SEE CEILING PLAN AND SPECIFICATIONS.

12.03 CEILING MOUNTED PRIVACY CURTAIN AND TRACK. SEE FINISH SCHEDULE AND PROJECT MANUAL. SEE DETAIL 12/A503A.

12.04 HEIGHT ADJUSTABLE SIT/STAND DESK. PROVIDED AND INSTALLED BY OWNERS VENDOR. MIDWEST COMMERCIAL INTERIORS (MWC). SEE ELECTRICAL DRAWINGS FOR POWER.

22.01 FLOOR MOUNTED WATER CLOSET. SEE DETAILS 1/G003 AND 1/G004 FOR MOUNTING HEIGHT, LOCATION, ETC. SEE PLUMBING DRAWINGS.

22.02 WALL MOUNTED LAVATORY (SINK). SEE DETAILS 1/G003 AND 1/G004 FOR MOUNTING HEIGHT, LOCATION, ETC. SEE PLUMBING DRAWINGS.

22.13 WALL MOUNTED MED GASES. SEE PLUMBING DRAWINGS.

23.10 RECESSED MED GAS ALARM PANEL. SEE M/E/P DRAWINGS.

26.01 NURSE CALL/CODE BLUE. SEE ELECTRICAL DRAWINGS.

26.09 CEILING MOUNTED SECURITY CAMERA. SEE ELECTRICAL DRAWINGS.

26.13 POWER RECEPTACLE FOR MICROWAVE IN CABINET ABOVE. PROVIDE GROMMET AS NEEDED.

26.18 WALL MOUNTED LIGHT FIXTURE. SEE ELECTRICAL DRAWINGS.

26.20 WALL MOUNTED PHONE. SEE ELECTRICAL DRAWINGS.

26.27 WALL MOUNTED LIGHT FIXTURE. SEE ELECTRICAL DRAWINGS. PROVIDE IN-WALL BACKING PER MANUFACTURERS RECOMMENDATION.

GENERAL NOTES

A. SEE SHEET G003 AND G005 FOR SYMBOLS, GENERAL NOTES AND LEGEND.

B. SEE SHEET A505A FOR CABINET LEGEND.

C. SEE SHEET A601A FOR DOOR AND WINDOW SCHEDULE.

D. SEE SHEET A603A FOR FINISH SCHEDULE AND GENERAL NOTES.

HR ARCHITECTS

NJR ARCHITECTS

NJRA Architects, Inc.
 5272 S. College Drive, Suite 104
 Murray, Utah 84123
 801.364.9259
 www.njrarchitects.com

INTERMOUNTAIN HEALTHCARE CAMPUS RECONFIGURATION - ASC

1350N 500 E
 Logan, UT 84341

Intermountain Healthcare

Project Manager	TERRI SLIDBROOK
Project Designer	ERIC MEUB
Project Architect	FRANK PENROSE
Landscape Architect	ARCOTITO
Civil Engineer	GREAT BASIN
Structural Engineer	REAVLEY
Mechanical Engineer	VAN BOERUM & FRANK
Electrical Engineer	SPECTRUM
Plumbing Engineer	VAN BOERUM & FRANK
Interior Designer	RUBY THORP
Equipment Planner	ROBERT GRIESCHE
Wayfinding	

MARK	DATE	DESCRIPTION


Project Number 10173823
 Original Issue 11/6/20

SELVAM RAJAVELU
 267657-4306
 LICENSED ARCHITECT


Sheet Name
Interior Elevations

Sheet Number
A252


Project Status
100% Construction Documents

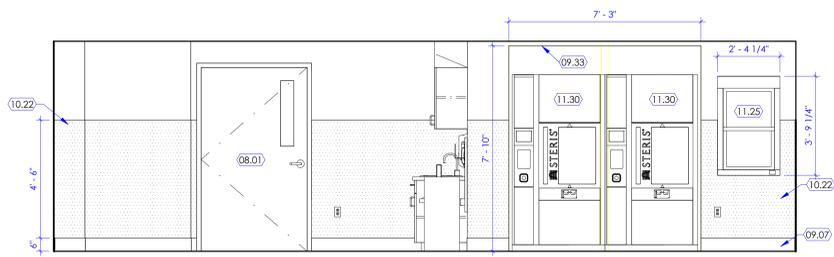


1 Sterile Processing - North
SCALE: 3/8" = 1'-0"

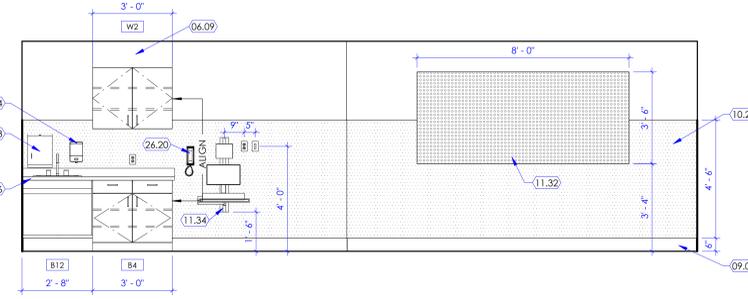


2 Sterile Processing - East
SCALE: 3/8" = 1'-0"

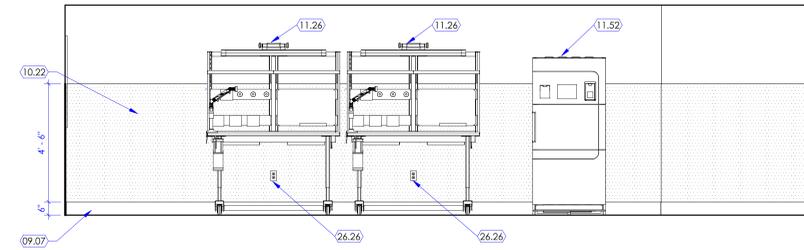


3 Sterile Processing - South
SCALE: 3/8" = 1'-0"

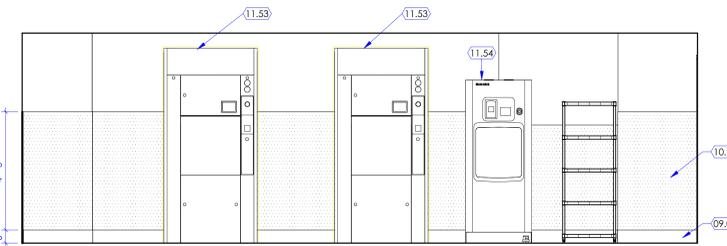


4 Sterile Processing - West
SCALE: 3/8" = 1'-0"

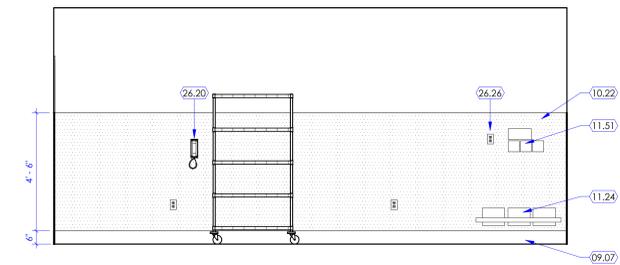


5 Decontamination - North
SCALE: 3/8" = 1'-0"

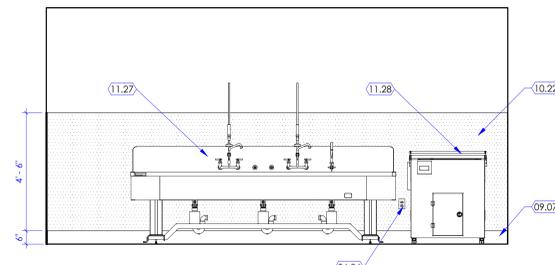

6 Decontamination - East
SCALE: 3/8" = 1'-0"

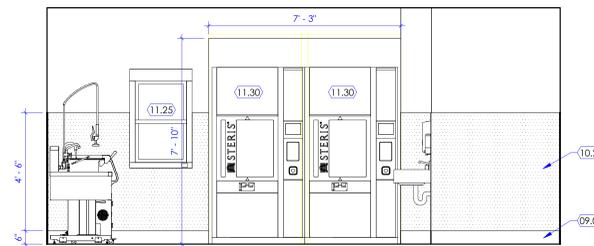

7 Decontamination - South
SCALE: 3/8" = 1'-0"

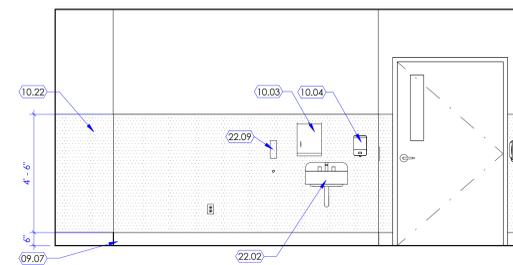

8 Decontamination - West
SCALE: 3/8" = 1'-0"

KEYED NOTES

- 06.06 SOLID SURFACE COUNTER WITH FULL BULLNOSE EDGE AND INTEGRAL BACKSPASH. SEE DETAIL 6/A505B. PROVIDE INTEGRAL SIDE SPLASH WHERE COUNTER ABUTS PERPENDICULAR WALL/CABINET.
- 06.09 P-LAM CLOSER PANEL TO CEILING ABOVE. SEE DETAIL 2/A505B
- 08.01 NEW DOOR AND DOOR FRAME. SEE DOOR SCHEDULE.
- 09.07 WALL BASE AS SCHEDULED. SEE FINISH FLOOR PLANS AND FINISH SCHEDULE FOR MATERIAL, SIZE, COLOR, ETC.
- 09.33 GYPSUM BOARD HEADER. SEE DETAIL 6/A503A.
- 10.03 PAPER TOWEL DISPENSER, OFCL. SEE SHEET G003 FOR MOUNTING HEIGHT.
- 10.04 SOAP DISPENSER, OFCL. SEE SHEET G003 FOR MOUNTING HEIGHT.
- 10.22 STAINLESS STEEL WALL PROTECTION WAINSCOT, TYPE 304, 18 GA. WAINSCOTING TO SPAN FROM TOP OF BASE TO 4'-0" ABOVE BASE - TYPICAL ALL WALLS.
- 11.24 RAIL SYSTEM FOR DETERGENT STORAGE CONTAINERS. FURNISHED BY STERIS. INSTALLED BY CONTRACTOR. PROVIDE TYPE 1 BACKING PER DETAIL 5/A502A. COORDINATE EXACT LOCATION WITH STERIS.
- 11.25 AUTOMATED PASS THROUGH WINDOW. FURNISHED BY STERIS. INSTALLED BY CONTRACTOR. COORDINATE WITH STERIS ON ROUGH OPENING DIMENSIONS. ALSO SEE ELECTRICAL DRAWINGS.
- 11.26 HEIGHT ADJUSTABLE INSTRUMENT ASSEMBLY TABLES. FURNISHED BY STERIS. INSTALLED BY CONTRACTOR. SEE ELECTRICAL DRAWINGS.
- 11.27 THREE COMPARTMENT SINK. FURNISHED BY STERIS. INSTALLED BY CONTRACTOR. SEE PLUMBING DRAWINGS.
- 11.28 ULTRASONIC CLEANER. FURNISHED BY STERIS. INSTALLED BY CONTRACTOR. SEE PLUMBING DRAWINGS.
- 11.30 PASS THROUGH WASHER. FURNISHED BY STERIS. INSTALLED BY CONTRACTOR. SEE PLUMBING DRAWINGS. PROVIDE A 87" W X 94" H FINISHED OPENING. COORDINATE WITH STERIS.
- 11.32 WALL MOUNTED PEG BOARD, OFCL. PROVIDE TYPE 2 BACKING PER DETAIL 5/A502A.
- 11.34 NURSE CHARTING STATION. SEE DETAIL 13/A502A. ALSO SEE ELECTRICAL DRAWINGS FOR POWER AND DATA.
- 11.51 AUTOMATED CHEMICAL/DETERGENT DISPENSER. FURNISHED BY STERIS. INSTALLED BY CONTRACTOR. PROVIDE A 3 INCH I.D. IN-WALL STEEL CONDUIT BETWEEN DETERGENT DISPENSER AND TOP OF PASS THROUGH WASHERS. COORDINATE EXACT ROUTING AND LOCATION WITH STERIS.
- 11.52 AMSCO V-PRO MAX2 HYDROGEN PEROXIDE STERILIZER. FURNISHED BY STERIS. INSTALLED BY CONTRACTOR. SEE M/E/P DRAWINGS.
- 11.53 AMSCO400 SERIES STEAM STERILIZER. FURNISHED BY STERIS. INSTALLED BY CONTRACTOR. SEE M/E/P DRAWINGS.
- 11.54 AMSCO400 SERIES SMALL STEAM STERILIZER. FURNISHED BY STERIS. INSTALLED BY CONTRACTOR. SEE M/E/P DRAWINGS.
- 22.02 WALL MOUNTED LAVATORY (SINK). SEE DETAILS 1/G003 AND 1/G004 FOR MOUNTING HEIGHT, LOCATION, ETC. SEE PLUMBING DRAWINGS.
- 22.09 WALL MOUNTED EMERGENCY EYE WASH. SEE PLUMBING DRAWINGS.
- 26.20 WALL MOUNTED PHONE. SEE ELECTRICAL DRAWINGS.
- 26.26 PLEASE COORDINATE PLACEMENT OF ELECTRICAL RECEPTACLES WITH EQUIPMENT.

GENERAL NOTES

- A. SEE SHEET G003 AND G005 FOR SYMBOLS, GENERAL NOTES AND LEGEND.
- B. SEE SHEET A505A FOR CABINET LEGEND.
- C. SEE SHEET A601A FOR DOOR AND WINDOW SCHEDULE.
- D. SEE SHEET A603A FOR FINISH SCHEDULE AND GENERAL NOTES.



NJRA Architects, Inc.
5272 S. College Drive, Suite 104
Murray, Utah 84123
801.364.9259
www.njraarchitects.com

INTERMOUNTAIN
HEALTHCARE
CAMPUS
RECONFIGURATION -
ASC

1350N 500 E
Logan, UT 84341



Project Manager	TERRI SDOBROOK
Project Designer	ERIC MEUB
Project Architect	FRANK PENROSE
Landscape Architect	ARCOTITO
Civil Engineer	GREAT BASIN
Structural Engineer	REAVELEY
Mechanical Engineer	VAN BOERUM & FRANK
Electrical Engineer	SPECTRUM
Plumbing Engineer	VAN BOERUM & FRANK
Interior Designer	RUBY THORP
Equipment Planner	ROBERT GRIESCHE
Wayfinding	

Sheet Reviewer Author

MARK	DATE	DESCRIPTION

Project Number 10173823
Original Issue 11/6/20



Sheet Name
Interior Elevations

Sheet Number
A254

Project Status
100% Construction Documents



NJRA Architects, Inc.
 5272 S. College Drive, Suite 104
 Murray, Utah 84123
 801.364.9259
 www.njraarchitects.com

**INTERMOUNTAIN
 HEALTHCARE
 CAMPUS
 RECONFIGURATION -
 ASC**
 1350N 500 E
 Logan, UT 84341



Project Manager	TERRI SLODBROOK
Project Designer	ERIC MEUB
Architect	FRANK PENROSE
Landscape Architect	ARISTO
Civil Engineer	GREAT BASIN
Structural Engineer	REAVLEY
Mechanical Engineer	VAN BOERUM & FRANK
Electrical Engineer	SPECTRUM
Plumbing Engineer	VAN BOERUM & FRANK
Interior Designer	RUBY THORP
Equipment Planner	ROBERT GRIESCHE
Wayfinding	

MARK	DATE	DESCRIPTION

Project Number	10173823
Original Issue	11/6/20



Sheet Name
Wall Types

Sheet Number
A501A


Project Status
100% Construction Documents

KEYED NOTE


- LINE OF FLOOR OR ROOF DECK AS OCCURS.
- TO ACCOMMODATE FOR STRUCTURE DEFLECTION, PROVIDE SLIP CONNECTION BETWEEN TOP RUNNER TRACK AND METAL STUD FRAMING. SEE DETAIL 9 / A502B
- STUD FRAMING AROUND DUCT OPENINGS. SEE DETAIL 11 / A502A
- METAL STUDS, 20 GA STRUCTURAL (30 MILS) AT 16" O.C. U.N.O. BASED ON WALL TYPES INDICATED IN FLOOR PLAN. PROVIDE STUD SIZE AS INDICATED IN WALL TYPES WITH TRACK RUNNERS AT TOP AND BOTTOM. FOR STUD FRAMING AROUND DOOR AND WINDOW OPENINGS, SEE DETAIL 11 / A502A
- LINE OF CEILING AS OCCURS. SEE REFLECTED CEILING PLAN.
- STEEL STUDS, "C"-H SHAPED, 20 GA STRUCTURAL AT 24" O.C.
- PROVIDE ACOUSTIC INSULATION BLANKET FOR FULL DEPTH OF THE STUD CAVITY THROUGHOUT. UNO, FOR 4" & 3" STUDS PROVIDE R-13 UNFACED BATT INSULATION AND FOR 6" STUDS PROVIDE R-19 UNFACED BATT INSULATION. PROVIDE KRAFT FACED INSULATION FOR ALL APPLICATIONS AT EXTERIOR WALLS.
- GYPSUM BOARD, 5/8" THICK, TYPE "X", U.N.O. ATTACHED TO METAL STUD FRAMING. SEE GENERAL NOTE 8 BELOW.
- ANCHOR BASE TRACK TO CONCRETE FLOOR BELOW. SEE DETAIL 8 / A502A
- FILL GAP BETWEEN DECK AND METAL TRACK TOP RUNNER WITH FIRESTOP SEALANT, SEAL TIGHTLY AROUND ALL PIPES, CONDUITS, DUCTS, ETC. ON EACH SIDE OF THE FIRE BARRIER WALL (CONTINUOUS) WITH APPROVED FIRESTOP SEALANT INSTALLED AROUND ALL PENETRATIONS TO MAINTAIN THE INTEGRITY OF THE FIRE BARRIER.
- FILL GAP BETWEEN DECK AND METAL TRACK TOP RUNNER WITH ACOUSTIC SEALANT, SEAL TIGHTLY AROUND ALL PIPES, CONDUITS, DUCTS, ETC. ON EACH SIDE OF THE WALL (CONTINUOUS) AND AROUND ALL PENETRATIONS TO MAINTAIN THE INTEGRITY OF THE WALL.
- STOP GYPSUM BOARD 1/4" ABOVE THE FLOOR TYP. ON EACH SIDE OF WALL. PROVIDE ACOUSTIC SEALANT AT SOUND WALLS AND FIRESTOP SEALANT AT RATED WALLS ON EACH SIDE OF THE WALL (CONTINUOUS).
- OUTLET BOX AS OCCURS. PROVIDE FIRE BARRIER MOLDABLE PUTTY PADS AND FIRESTOP SEALANT AROUND ELECTRICAL BOXES AT ALL RATED WALLS AND SOUND BARRIER WALLS AND AT BACK TO BACK ELECTRICAL BOXES AT SMOKE PARTITION WALLS, TYP.
- PROVIDE STRAPPING AND BLOCKING AT FURRING WALL. SEE DETAIL 12 / A502A
- LINE INDICATES EXISTING WALL OR STRUCTURE. PROVIDE 1/4" AIR GAP.
- GYPSUM BOARD SHAFER LINER PANEL, 1" THICK, TYPE "X", ATTACHED TO C-H STUDS.
- STEEL RUNNER, "J" SHAPED WITH UNEQUAL LEGS OF 1" AND 2", 20 GA. ATTACHED TO FLOOR AND STRUCTURE ABOVE WITH FASTENERS LOCATED NO GREATER THAN 2" FROM ENDS AND NO MORE THAN 24" O.C. RUNNERS SHOULD BE POSITIONED WITH SHORT LEG TO FINISHED SIDE OF WALL.
- STOP STUD RUNNER AT BASE PLATES.
- STEEL PLATE, 3/8" THICK WITH 4-1/2" DIA. HILTI-HY200 EPOXY ANCHORS WITH 2-3/8" HILTI-2 ANCHORS, EMBED INTO CONCRETE 2-3/8".
- TUBE STEEL 3" x 3" x 3/16" AT 4'-0" O.C.
- SOLID STEEL OR QUARTZ MATERIAL AS OCCURS. ATTACHED TO WALL BELOW. SEE FINISH SCHEDULE.
- PLYWOOD, 1/2" THICK, CONTINUOUS FIRE TREATED, ATTACH PLYWOOD TO VERTICAL STEEL TUBE POST WITH 1" SHAPED METAL CLIPS AND FASTENERS.
- PROVIDE FULL BULLNOSE EDGE, CONTINUOUS.
- METAL STUDS 16 GA STRUCTURAL (35 MIL) AT 16" O.C. PROVIDE RUNNERS AT TOP AND BOTTOM. ATTACH TOP RUNNER TO PLYWOOD AND VERTICAL STEEL POST.
- LINE OF FLOOR.
- RESILIENT CHANNEL, 2" x 1/2", INSTALLED HORIZONTALLY AND SPACED AT 24" O.C.
- WHERE CONDITIONS PROHIBIT EXTENDING STUDS TO DECK, PROVIDE CROSS BRACING FROM TOP RUNNER OF WALL TO STRUCTURE ABOVE WITH 3-5/8" 20 GA STUDS AT 4'-0" O.C. ALTERNATE DIRECTION OF BRACING TO STRUCTURE EVERY 48" AS CONDITIONS ALLOW.
- TOP TRACK, 18 GA. REQUIRED AT CROSS-BRACED WALLS.

GENERAL NOTES

- CONTRACTOR SHALL VERIFY ITEMS LIKE SEMI OR FULLY RECESSED MISCELLANEOUS BOXES, PANELS, PLUMBING LINES, CONDUITS, PIPES, ETC. THAT ARE CONCEALED IN THE WALL. IF 3-5/8" METAL STUDS ARE INADEQUATE, CONTRACTOR SHALL NOTIFY THE ARCHITECT AND USE 6" STUDS. COORDINATE WITH ALL CONSULTANT DRAWINGS PRIOR TO WALL CONSTRUCTION AND USE 6" OR 8" 20 GAUGE METAL STUDS FOR FRAMING IN LIEU OF 3-5/8" METAL STUDS.
- USE 5/8" CEMENTITIOUS BOARD IF CERAMIC OR PORCELAIN WALL TILES ARE INDICATED IN THE FINISH SCHEDULE AS WALL FINISH. CEMENTITIOUS BOARD SHALL EXTEND FROM FINISHED FLOOR TO HEIGHT OF TILE. 5/8" WATER RESISTANT GYPSUM BOARD TO BE USED ABOVE TILE HEIGHT IN RESTROOMS. SEE FLOOR PLANS FOR CERTAIN UNIQUE LOCATIONS THAT REQUIRE LEAD LINED GYPSUM BOARD, IMPACT RESISTANT GYPSUM BOARD, SOUND ATTENUATION GYPSUM BOARD, ETC.
- PROVIDE CONTROL JOINT AS PER DETAIL 14 / A502A WHEN LENGTH OF GYPSUM BOARD EXCEEDS 50' IN ONE DIRECTION OR AS DIRECTED BY ARCHITECT. COORDINATE WITH ARCHITECT FOR CONTROL JOINT LOCATIONS. WHEN GYPSUM BOARD OR CEMENTITIOUS BOARD IS ATTACHED VERTICALLY, USE 1" LONG #6 DRYWALL SCREWS TO EACH STUD. SCREWS ARE 8" O.C. AT PERIMETER AND 12" AT INTERMEDIATE STUD. WHEN GYPSUM BOARD IS ATTACHED HORIZONTALLY TO STUDS, HORIZONTAL JOINTS SHALL BE STAGGERED WITH THOSE ON THE OPPOSITE SIDE. SCREWS FOR HORIZONTAL APPLICATION SHALL BE 8" O.C. AT VERTICAL EDGES AND 12" O.C. AT INTERMEDIATE STUDS.
- FOR LOCATION OF FIRE RATED WALLS AND SMOKE PARTITION WALLS SEE CODE COMPLIANCE PLAN.
- SEE DIMENSION FLOOR PLANS FOR WALL TYPES USED IN THIS PROJECT. SOME WALL TYPES MAY NOT BE USED IN THIS PROJECT.
- WHERE LEAD LINED WALLS ARE INDICATED ON THE DRAWINGS, USE 16 GA STUDS IN LIEU OF THE GAUGE OF STUDS CALLED OUT IN THE WALL TYPES.
- IN PLACES WHERE MECHANICAL DUCTS ARE DESIGNED TO PENETRATE THE FLOOR, TO MEET THE REQUIREMENTS OF FIRE RATING, PROVIDE A TWO-HOUR FIRE RATED ENCLOSURE AT TOP AND BOTTOM AS INDICATED IN DETAILS 5 / A502B AND 8 / A502B
- IN PLACES WHERE A TWO-HOUR HORIZONTAL ENCLOSURE IS REQUIRED TO SEPARATE THE DUCTS FROM THE SPACE BELOW, PROVIDE A TWO-HOUR FIRE RATED HORIZONTAL ASSEMBLY AS PER DETAIL 5 / A502B AND 8 / A502B
- IN PLACES WHERE BACKING IS REQUIRED IN WALLS TO SUPPORT WALL HUNG EQUIPMENT, CABINETS, ETC., PROVIDE BACKING IN WALL PER DETAILS 5 / A502A AND 13 / A502A

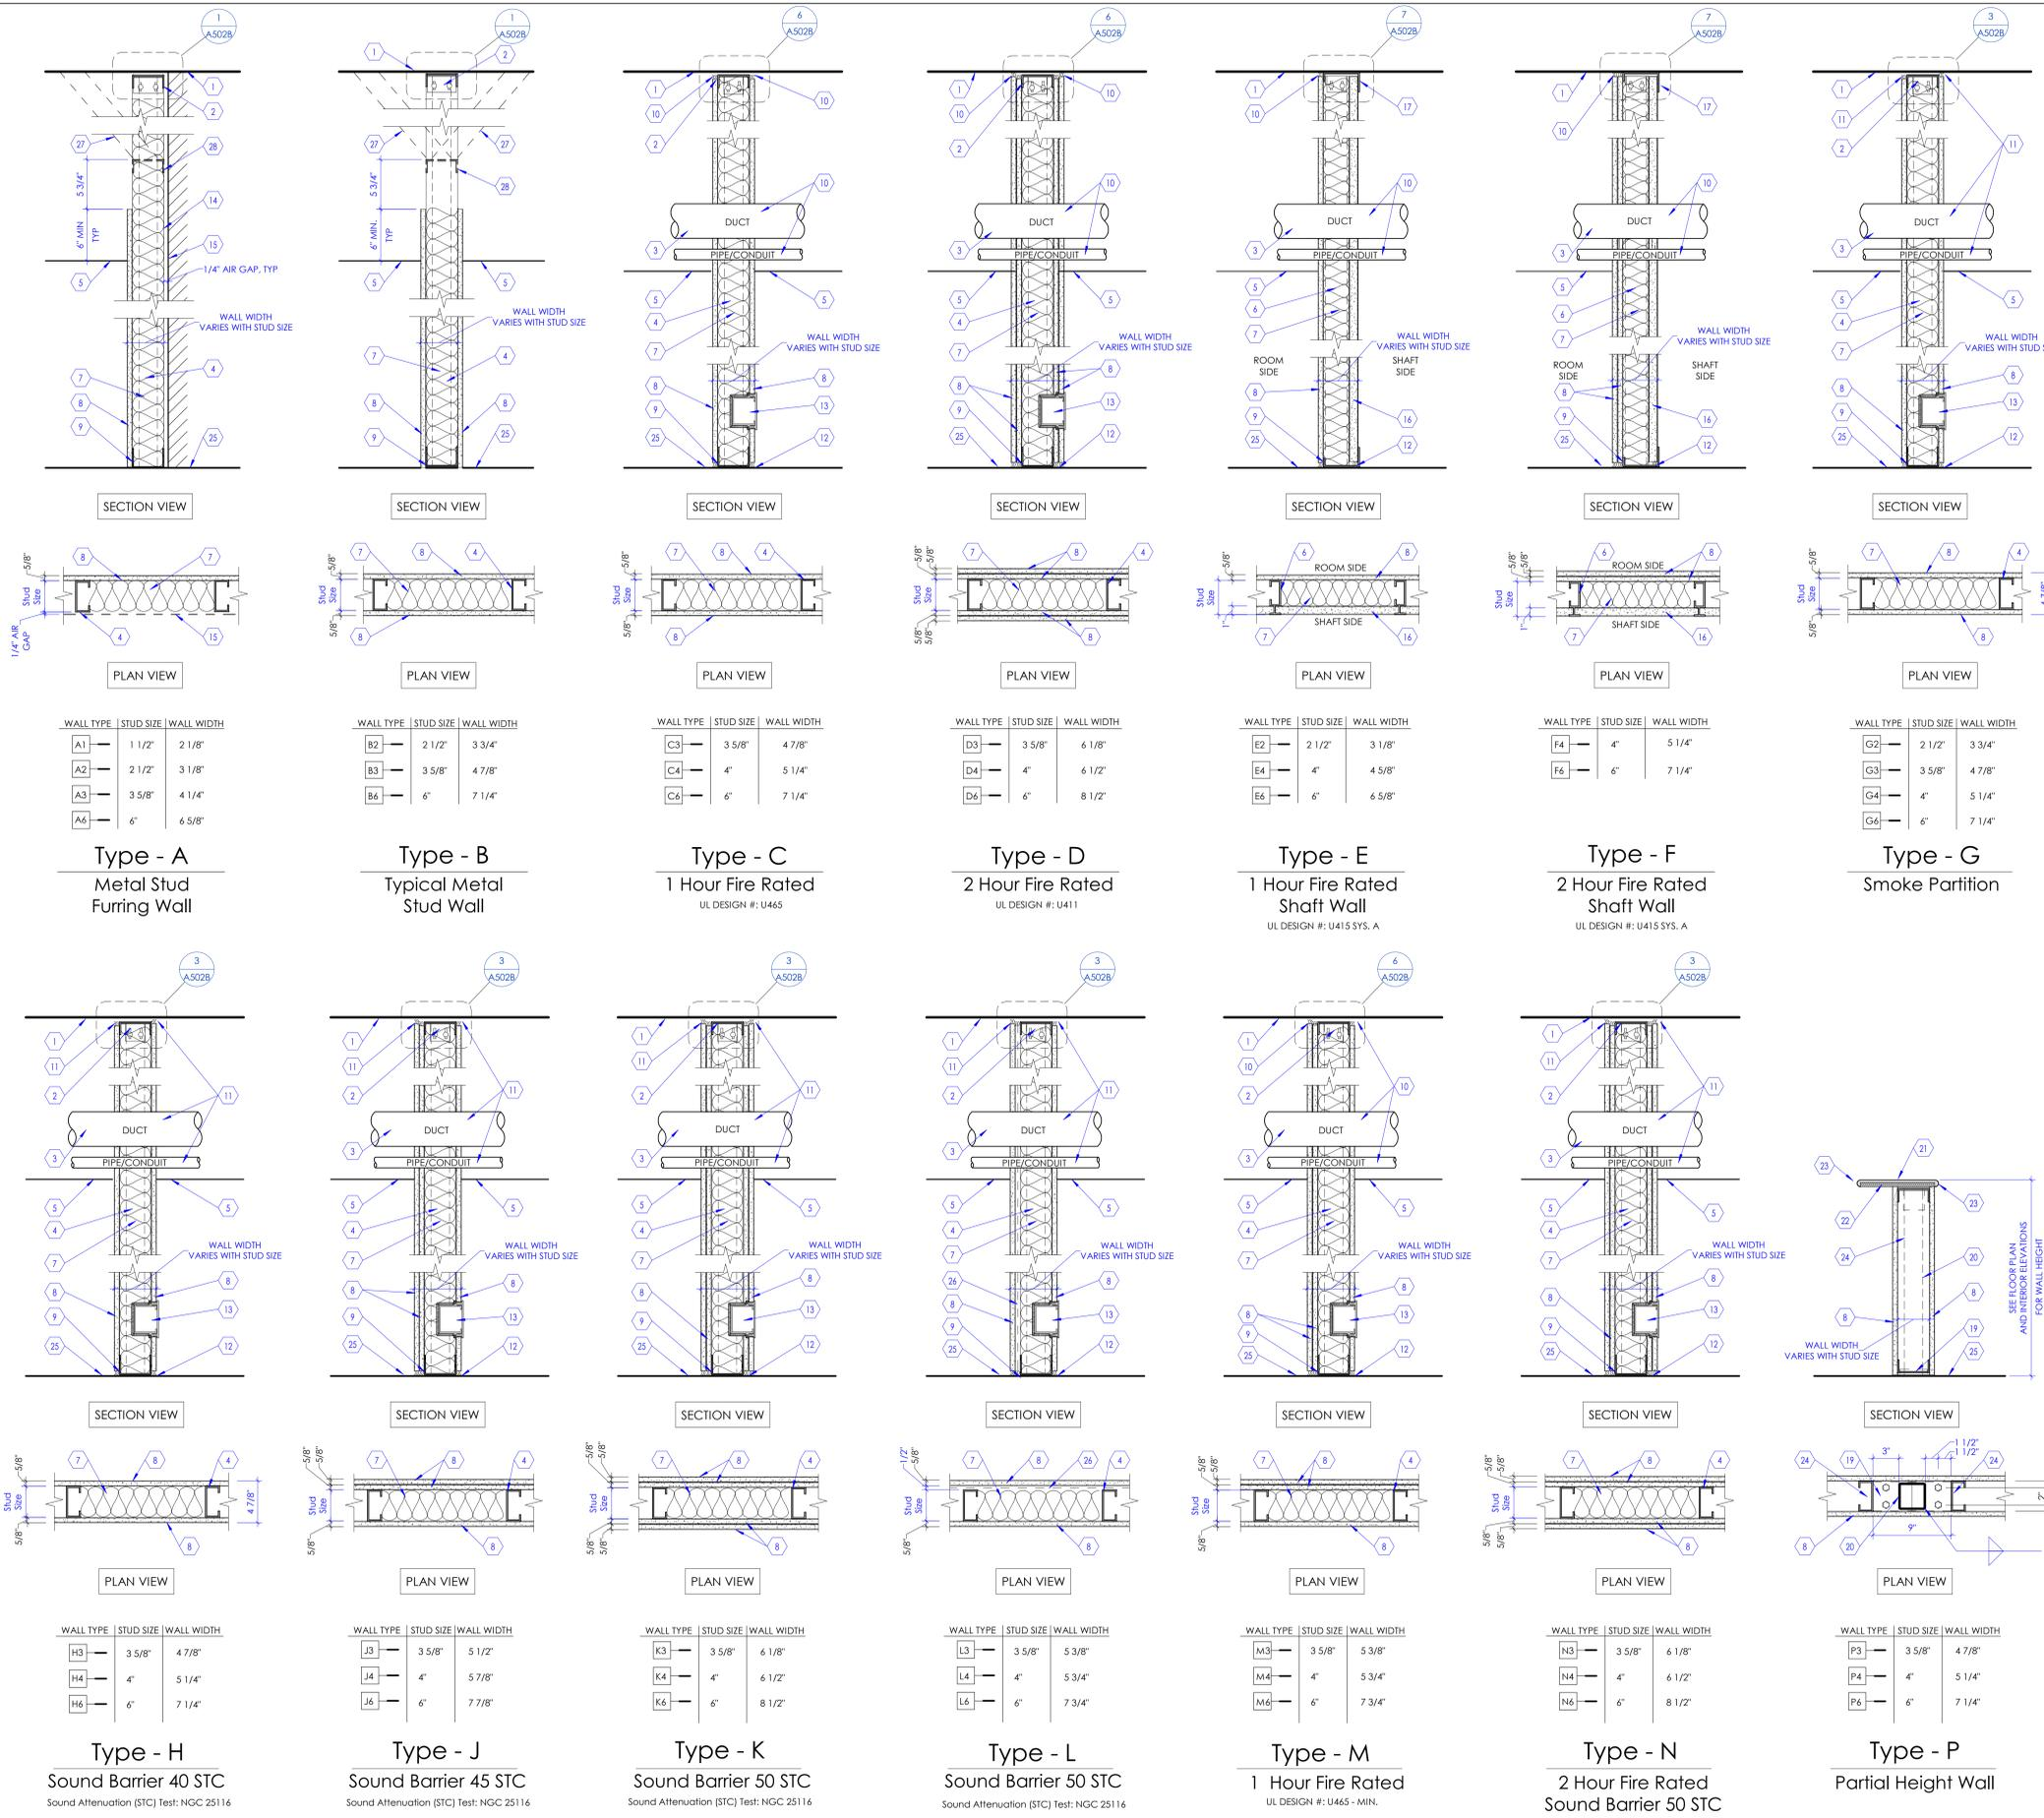


1 Wall Types (Note: See dimension floor plans for locations of wall types used in this project. Some wall types shown above may not be used in this project.)
 SCALE: 1 1/2" = 1'-0"

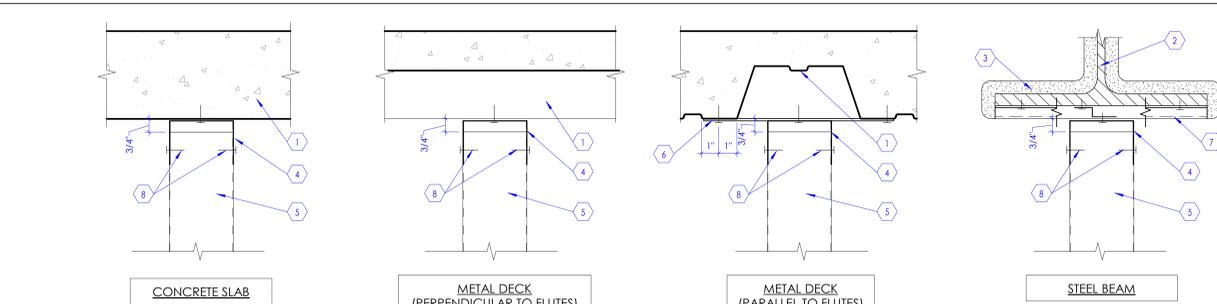

1 Head Condition at Non Fire Rated, Non Smoke Rated and Non Sound Barrier Partitions
SCALE: 3" = 1'-0"

KEYED NOTES

- FLOOR OR ROOF DECK AS OCCURS.
- STEEL BEAM AS OCCURS. SEE STRUCTURAL DRAWINGS.
- SPRAY APPLIED FIRE RESISTIVE MATERIAL (SFRM).
- SLOTTED TOP TRACK. FOR ADDITIONAL INFORMATION SEE DETAIL 9 / A502B
- METAL STUD WALL. SEE WALL TYPES ON SHEET A501A FOR ADDITIONAL INFORMATION.
- STRAPS 2" x 18" GA AT 16" O.C.
- Z-BARS 20 GA TO ACCOMMODATE SFRM THICKNESS.

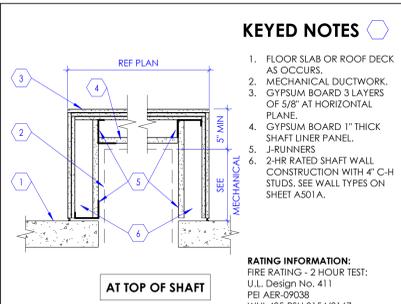


2 2-HR Enclosure at Top of Shaft
SCALE: 1" = 1'-0"

KEYED NOTES

- FLOOR SLAB OR ROOF DECK AS OCCURS.
- MECHANICAL DUCTWORK.
- GYPSON BOARD 3 LAYERS OF 5/8" AT HORIZONTAL PLANE.
- GYPSON BOARD 1" THICK SHAFT LINER PANEL.
- J-RUNNERS.
- 2-HR RATED SHAFT WALL CONSTRUCTION WITH 4" C-H STUDS. SEE WALL TYPES ON SHEET A501A.

RATING INFORMATION:
FIRE RATING - 2 HOUR TEST:
U.L. Design No. 411
PEI AER-0903B
WHI-495-PSH 0154/0167

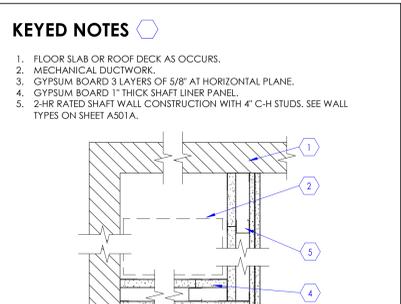


3 2-HR Horizontal Assembly
SCALE: 1 1/2" = 1'-0"

KEYED NOTES

- FLOOR SLAB OR ROOF DECK AS OCCURS.
- MECHANICAL DUCTWORK.
- GYPSON BOARD 3 LAYERS OF 5/8" AT HORIZONTAL PLANE.
- GYPSON BOARD 1" THICK SHAFT LINER PANEL.
- J-RUNNERS.
- 2-HR RATED SHAFT WALL CONSTRUCTION. SEE WALL TYPES ON SHEET A501A.

RATING INFORMATION:
HORIZONTAL FIRE RATING - 2 HOUR TEST:
WHI-495-PSH 0154/0167


RATING INFORMATION:
HORIZONTAL FIRE RATING - 2 HOUR TEST:
WHI-495-PSH 0154/0167

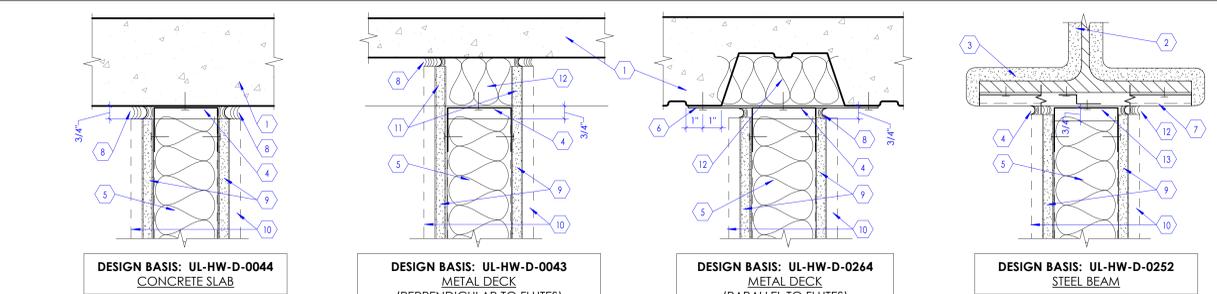

4 Head Condition at Smoke Partitions and Sound Barrier Walls
SCALE: 3" = 1'-0"

KEYED NOTES

- FLOOR OR ROOF DECK AS OCCURS.
- STEEL BEAM AS OCCURS. SEE STRUCTURAL DRAWINGS.
- SPRAY APPLIED FIRE RESISTIVE MATERIAL (SFRM).
- SLOTTED TOP TRACK. FOR ADDITIONAL INFORMATION SEE DETAIL 9 / A502B
- METAL STUD WALL. SEE WALL TYPES ON SHEET A501A FOR ADDITIONAL INFORMATION.
- STRAPS, 2" x 18" GA AT 16" O.C.
- Z-BARS, 20 GA TO ACCOMMODATE SFRM THICKNESS.
- ACOUSTIC SEALANT, CONTINUOUS.
- GYPSON BOARD, 5/8" THICK. SEE WALL TYPES ON SHEET A501 FOR ADDITIONAL INFORMATION.
- ADDITIONAL LAYER OF GYP. BD. WHERE OCCURS.
- GYPSON BOARD CUT TO FOLLOW PROFILE OF DECKING AT SMOKE PARTITION BOTH AT SOUND WALLS.
- FILL FLUTE VOID WITH BATT INSULATION.

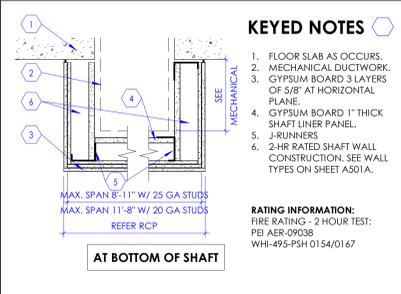

5 2-HR Enclosure at B.O. Shaft
SCALE: 1" = 1'-0"

KEYED NOTES

- FLOOR SLAB AS OCCURS.
- MECHANICAL DUCTWORK.
- GYPSON BOARD 3 LAYERS OF 5/8" AT HORIZONTAL PLANE.
- GYPSON BOARD 1" THICK SHAFT LINER PANEL.
- J-RUNNERS.
- 2-HR RATED SHAFT WALL CONSTRUCTION. SEE WALL TYPES ON SHEET A501A.


RATING INFORMATION:
FIRE RATING - 2 HOUR TEST:
PEI AER-0903B
WHI-495-PSH 0154/0167

KEYED NOTES

- FLOOR SLAB OR ROOF DECK AS OCCURS.
- MECHANICAL DUCTWORK.
- GYPSON BOARD 3 LAYERS OF 5/8" AT HORIZONTAL PLANE.
- GYPSON BOARD 1" THICK SHAFT LINER PANEL.
- J-RUNNERS.
- 2-HR RATED SHAFT WALL CONSTRUCTION WITH 4" C-H STUDS. SEE WALL TYPES ON SHEET A501A.

RATING INFORMATION:
HORIZONTAL FIRE RATING - 2 HOUR TEST:
WHI-495-PSH 0154/0167


6 Head Condition at Fire Rated Partitions
SCALE: 3" = 1'-0"

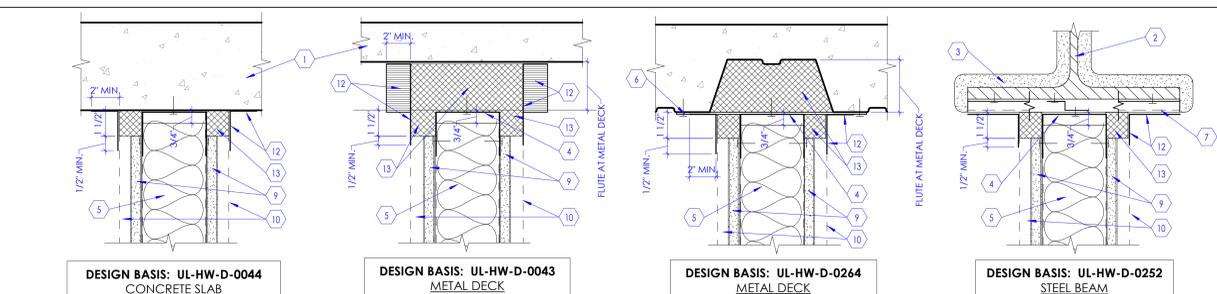

6 Head Condition at Fire Rated Partitions
SCALE: 3" = 1'-0"

KEYED NOTES

- FLOOR OR ROOF DECK AS OCCURS.
- STEEL BEAM AS OCCURS. SEE STRUCTURAL DRAWINGS.
- SPRAY APPLIED FIRE RESISTIVE MATERIAL (SFRM).
- SLOTTED TOP TRACK. FOR ADDITIONAL INFORMATION SEE DETAIL 9 / A502B
- METAL STUD WALL. SEE WALL TYPES ON SHEET A501A FOR ADDITIONAL INFORMATION.
- STRAPS, 2" x 18" GA AT 16" O.C.
- Z-BARS, 20 GA TO ACCOMMODATE SFRM THICKNESS.
- ACOUSTIC SEALANT, CONTINUOUS.
- GYPSON BOARD, 5/8" THICK, TYPE 'X'.
- ADDITIONAL LAYER OF GYP. BD. AT 2-HR RATED WALLS.
- GYPSON BOARD CUT TO FOLLOW PROFILE OF DECKING AT SMOKE PARTITION BOTH AT SOUND WALLS.
- FIRE STOP JOINT SPRAY.
- MINERAL WOOL 4 LB. FRICTION FIT BETWEEN TOP TRACK AND FLUTE.

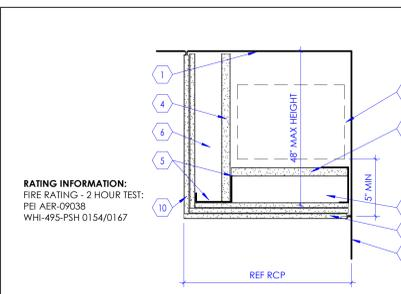

7 2-HR Horizontal Enclosure at Ductwork
SCALE: 1 1/2" = 1'-0"


KEYED NOTES

- FLOOR SLAB OR ROOF DECK AS OCCURS.
- MECHANICAL DUCTWORK.
- GYPSON BOARD 3 LAYERS OF 5/8" AT HORIZONTAL PLANE.
- GYPSON BOARD 1" THICK SHAFT LINER PANEL.
- J-RUNNERS.
- 2-HR RATED SHAFT WALL CONSTRUCTION WITH 4" C-H STUDS. SEE WALL TYPES ON SHEET A501A.
- WALL BEYOND.
- METAL STUD FRAMING: SEE PLANS FOR STUD SIZE.
- SHAFT WALL FRAMING WITH 1 1/2" C-H STUDS.
- GYPSON BOARD 2 LAYERS OF 5/8".

RATING INFORMATION:
HORIZONTAL FIRE RATING - 2 HOUR TEST:
PEI AER-0903B
WHI-495-PSH 0154/0167

KEYED NOTES

- FLOOR SLAB OR ROOF DECK AS OCCURS.
- MECHANICAL DUCTWORK.
- GYPSON BOARD 3 LAYERS OF 5/8" AT HORIZONTAL PLANE.
- GYPSON BOARD 1" THICK SHAFT LINER PANEL.
- J-RUNNERS.
- 2-HR RATED SHAFT WALL CONSTRUCTION WITH 4" C-H STUDS. SEE WALL TYPES ON SHEET A501A.
- WALL BEYOND.
- METAL STUD FRAMING: SEE PLANS FOR STUD SIZE.
- SHAFT WALL FRAMING WITH 1 1/2" C-H STUDS.
- GYPSON BOARD 2 LAYERS OF 5/8".

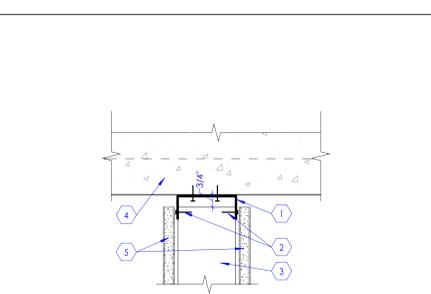


8 Slip Connection Detail
SCALE: 3" = 1'-0"

KEYED NOTES

- SLOTTED DEEP LEG DEFLECTION TRACK, 16GA CONTINUOUS. SECURE TO SUPERSTRUCTURE ABOVE IN A WAY THAT PROVIDES LATERAL STABILITY PERPENDICULAR TO AND IN-PLANE WITH WALL YET ALLOWING FOR A MINIMUM OF 3/4" OF VERTICAL DEFLECTION OF THE SUPERSTRUCTURE.
- SLIP CONNECTION. SECURE VERTICAL STUDS TO SLOTTED TOP TRACK AT MID-HEIGHT OF VERTICAL SLOTS IN TRACK. COMPONENTS INTENDED TO SLIDE VERTICALLY AS SUPERSTRUCTURE DEFLECTS.
- VERTICAL STUD. SEE INTERIOR WALL TYPES ON SHEET A501A.
- FLOOR OR ROOF DECK AS OCCURS.
- GYPSON BOARD, 5/8" THICK, TYPE 'X'. TYPICAL. DO NOT SCREW GYPSON WALLBOARD TO TOP TRACK OR SUPERSTRUCTURE. GWB SCREWS INTO THE STUDS MUST BE AT LEAST 1" BELOW THE BOTTOM OF THE TOP TRACK.

GENERAL NOTES


- CONDITIONS INDICATED SHOW DESIGN INTENT. ESPECIALLY IN REGARD TO ACCOMMODATION OF STRUCTURAL DEFLECTION AND CONTINUITY OF INTEGRITY OF SOUND, SMOKE AND FIRE WALLS.
- DESIGN INTENT DETAILS MAY NOT SHOW ALL CONDITIONS TO BE ENCOUNTERED ON A PROJECT.
- RIGIDLY SECURE SLOTTED TOP TRACK TO BUILDING SUPERSTRUCTURE IN AN APPROVED MANNER. EMPLOY Z-BARS, COLD-ROLLED CHANNELS OR SIMILAR SPACER TO ACCOMMODATE THICKNESS OF SPRAY-APPLIED FIRE-RESISTIVE MATERIALS (SFRM).
- SLOTTED TOP TRACK, INDICATED ON THESE DETAILS, IS THE BASIS FOR DESIGN AND REFERS TO DEEP-LEG TRACKS WITH VERTICALLY SLOTTED HOLES.
- REFER TO PARTITION STANDARDS FOR SPECIFIC WALL TYPES.
- AT FIRE-RATED WALLS REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS REGARDING HEAD-OF-WALL CONDITIONS.
- MAINTAIN ACOUSTIC RATING WHERE SOUND-CONTROL WALLS ARE INDICATED.
- FIRESTOPPING AND ACOUSTICAL SEALANTS SHALL AUTOBOND, PROVIDE EXPLOSION CLEAN SEALANT (TO CONCEAL FIRESTOPPING) AT FOOD SERVICE FACILITIES, KITCHEN, BIOLOGICAL CONTAINMENT AND CLEAN ROOM APPLICATIONS.
- WHERE A WALL IS DESIGNATED AS BOTH A SOUND-CONTROL WALL AND A FIRE-RATED WALL REFER TO FIRE-RATED HEAD-OF-WALL CONDITIONS.
- WHERE A WALL IS DESIGNATED AS A SOUND-CONTROL WALL, FILL ALL VOIDS WITH SOUND ATTENUATION BATS (SAB).
- AT SMOKE PARTITIONS AND SOUND-CONTROL WALLS EXTEND GWB ON BOTH SIDES INTO THE FLUTES. CUT TO FOLLOW UNDOULATING SURFACES OF THE SUPERSTRUCTURE INCLUDING, BUT NOT LIMITED TO, FLUTES IN METAL DECKING. PROVIDE A CONTINUOUS BEAD OF SEALANT (AS SPECIFIED) TO SUPERSTRUCTURE.

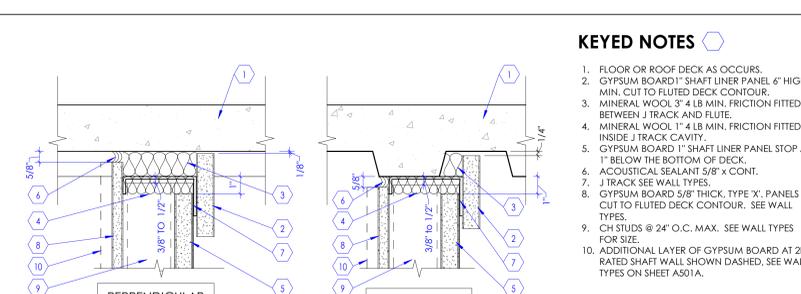

9 Alternate Framing Details at Rated Walls
SCALE: 3" = 1'-0"

KEYED NOTES

- FLOOR OR ROOF DECK AS OCCURS.
- GYPSON BOARD 1" SHAFT LINER PANEL 6" HIGH MIN. CUT TO FLUTED DECK CONTOUR.
- MINERAL WOOL 3" 4 LB MIN. FRICTION FITTED BETWEEN J TRACK AND FLUTE.
- MINERAL WOOL 1" 4 LB MIN. FRICTION FITTED INSIDE J TRACK CAVITY.
- GYPSON BOARD 1" SHAFT LINER PANEL STOP AT 1" BELOW THE BOTTOM OF DECK.
- ACOUSTICAL SEALANT 5/8" X CONT.
- J TRACK SEE WALL TYPES.
- GYPSON BOARD 5/8" THICK, TYPE 'X'. PANELS CUT TO FLUTED DECK CONTOUR. SEE WALL TYPES.
- C-H STUDS @ 24" O.C. MAX. SEE WALL TYPES FOR SIZE.
- ADDITIONAL LAYER OF GYPSON BOARD AT 2HR RATED SHAFT WALL SHOWN DASHED, SEE WALL TYPES ON SHEET A501A.

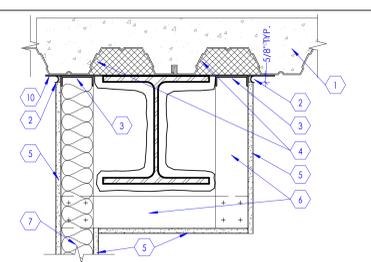


10 2-HR Horizontal Enclosure WITH OFFSET
SCALE: 1 1/2" = 1'-0"

KEYED NOTES

- FLOOR OR ROOF DECK AS OCCURS.
- CONTINUOUS ACOUSTIC/SMOKE SEALANT/FIRE STOP AS REQUIRED EACH SIDE.
- SLOTTED TOP TRACK. FOR ADDITIONAL INFORMATION SEE DETAIL 9 / A502B
- FILL FLUTE AT METAL DECK WITH CONTINUOUS 4LB MINERAL WOOL. FRICTION FIT BETWEEN TOP TRACK AND FLUTE.
- GYPSON BOARD, 5/8" THICK, TYPE 'X', TYPICAL.
- METAL STUDS AT 16" O.C. MATCH PARTITION TYPE, PACK FULL WITH INSULATION AS REQUIRED.
- PARTITION WALL AS SCHEDULED.
- SHAFT WALL AS SCHEDULED.
- FIRE STOP AS REQUIRED.
- STRAPS, 2" x 18" GA AT 16" O.C.

NOTE: THIS DETAIL APPLIES AT ALL FULL HEIGHT NON-RATED, SMOKE TIGHT, OR 1 HOUR RATED PARTITIONS WHERE GWB IS OBSTRUCTED. U.N.O.

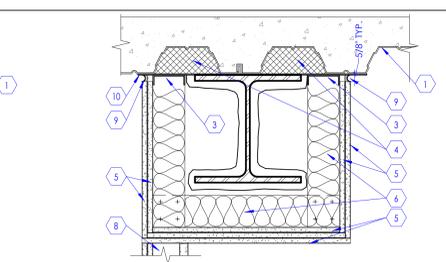

11 2-HR Horizontal Enclosure WHERE ONE SIDE OF WALL IS OBSTRUCTED
SCALE: 1 1/2" = 1'-0"

KEYED NOTES

- FLOOR OR ROOF DECK AS OCCURS.
- CONTINUOUS ACOUSTIC/SMOKE SEALANT/FIRE STOP AS REQUIRED EACH SIDE.
- SLOTTED TOP TRACK. FOR ADDITIONAL INFORMATION SEE DETAIL 9 / A502B
- FILL FLUTE AT METAL DECK WITH CONTINUOUS 4LB MINERAL WOOL. FRICTION FIT BETWEEN TOP TRACK AND FLUTE.
- GYPSON BOARD, 5/8" THICK, TYPE 'X', TYPICAL.
- METAL STUDS AT 16" O.C. MATCH PARTITION TYPE, PACK FULL WITH INSULATION AS REQUIRED.
- PARTITION WALL AS SCHEDULED.
- SHAFT WALL AS SCHEDULED.
- FIRE STOP AS REQUIRED.
- STRAPS, 2" x 18" GA AT 16" O.C.

NOTE: THIS DETAIL APPLIES AT ALL SHAFTWALL CONDITIONS WHERE WALL CANNOT EXTEND FULLY TO DECK. U.N.O.

NJRA ARCHITECTS
NJRA Architects, Inc.
5272 S. College Drive, Suite 104
Murray, Utah 84123
801.364.9259
www.njraarchitects.com


INTERMOUNTAIN HEALTHCARE CAMPUS RECONFIGURATION - ASC
1350N 500 E
Logan, UT 84341

Project Manager	TERRI SDOBROOK
Project Designer	ERIC MEUB
Project Architect	FRANK PENROSE
Landscape Architect	ARCSITO
Civil Engineer	GREAT BASIN
Structural Engineer	REAVLEY
Mechanical Engineer	VAN BOERUM & FRANK
Electrical Engineer	SPICERUM
Plumbing Engineer	VAN BOERUM & FRANK
Interior Designer	RUBY THORP
Equipment Planner	ROBERT GRIESCHE
Wayfinding	


MARK	DATE	DESCRIPTION

Project Number 10173823
Original Issue 11/6/20

Sheet Name **Wall Details**
Sheet Number **A502B**
Project Status 100% Construction Documents

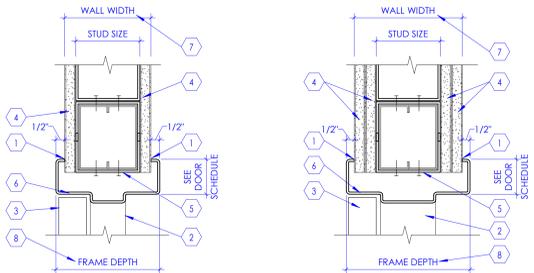





HEAD DETAIL - SECTION VIEW

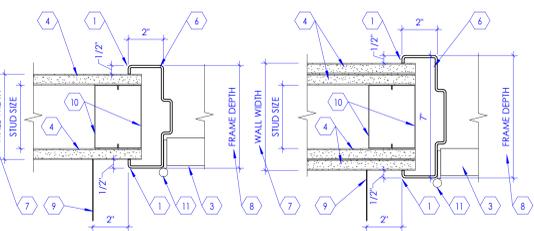

JAMB DETAIL - PLAN VIEW

- KEYED NOTES**
- CONTINUOUS SEALANT ON ALL SIDES INCLUDING TOP OF DOOR FRAME.
 - DOOR FRAME SEEN BEYOND.
 - DOOR. SEE DOOR SCHEDULE FOR DOOR TYPE.
 - GYPSUM BOARD, 5/8" THICK, TYPE 'X'. ATTACH TO METAL STUD FRAMING. SEE WALL TYPES.
 - STEEL RINNER (18 GAUGE) FASTENED WITH SCREWS TO STRUT STUDS AT EACH END. SEE DETAIL 4/A502A.
 - HOLLOW METAL DOOR FRAME. FRAME THICKNESS VARIES WITH WALL THICKNESS. SEE FLOOR PLAN AND WALL SECTIONS. PAINT FRAME.
 - SEE WALL TYPES FOR WALL WIDTH AND STUD SIZE.
 - FRAME DEPTH SHALL BE WALL WIDTH PLUS 1".
 - LINE OF WALL AS OCCURS.
 - PROVIDE DOUBLE METAL STUDS AT FRAME JAMBS, WALL ENDS, ETC. PROVIDE STEEL STRAPS (6" HIGH 16 GAUGE STRAPS AT 2'-0" O.C.) SEE DETAIL 7/A502A.
 - DOOR HINGE AS OCCURS. SEE DOOR AND HARDWARE SCHEDULE. SEE FLOOR PLAN FOR DOOR SWING.

1 Door Frame in Stud Wall
SCALE: 3" = 1'-0"

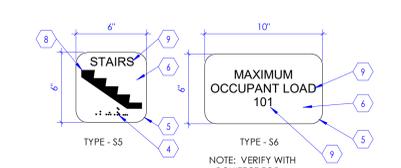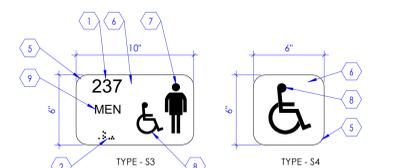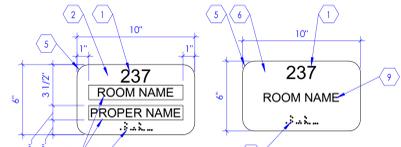


NOTE: TYPE - S1 SIGN SHOWN. MOUNTING FOR OTHER SIGN TYPES SHALL BE SIMILAR.

A Sign Types
SCALE: 2" = 1'-0"

2 Room Signage Detail
SCALE: 2" = 1'-0"


- KEYED NOTES**
- ROOM NUMBER (1/32" RAISED TEXT CHARACTERS, HELVETICA FONT, MATTE FINISHED OPAQUE ACRYLIC SHEET) ATTACHED TO FRONT PANEL.
 - MATE FINISHED OPAQUE ACRYLIC FRONT PANEL (WITH TRANSPARENT WINDOW) ATTACHED TO BASE PANEL.
 - TRANSPARENT WINDOW FOR TEXT INSERT (HELVETICA FONT). TEXT INSERT SHALL BE FURNISHED AND INSTALLED BY SIGN CONTRACTOR.
 - BRILLE CHARACTERS AS PER ADA (AMERICANS WITH DISABILITIES ACT) REQUIREMENTS DENOTING ROOM NUMBER AND NAME.
 - RADIUS CORNER, 1" TYPICAL.
 - MATE FINISHED OPAQUE ACRYLIC FRONT PANEL ATTACHED TO BASE PANEL.
 - PROVIDE APPROPRIATE SYMBOL FOR MEN, WOMEN, UNISEX, BOYS AND GIRLS TOILET ROOM AS OCCURS.
 - PROVIDE APPROPRIATE SYMBOL FOR STAIR, DISABLED SIGN, ETC. AS INDICATED.
 - ROOM NAME (1/32" RAISED TEXT CHARACTERS, HELVETICA FONT, MATTE FINISHED OPAQUE ACRYLIC SHEET) ATTACHED TO FRONT PANEL.
 - PROVIDE DISABLED SYMBOL AS INDICATED IN THE SIGN FOR ALL ROOMS THAT ARE WHEEL CHAIR ACCESSIBLE.
 - LINE OF WALL.
 - MATE FINISHED, OPAQUE ACRYLIC SHEET BASE PANEL. ATTACHED TO SHIM PLATE.
 - SHIM PLATE, ALUMINUM, 1/4" THICK, CONCEALED, WITH PRE-DRILLED HOLES FOR COUNTERSUNK FASTENERS. USE APPROPRIATE FASTENERS DEPENDING ON THE SUBSTRATE.
 - DOOR FRAME. SEE DOOR SCHEDULE.
 - RECESS 1/16" FOR TEXT INSERT, FOR SIGN TYPE - S1 ONLY.
 - SIGNAGE, O.F.O.I.
 - SIGN AT ALL ACCESSIBLE LOCATION, O.F.O.I.
 - DOOR FRAME. SEE DOOR SCHEDULE.
 - DOOR. SEE DOOR SCHEDULE.
 - OPENING IN WALL.
 - LINE OF FLOOR.

- NOTE:
A. PROVIDE ROOM SIGN AT EACH DOORWAY OR A WALL OPENING LEADING TO A ROOM.
B. SIGNAGE TO BE OWNER FURNISHED AND INSTALLED BY OWNERS VENDOR.

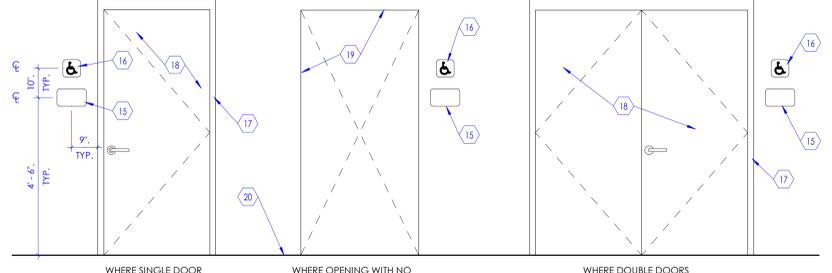


WHERE SINGLE DOOR OCCURS, MOUNT SIGNS ALONG THE LATCH SIDE.
WHERE OPENING WITH NO DOOR OCCURS, MOUNT SIGNS ALONG THE RIGHT SIDE.
WHERE DOUBLE DOORS OCCUR, MOUNT SIGNS ALONG THE RIGHT SIDE OF THE RIGHT-HAND DOOR.

C Sign Mounting Elevations
SCALE: 1/2" = 1'-0"

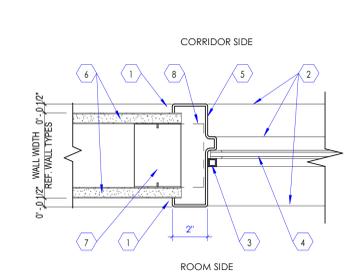


- KEYED NOTES**
- CONTINUOUS SEALANT ON BOTH SIDES OF THE FRAME.
 - WINDOW FRAME SEEN BELOW.
 - WINDOW GLAZING STOP. STOPS SHALL BE LOCATED ON THE MORE SECURE ROOM SIDE (AS OPPOSED TO THE LESS SECURE, CORRIDOR SIDE). COORDINATE WITH ARCHITECT FOR LESS AND MORE SECURE AREAS THAT ARE NOT APPARENT IN FLOOR PLAN.
 - 1/4" THICK, TEMPERED GLAZING. SEE WINDOW SCHEDULE.
 - HOLLOW METAL WINDOW FRAME. FRAME THICKNESS VARIES WITH WALL THICKNESS. SEE FLOOR PLAN AND WALL SECTIONS FOR WALL THICKNESS. PAINT FRAME.
 - GYPSUM BOARD, 5/8" THICK, TYPE 'X' TYPICAL. ATTACH TO METAL STUDS. SEE WALL TYPES.
 - WINDOW JAMB FRAMING. SEE DETAIL 11/A502A.
 - STEEL ANCHORS. ATTACH TO METAL STUDS WITH #8 PAN HEAD S.M.S., TYP. WELD TO FRAME.

3 Hollow Metal Window Frame - Jamb Detail
SCALE: 3" = 1'-0"

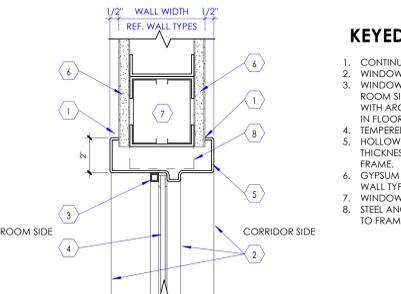


- KEYED NOTES**
- CONTINUOUS SEALANT ON BOTH SIDES OF THE FRAME.
 - WINDOW FRAME SEEN BEYOND.
 - WINDOW GLAZING STOP. STOPS SHALL BE LOCATED ON THE MORE SECURE ROOM SIDE (AS OPPOSED TO THE LESS SECURE, CORRIDOR SIDE). COORDINATE WITH ARCHITECT FOR LESS AND MORE SECURE AREAS THAT ARE NOT APPARENT IN FLOOR PLAN.
 - TEMPERED GLAZING. SEE WINDOW SCHEDULE.
 - HOLLOW METAL WINDOW FRAME. FRAME THICKNESS VARIES WITH WALL THICKNESS. SEE FLOOR PLAN AND WALL SECTIONS FOR WALL THICKNESS. PAINT FRAME.
 - GYPSUM BOARD, 5/8" THICK, TYPE 'X' TYPICAL. ATTACH TO METAL STUDS. SEE WALL TYPES.
 - WINDOW HEAD FRAMING. SEE DETAIL 11/A502A.
 - STEEL ANCHORS. ATTACH TO METAL STUDS WITH #8 PAN HEAD S.M.S., TYP. WELD TO FRAME.

4 Hollow Metal Window Frame - Head Detail
SCALE: 3" = 1'-0"

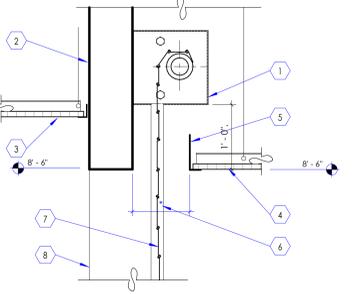


- KEYED NOTES**
- ELECTRICALLY OPERATED ROLL-UP DOOR / GRILLE HOOD.
 - GYPSUM BOARD HEADER. SEE CEILING PLAN.
 - SCHEDULED SLOPED CEILING. SEE CEILING PLAN.
 - WOOD PANEL CEILING AS SCHEDULED. SEE CEILING PLAN.
 - 4" HIGH AXONOM TRIM, BASIS OF DESIGN ARMSTRONG.
 - SLOT FOR ROLL-UP DOOR IN CEILING, PER MANUFACTURER.
 - DOOR / GRILLE & TRACK, PER MANUFACTURER.
 - FACE OF WALL BEYOND.
- NOTE:
COILING DOOR / ROLLING GRILLE MFR. TO PROVIDE TUBE STEEL COLUMNS AND BEAMS FOR HOOD AND JAMB ATTACHMENTS. CONTRACTOR TO COORDINATE W/ DOOR MFR. FOR BEAM / HOOD ELEVATION. NOTIFY ARCHITECT IF CONFLICTS ARISE.

6 Coiling Grille Head Detail
SCALE: 1 1/2" = 1'-0"

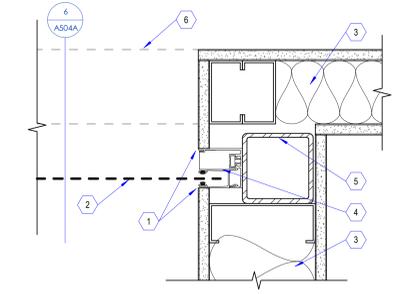


- KEYED NOTES**
- L-BEAD AND SEALANT, TYPICAL.
 - AUTOMATED COILING ROLL UP GRILLE. SEE FLOOR PLAN FOR DETAILS.
 - WALL AS SCHEDULED. SEE DIMENSION PLAN FOR WALL TYPE.
 - ALUMINUM GUIDES FOR ROLL UP GRILLE PER MANUFACTURER.
 - TUBE STEEL POST, 4" X 4" X 1/4" TUBE STEEL POST. ATTACH TO STRUCTURE ABOVE. SEE DETAIL 8/A504A.
 - GYPSUM BOARD HEADER ABOVE. SEE CEILING PLAN.

7 Detail at Guide
SCALE: 3" = 1'-0"

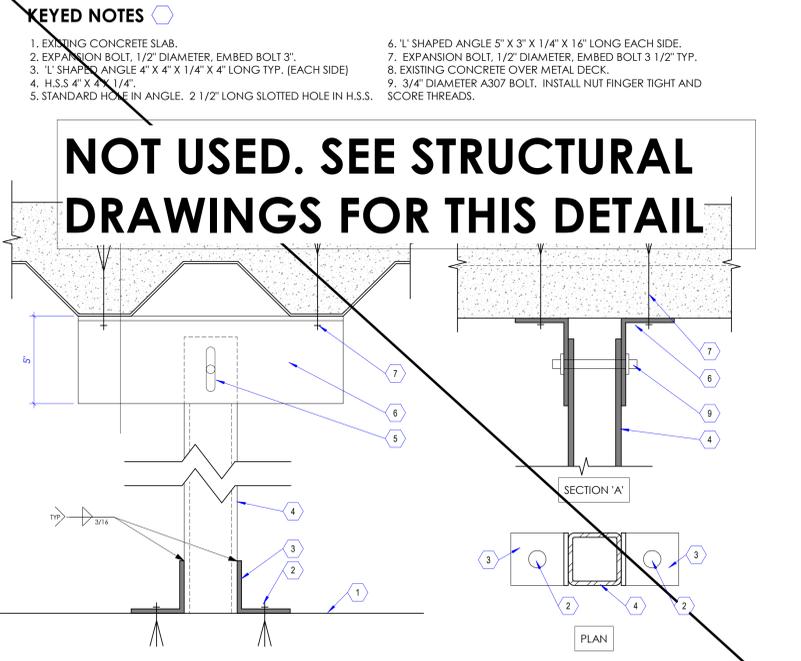

8 Tubular Steel Connection
SCALE: 3" = 1'-0"

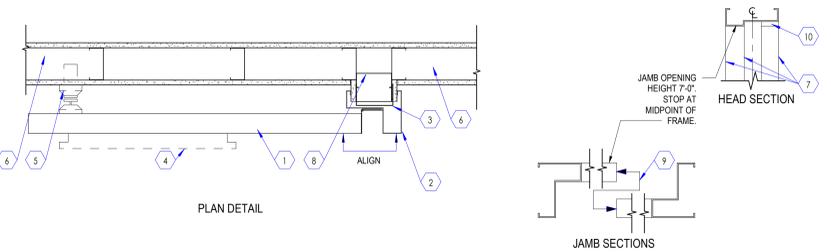

- KEYED NOTES**
- DOOR AS SCHEDULED (IN OPEN POSITION). SEE SHEET A1601.
 - DOOR FRAME. SEE DOOR HEAD AND JAMB DETAILS BELOW.
 - DOOR FRAME ANCHOR.
 - PANIC DEVICE HARDWARE.
 - ELECTROMAGNETIC HOLD OPEN, WHERE OCCURS.
 - METAL STUD WALL WITH GYPSUM BOARD. SEE FLOOR PLAN FOR PARTITION TYPES.
 - DOOR JAMB BEYOND.
 - JAMB STUDS. SEE DETAIL 11/A502A FOR CONDITION AT JAMB AND HEAD.
 - ALIGN AT MIDPOINT OF FRAME.
 - DOOR STOP BEYOND.

5 Double Egress Door Detail
SCALE: 1 1/2" = 1'-0"



NJRA Architects, Inc.
5272 S. College Drive, Suite 104
Murray, Utah 84123
801.364.9259
www.njraarchitects.com

INTERMOUNTAIN
HEALTHCARE
CAMPUS
RECONFIGURATION -
ASC
1350N 500 E
Logan, UT 84341



Project Manager	TERRI SLODROOK
Project Designer	ERIC MEUB
Project Architect	FRANK PENROSE
Landscape Architect	ARCSITO
Civil Engineer	GREAT BASIN
Structural Engineer	REAVELEY
Mechanical Engineer	VAN BOERUM & FRANK
Electrical Engineer	SPECTRUM
Plumbing Engineer	VAN BOERUM & FRANK
Interior Designer	RUBY THORP
Equipment Planner	ROBERT GRIESCHE
Wayfinding	

MARK	DATE	DESCRIPTION


Project Number 10173823
Original Issue 11/6/20



Sheet Name
Door & Window Details

Sheet Number
A504A

Project Status
100% Construction Documents

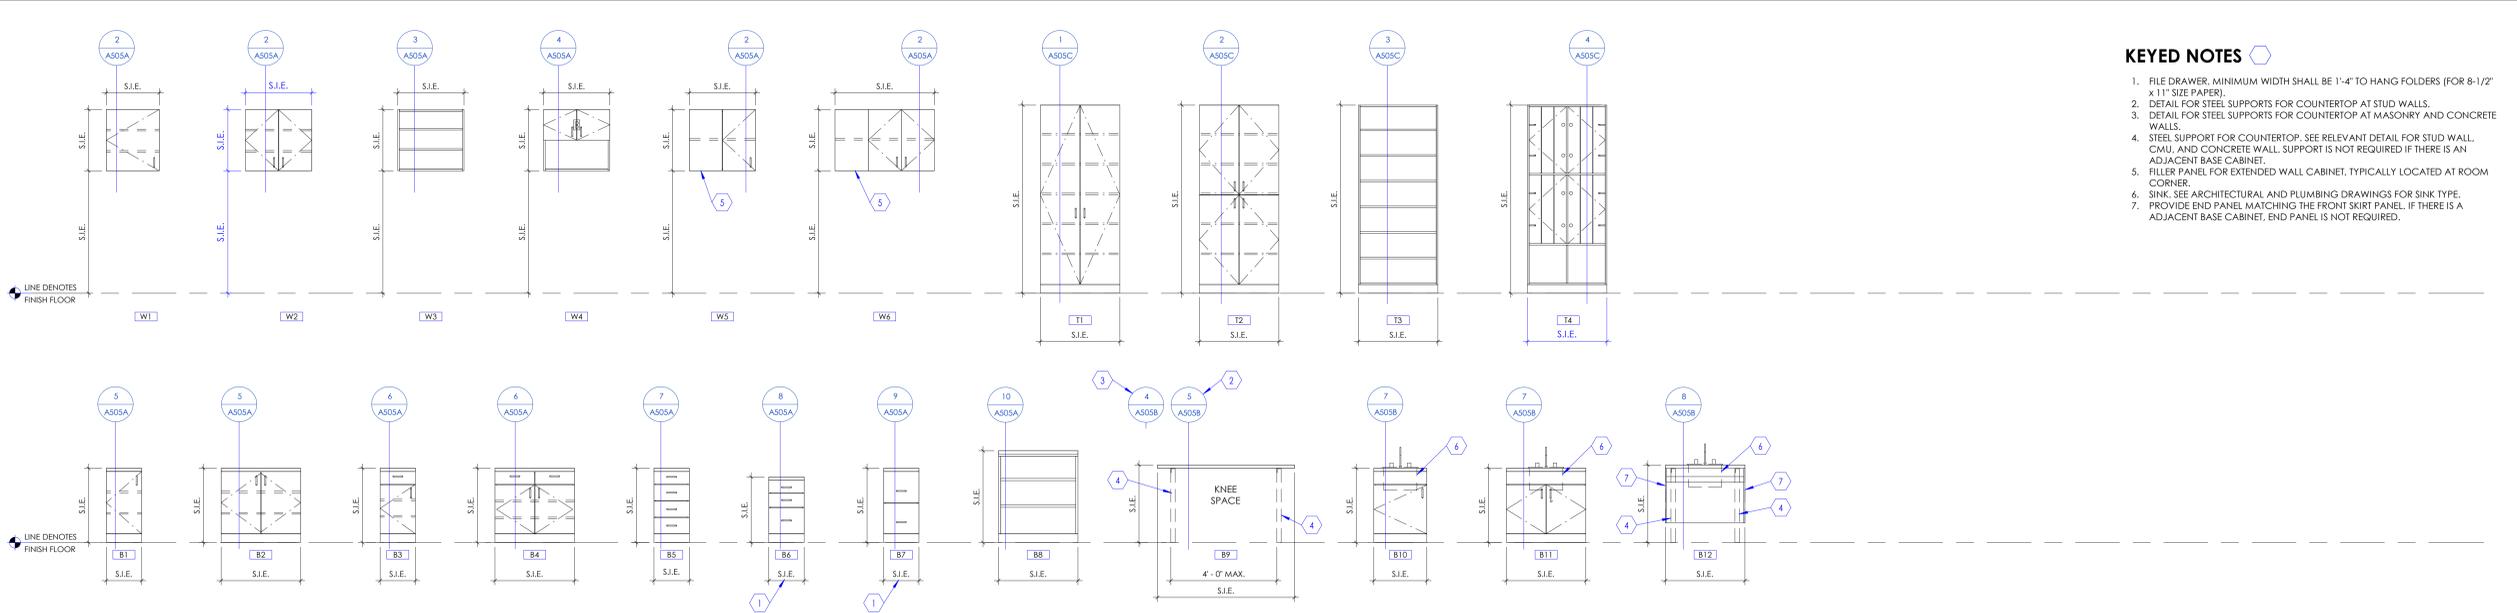


KEYED NOTES

- FILE DRAWER. MINIMUM WIDTH SHALL BE 1'-4" TO HANG FOLDERS (FOR 8-1/2" x 11" SIZE PAPER).
- DETAIL FOR STEEL SUPPORTS FOR COUNTERTOP AT STUD WALLS.
- DETAIL FOR STEEL SUPPORTS FOR COUNTERTOP AT MASONRY AND CONCRETE WALLS.
- STEEL SUPPORT FOR COUNTERTOP. SEE RELEVANT DETAIL FOR STUD WALL, CMU, AND CONCRETE WALL. SUPPORT IS NOT REQUIRED IF THERE IS AN ADJACENT BASE CABINET.
- FILLER PANEL FOR EXTENDED WALL CABINET, TYPICALLY LOCATED AT ROOM CORNER.
- SINK. SEE ARCHITECTURAL AND PLUMBING DRAWINGS FOR SINK TYPE.
- PROVIDE END PANEL MATCHING THE FRONT SKIRT PANEL, IF THERE IS A ADJACENT BASE CABINET, END PANEL IS NOT REQUIRED.


1 Cabinet Legend

Note: See Interior Elevations (S.I.E.) for occurrence of cabinet types used in this project. Some cabinet type shown above may not be used in this project.


SCALE: 3/8" = 1'-0"

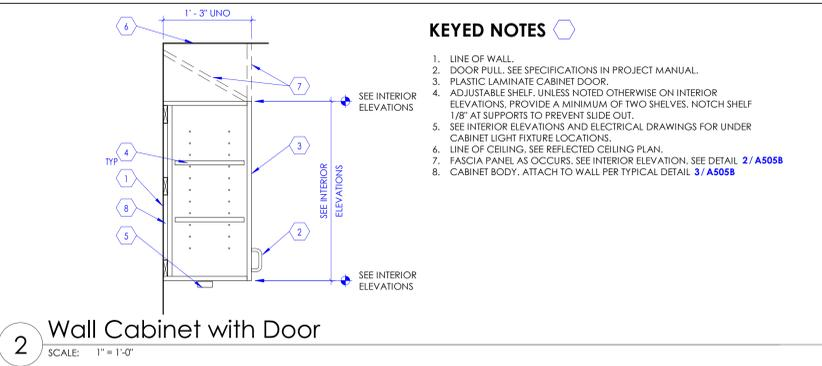


2 Wall Cabinet with Door

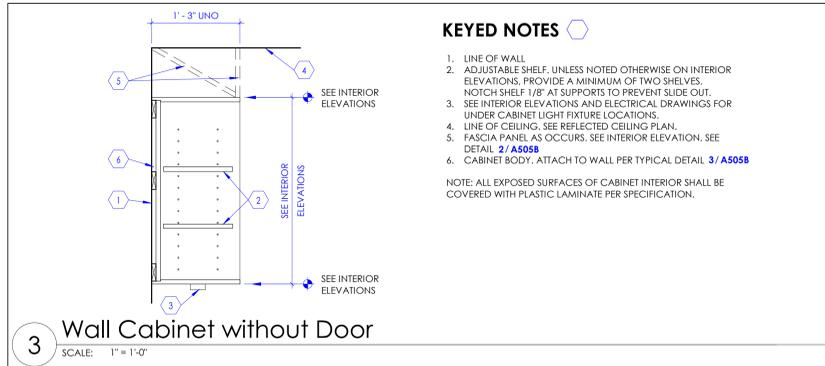


3 Wall Cabinet without Door

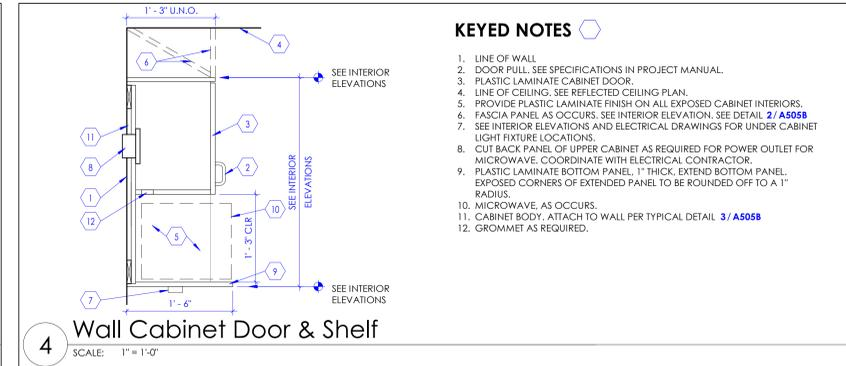


4 Wall Cabinet Door & Shelf

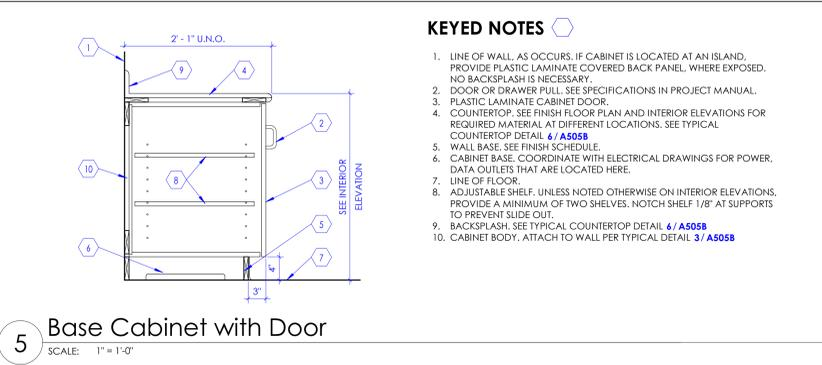


5 Base Cabinet with Door

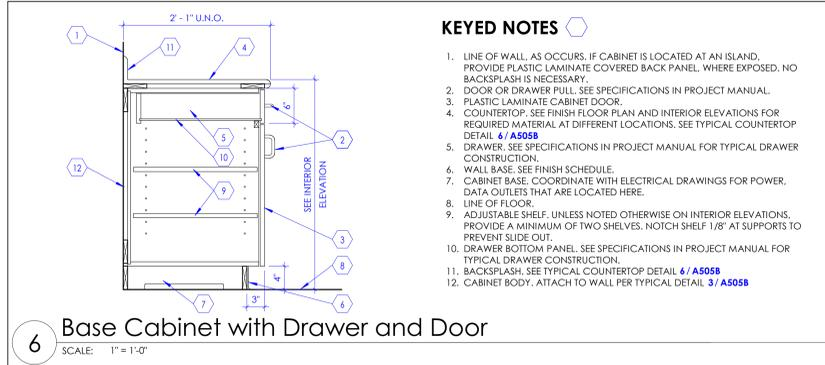


6 Base Cabinet with Drawer and Door

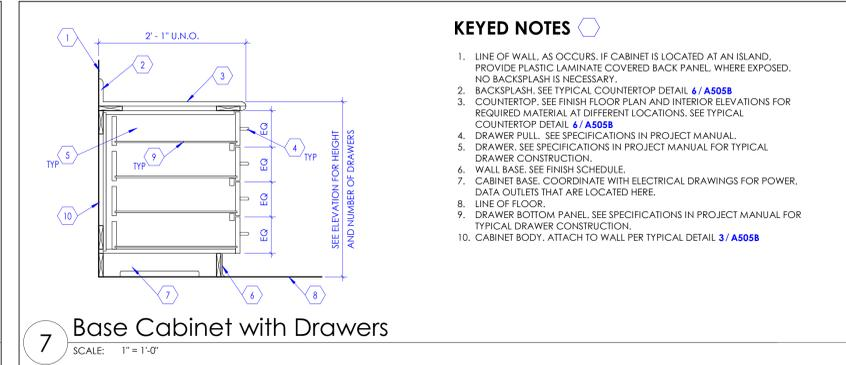


7 Base Cabinet with Drawers

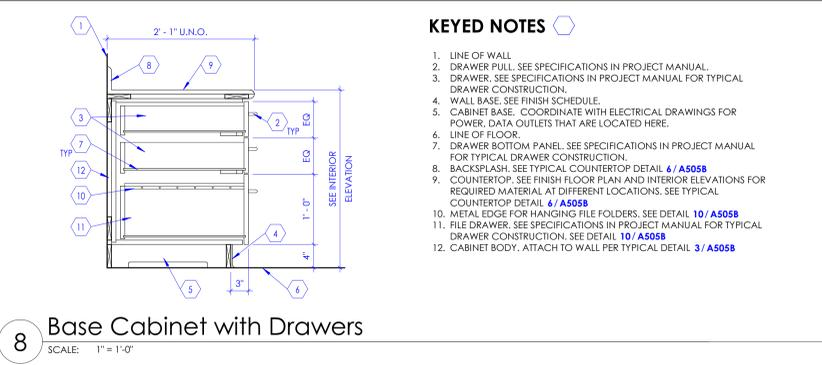

8 Base Cabinet with Drawers

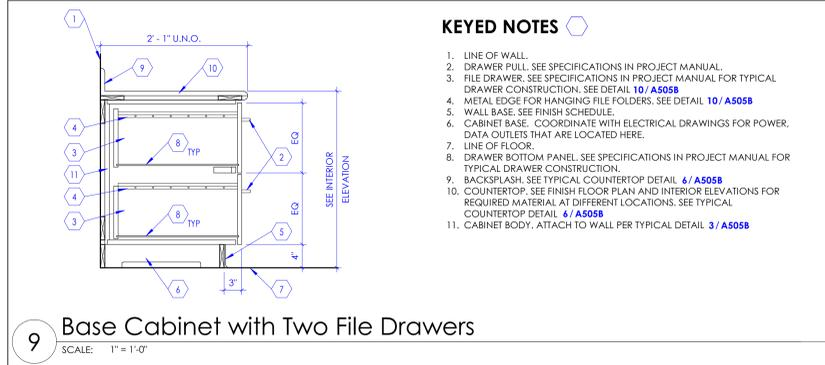

9 Base Cabinet with Two File Drawers

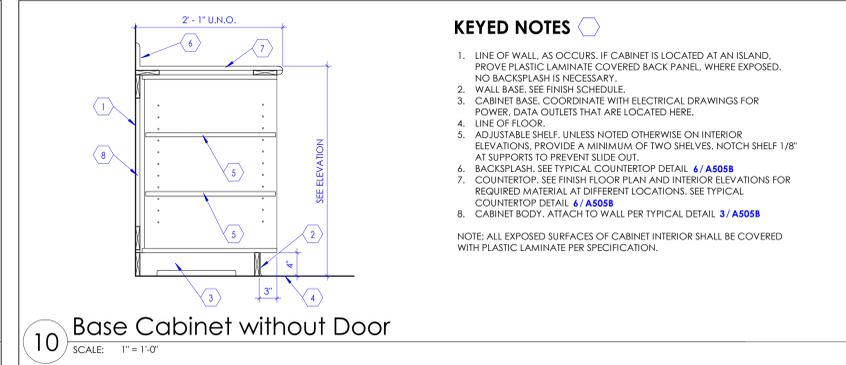

10 Base Cabinet without Door



NJRA Architects, Inc.
 5272 S. College Drive, Suite 104
 Murray, Utah 84123
 801.364.9259
 www.njraarchitects.com

**INTERMOUNTAIN
HEALTHCARE
CAMPUS
RECONFIGURATION -
ASC**

1350N 500 E
Logan, UT 84341



Project Manager	TERRI SDOBROOK
Project Designer	ERIC MEUB
Landscape Architect	FRANK PENROSE
Civil Engineer	ARCOSTITO
Structural Engineer	GREAT BASIN
Mechanical Engineer	REAVLEY
Electrical Engineer	VAN BOERUM & FRANK
Plumbing Engineer	SPECTRUM
Interior Designer	VAN BOERUM & FRANK
Equipment Planner	RUBY THORP
Wayfinding	ROBERT GRIESCHE

MARK	DATE	DESCRIPTION


Project Number | 10173823
 Original Issue | 11/6/20



Sheet Name
Cabinet Legend & Details

Sheet Number
A505A


Project Status
100% Construction Documents

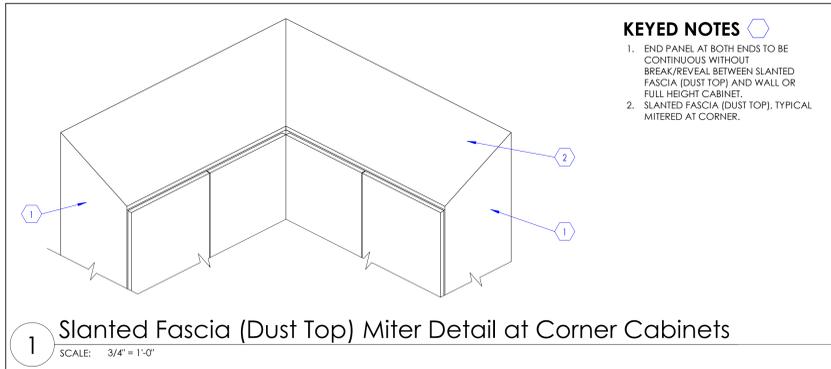

1 Slanted Fascia (Dust Top) Miter Detail at Corner Cabinets

SCALE: 3/4" = 1'-0"


- KEYED NOTES**
1. END PANEL AT BOTH ENDS TO BE CONTINUOUS WITHOUT BREAK/REVEAL BETWEEN SLANTED FASCIA (DUST TOP) AND WALL OR FULL HEIGHT CABINET.
 2. SLANTED FASCIA (DUST TOP), TYPICAL MITERED AT CORNER.

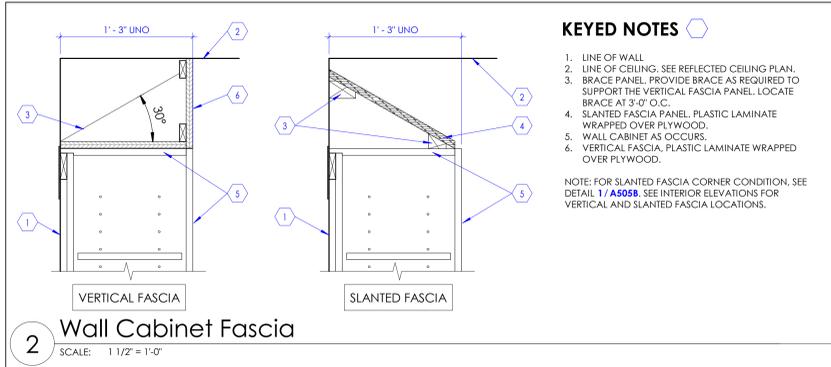

2 Wall Cabinet Fascia

SCALE: 1 1/2" = 1'-0"


- KEYED NOTES**
1. LINE OF WALL.
 2. LINE OF CEILING. SEE REFLECTED CEILING PLAN.
 3. BRACE PANEL. PROVIDE BRACE AS REQUIRED TO SUPPORT THE VERTICAL FASCIA PANEL. LOCATE BRACE AT 3'-0" O.C.
 4. SLANTED FASCIA PANEL. PLASTIC LAMINATE WRAPPED OVER PLYWOOD.
 5. WALL CABINET AS OCCURS.
 6. VERTICAL FASCIA. PLASTIC LAMINATE WRAPPED OVER PLYWOOD.
- NOTE: FOR SLANTED FASCIA CORNER CONDITION, SEE DETAIL 1/A505B. SEE INTERIOR ELEVATIONS FOR VERTICAL AND SLANTED FASCIA LOCATIONS.

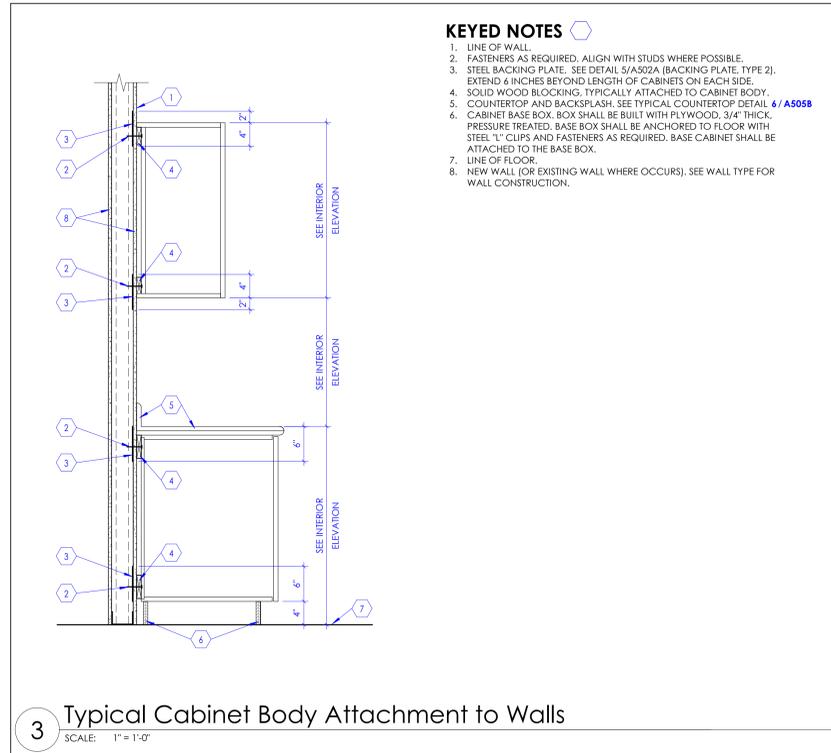

3 Typical Cabinet Body Attachment to Walls

SCALE: 1" = 1'-0"


- KEYED NOTES**
1. LINE OF WALL.
 2. FASTENERS AS REQUIRED. ALIGN WITH STUDS WHERE POSSIBLE.
 3. STEEL BACKING PLATE. SEE DETAIL 5/A502A (BACKING PLATE, TYPE 2). EXTEND 6 INCHES BEYOND LENGTH OF CABINETS ON EACH SIDE.
 4. SOLID WOOD BLOCKING, TYPICALLY ATTACHED TO CABINET BODY.
 5. COUNTERTOP AND BACKPLASH. SEE TYPICAL COUNTERTOP DETAIL 6/A505B.
 6. CABINET BASE BOX. BOX SHALL BE BUILT WITH PLYWOOD, 3/4" THICK, PRESSURE TREATED. BASE BOX SHALL BE ANCHORED TO FLOOR WITH STEEL 1" CLIPS AND FASTENERS AS REQUIRED. BASE CABINET SHALL BE ATTACHED TO THE BASE BOX.
 7. LINE OF FLOOR.
 8. NEW WALL (OR EXISTING WALL WHERE OCCURS). SEE WALL TYPE FOR WALL CONSTRUCTION.

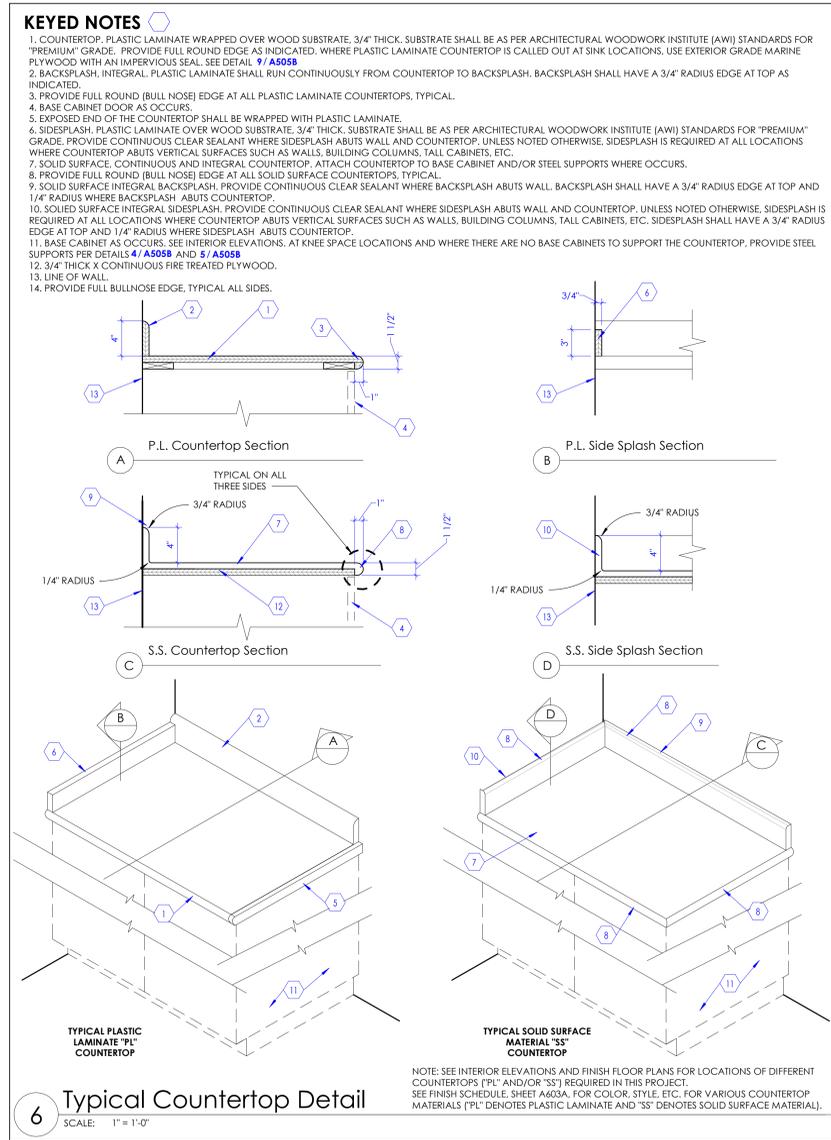

4 Steel Support For Countertop at Masonry & Concrete Walls

SCALE: 1" = 1'-0"

- KEYED NOTES**
1. LINE OF FLOOR.
 2. WALL BASE. SEE FINISH SCHEDULE.
 3. LINE OF MASONRY OR CONCRETE WALL AS OCCURS.
 4. COUNTERTOP SUPPORT. PAINTED. SUPPORT SHALL BE STEEL ANGLE, 2"x2"x1/4", PIECES MITERED AND WELDED @ 90° ANGLE AS INDICATED. CHAMFER EXPOSED EDGES SMOOTH. ATTACH SUPPORT TO MASONRY OR CONCRETE WALL WITH 3/8" EPOXY BOLTS, AS SHOWN. SUPPORTS SHALL BE LOCATED VERTICALLY ON WALL AT 4'-0" O.C. MAXIMUM.
 5. BACKPLASH. SEE TYPICAL COUNTERTOP DETAIL 6/A505B.
 6. PROVIDE GROMMETS AT COMPUTER MONITOR LOCATIONS, KNEE SPACES, COUNTERTOP EQUIPMENT, ETC.
 7. COUNTERTOP. SEE FINISH FLOOR PLAN AND INTERIOR ELEVATIONS FOR REQUIRED MATERIAL AT DIFFERENT LOCATIONS. SEE TYPICAL COUNTERTOP DETAIL 6/A505B.

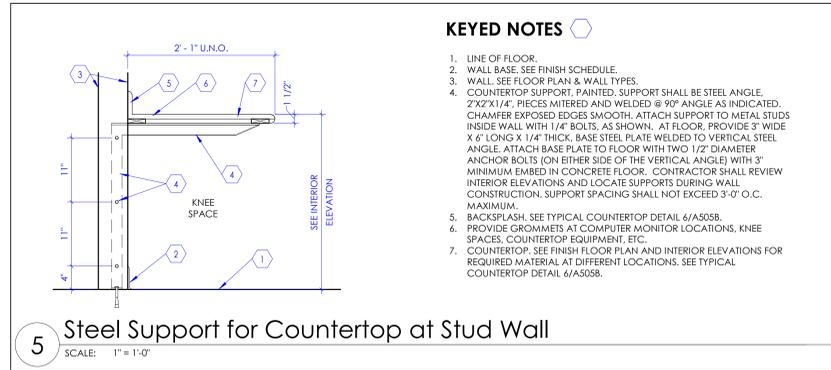

5 Steel Support for Countertop at Stud Wall


SCALE: 1" = 1'-0"

- KEYED NOTES**
1. LINE OF FLOOR.
 2. WALL BASE. SEE FINISH SCHEDULE.
 3. WALL. SEE FLOOR PLAN & WALL TYPES.
 4. COUNTERTOP SUPPORT. PAINTED. SUPPORT SHALL BE STEEL ANGLE, 2"x2"x1/4", PIECES MITERED AND WELDED @ 90° ANGLE AS INDICATED. CHAMFER EXPOSED EDGES SMOOTH. ATTACH SUPPORT TO METAL STUDS INSIDE WALL WITH 1/4" BOLTS, AS SHOWN. AT FLOOR, PROVIDE 3" WIDE X 6" LONG X 1/4" THICK, BASE STEEL PLATE WELDED TO VERTICAL STEEL ANGLE. ATTACH BASE PLATE TO FLOOR WITH TWO 1/2" DIAMETER ANCHOR BOLTS (ON EITHER SIDE OF THE VERTICAL ANGLE) WITH 3" MINIMUM EMBED IN CONCRETE FLOOR. CONTRACTOR SHALL REVIEW INTERIOR ELEVATIONS AND LOCATE SUPPORTS DURING WALL CONSTRUCTION. SUPPORT SPACING SHALL NOT EXCEED 3'-0" O.C. MAXIMUM.
 5. BACKPLASH. SEE TYPICAL COUNTERTOP DETAIL 6/A505B.
 6. PROVIDE GROMMETS AT COMPUTER MONITOR LOCATIONS, KNEE SPACES, COUNTERTOP EQUIPMENT, ETC.
 7. COUNTERTOP. SEE FINISH FLOOR PLAN AND INTERIOR ELEVATIONS FOR REQUIRED MATERIAL AT DIFFERENT LOCATIONS. SEE TYPICAL COUNTERTOP DETAIL 6/A505B.

6 Typical Countertop Detail

SCALE: 1" = 1'-0"


- KEYED NOTES**
1. COUNTERTOP. PLASTIC LAMINATE WRAPPED OVER WOOD SUBSTRATE, 3/4" THICK. SUBSTRATE SHALL BE AS PER ARCHITECTURAL WOODWORK INSTITUTE (AWI) STANDARDS FOR "PREMIUM" GRADE. PROVIDE FULL ROUND EDGE AS INDICATED. WHERE PLASTIC LAMINATE COUNTERTOP IS CALLED OUT AT SINK LOCATIONS, USE EXTERIOR GRADE MARINE PLYWOOD WITH AN IMPERVIOUS SEAL. SEE DETAIL 9/A505B.
 2. BACKPLASH. INTEGRAL. PLASTIC LAMINATE SHALL RUN CONTINUOUSLY FROM COUNTERTOP TO BACKPLASH. BACKPLASH SHALL HAVE A 3/4" RADIUS EDGE AT TOP AS INDICATED.
 3. PROVIDE FULL ROUND (BULL NOSE) EDGE AT ALL PLASTIC LAMINATE COUNTERTOPS, TYPICAL.
 4. BASE CABINET DOOR AS OCCURS.
 5. EXPOSED END OF THE COUNTERTOP SHALL BE WRAPPED WITH PLASTIC LAMINATE.
 6. SIDESPLASH. PLASTIC LAMINATE OVER WOOD SUBSTRATE, 3/4" THICK. SUBSTRATE SHALL BE AS PER ARCHITECTURAL WOODWORK INSTITUTE (AWI) STANDARDS FOR "PREMIUM" GRADE. PROVIDE CONTINUOUS CLEAR SEALANT WHERE SIDESPLASH ABUTS WALL AND COUNTERTOP. UNLESS NOTED OTHERWISE, SIDESPLASH IS REQUIRED AT ALL LOCATIONS WHERE COUNTERTOP ABUTS VERTICAL SURFACES SUCH AS WALLS, BUILDING COLUMNS, TALL CABINETS, ETC.
 7. SOLID SURFACE. CONTINUOUS AND INTEGRAL COUNTERTOP. ATTACH COUNTERTOP TO BASE CABINET AND/OR STEEL SUPPORTS WHERE OCCURS.
 8. PROVIDE FULL ROUND (BULL NOSE) EDGE AT ALL SOLID SURFACE COUNTERTOPS, TYPICAL.
 9. SOLID SURFACE INTEGRAL BACKPLASH. PROVIDE CONTINUOUS CLEAR SEALANT WHERE BACKPLASH ABUTS WALL. BACKPLASH SHALL HAVE A 3/4" RADIUS EDGE AT TOP AND 1/4" RADIUS WHERE BACKPLASH ABUTS COUNTERTOP.
 10. SOLID SURFACE INTEGRAL SIDESPLASH. PROVIDE CONTINUOUS CLEAR SEALANT WHERE SIDESPLASH ABUTS WALL AND COUNTERTOP. UNLESS NOTED OTHERWISE, SIDESPLASH IS REQUIRED AT ALL LOCATIONS WHERE COUNTERTOP ABUTS VERTICAL SURFACES SUCH AS WALLS, BUILDING COLUMNS, TALL CABINETS, ETC. SIDESPLASH SHALL HAVE A 3/4" RADIUS EDGE AT TOP AND 1/4" RADIUS WHERE SIDESPLASH ABUTS COUNTERTOP.
 11. BASE CABINET AS OCCURS. SEE INTERIOR ELEVATIONS. AT KNEE SPACE LOCATIONS AND WHERE THERE ARE NO BASE CABINETS TO SUPPORT THE COUNTERTOP, PROVIDE STEEL SUPPORTS PER DETAILS 4/A505B AND 5/A505B.
 12. 3/4" THICK X CONTINUOUS FIRE TREATED PLYWOOD.
 13. LINE OF WALL.
 14. PROVIDE FULL BULLNOSE EDGE, TYPICAL ALL SIDES.

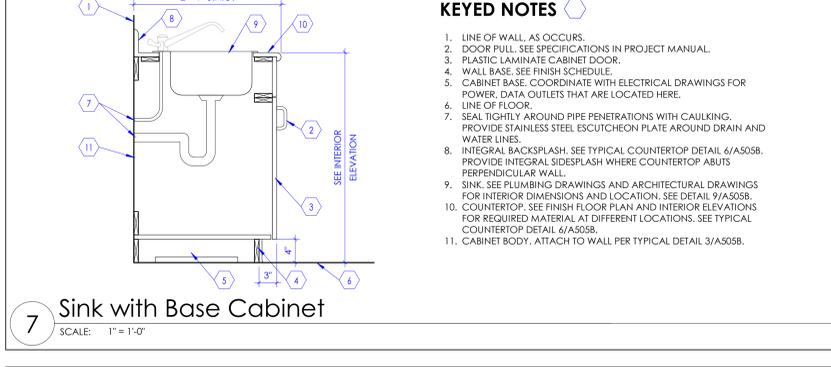

7 Sink with Base Cabinet

SCALE: 1" = 1'-0"


- KEYED NOTES**
1. LINE OF WALL, AS OCCURS.
 2. DOOR PULL. SEE SPECIFICATIONS IN PROJECT MANUAL.
 3. PLASTIC LAMINATE CABINET DOOR.
 4. WALL BASE. SEE FINISH SCHEDULE.
 5. CABINET BASE. COORDINATE WITH ELECTRICAL DRAWINGS FOR POWER, DATA, OUTLETS THAT ARE LOCATED HERE.
 6. LINE OF FLOOR.
 7. SEAL TIGHTLY AROUND PIPE PENETRATIONS WITH CAULKING. PROVIDE STAINLESS STEEL ESCUTCHEON PLATE AROUND DRAIN AND WATER LINES.
 8. INTEGRAL BACKPLASH. SEE TYPICAL COUNTERTOP DETAIL 6/A505B. PROVIDE INTEGRAL SIDESPLASH WHERE COUNTERTOP ABUTS PERPENDICULAR WALL.
 9. SINK. SEE PLUMBING DRAWINGS AND ARCHITECTURAL DRAWINGS FOR INTERIOR DIMENSIONS AND LOCATION. SEE DETAIL 9/A505B.
 10. COUNTERTOP. SEE FINISH FLOOR PLAN AND INTERIOR ELEVATIONS FOR REQUIRED MATERIAL AT DIFFERENT LOCATIONS. SEE TYPICAL COUNTERTOP DETAIL 6/A505B.
 11. CABINET BODY. ATTACH TO WALL PER TYPICAL DETAIL 3/A505B.

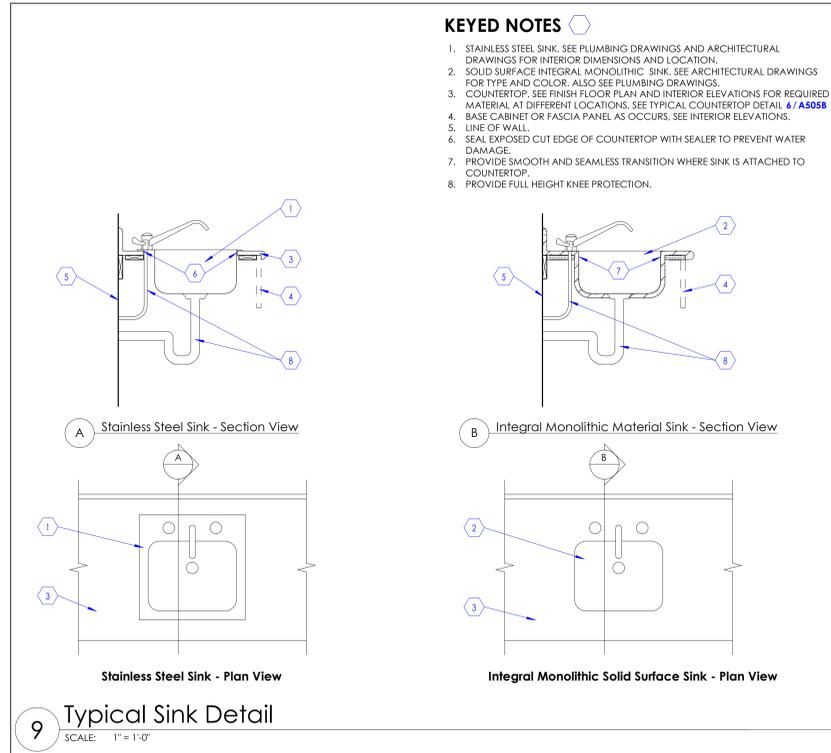

9 Typical Sink Detail

SCALE: 1" = 1'-0"

- KEYED NOTES**
1. STAINLESS STEEL SINK. SEE PLUMBING DRAWINGS AND ARCHITECTURAL DRAWINGS FOR INTERIOR DIMENSIONS AND LOCATION.
 2. SOLID SURFACE INTEGRAL MONOLITHIC SINK. SEE ARCHITECTURAL DRAWINGS FOR TYPE AND COLOR. ALSO SEE PLUMBING DRAWINGS.
 3. COUNTERTOP. SEE FINISH FLOOR PLAN AND INTERIOR ELEVATIONS FOR REQUIRED MATERIAL AT DIFFERENT LOCATIONS. SEE TYPICAL COUNTERTOP DETAIL 6/A505B.
 4. BASE CABINET OR FASCIA PANEL AS OCCURS. SEE INTERIOR ELEVATIONS.
 5. LINE OF WALL.
 6. SEAL EXPOSED CUT EDGE OF COUNTERTOP WITH SEALER TO PREVENT WATER DAMAGE.
 7. PROVIDE SMOOTH AND SEAMLESS TRANSITION WHERE SINK IS ATTACHED TO COUNTERTOP.
 8. PROVIDE FULL HEIGHT KNEE PROTECTION.

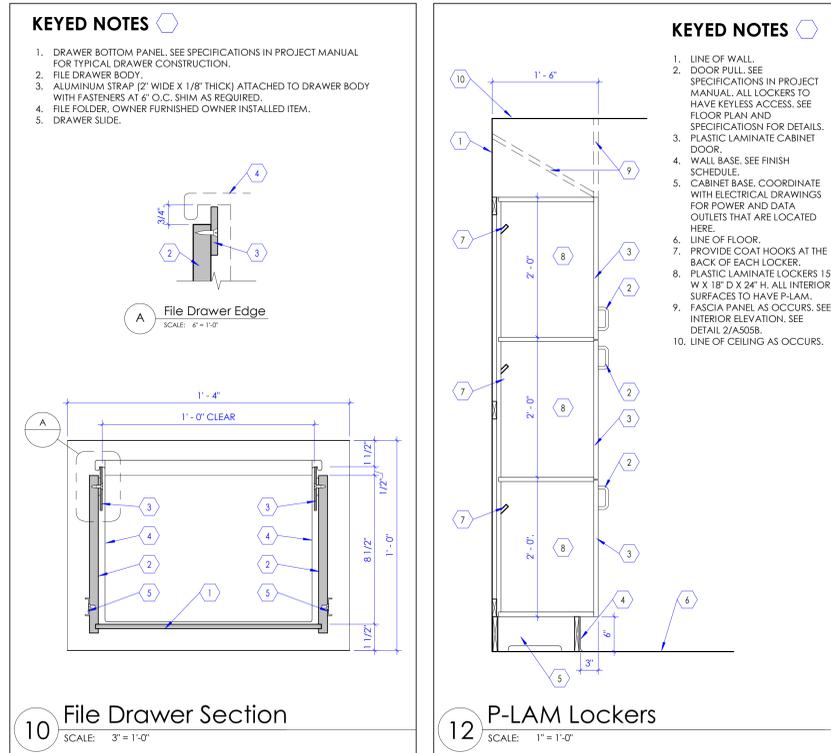


10 File Drawer Section

SCALE: 3" = 1'-0"

- KEYED NOTES**
1. LINE OF WALL.
 2. DOOR PULL. SEE SPECIFICATIONS IN PROJECT MANUAL. ALL LOCKERS TO HAVE KEYS ACCESS. SEE FLOOR PLAN AND SPECIFICATIONS FOR DETAILS.
 3. PLASTIC LAMINATE CABINET DOOR.
 4. WALL BASE. SEE FINISH SCHEDULE.
 5. CABINET BASE. COORDINATE WITH ELECTRICAL DRAWINGS FOR POWER AND DATA OUTLETS THAT ARE LOCATED HERE.
 6. LINE OF FLOOR.
 7. PROVIDE COAT HOOKS AT THE BACK OF EACH LOCKER.
 8. PLASTIC LAMINATE LOCKERS 15" W X 18" D X 24" H. ALL INTERIOR SURFACES TO HAVE P-LAM.
 9. FASCIA PANEL AS OCCURS. SEE INTERIOR ELEVATION. SEE DETAIL 2/A505B.
 10. LINE OF CEILING AS OCCURS.

12 P-LAM Lockers

SCALE: 1" = 1'-0"

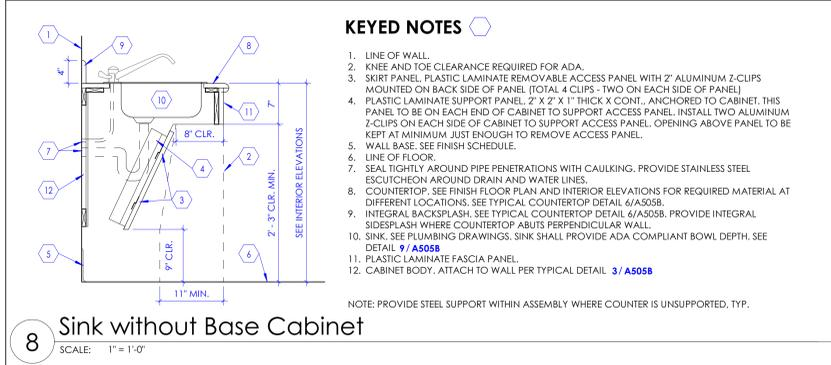

8 Sink without Base Cabinet

SCALE: 1" = 1'-0"

- KEYED NOTES**
1. LINE OF WALL.
 3. SKIRT PANEL. PLASTIC LAMINATE REMOVABLE ACCESS PANEL WITH 2" ALUMINUM Z-CLIPS MOUNTED ON BACK SIDE OF PANEL (TOTAL 4 CLIPS, TWO ON EACH SIDE OF PANEL).
 4. PLASTIC LAMINATE SUPPORT PANEL, 2" X 2" X 1" THICK X CONT. ANCHORED TO CABINET. THIS PANEL TO BE ON EACH END OF CABINET TO SUPPORT ACCESS PANEL. INSTALL TWO ALUMINUM Z-CLIPS ON EACH SIDE OF CABINET TO SUPPORT ACCESS PANEL. OPENING ABOVE PANEL TO BE KEPT AT MINIMUM JUST ENOUGH TO REMOVE ACCESS PANEL.
 5. WALL BASE. SEE FINISH SCHEDULE.
 6. LINE OF FLOOR.
 7. SEAL TIGHTLY AROUND PIPE PENETRATIONS WITH CAULKING. PROVIDE STAINLESS STEEL ESCUTCHEON AROUND DRAIN AND WATER LINES.
 8. COUNTERTOP. SEE FINISH FLOOR PLAN AND INTERIOR ELEVATIONS FOR REQUIRED MATERIAL AT DIFFERENT LOCATIONS. SEE TYPICAL COUNTERTOP DETAIL 6/A505B.
 9. INTEGRAL BACKPLASH. SEE TYPICAL COUNTERTOP DETAIL 6/A505B. PROVIDE INTEGRAL SIDESPLASH WHERE COUNTERTOP ABUTS PERPENDICULAR WALL.
 10. SINK. SEE PLUMBING DRAWINGS. SINK SHALL PROVIDE ADA COMPLIANT BOWL DEPTH. SEE DETAIL 9/A505B.
 11. PLASTIC LAMINATE FASCIA PANEL.
 12. CABINET BODY. ATTACH TO WALL PER TYPICAL DETAIL 3/A505B.

NOTE: PROVIDE STEEL SUPPORT WITHIN ASSEMBLY WHERE COUNTER IS UNSUPPORTED, TYP.

NJRA Architects, Inc.
5272 S. College Drive, Suite 104
Murray, Utah 84123
801.364.9259
www.njraarchitects.com

INTERMOUNTAIN HEALTHCARE CAMPUS RECONFIGURATION - ASC

1350N 500 E
Logan, UT 84341



Project Manager	TERRI SDOBROOK
Project Designer	ERIC MEUB
Project Architect	FRANK PENROSE
Landscape Architect	ARCSOTTO
Civil Engineer	GREAT BASIN
Structural Engineer	REAVELEY
Mechanical Engineer	VAN BOERUM & FRANK
Electrical Engineer	SPECTRUM
Plumbing Engineer	VAN BOERUM & FRANK
Interior Designer	RUBY THORP
Equipment Planner	ROBERT GRIESCHE
Wayfinding	

MARK	DATE	DESCRIPTION

Project Number	10173823
Original Issue	11/6/20



Sheet Name
Cabinet Details

Sheet Number
A505B

Project Status
100% Construction Documents

11/6/2020 10:52:21 AM B:\M\Documents\92222\01\PH-A5C-19-Central Station\NJD\..._nt

