
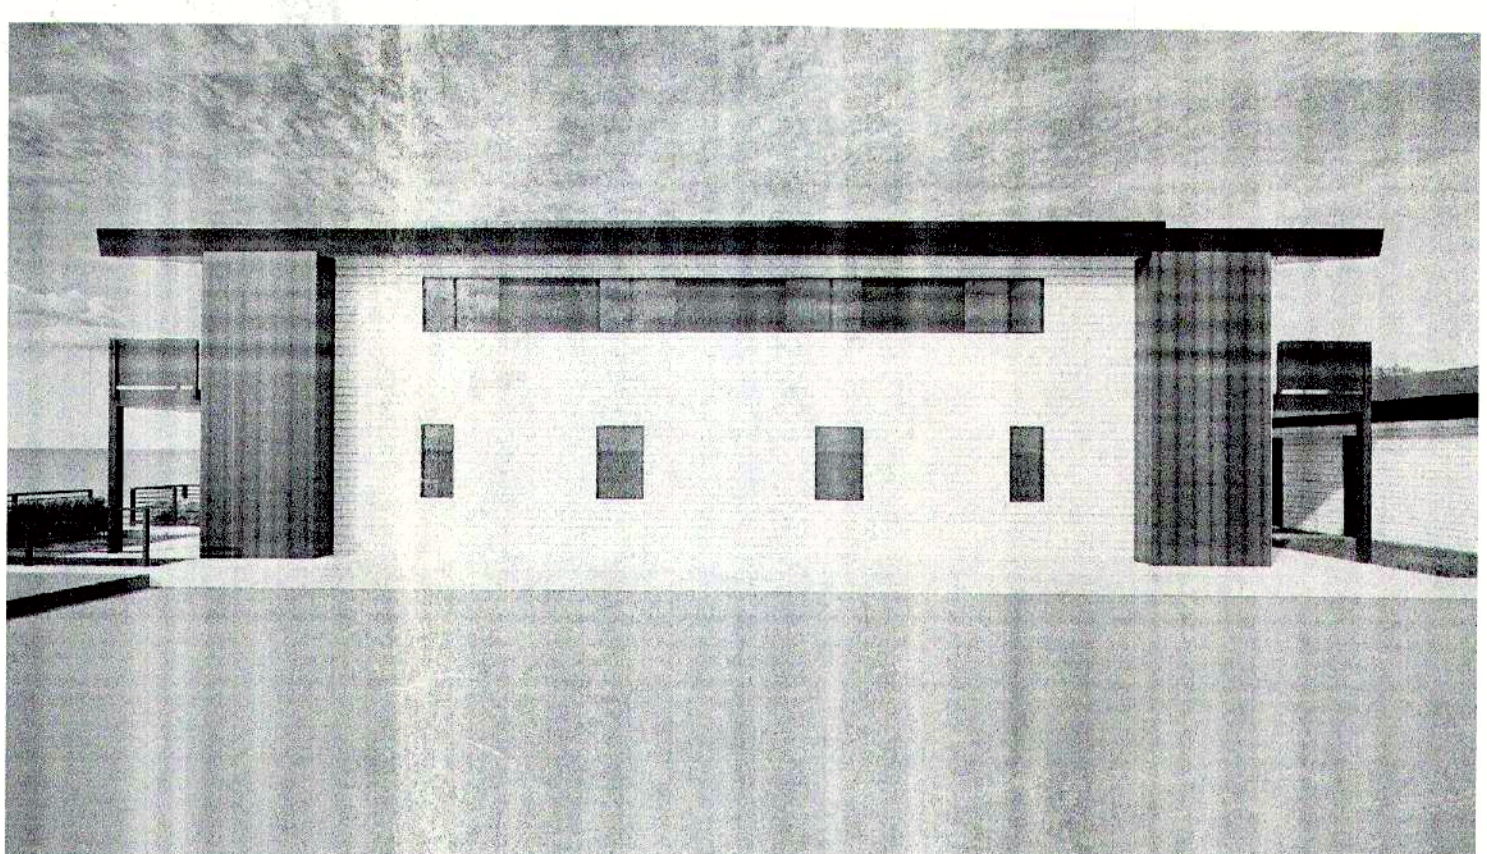
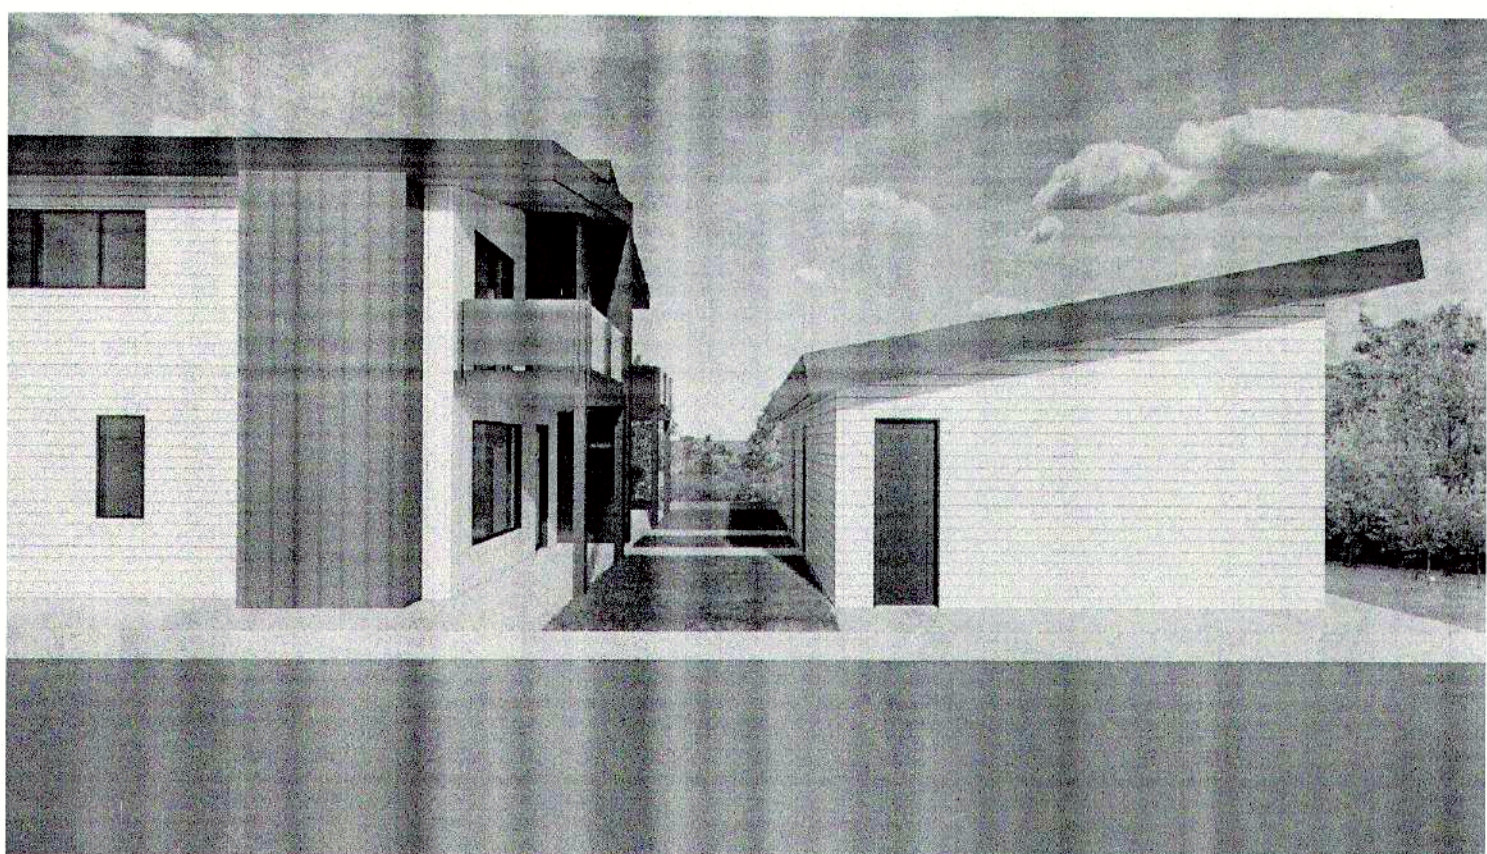
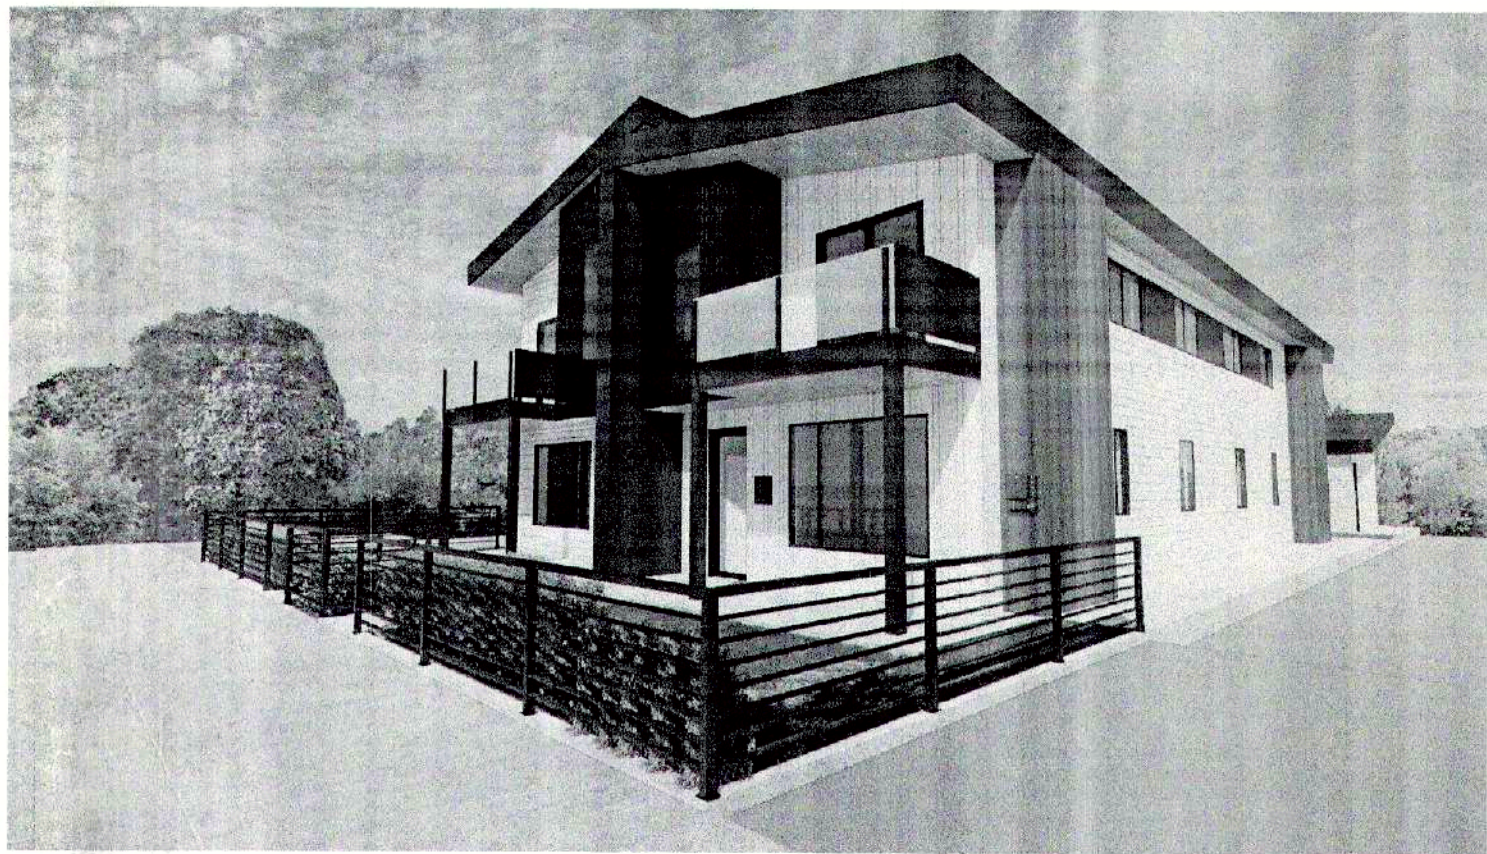


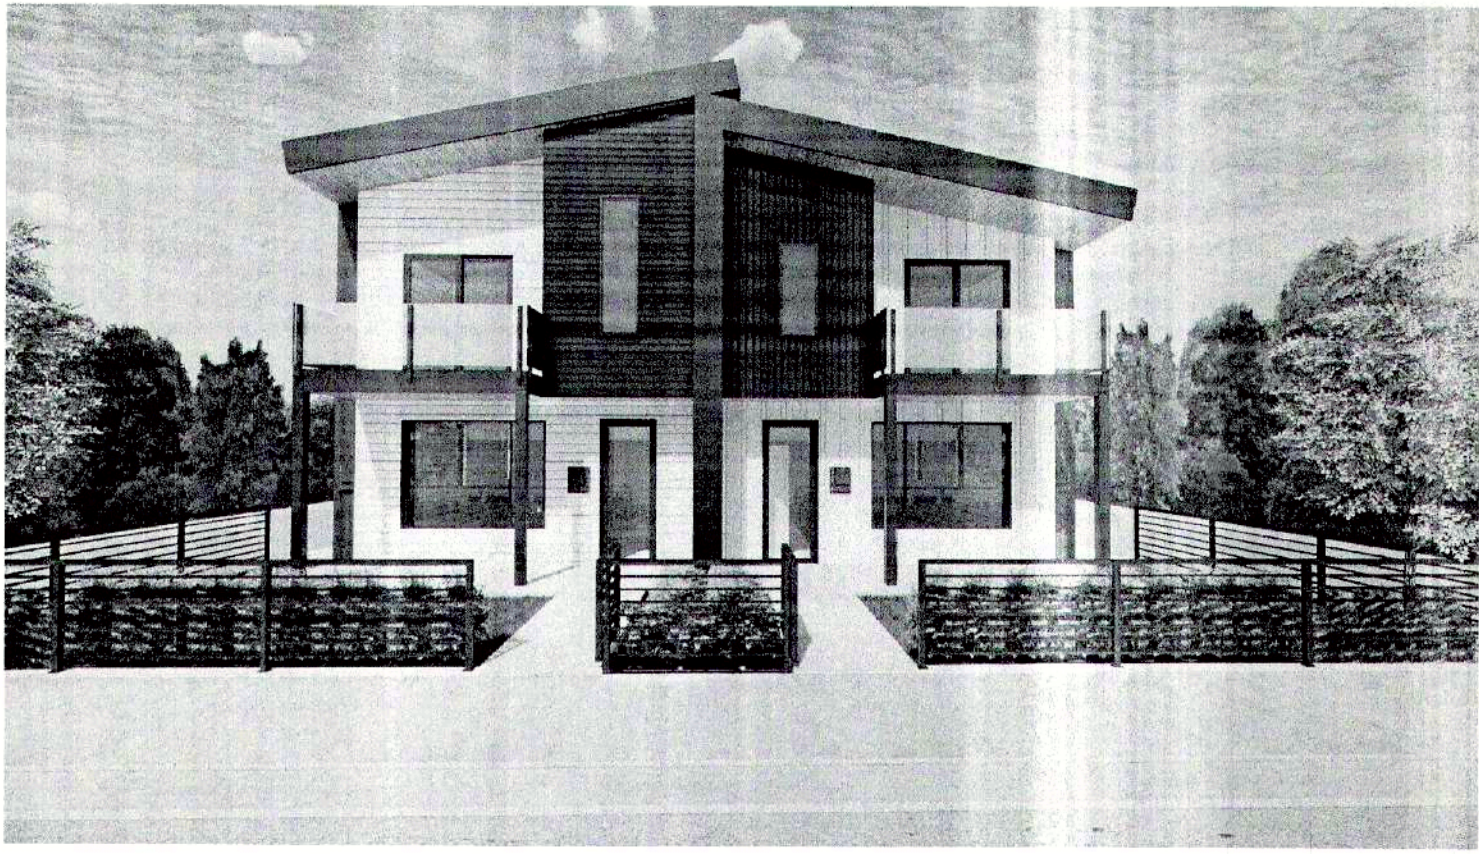

837 STOCKWELL AVE.

PROJECT DATA

- LEGAL DESCRIPTION**
LOT 07, PLAN #KAP1319
837 STOCKWELL AVE.
KELOWNA, BC
- ZONING**
MF1 - INFILL HOUSING
- SITE CALCULATIONS**

Lot Area: 585.79 m² (6,305.40 ft²)
FAR (0.8)= 468.63 m² (5,044.32 ft²)
PROPOSED FAR = 0.796 (466.11 m²)

MAX. SITE COVERAGE (55%)= 322.18 m² (3,467.97 ft²)
BUILDING FOOTPRINT AREA= 319.75 m² (3,441.76 ft²)
PROPOSED SITE COVERAGE = 54.58%

Front Yard Setback - 4.00 m
Side Yard Setback - 1.20 m
Rear Yard Setback - 0.90 m
Maximum Height - 8.00 m

GENERAL NOTES


- CONTRACTOR TO VERIFY ALL DIMENSIONS AND DETAILS PRIOR TO COMMENCEMENT OF WORK AND SHALL NOTIFY DESIGNER OF ANY ERRORS OR DISCREPANCIES.
- NOTED DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALED DRAWINGS.
- EXTERIOR DIMENSIONING IS TO FACE OF SHEATHING/CONCRETE. INTERIOR DIMENSIONING IS TO CENTER LINE OF PARTITION.
- WHERE NOTED BY "ENG." OR "ENGINEERED", ALL STRUCTURE SHALL BE ENGINEERED BY CERTIFIED STRUCTURAL ENGINEER, INCLUDING, BUT NOT LIMITED TO: SPANS, SHEAR WALLS, FOOTINGS AND FOUNDATION WALLS, BEAMS, JOISTS, LINTELS, COLUMNS AND CONNECTIONS. THIS APPLIES ALSO TO ITEMS NOTED BY "ENGINEERED". ENGINEERED DRAWINGS SHALL BE STAMPED WITH ENGINEER'S SEAL.
- ALL WORK SHALL BE EQUAL IN ALL RESPECTS TO GOOD CONSTRUCTION PRACTICE, AND SHALL CONFORM TO CURRENT RESIDENTIAL STANDARDS AND THE BRITISH COLUMBIA BUILDING CODE 2018.
- IT IS THE RESPONSIBILITY OF THE OWNER/CONTRACTOR TO HAVE SITE SOIL CONDITIONS INSPECTED, AND ADVISE DESIGNER OF ANY CONDITIONS WHICH MAY REQUIRE SPECIAL FOUNDATION DESIGN.
- PROVIDE ATTIC AND CRAWL SPACES WITH VENTILATION AND ACCESS IN ACCORDANCE WITH B.C.B.C. 2018 PART 9.
- ALL WOOD FRAMING TO GRADE AND SPECIES NOTED, OTHERWISE MAY BE SPF. ALL FRAMING IS TO BE IN GOOD PRACTICE AND IN ACCORDANCE WITH B.C.B.C. AND GOOD CONSTRUCTION PRACTICE.
- ALL WOOD LINTELS TO CONFORM TO B.C.B.C. PART 9 WHERE SUPPORTING FLOOR OR ROOF LOADS.
- INSTALL SMOKE DETECTORS IN ACCORDANCE WITH B.C.B.C. PART 9. INSTALL SMOKE DETECTORS NOT MORE THAN 9m (16'-0") FROM ANY BEDROOM EXIT DOORS.
- ALL WOOD IN CONTACT WITH CONCRETE, INCLUDING SILL PLATES & PRESSURE TREATED OR SEPARATED WITH SILL GASKET OR OTHER APPROVED MATERIAL.
- ALL NOTED "ENGINEERED" COMPONENTS, SUCH AS ROOF TRUSSES, BEAMS, AND ENGINEERED FLOOR SYSTEMS, REQUIRE ENGINEERED DRAWING SUBMITTAL AND MUST BE INSTALLED IN ACCORDANCE WITH SUPPLIER'S DETAILS AND SPECIFICATIONS.
- SUPPLY AND INSTALL ALL WINDOW TYPES, INTERIOR CASINGS, AND MILLWORK TO OWNER'S APPROVAL.
- INSTALL GRASPABLE HANDRAILS TO ALL INTERIOR STAIRS @ 36" ABOVE NOSING.
- INSTALL GUARDRAIL AT ALL BALCONIES, DECKS, AND PORCHES GREATER THAN 24" ABOVE ADJACENT GRADE OR LEVEL. INSTALL GUARDRAIL AT 42" ABOVE ADJACENT SURFACE.
- ALL WOOD LOCATED IN EXTERIOR LOCATIONS TO BE PRESSURE TREATED.
- INSTALL SELF-CLOSER AND WEATHERSTRIPPING TO NEW DOOR(S) FROM DWELLING UNIT TO GARAGE FOR VAPOR PROOF BARRIER.
- PROVIDE HEATING, MECHANICAL VENTILATION AND AIR CONDITIONING WHERE REQUIRED IN ACCORDANCE WITH CURRENT LOCAL BUILDING CODE AND BY-LAWS.

SITE PLAN NOTES:

- NO CONSTRUCTION PERMITTED ON, IN, OR OVER EASEMENTS, RESTRICTIVE COVENANTS, NO BUILD AREAS AND NO DISTURB AREAS.
- ONE DRIVEWAY PERMITTED NOT TO EXCEED 8.0 M IN WIDTH AND GRADE NOT TO EXCEED 15% AS PER SUBDIVISION AND DEVELOPMENT ENGINEERING BY-LAW.
- RETAINING WALLS OVER 1.2M ARE NOT ALLOWED PER ZONING BY-LAW.
- A SURVEY CERTIFICATE IS REQUIRED.



SITEPLAN - AERIAL IMAGE 2020

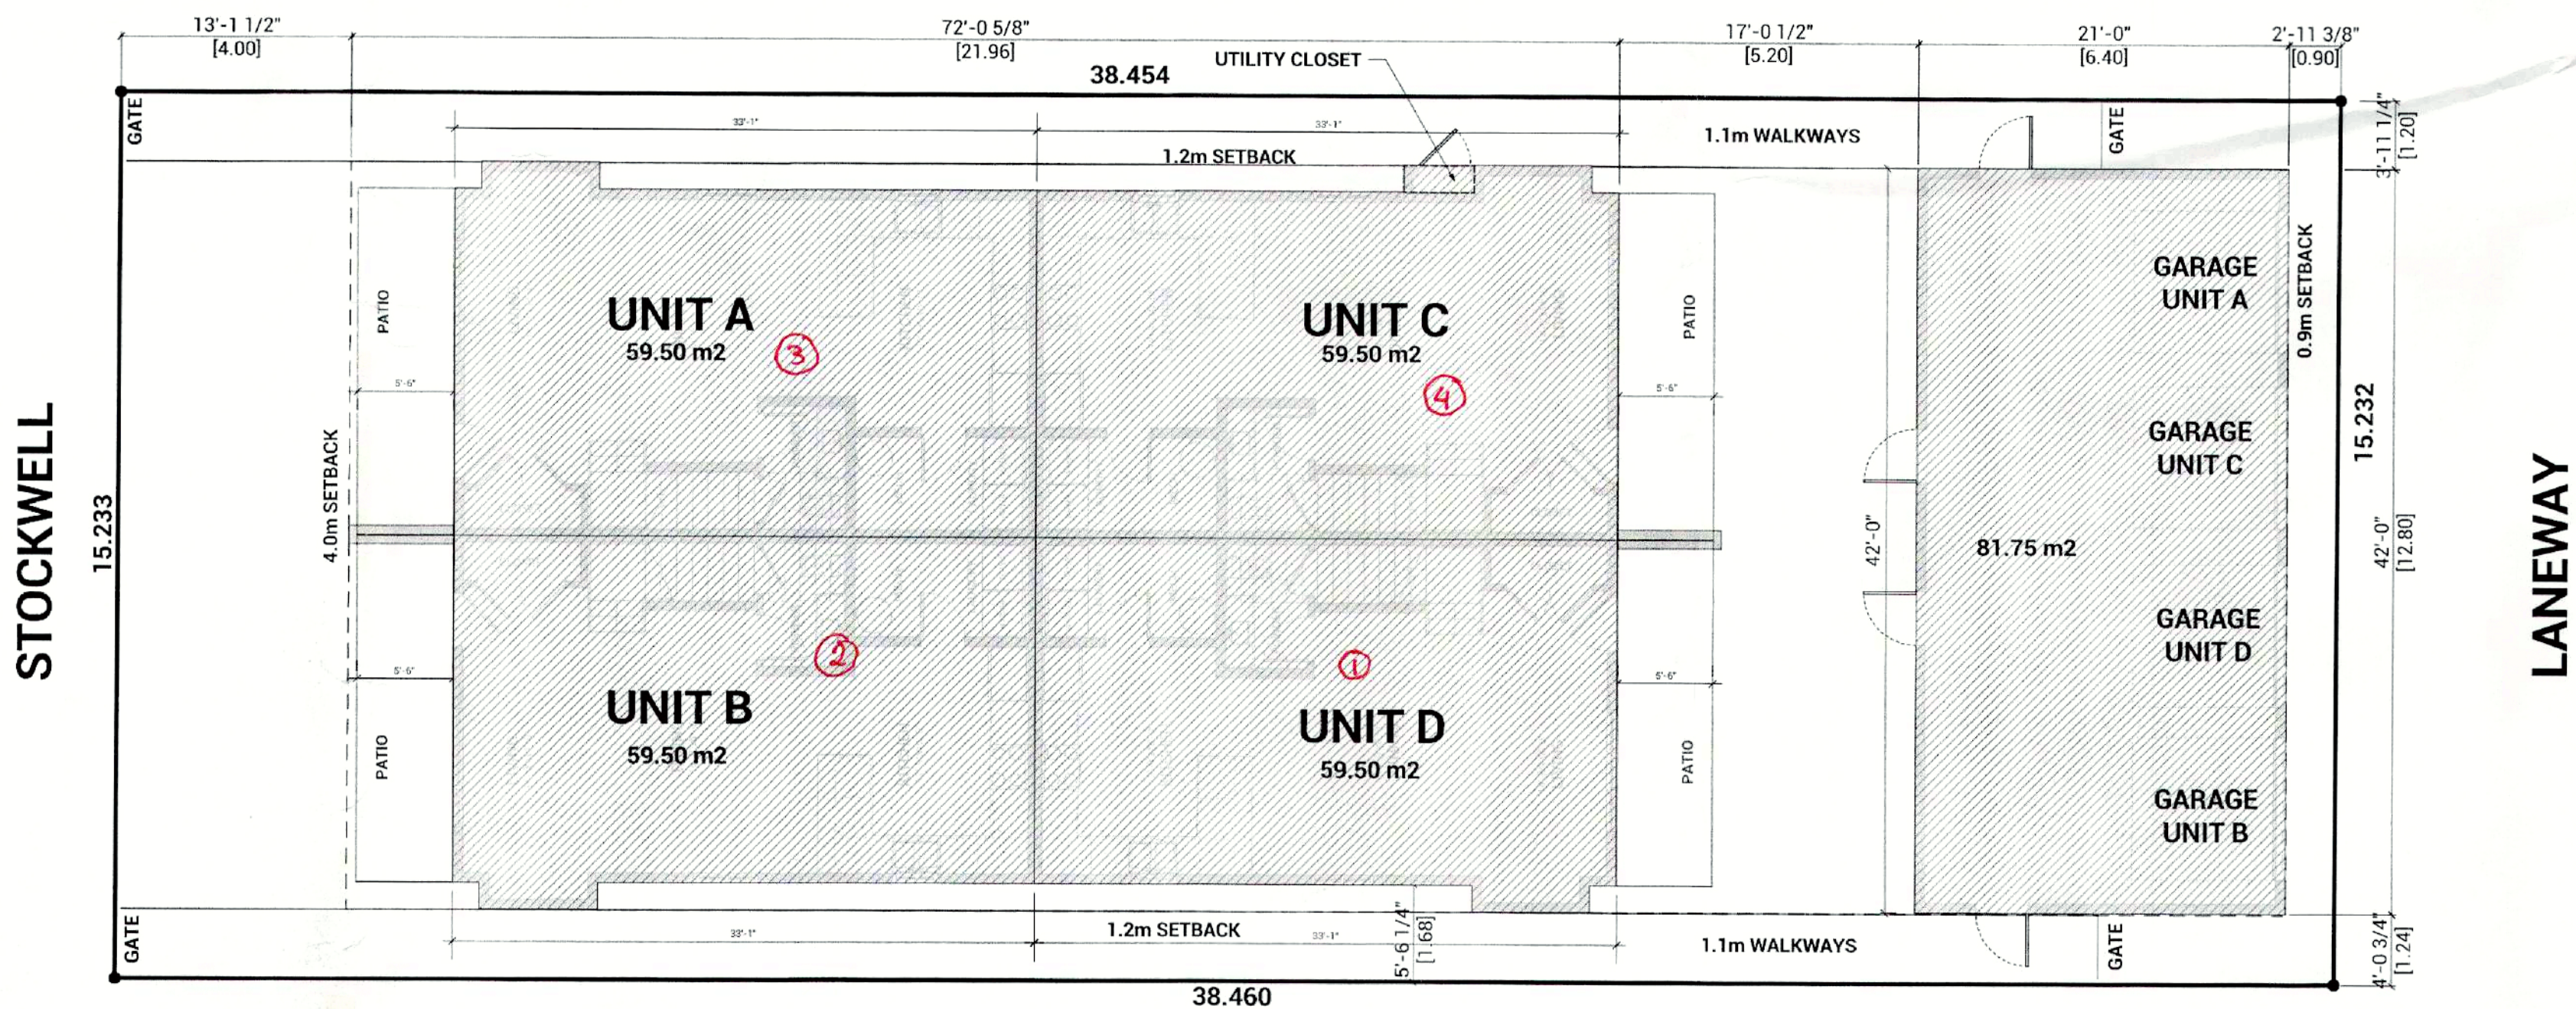

1 SITE PLAN
A1.01 1:100

DRAWING INDEX

A0.00	TITLEBLOCK
A1.01	SITE PLAN
A2.00	LEVEL 00 FOUNDATION
A2.01	LEVEL 01 MAIN FLOOR
A2.02	LEVEL 02 UPPER FLOOR
A2.03	LEVEL 03 ROOF PLAN
A3.01	EXTERIOR ELEVATIONS
A3.02	EXTERIOR ELEVATIONS 2
A4.01	BUILDING SECTIONS 1
A4.02	BUILDING SECTIONS 2
A5.01	DETAILS

ISSUED / REVISIONS		
NO.	DATE	DESCRIPTION
1	MAY 10, 2021	ISSUED FOR REVIEW
2	SEPT 15, 2023	REVISED FOR BP

NOTES

BUILDER

CLIENT

SNG DEVELOPMENTS


PROJECT


837 STOCKWELL AVE

SHEET

SITE PLAN


DESIGN BY	GS	A1.01
DRAWN BY	GS	
CHECKED BY	GS	
PROJECT	21-008	
As indicated		SHEET NO.

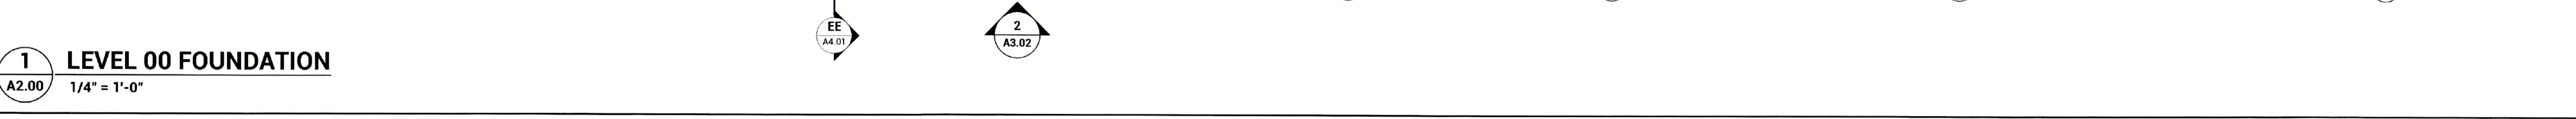

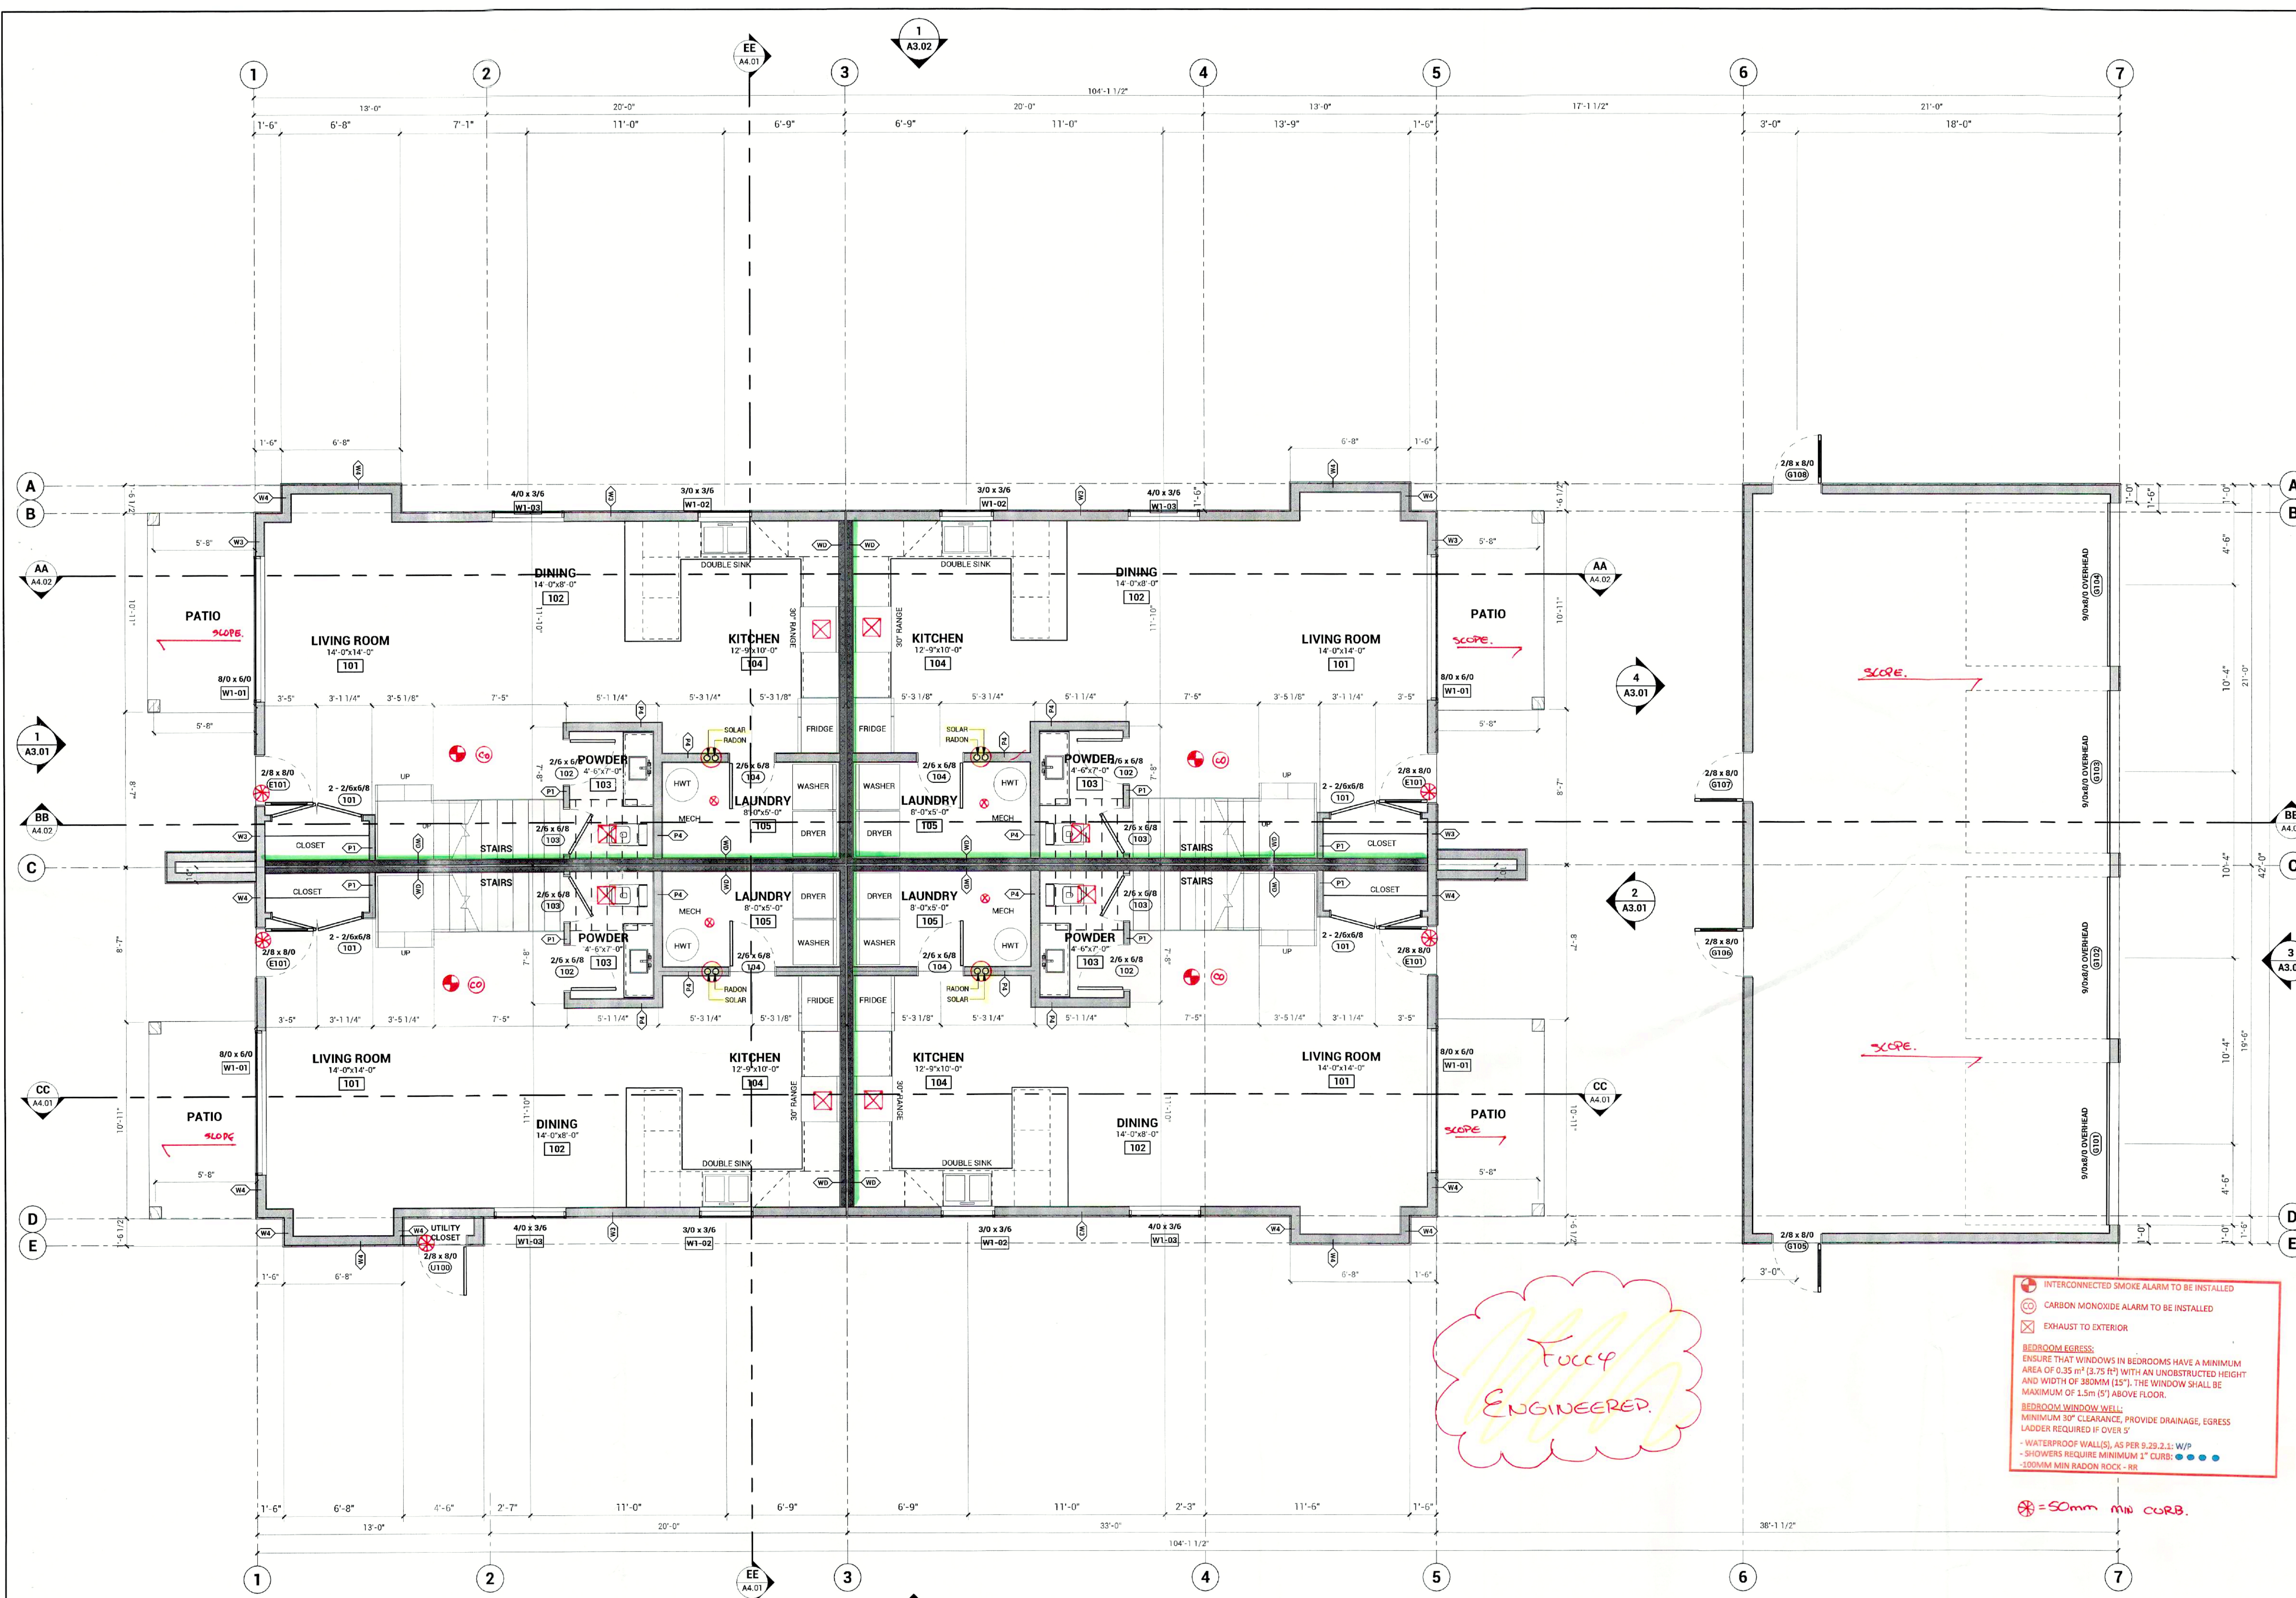

1
A2.01
LEVEL 01 MAIN FLOOR PLAN
1/4" = 1'-0"

ISSUED / REVISIONS		
NO.	DATE	DESCRIPTION
1	MAY 10, 2021	ISSUED FOR REVIEW
2	SEPT 15, 2023	REVISED FOR BP
3		
NOTES		
BUILDER		
CLIENT		
SNG DEVELOPMENTS		
PROJECT		
837 STOCKWELL AVE		
SHEET		
LEVEL 01 MAIN FLOOR		
DESIGN BY	GS	A2.01
DRAWN BY	GS	
CHECKED BY	GS	
PROJECT	21-008	
1/4" = 1'-0"		SHEET NO.

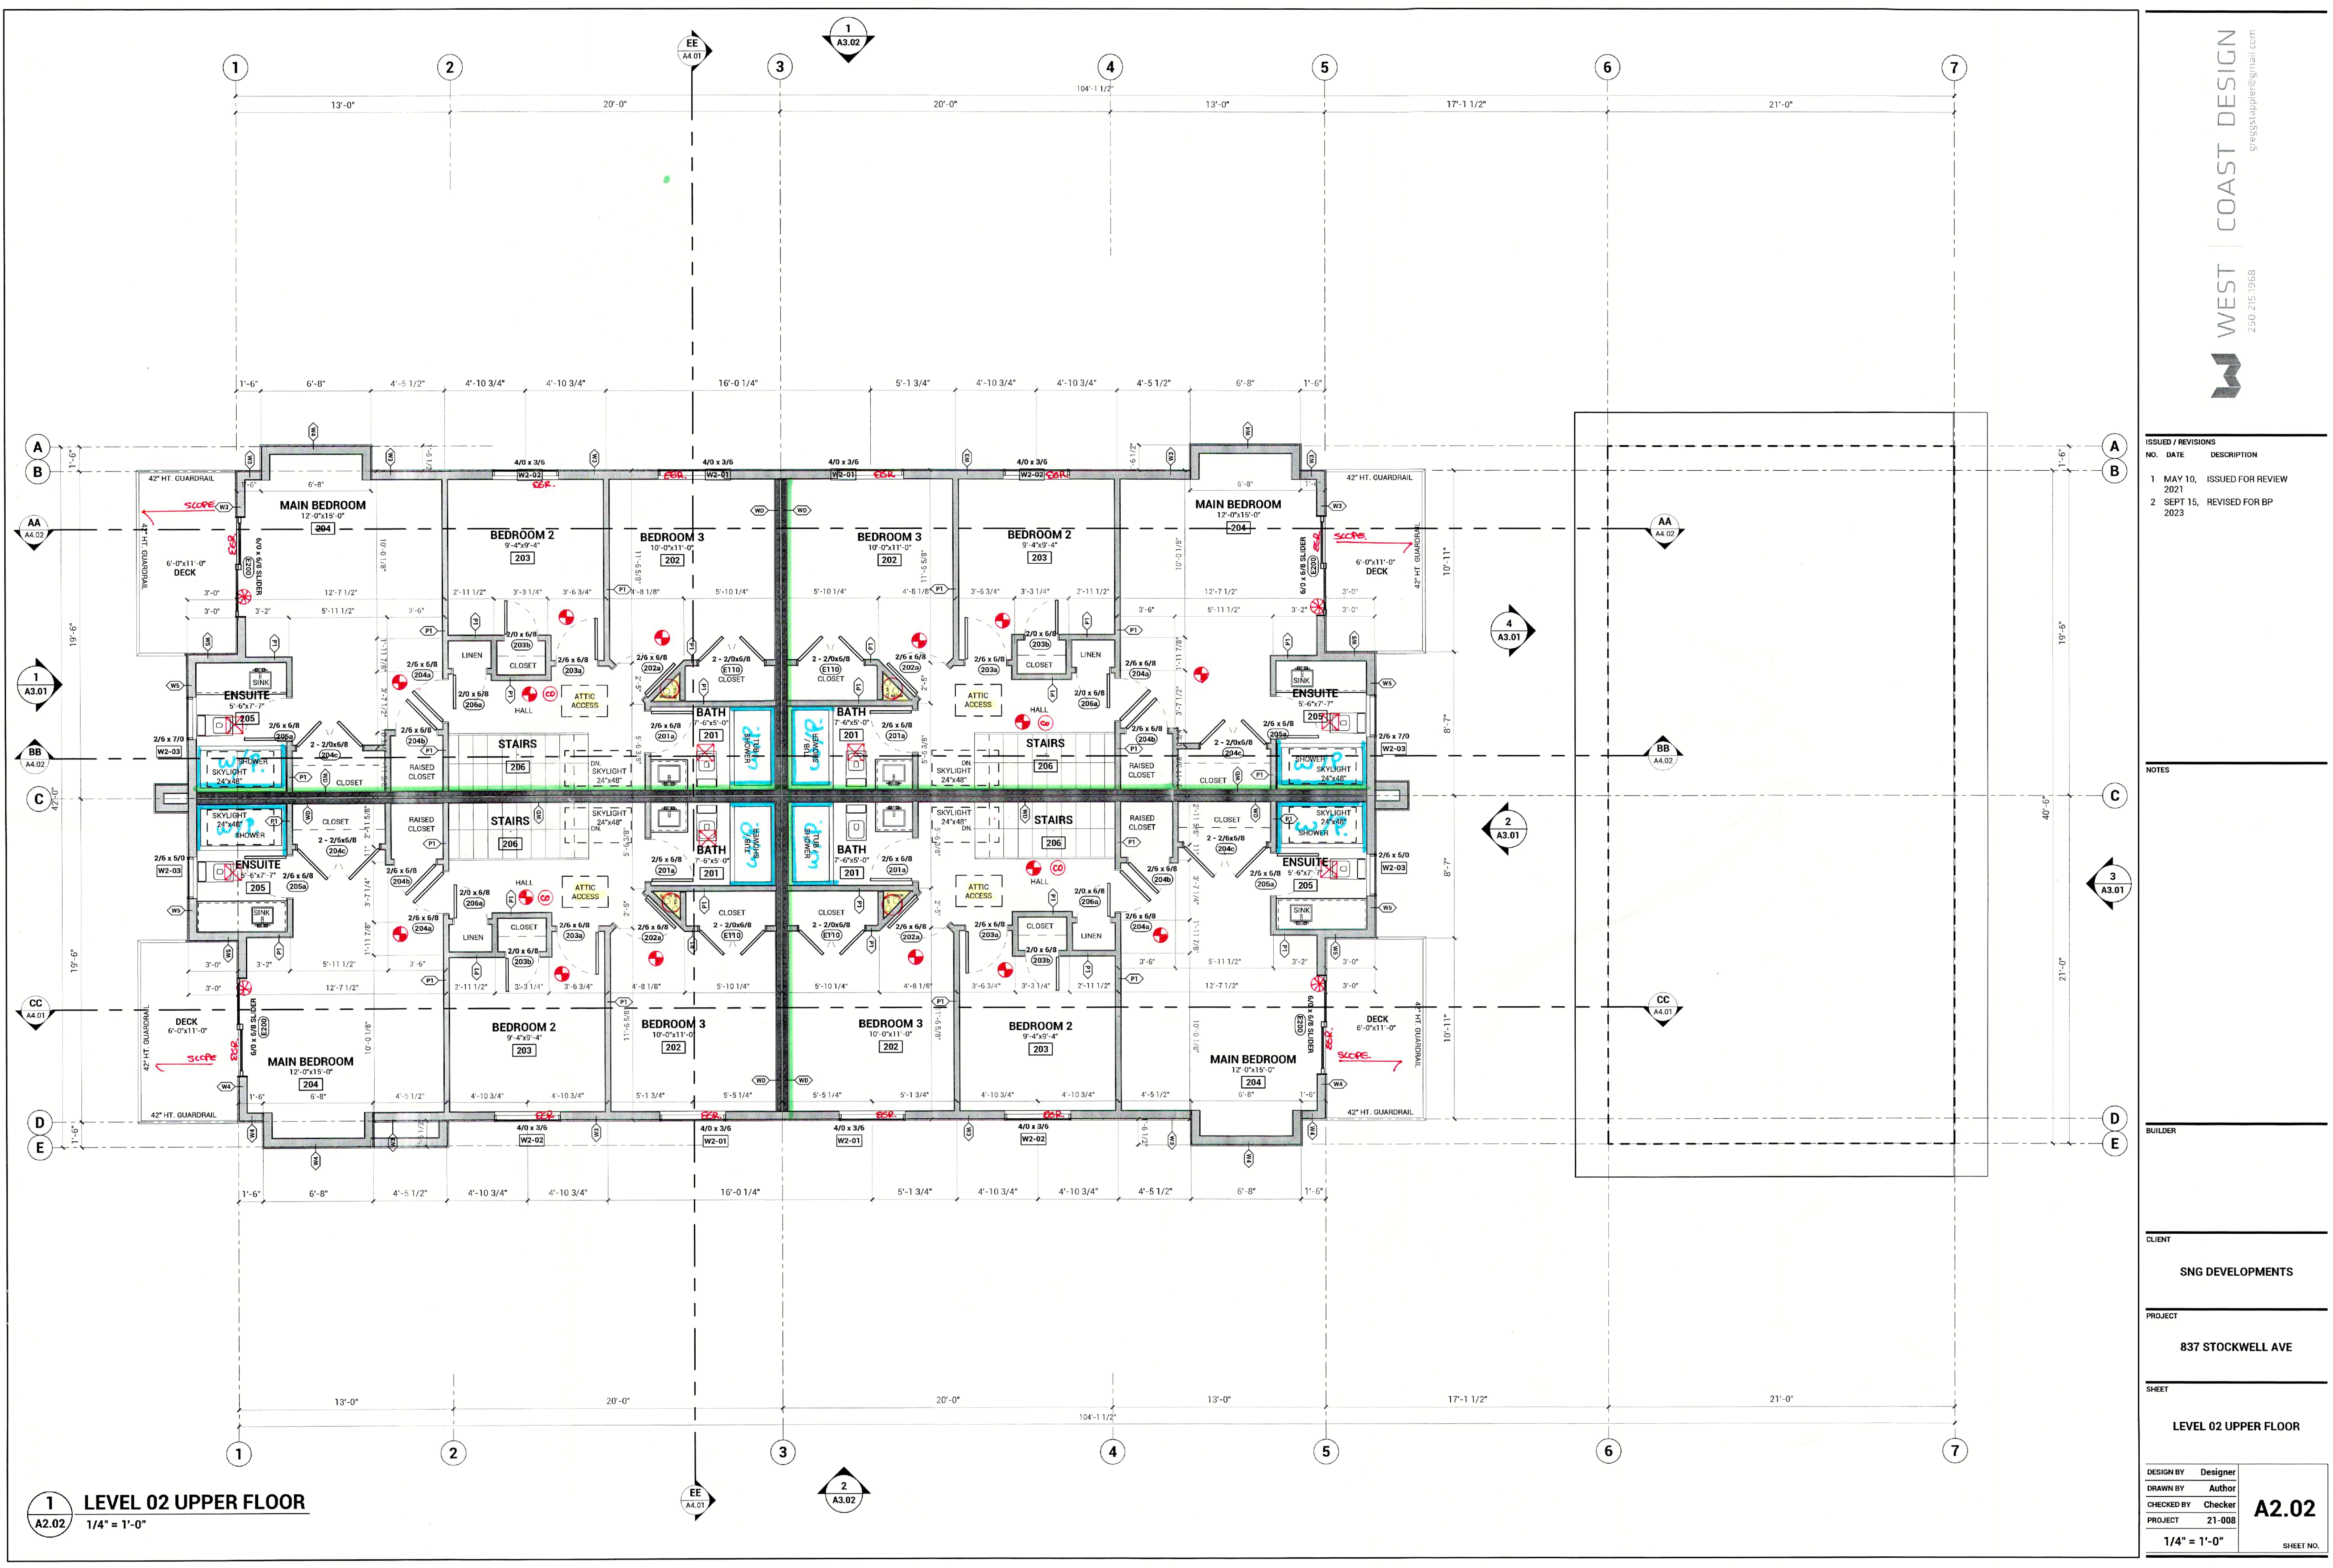

1
A2.02
LEVEL 02 UPPER FLOOR
1/4" = 1'-0"

ISSUED / REVISIONS		
NO.	DATE	DESCRIPTION
1	MAY 10, 2021	ISSUED FOR REVIEW
2	SEPT 15, 2023	REVISED FOR BP

NOTES

BUILDER

CLIENT

SNG DEVELOPMENTS

PROJECT

837 STOCKWELL AVE

SHEET

LEVEL 02 UPPER FLOOR

DESIGN BY	Designer
DRAWN BY	Author
CHECKED BY	Checker
PROJECT	21-008

1/4" = 1'-0"

A2.02

SHEET NO.

ISSUED / REVISIONS		
NO.	DATE	DESCRIPTION
1	MAY 10, 2021	ISSUED FOR REVIEW
2	SEPT 15, 2023	REVISED FOR BP

NOTES

BUILDER

CLIENT

SNG DEVELOPMENTS

PROJECT

837 STOCKWELL AVE

SHEET


LEVEL 03 ROOF PLAN

DESIGN BY	GS
DRAWN BY	GS
CHECKED BY	GS
PROJECT	21-008


3/16" = 1'-0"

A2.03


SHEET NO.

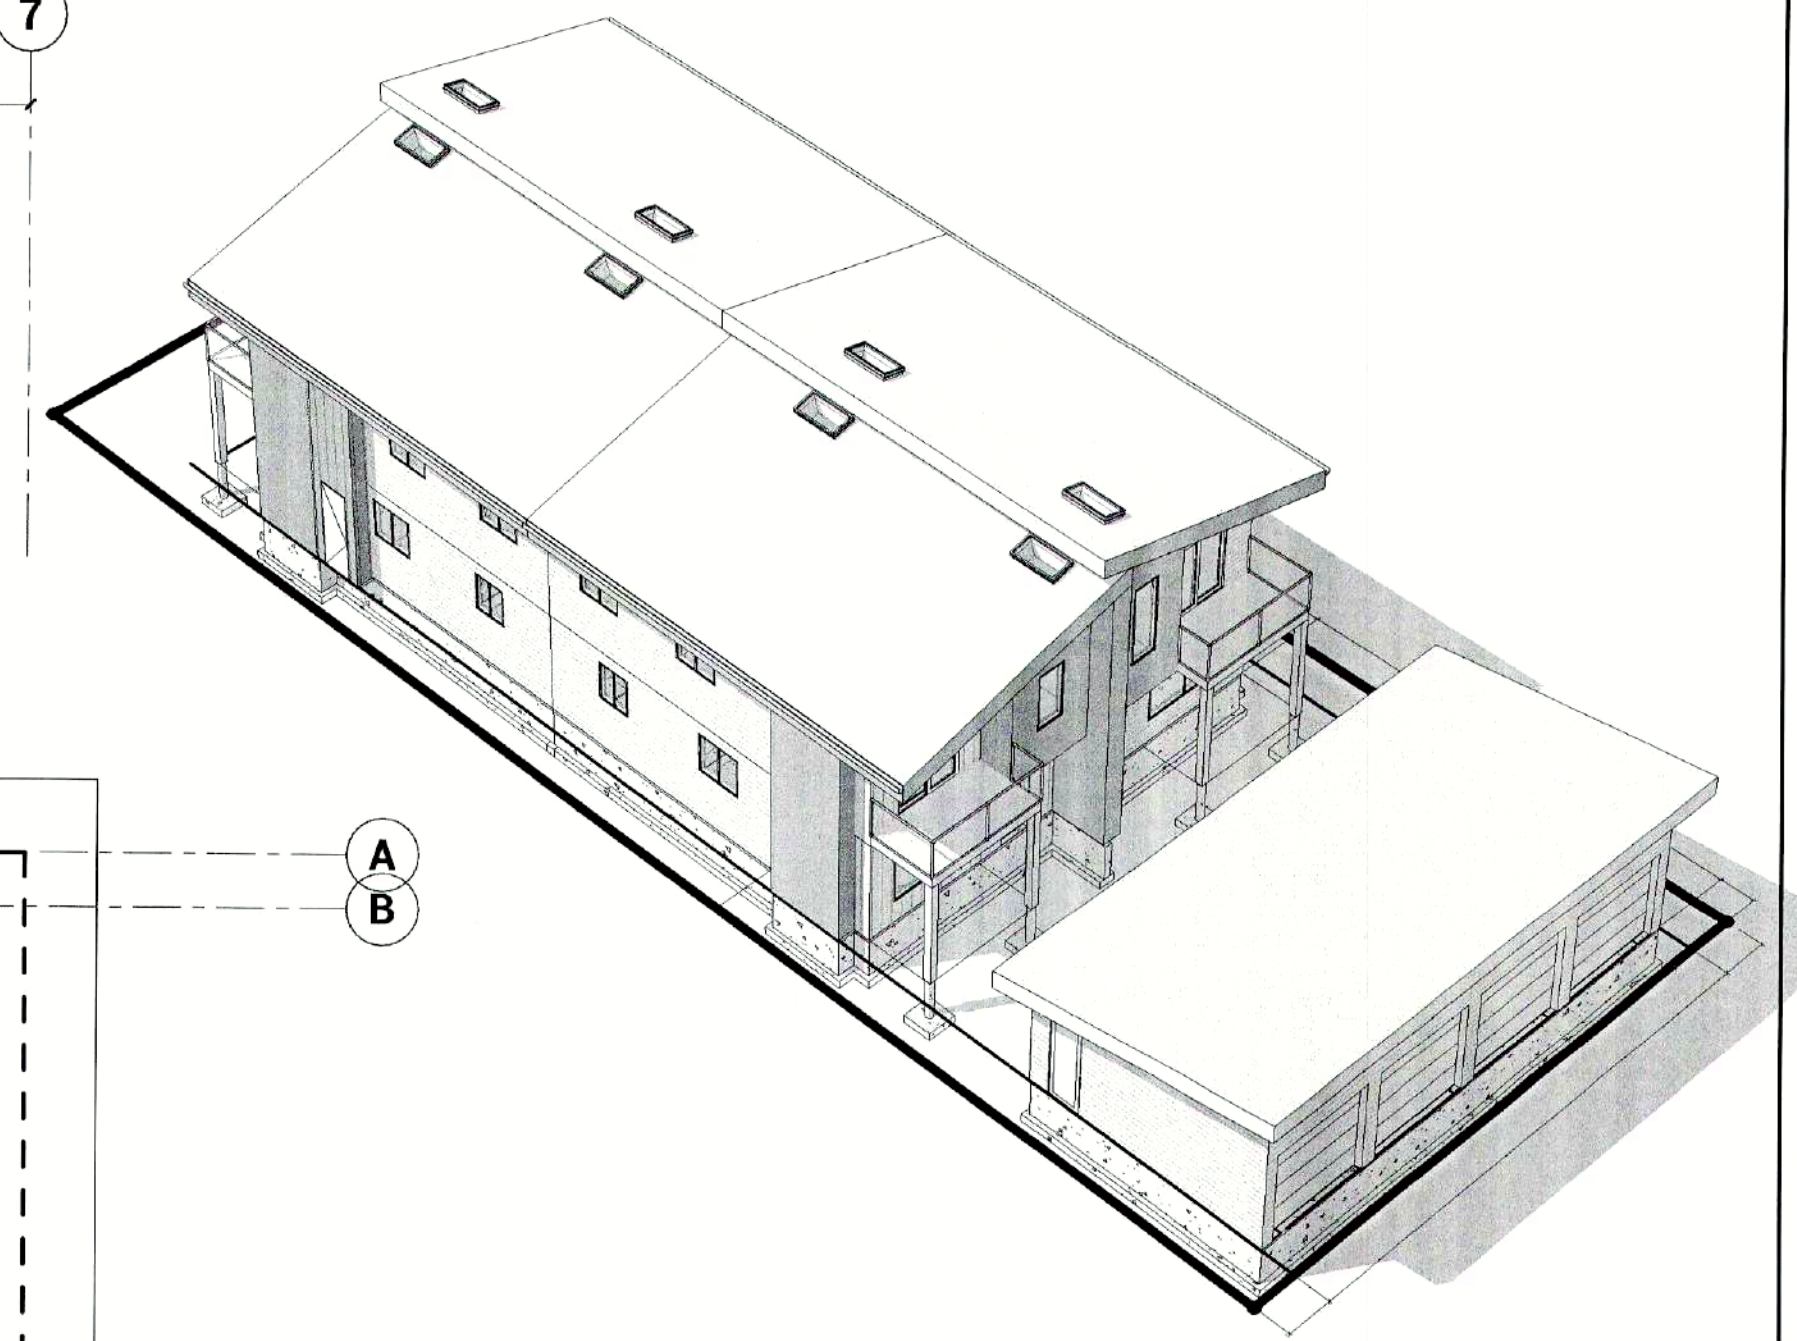

2 AERIAL - ROOF SOUTH EAST
A2.03

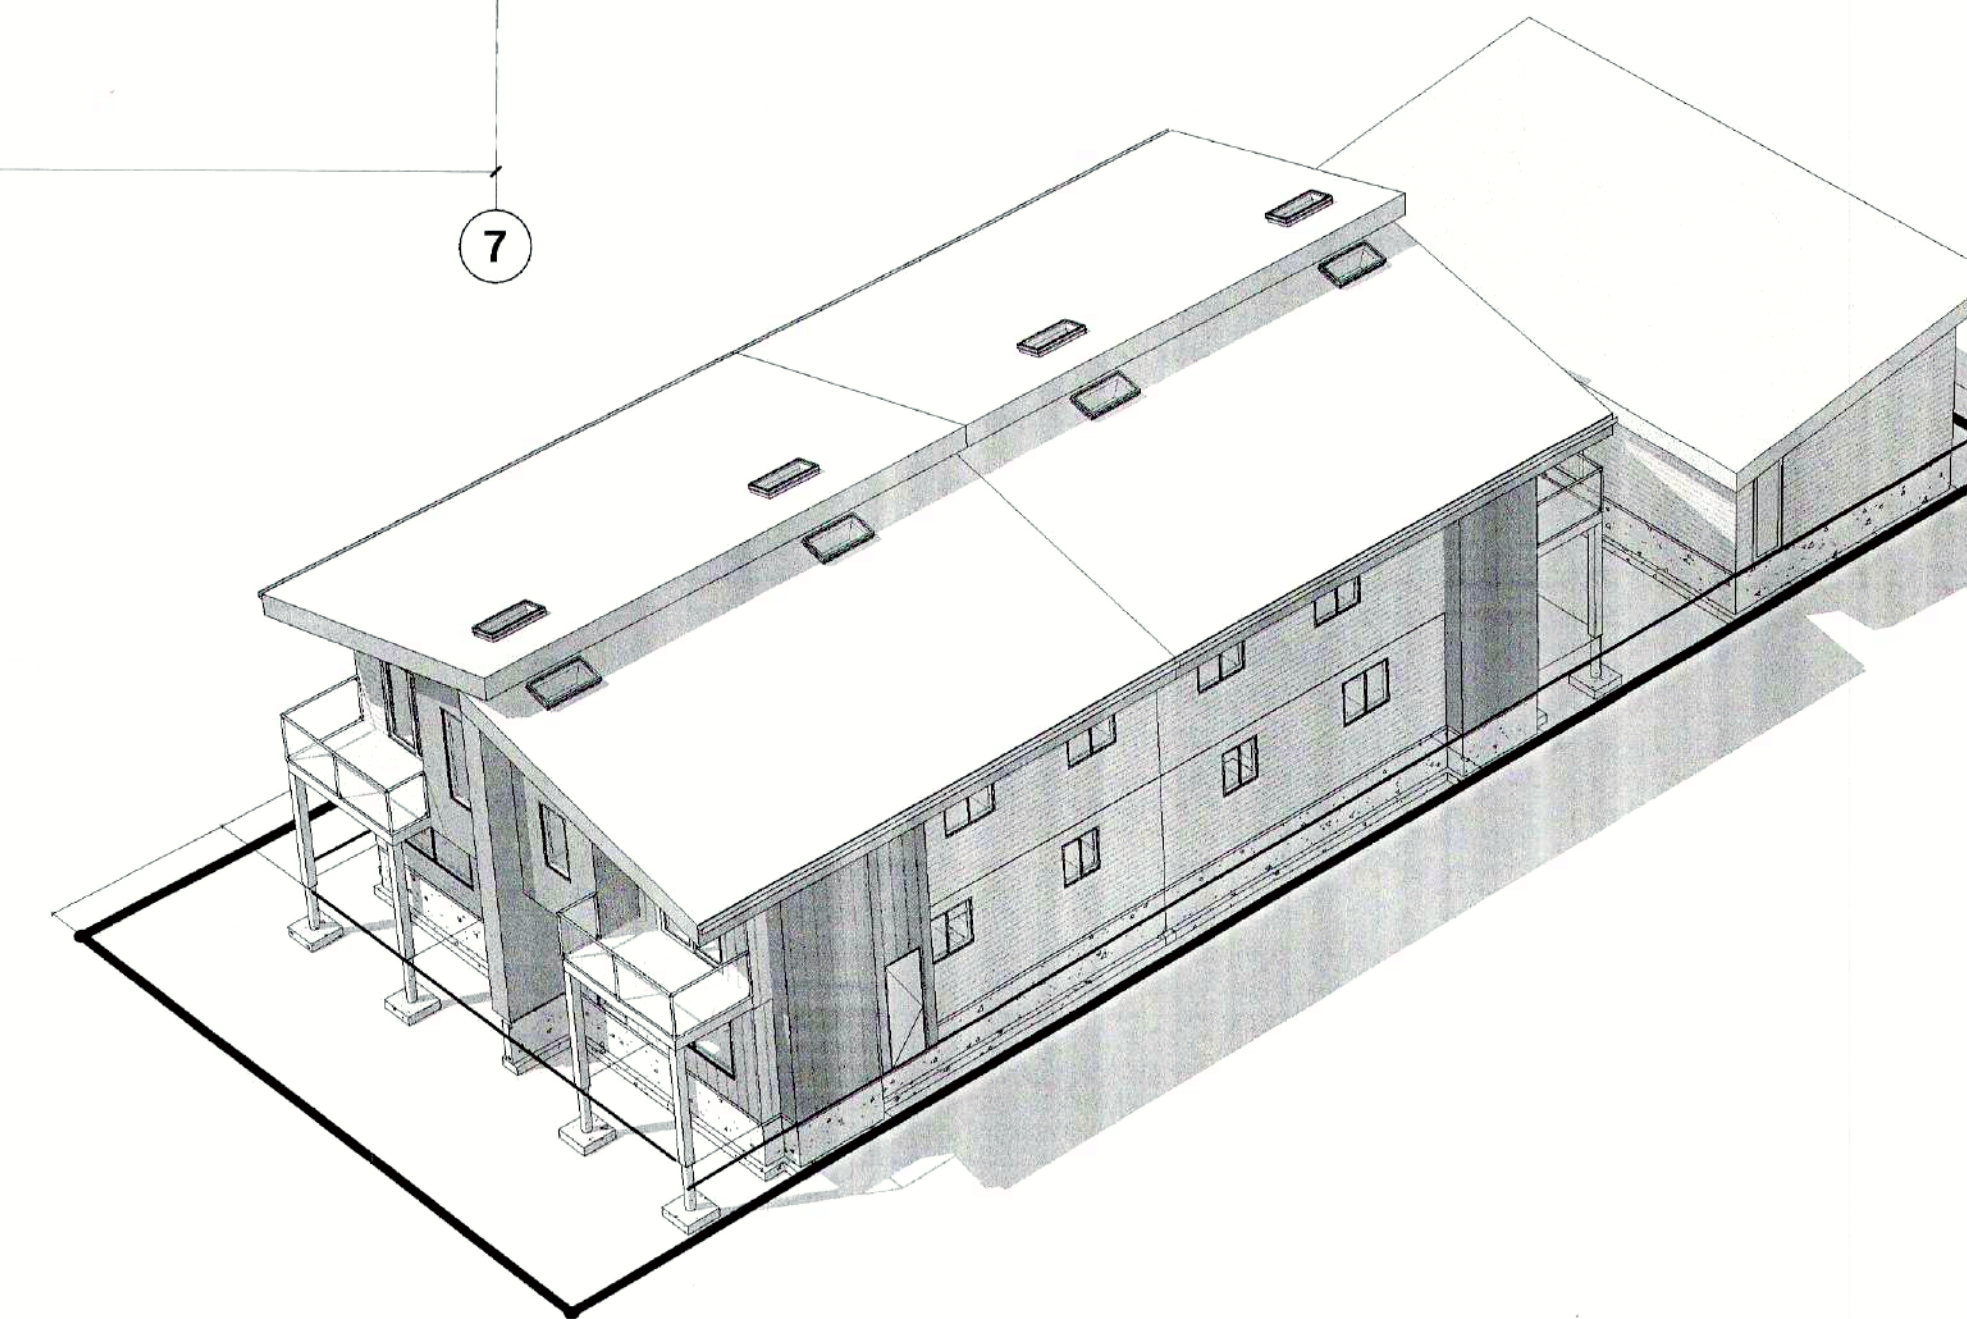


3 AERIAL - ROOF STREETSIDE
A2.03

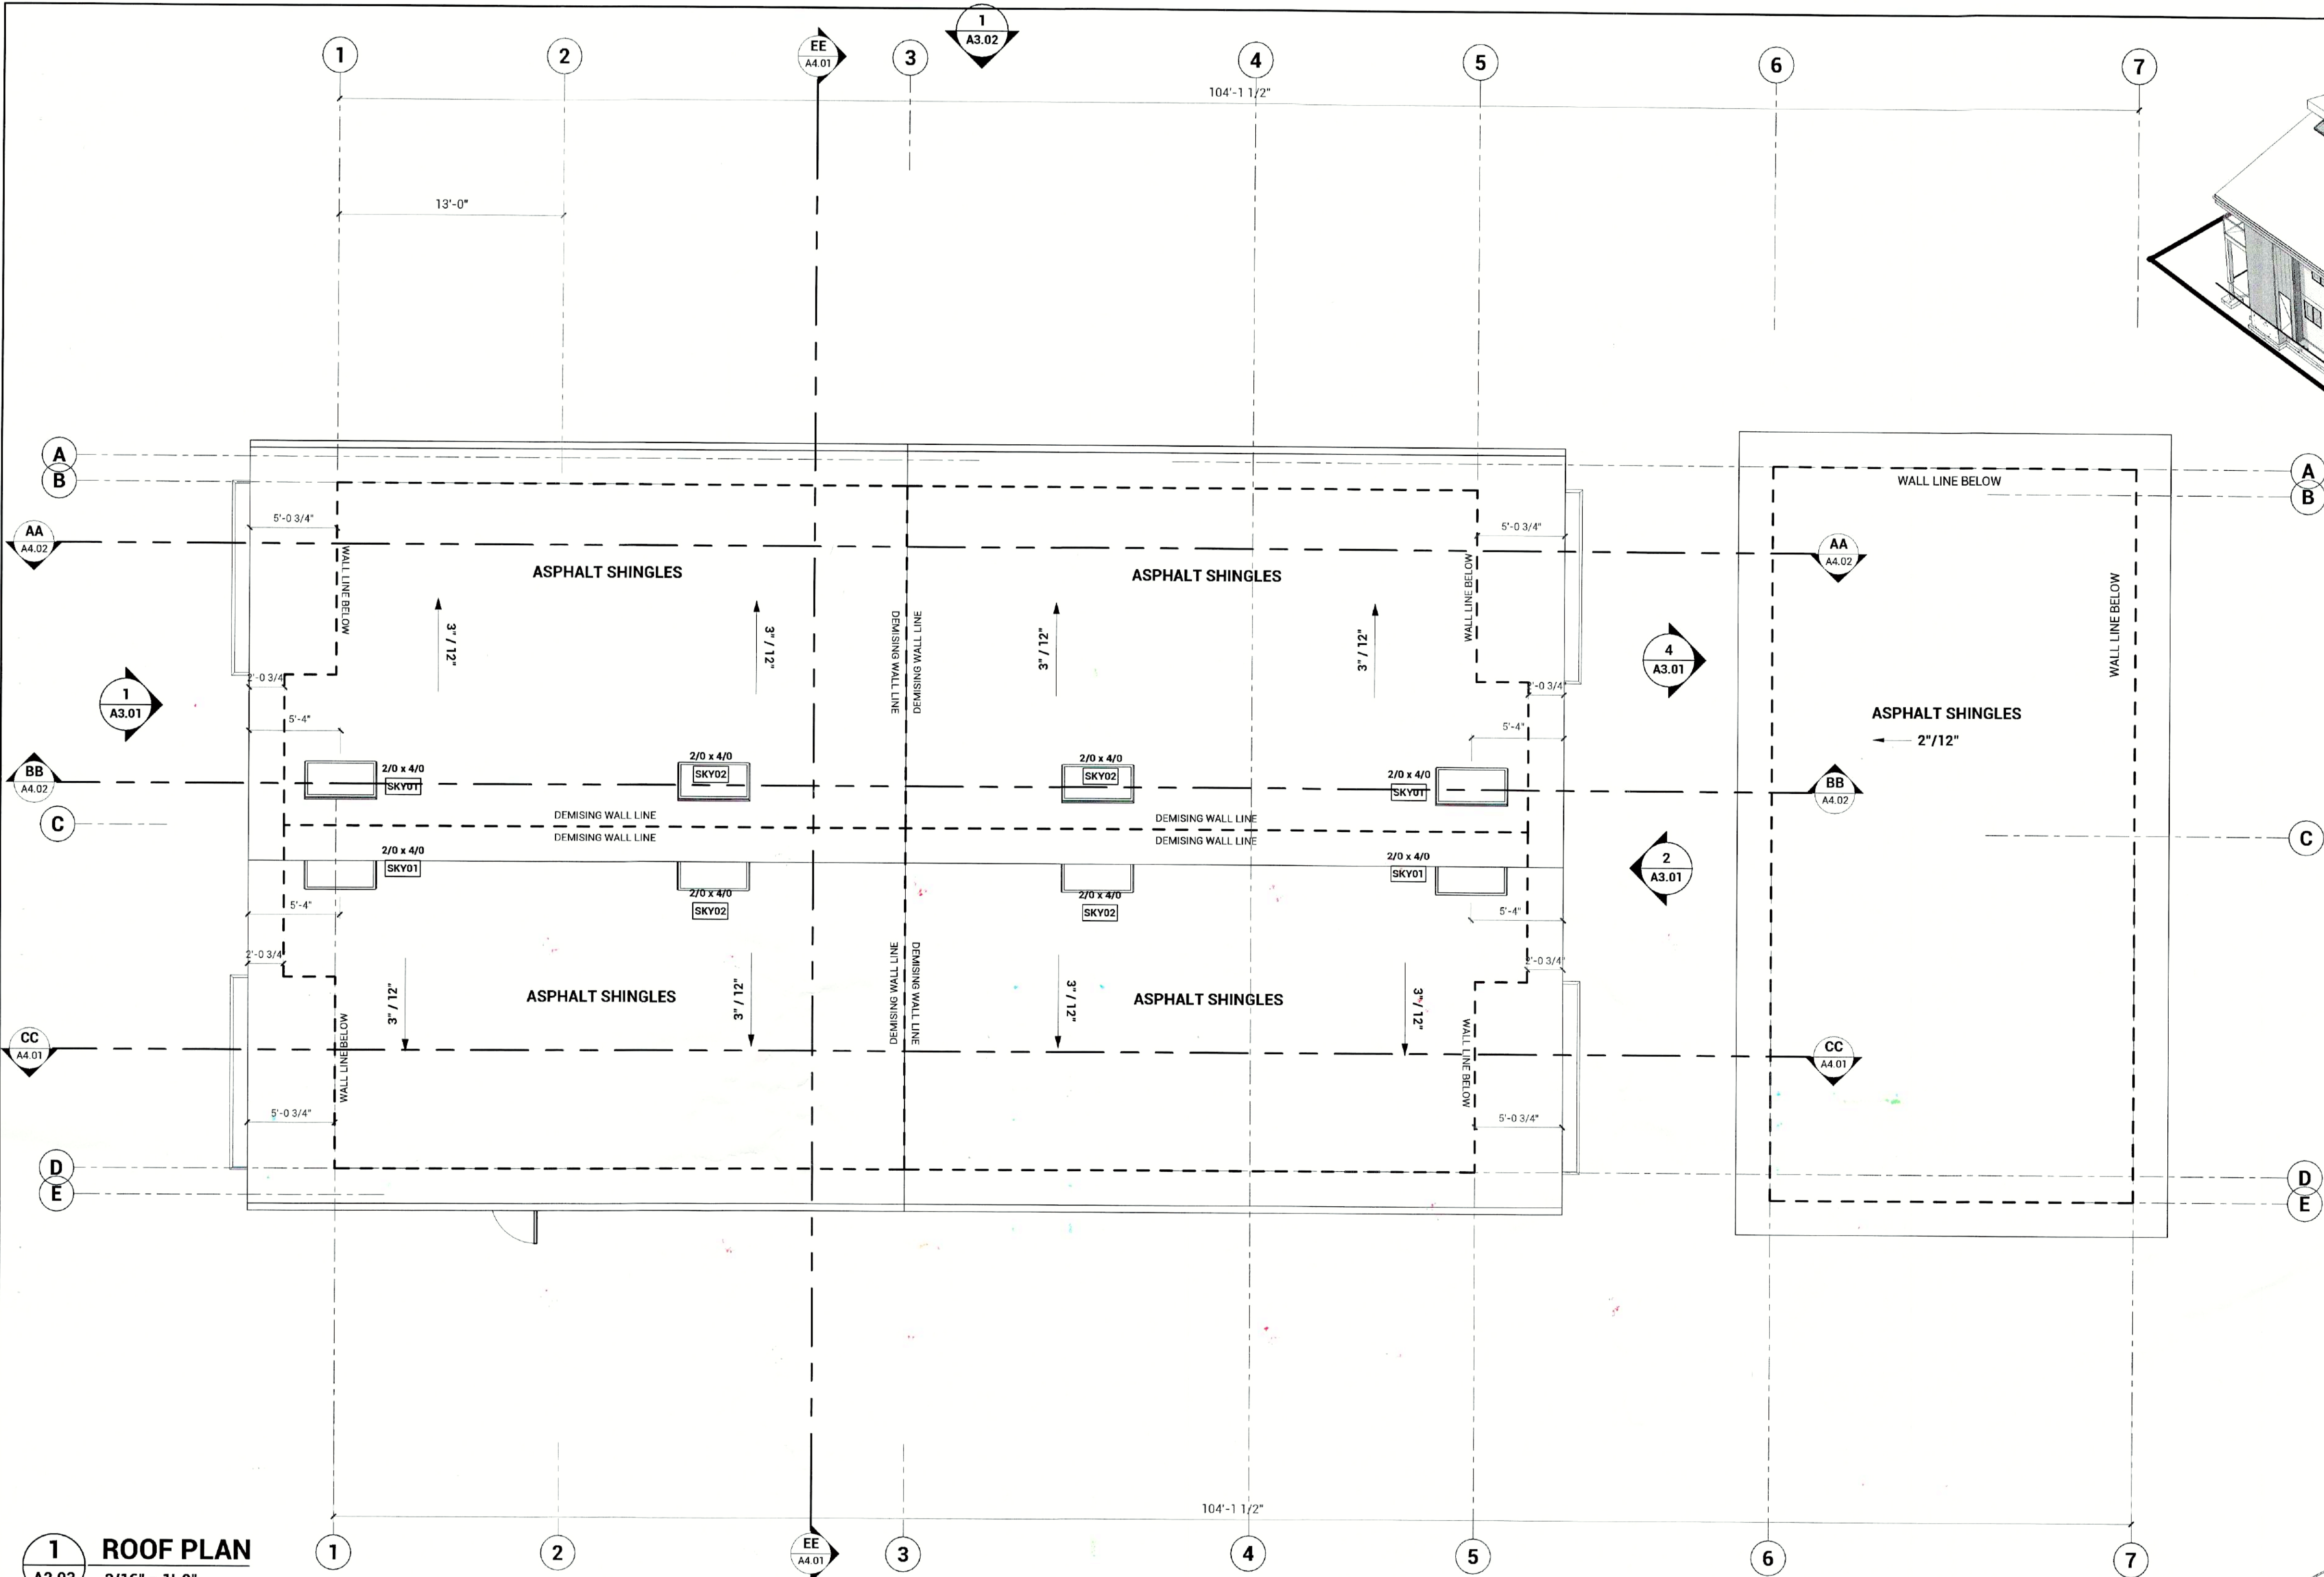


1 ROOF PLAN
A2.03
3/16" = 1'-0"

ROOF VENTILATION REQUIRED AS PER
SECTION 9.19 OF B.C. BUILDING CODE

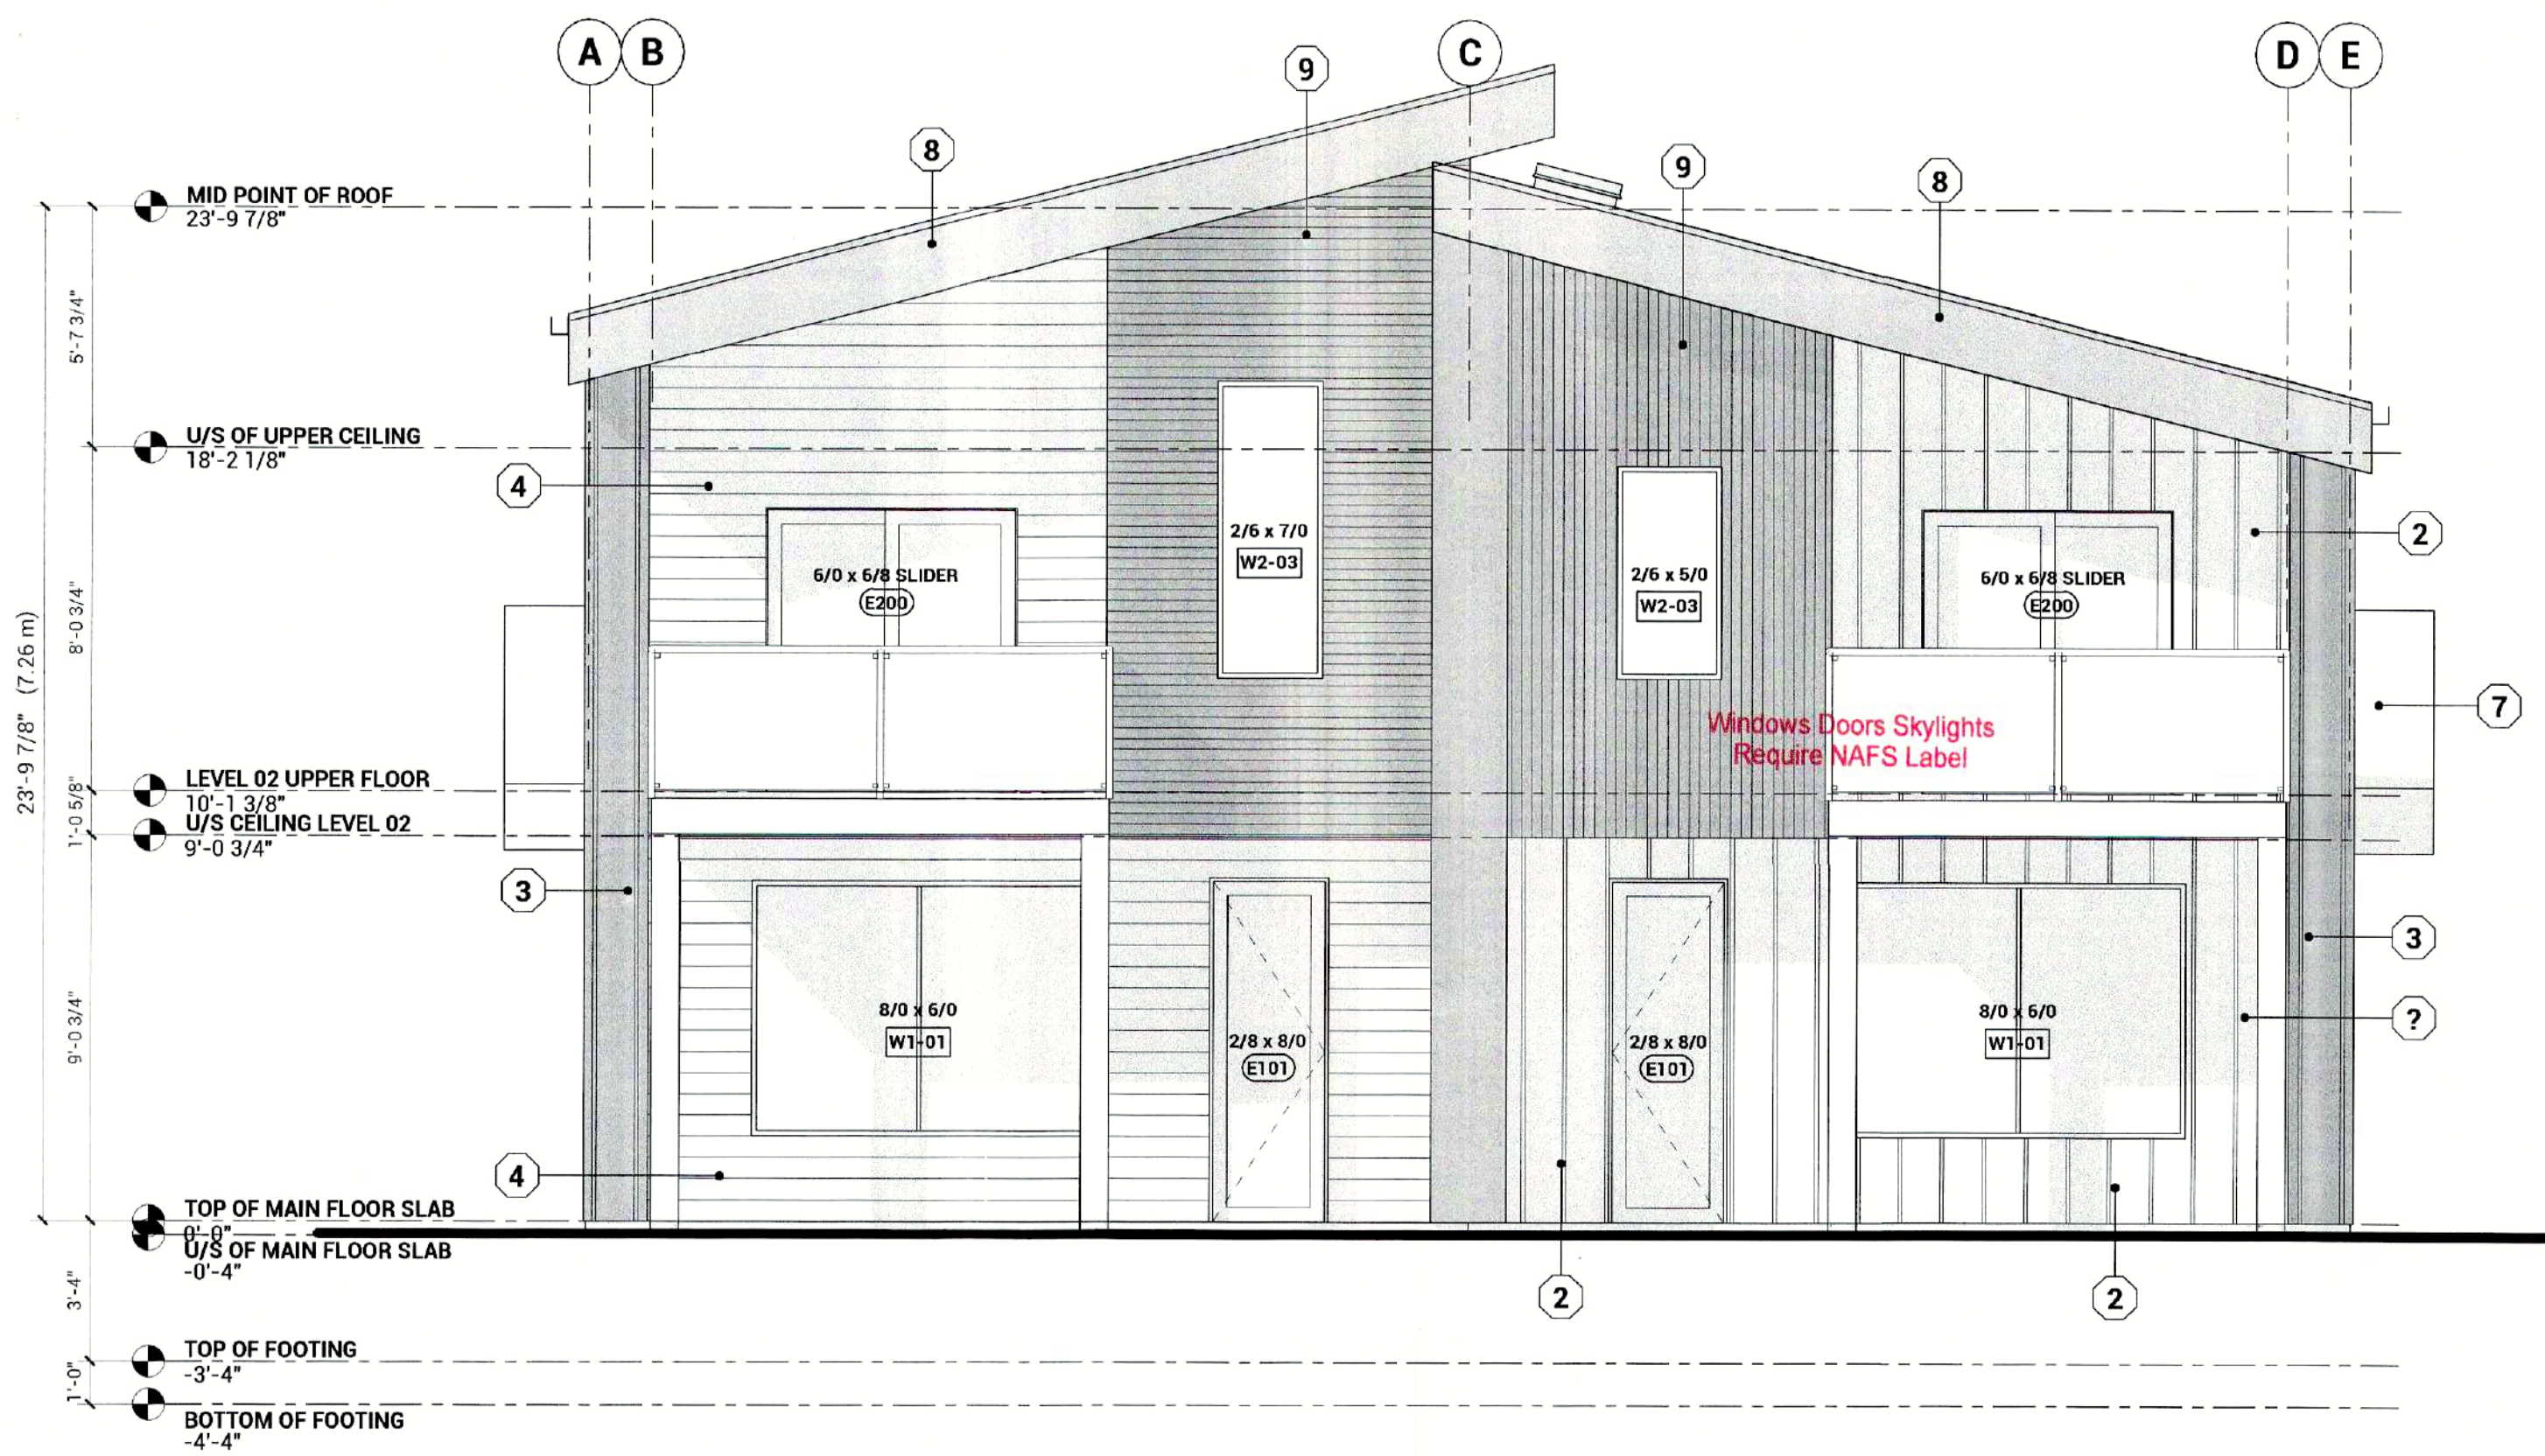


1 NORTH BUILDING ELEVATION
A3.01 1/4" = 1'-0"

FLASHINGS with end dams required at all exterior unprotected openings.
FLASHINGS required at all horizontal projections.
Minimum 6" clearance from grade to wood framing.
Minimum 8" clearance from grade to moisture-susceptible cladding or trim.
Minimum 2" clearance from roofing, decking & paving to moisture susceptible cladding, trim or wood framing.

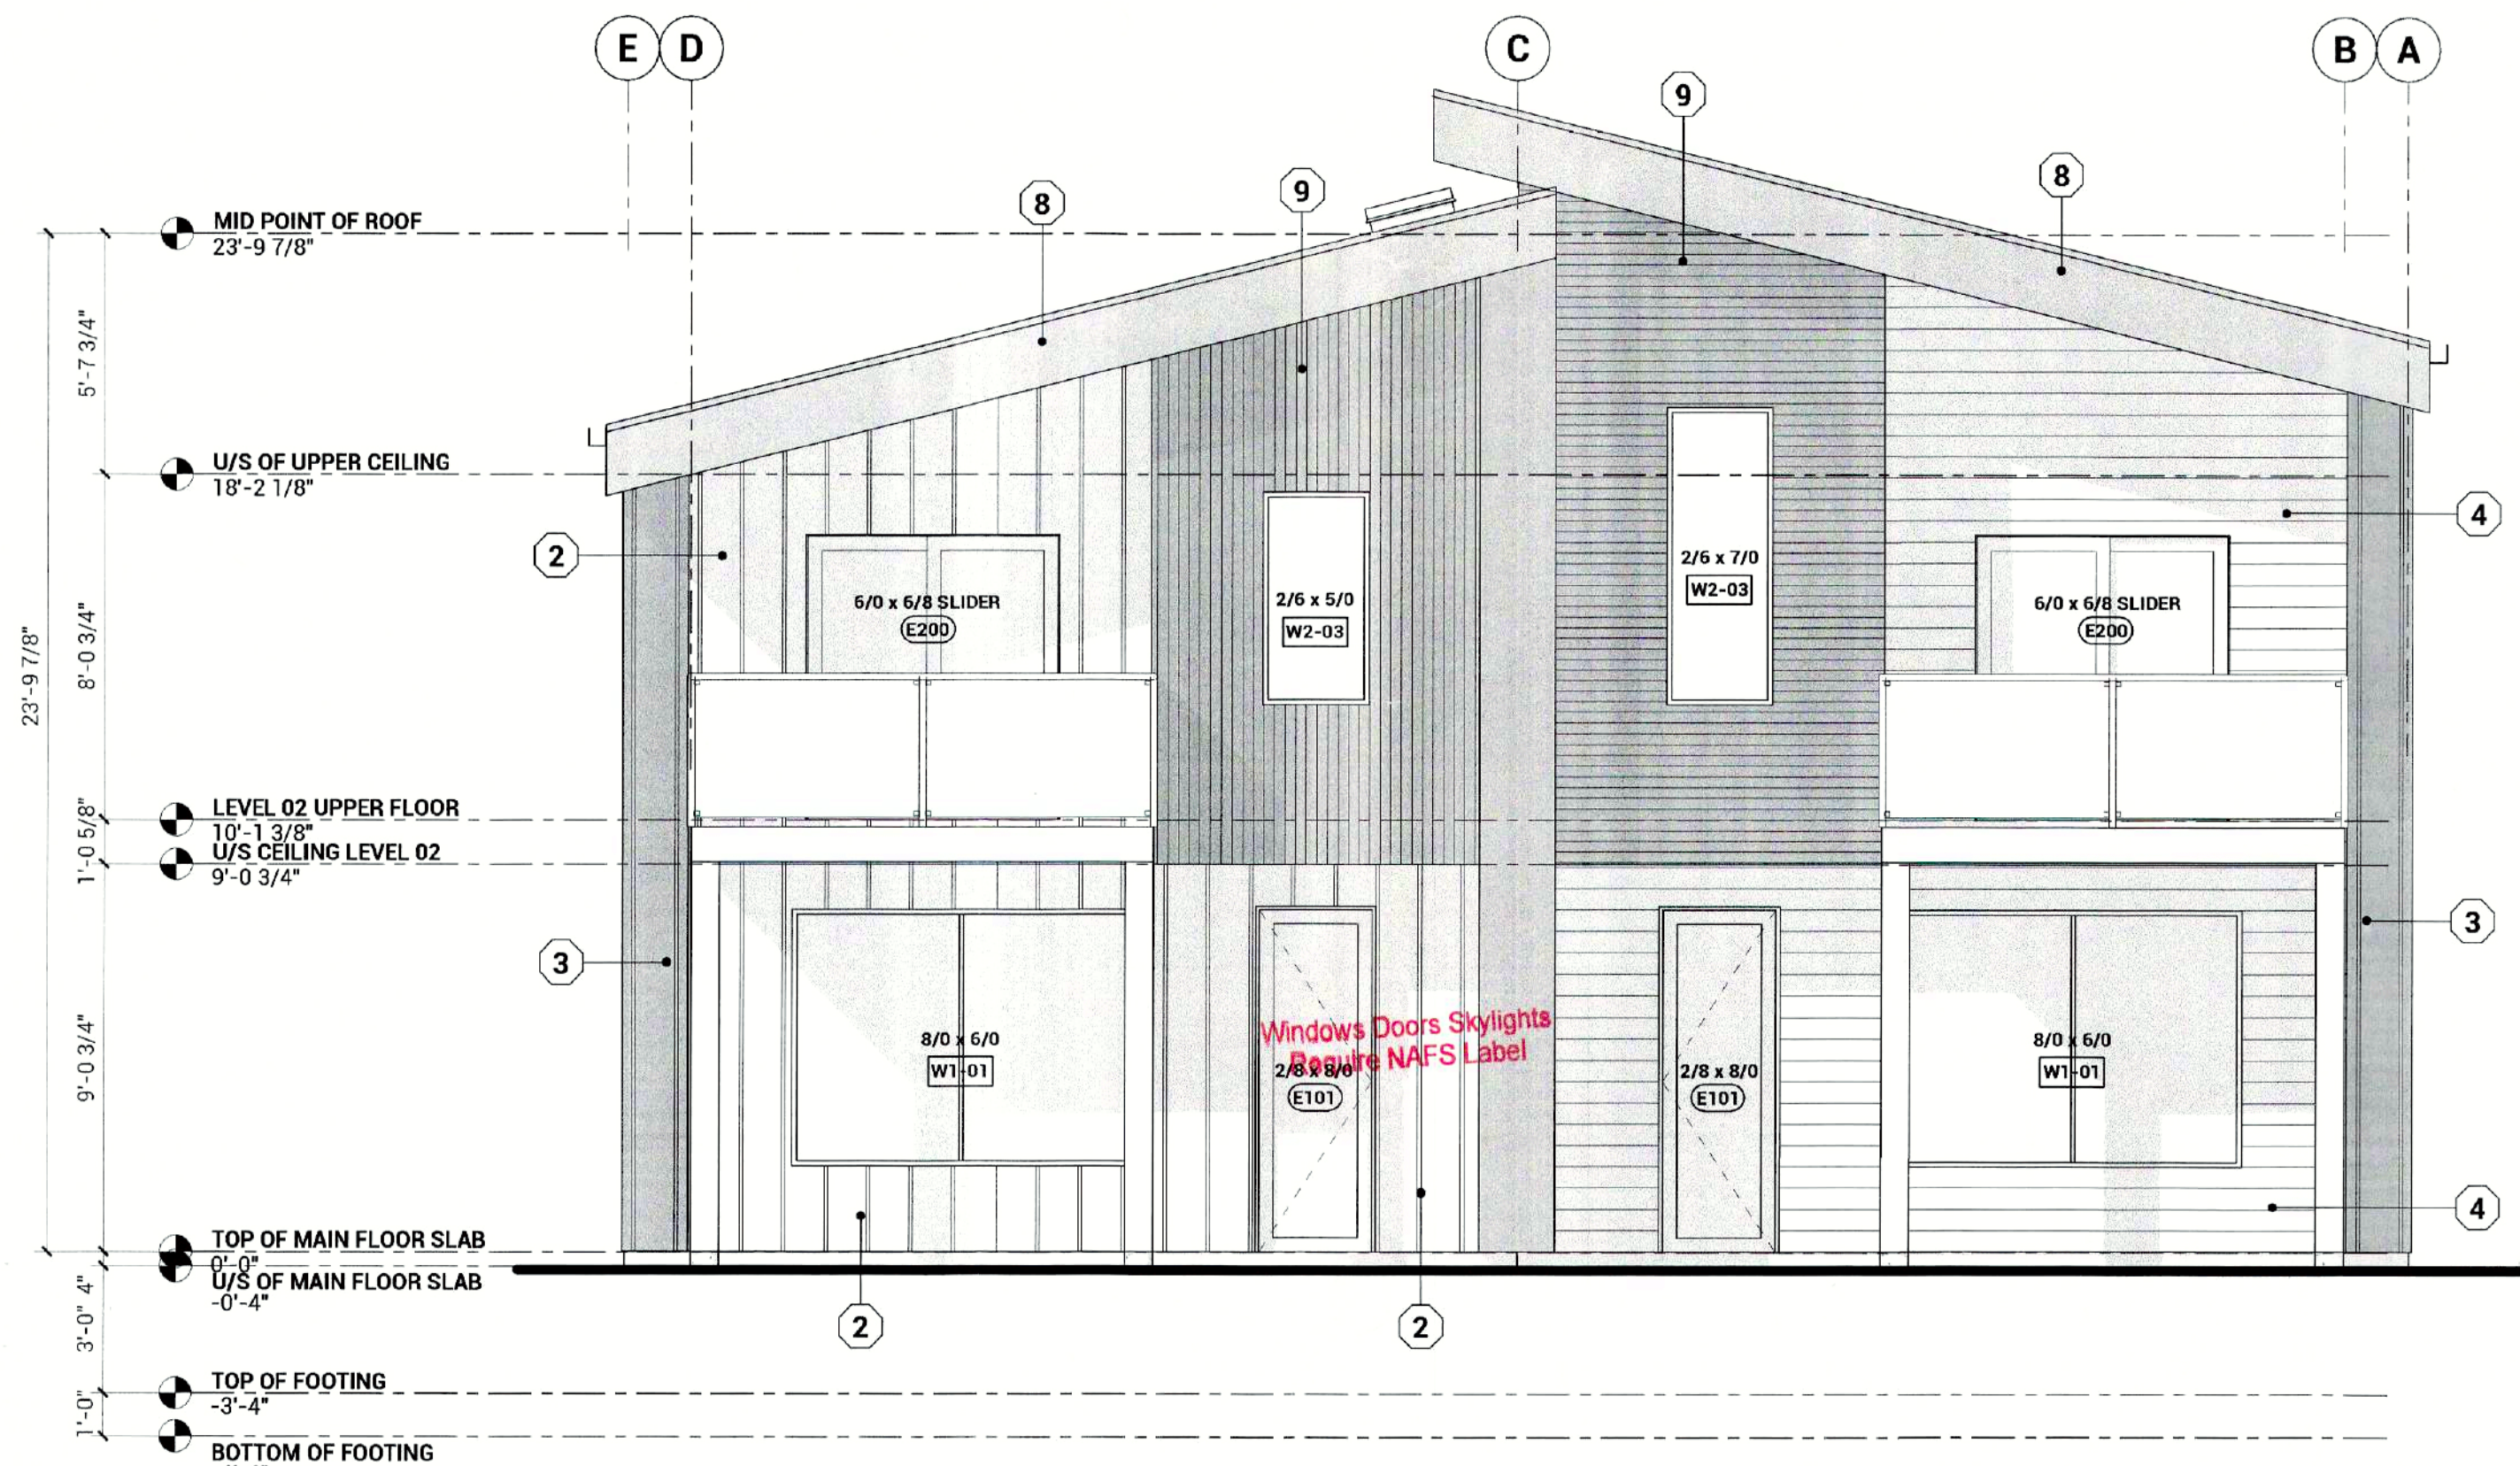

2 SOUTH BUILDING ELEVATION
A3.01 1/4" = 1'-0"

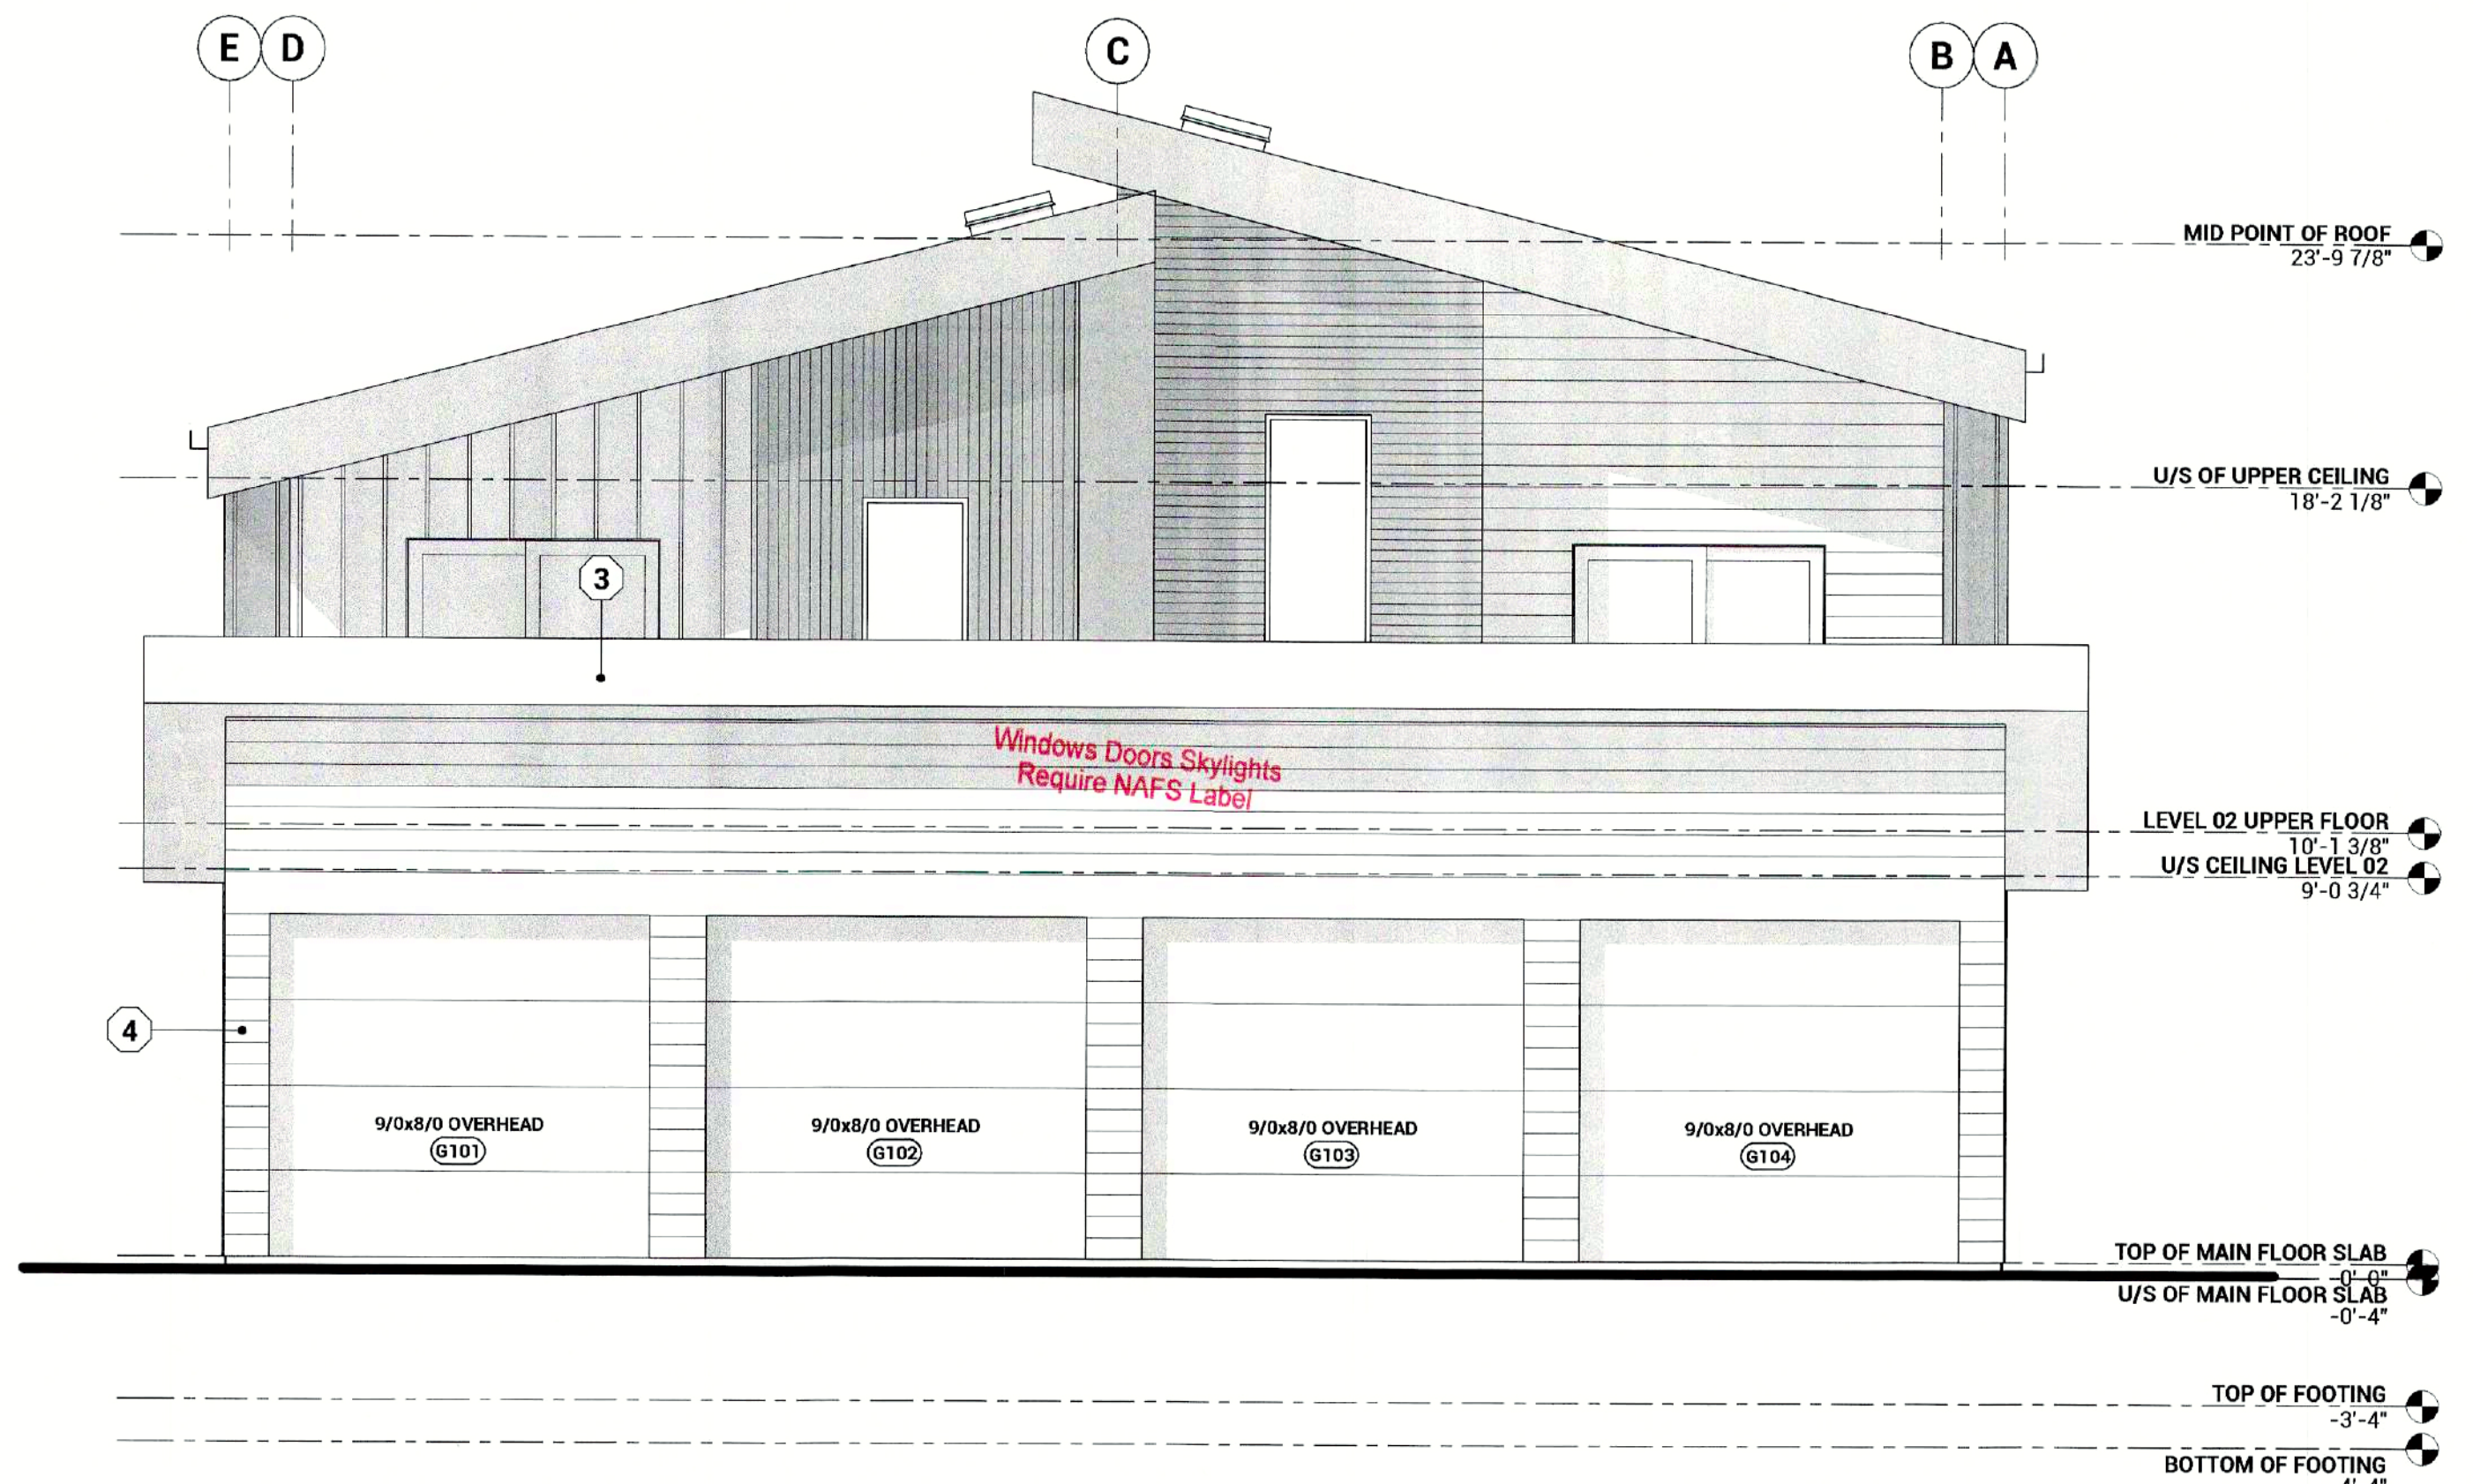


3 GARAGE - NORTH
A3.01 1/4" = 1'-0"

EXTERIOR MATERIALS

- DUAL BLACK, ARCHITECTURAL SERIES (IKO)
- COMPOSITE LAP SIDING, HARDIE COLOR PLUS - ARTIC WHITE
- COMPOSITE BOARD & BATTEN SIDING, HARDIE COLOR PLUS - BLACK
- COMPOSITE BOARD & BATTEN SIDING, HARDIE COLOR PLUS - ARTIC WHITE
- STEEL SIDING, VERTICAL & HORIZ: BLACK STEEL CORROGATED SIDING
- GUTTERS, DOWNPIPES & FLASHING: GENTEK ALUMINUM BLACK
- WINDOWS: BLACK VINYL

EXTERIOR FINISH LEGEND

- 1 SOFFIT - ALUMINUM, VENTED
- 2 BOARD & BATTEN SIDING
- 3 BOARD & BATTEN SIDING, PAINTED CHARCOAL
- 4 HARDIE LAP SIDING, PAINTED
- 5 METAL FLASHING CAP
- 6 ALUMINUM GUTTER & DOWNPIPES
- 7 ASPHALT SHINGLE ROOFING
- 8 FASCIA - HARDIE PANEL, SMOOTH
- 9 CORROGATED METAL SIDING

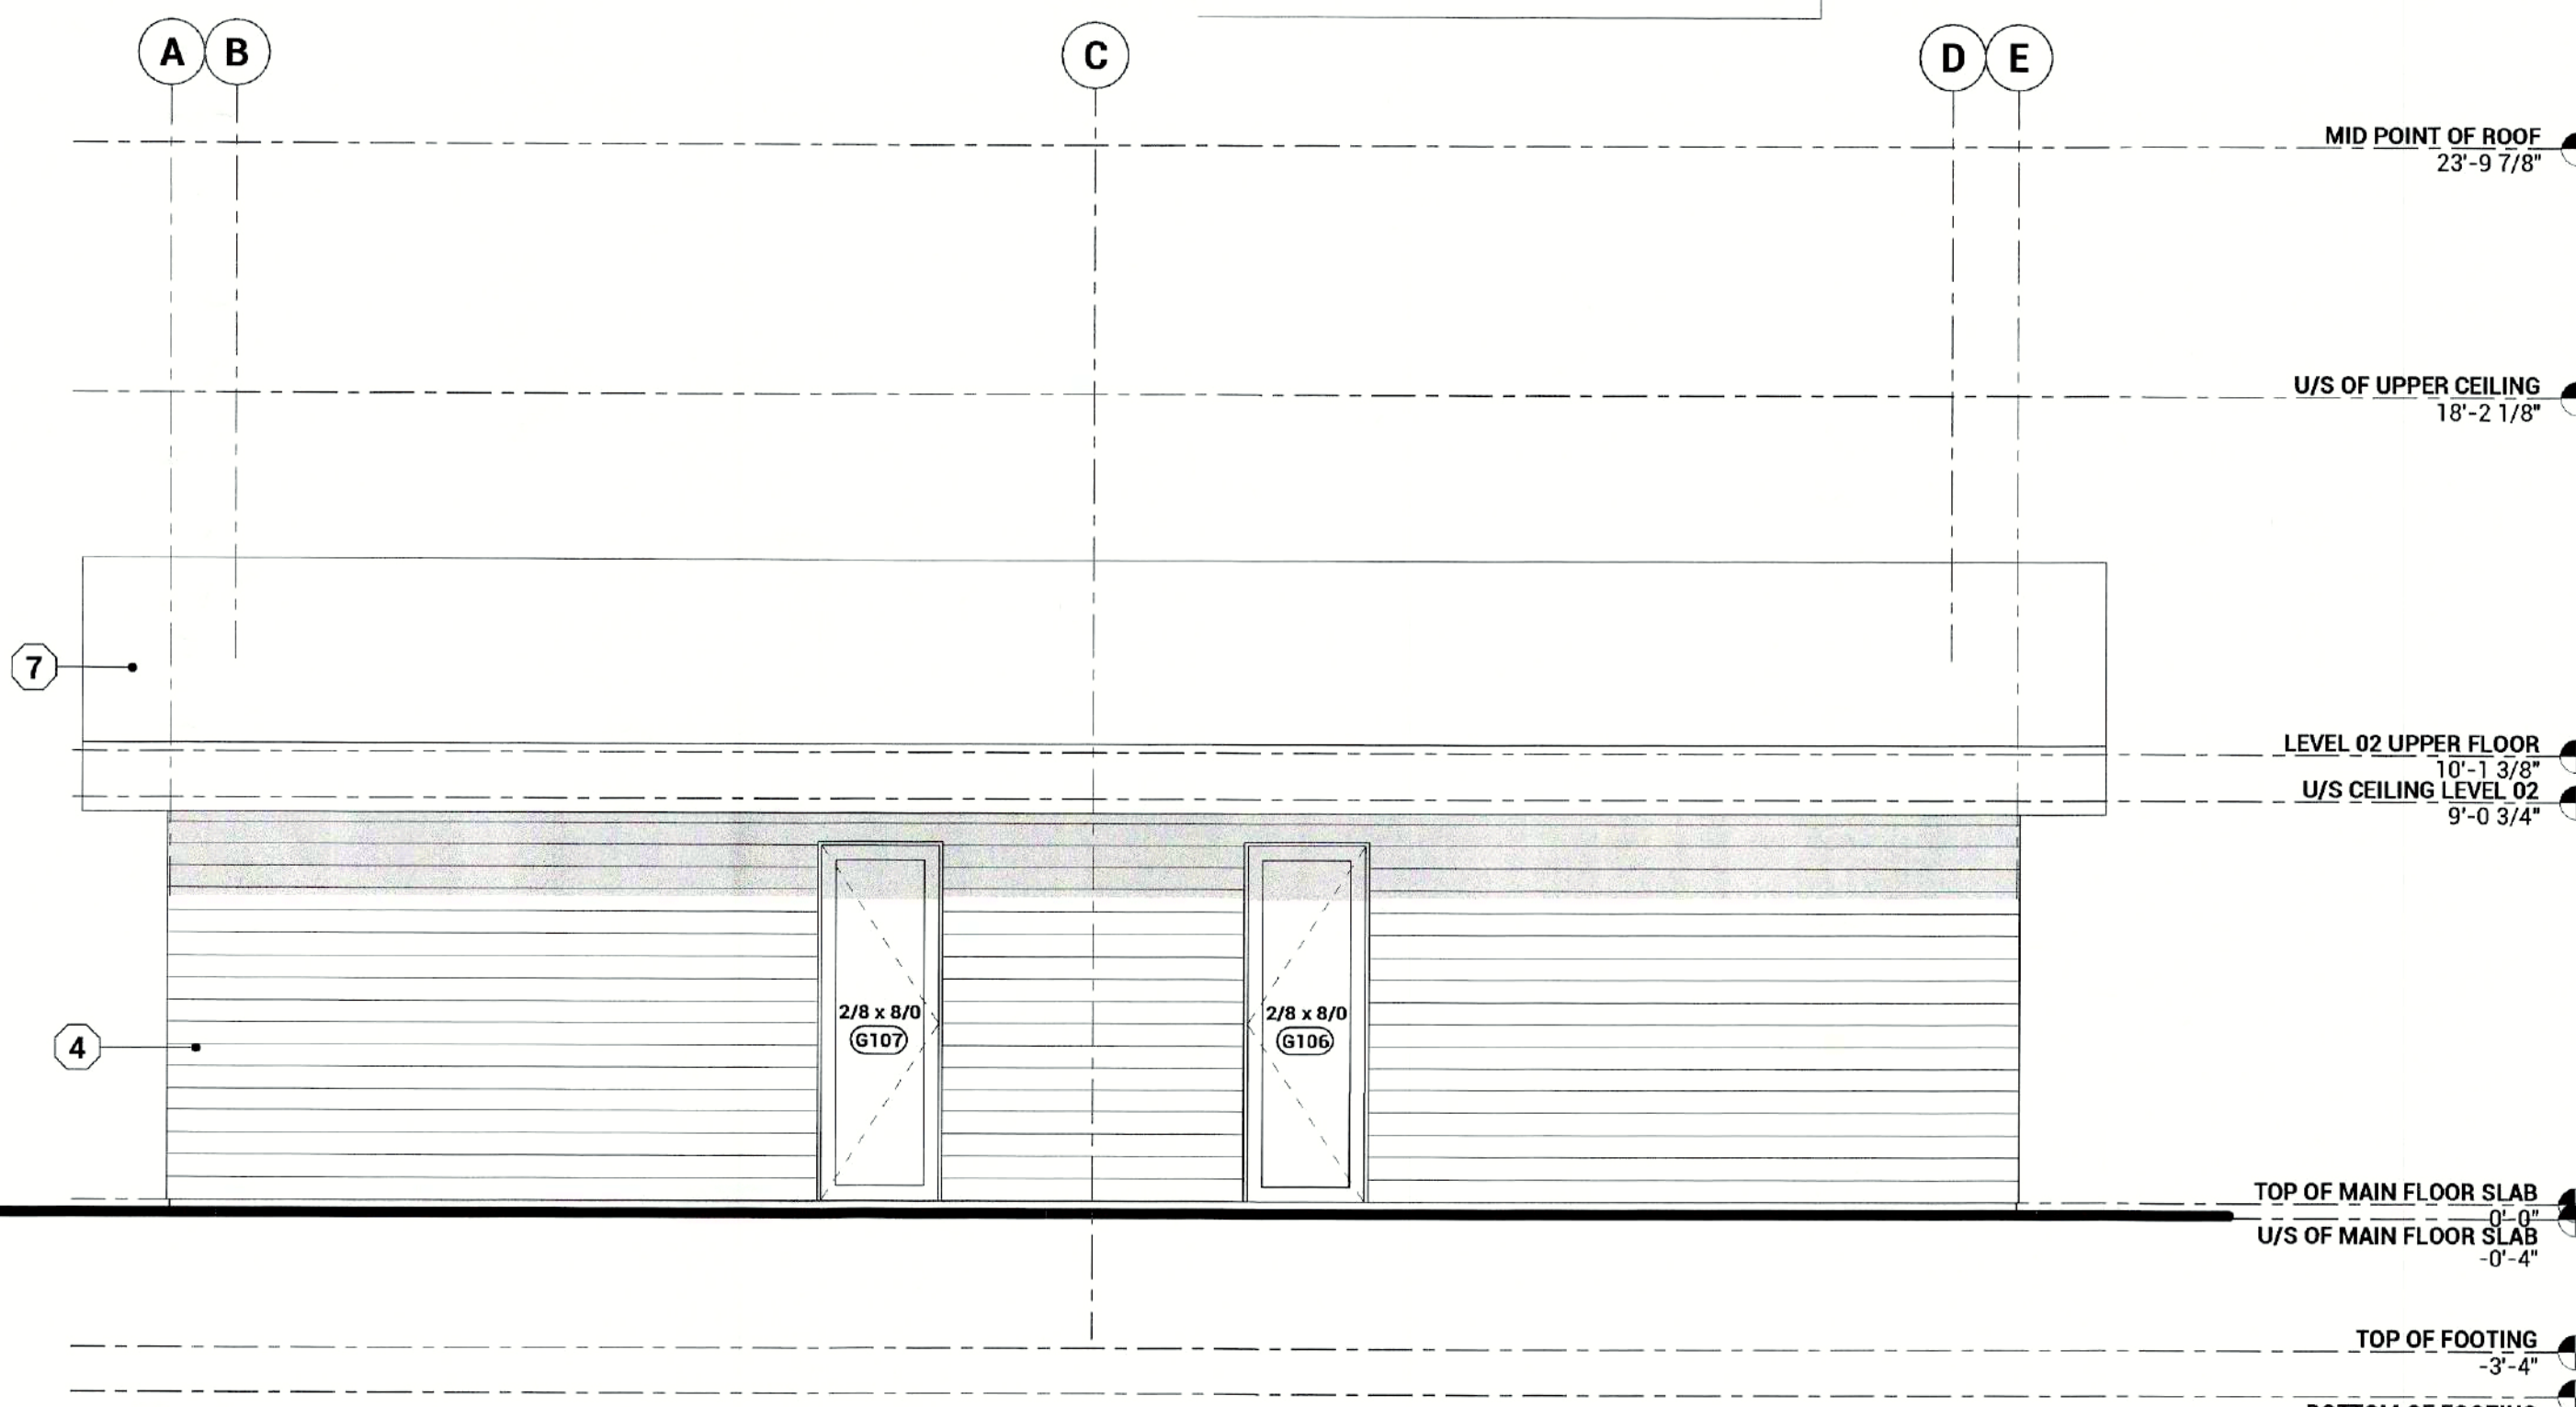

4 GARAGE - SOUTH
A3.01 1/4" = 1'-0"

ISSUED / REVISIONS		
NO.	DATE	DESCRIPTION
1	MAY 10, 2021	ISSUED FOR REVIEW
2	SEPT 15, 2023	REVISED FOR BP

NOTES

BUILDER

CLIENT

SNG DEVELOPMENTS

PROJECT

837 STOCKWELL AVE

SHEET

EXTERIOR ELEVATIONS

DESIGN BY GS
DRAWN BY GS
CHECKED BY GS
PROJECT 21-008

A3.01

1/4" = 1'-0"

SHEET NO.

ISSUED / REVISIONS		
NO.	DATE	DESCRIPTION
1	MAY 10, 2021	ISSUED FOR REVIEW
2	SEPT 15, 2023	REVISED FOR BP

NOTES

BUILDER

CLIENT

SNG DEVELOPMENTS

PROJECT

837 STOCKWELL AVE

SHEET


EXTERIOR ELEVATIONS 2

DESIGN BY	GS
DRAWN BY	GS
CHECKED BY	GS
PROJECT	21-008

A3.02

1/4" = 1'-0"

SHEET NO.

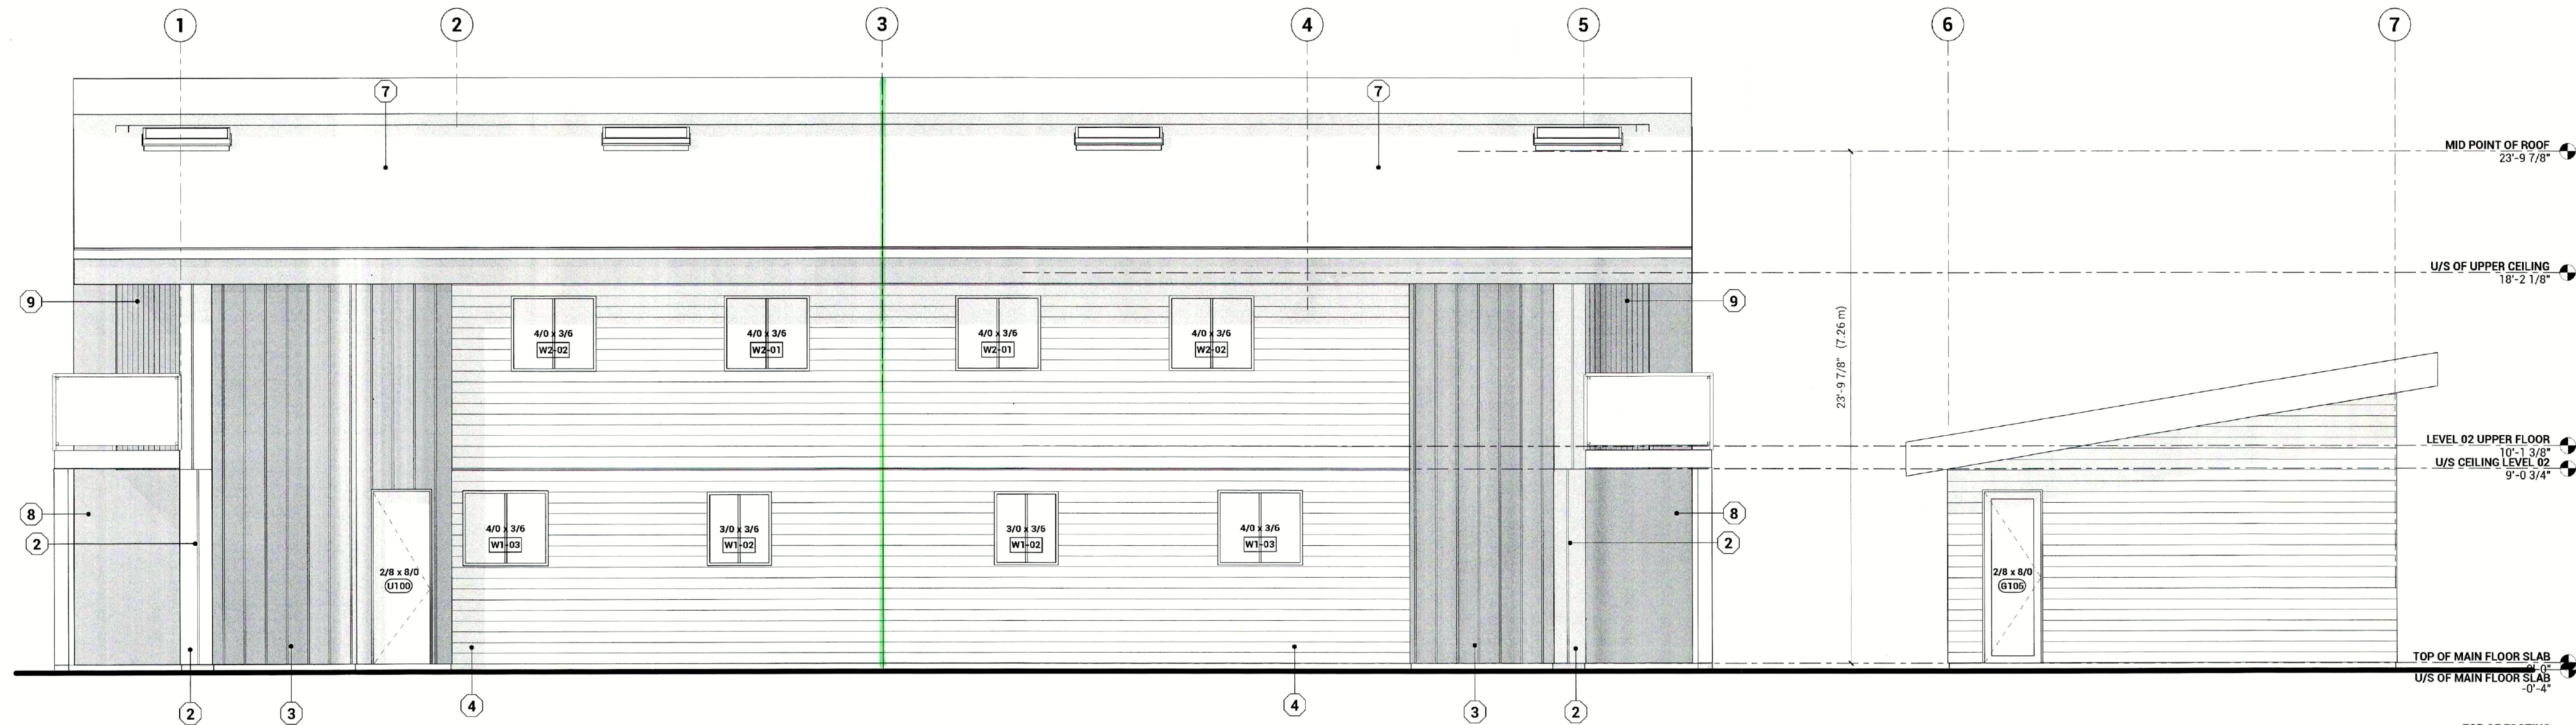

2 WEST BUILDING ELEVATION
A3.02 1/4" = 1'-0"


EXTERIOR FINISH LEGEND

- 1 SOFFIT - ALUMINUM, VENTED
- 2 BOARD & BATTEN SIDING
- 3 BOARD & BATTEN SIDING, PAINTED CHARCOAL
- 4 HARDIE LAP SIDING, PAINTED
- 5 METAL FLASHING CAP
- 6 ALUMINUM GUTTER & DOWNPIPES
- 7 ASPHALT SHINGLE ROOFING
- 8 FASCIA - HARDIE PANEL, SMOOTH
- 9 CORROGATED METAL SIDING


GUARDS NOTE:
GUARDS REQUIRED FOR FALL PROTECTION
ALONG HEIGHTS >0.6M. WHERE GUARDRAIL
COMPONENTS CONSIST OF GLASS PANELS,
A BC REGISTERED STRUCTURAL ENGINEER
TO DESIGN AND PROVIDE SEALED DRAWINGS
FOR BUILDING INSPECTOR ON SITE PRIOR
TO OCCUPANCY.

ALL E.R.F.
OR
SEE FILE CORP.


FLASHINGS with end dams required at all exterior unprotected
openings.
FLASHINGS required at all horizontal projections.
Minimum 6" clearance from grade to wood framing.
Minimum 8" clearance from grade to moisture-susceptible
cladding or trim.
Minimum 2" clearance from roofing, decking & paving to moisture
susceptible cladding, trim or wood framing.

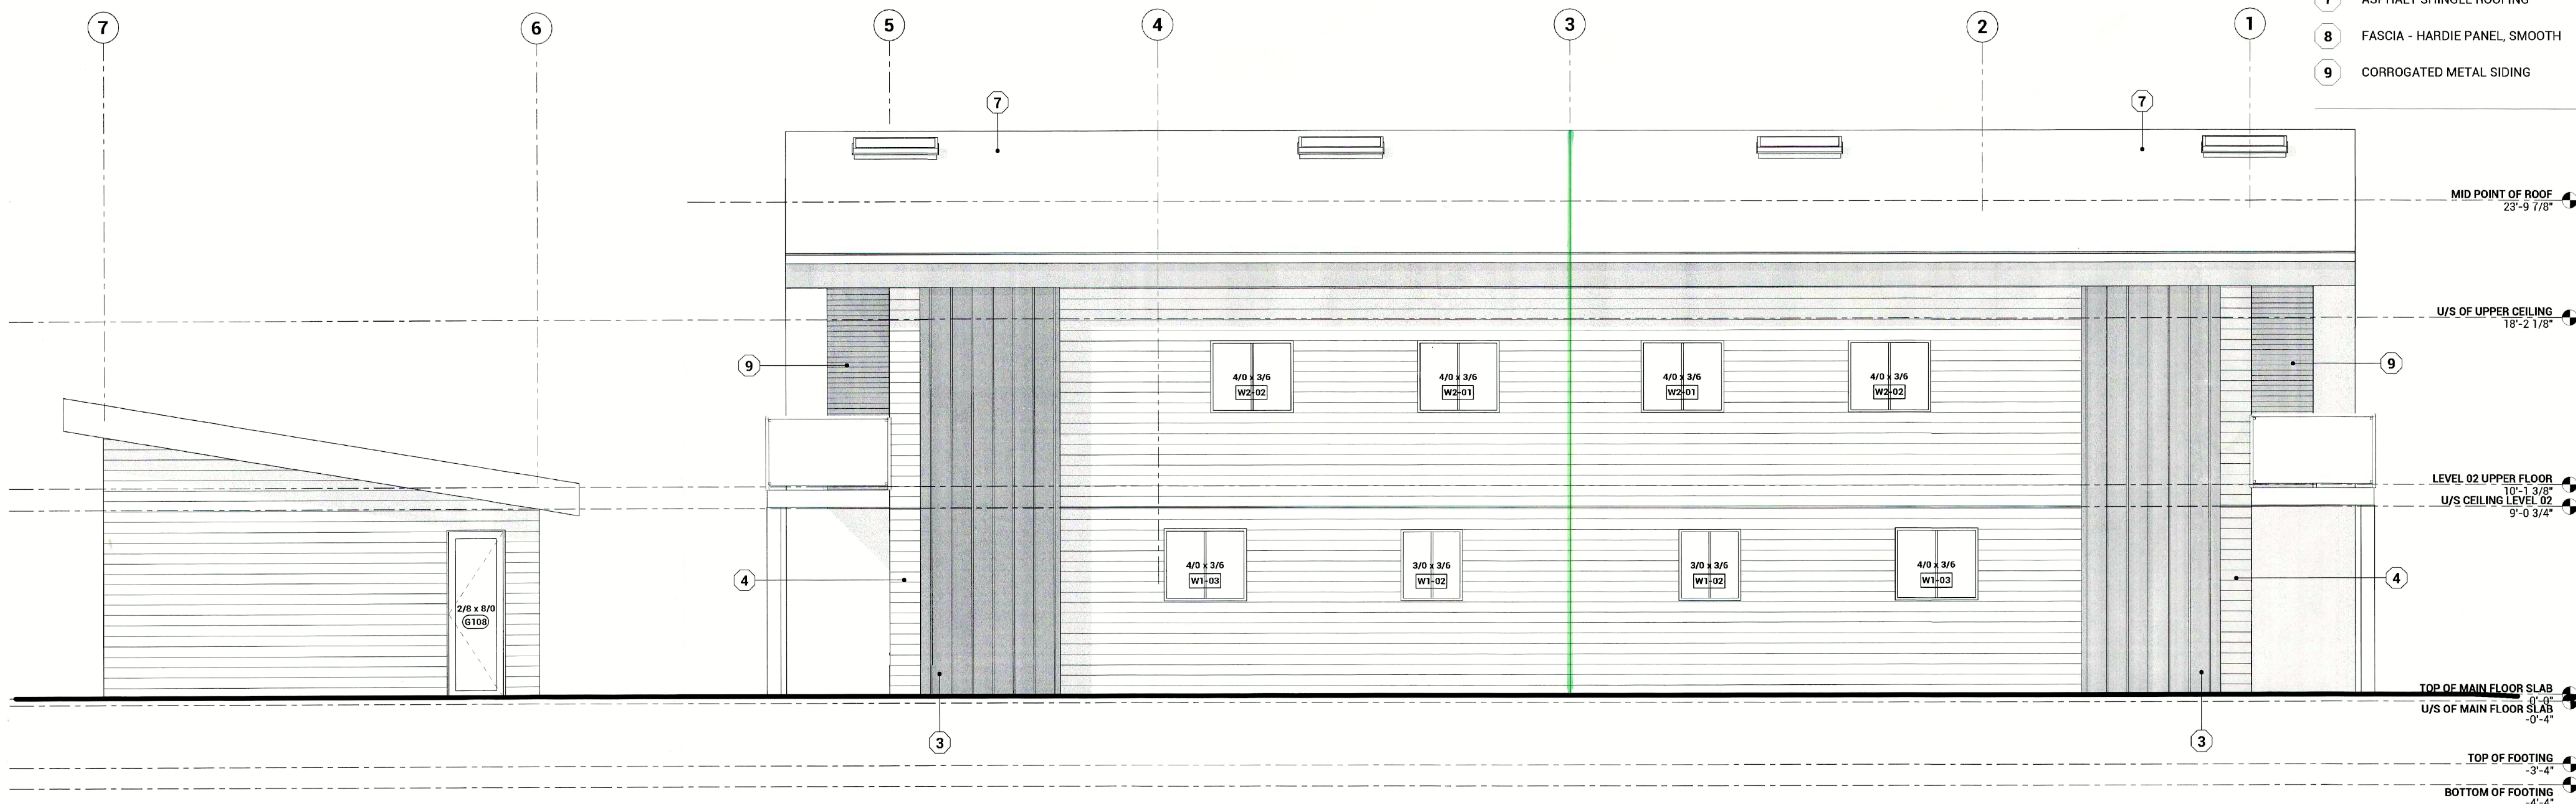

1 EAST BUILDING ELEVATION
A3.02 1/4" = 1'-0"

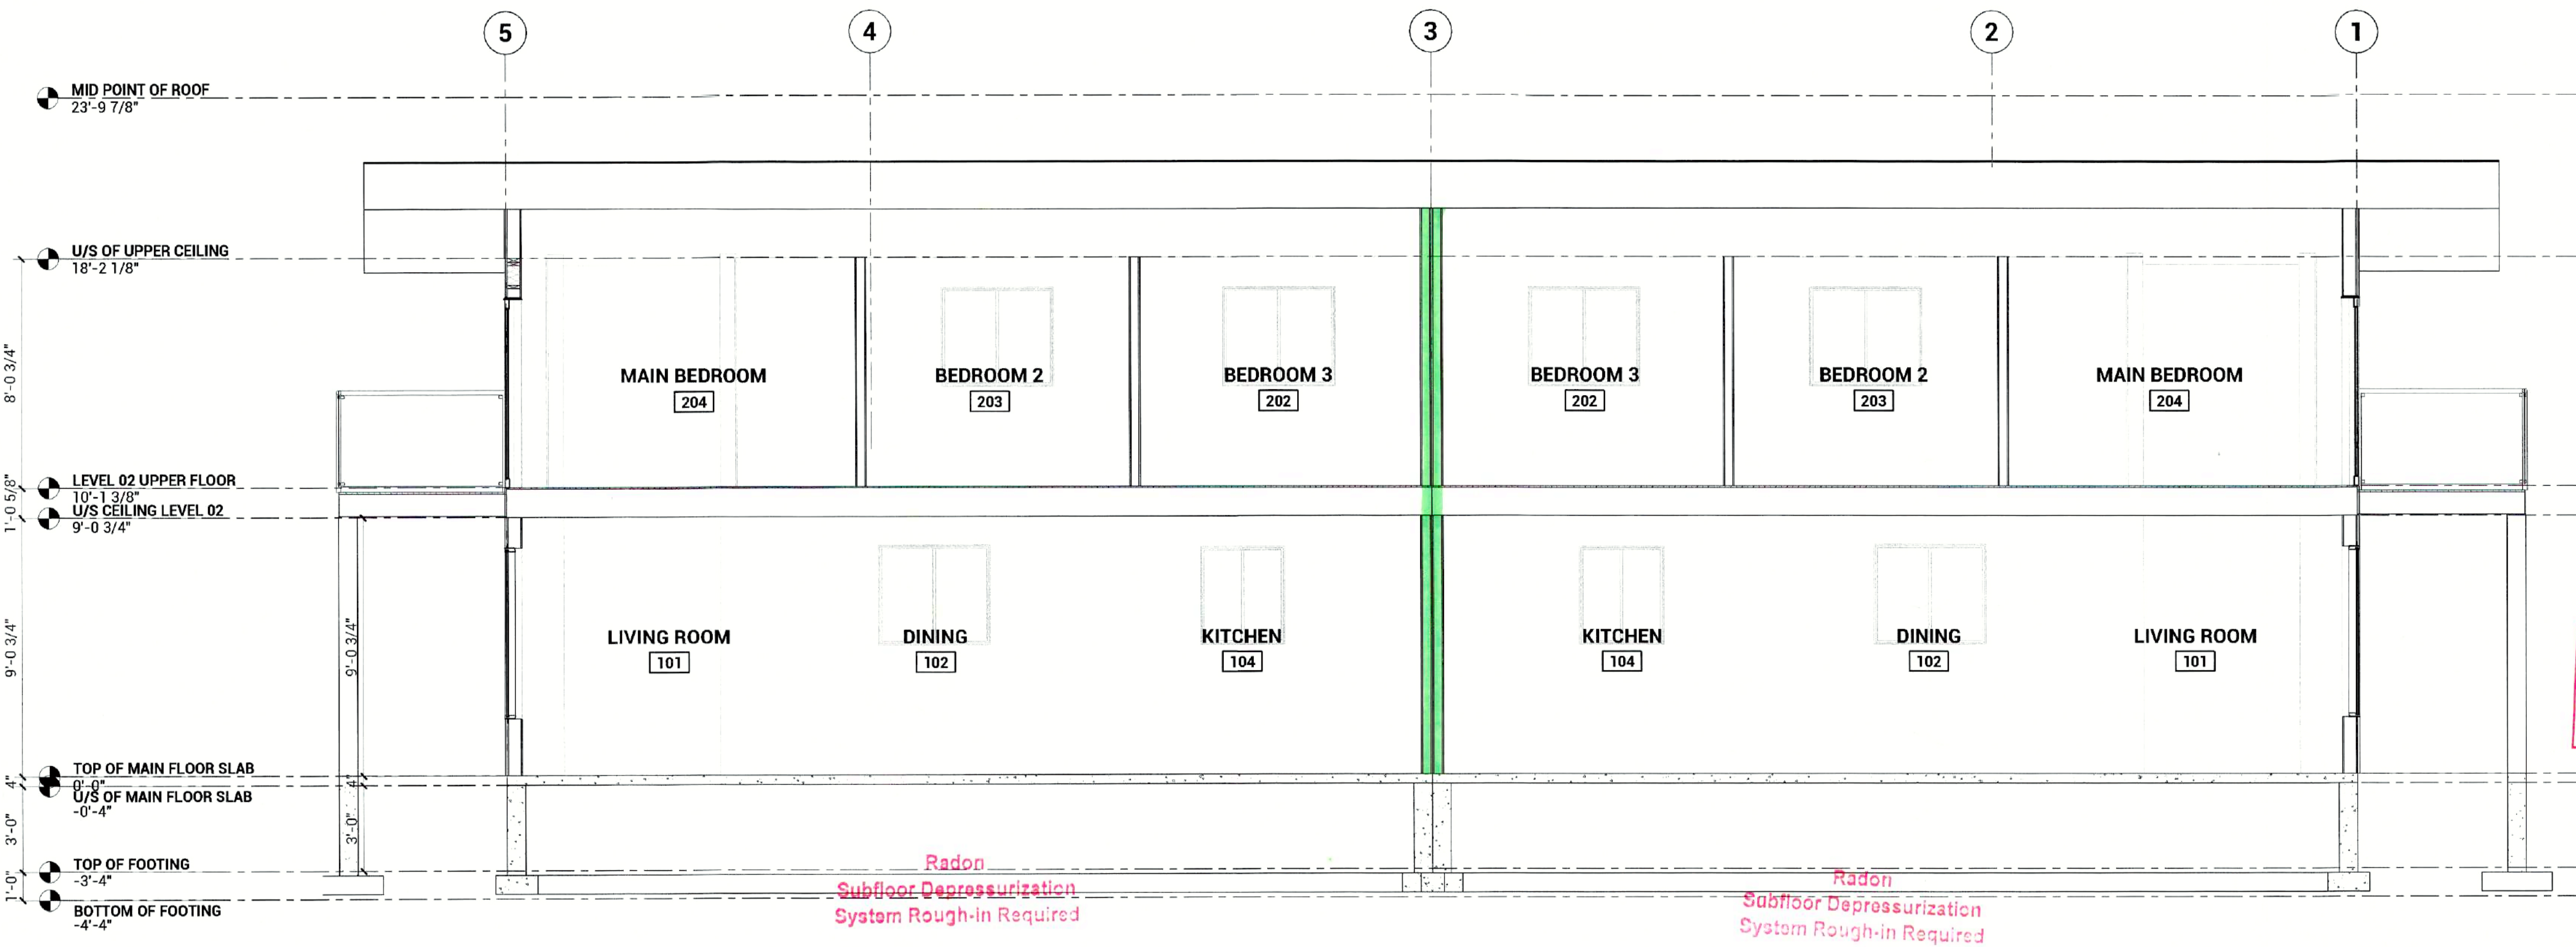

CC SECTION CC
A4.01 1/4" = 1'-0"

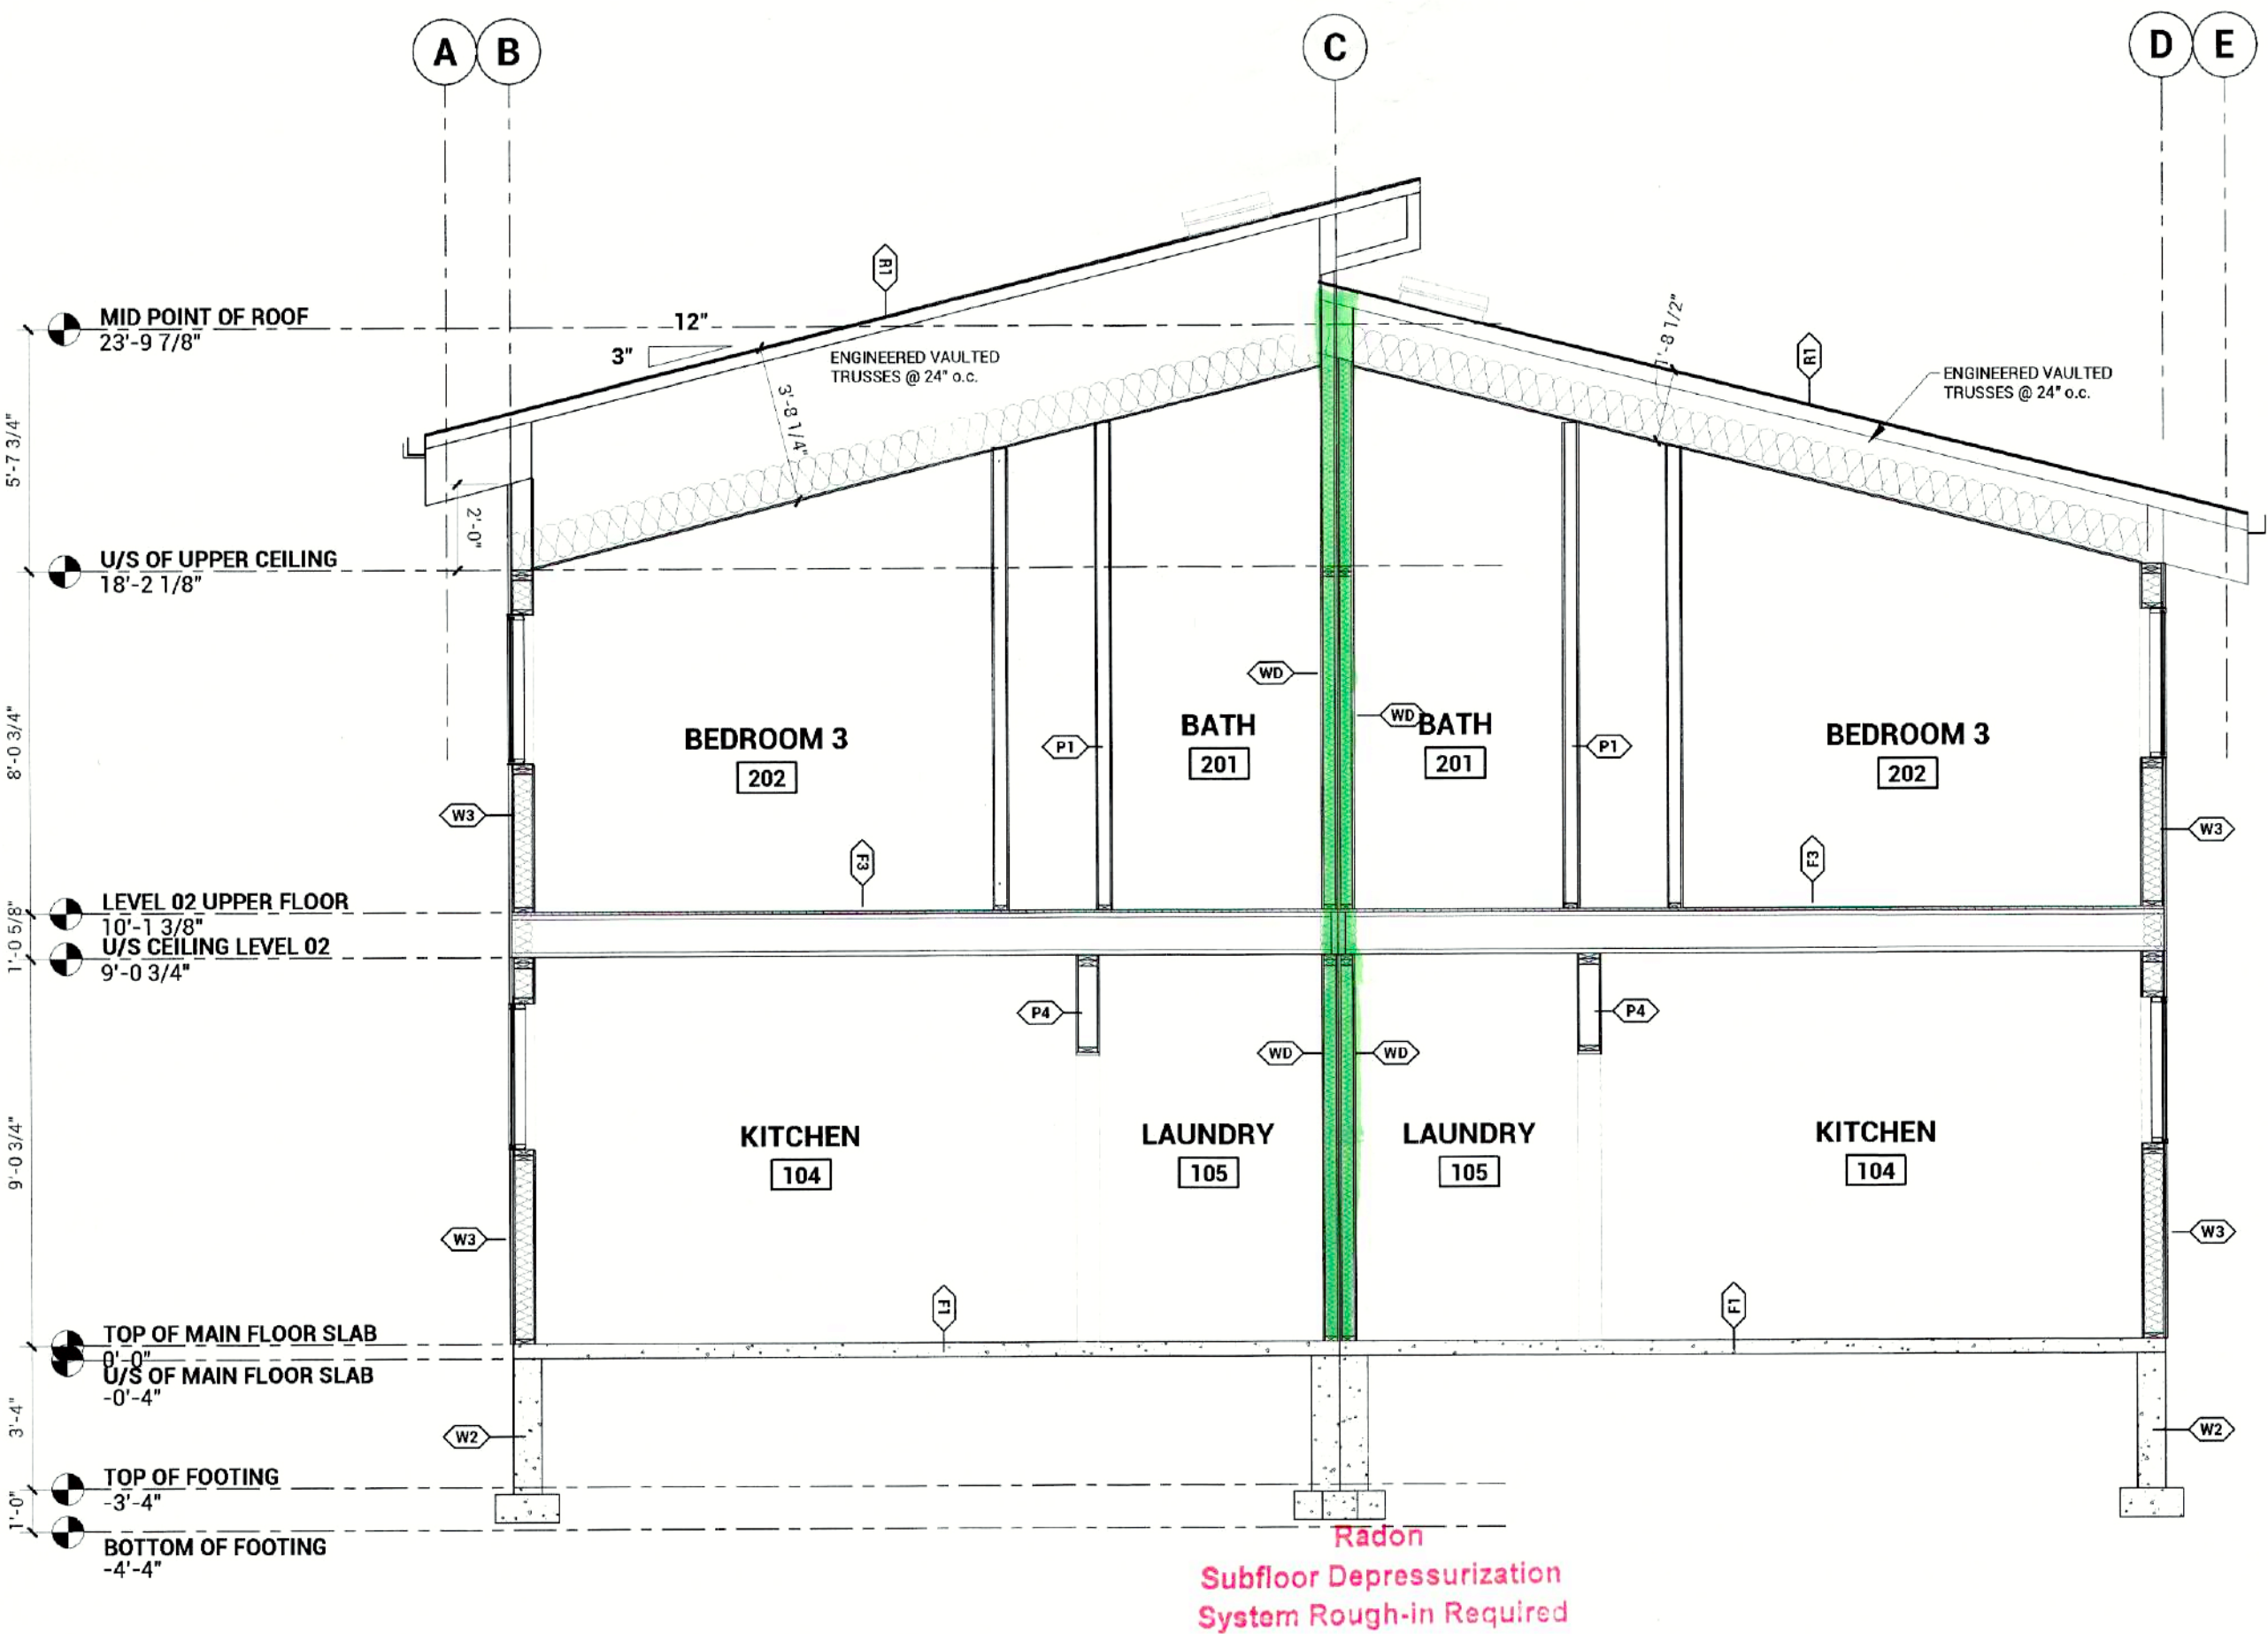


EE SECTION EE
A4.01 1/4" = 1'-0"

ENERGY REPORT NOTE:
SEE ATTACHED PRE-CONSTRUCTION ENERGY REPORT FOR ASSEMBLY DETAILS ON EXTERIOR WALLS & FLOOR HEADERS, ROOF/CEILINGS, FOUNDATION WALLS HEADERS & SLABS, AND FLOORS OVER UNHEATED SPACE.

LEGEND WALL SECTION

- WD - PARTITION WALL**
- 01 - MANUFACTURED TRUSS
 - 02 - 5/8" 1 HOUR FIRE RATED DRYWALL
 - 03 - R-28 SPRAY FOAM INSULATION
 - 04 - 3/8" OSB SHEATHING
 - 05 - 2X4 WALL
 - 06 - STANDARD 1/2" GYPSUM BOARD
 - 07 - 6mm VAPOUR BARRIER
 - 08 - 1" AIR GAP
 - 09 - 2X4 STUD, 16" O.C. BATT INSULATION
 - 10 - 5/8" 1 HOUR TYPE X GYPSUM BOARD
 - 11 - 3/8" OSB SHEETING
 - 12 - ANCHOR BOLTS
 - 13 - FOUNDATION WALL
 - 14 - 1 1/2" RIGID INSULATION
 - 15 - FOUNDATION FOOTINGS
 - 16 - CONCRETE SLAB
 - 17 - MIN. 4" SAND AND GRAVEL BED
 - 18 - RIGID BOARD INSULATION MECHANICALLY FASTENED TO FRAMING
 - 19 - 2 - 1/4" BEADS OF ACOUSTIC SEALANT UNDER THE BOTTOM PLATES
 - 20 - INSULATION COMPRESSED TO 1"

1 WD - DEMISING WALL
A4.01 NTS

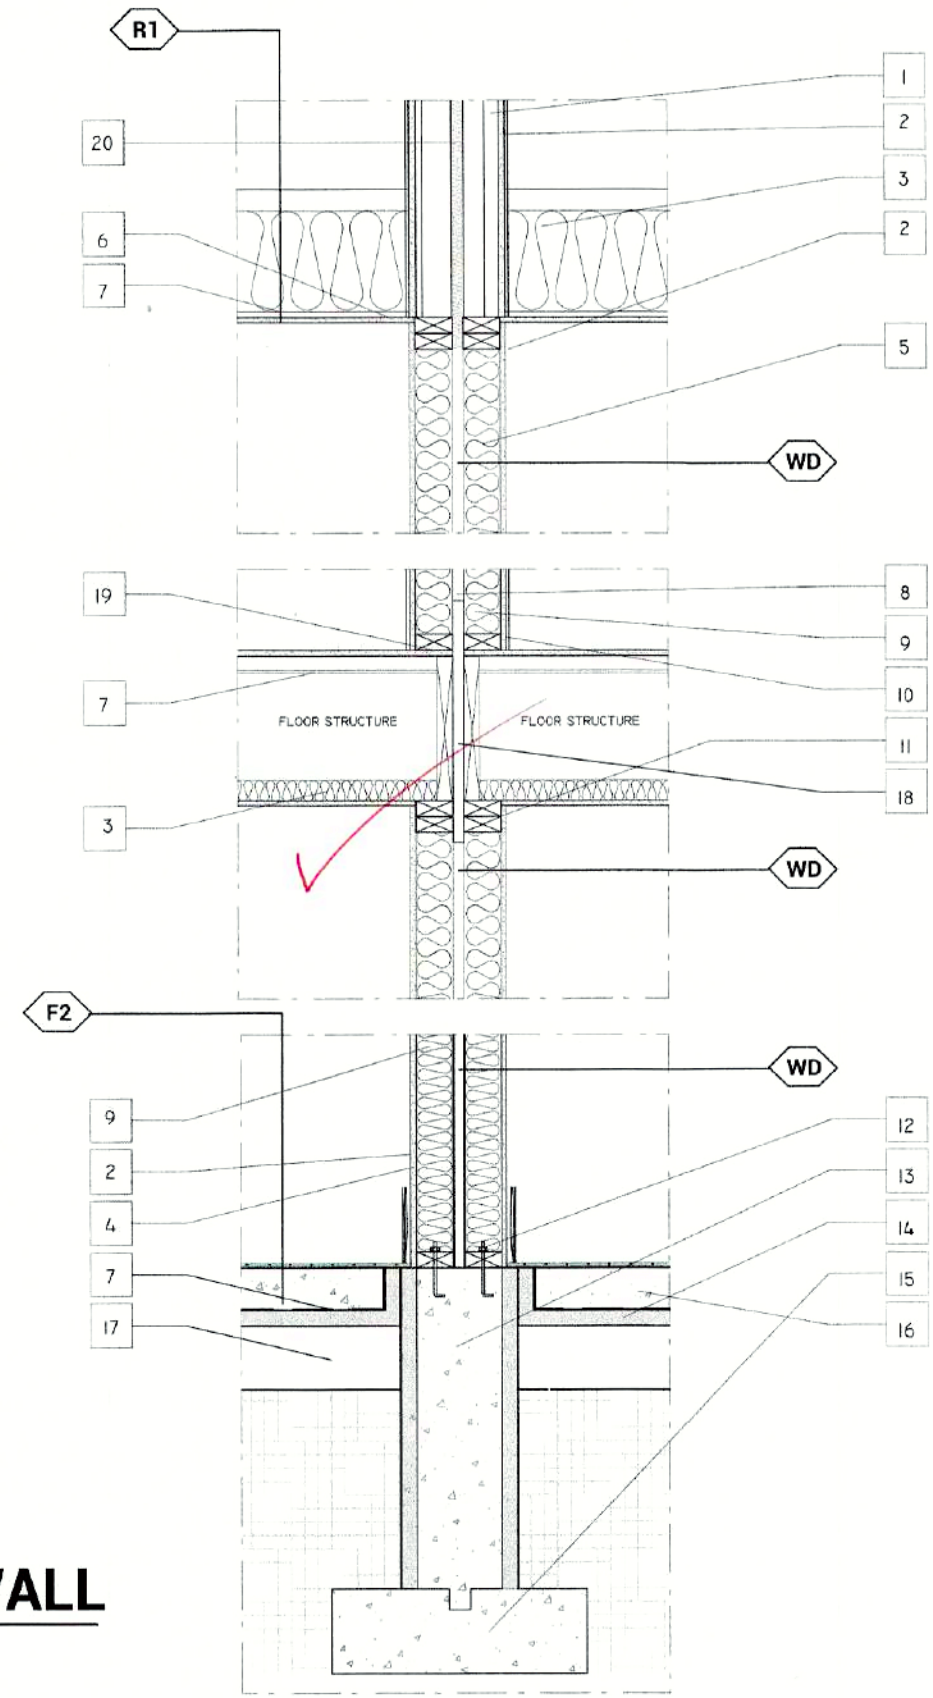

WALL CONSTRUCTION TYPES:

		R.S.I. (BCBC 9.36)
W1	8" CONCRETE, C/W STEEL REINFORCING 2 COATS OF DAMPROOFING (1/2" AIR SPACE, 2x6 STUDS @ 24" O.C. R-24 BATT INSULATION 6mil POLY VAPOUR BARRIER 1/2" GYPSUM WALL BOARD, PAINTED TO INTERIOR WALLS WHERE REQUIRED)	0.08 (CONC.) 0.00 0.00 2.80 0.00 0.08 0.12 (AIR FILM) 3.08 (2.98 min)
W2	8" CONCRETE, C/W STEEL REINFORCING 2 COATS OF DAMPROOFING, IF REQ'D 8"x16" CONCRETE STRIP FOOTING	
W3	HARDIE LAP SIDING 1/2" PLYWOOD SHEATHING 2x6 SPF STUDS @ 24" O.C. SPRAY FOAM INSULATION 3.5" 1/2" GYPSUM WALL BOARD MIN. DRYWALL FINISH LEVEL 4	0.03 (AIR FILM) 0.01 (HARDIE) 0.11 0.00 2.80 0.00 0.08 0.12 (AIR FILM) 3.15 (3.08 min)
W4	BOARD & BATTEN SIDING 1/2" PLYWOOD SHEATHING 2x6 SPF STUDS @ 24" O.C. R24 BATT INSULATION 1/2" GYPSUM WALL BOARD MIN. DRYWALL FINISH LEVEL 4	0.03 (AIR FILM) 0.01 (B&B) 0.11 0.00 2.80 0.08 0.12 (AIR FILM) 3.15 (3.08 min)
W5	CORROGATED METAL SIDING 1/2" PLYWOOD SHEATHING 2x6 SPF STUDS @ 24" O.C. R24 BATT INSULATION 1/2" GYPSUM WALL BOARD MIN. DRYWALL FINISH LEVEL 4	0.03 (AIR FILM) 0.01 (METAL) 0.11 0.00 2.80 0.08 0.12 (AIR FILM) 3.15 (3.08 min)
WD	5/8" 1hr. RATED GYPSUM BOARD 2x4 STUDS @ 16" o.c. BATT INSULATION 1" AIR SPACE 2x4 STUDS @ 16" o.c. BATT INSULATION 5/8" 1hr. RATED GYPSUM BOARD (MIN. DRYWALL FINISH LEVEL 4)	0.03 (AIR FILM) 0.01 (METAL) 0.11 0.00 2.80 0.08 0.12 (AIR FILM) 3.15 (3.08 min)

PARTITION WALL TYPES:

P1	1/2" GYPSUM BOARD, PAINTED 2x4 or 2x6 STUDS @ 16" O.C. 1/2" GYPSUM BOARD, PAINTED	
P2	1/2" GYPSUM BOARD, PAINTED 2x4 or 2x6 STUDS @ 16" O.C. BATT SOUND INSULATION 1/2" GYPSUM BOARD, PAINTED	SOUND INSULATE
P3	1/2" GYPSUM BOARD, PAINTED 2x4 or 2x6 STUDS @ 16" O.C. BEARING WALL, BLOCKING REQ'D 1/2" GYPSUM BOARD, PAINTED	BEARING WALL

FLOOR CONSTRUCTION TYPES:

		R.S.I. (BCBC 9.36)
F1	4" - 5" CONCRETE SLAB (32MPa) C/W 10m REBAR @24" o.c. 6 MIL POLY V.B. / RADON BARRIER COMPACTED SAND & GRAVEL BASE SLOPE SLAB TOWARD O.H. DOORS	
F2	OWNER APPROVED FINISH 4" CONCRETE SLAB C/W 10m REBAR @24" o.c. 6 MIL POLY V.B. / RADON BARRIER COMPACTED SAND & GRAVEL BASE	
F3	OWNER SPECIFIED FINISH FLOORING 3/4" PLYWOOD (SCREWED & GLUED) 11 7/8" ENGINEERED I-JOISTS 6 MIL POLY V.B. 1/2" GYPSUM CEILING BOARD, PTD	

ROOF CONSTRUCTION TYPES:

		R.S.I. (BCBC 9.36)
R1	ASPHALT SHINGLES 1/2" T&G PLYWOOD SHEATHING ENG'D TRUSSES @ 24" O.C. R-50 BATT INSULATION 6 MIL POLY V.P. 1/2" GYPSUM CEILING BOARD, PAINTED SMOOTH FINISH	0.03 (AIR FILM) 0.00 0.00 8.56 (EFFECTIVE) 0.00 0.08 0.11 (AIR FILM) 8.78 (8.67 min)

HRV INSTALLED

Table A-9.10.3.1.A
Fire and Sound Resistance of Walls

Type of Wall	Wall Number	Description	Fire-Resistance Rating ⁽¹⁾		Typical Sound Transmission Class ⁽¹⁾⁽²⁾⁽³⁾
			Loadbearing	Non-Loadbearing	
• Wood Studs • Two Rows on Separate Plates	W13	• two rows 38 mm x 89 mm studs, each spaced 400 mm or 600 mm o.c. on separate 38 mm x 89 mm plates set 25 mm apart • with or without absorptive material • 1 layer of gypsum board on each side			
• Loadbearing or Non-Loadbearing	W13a	W13 with • 89 mm thick absorptive material on each side ⁽⁴⁾⁽⁵⁾ • 15.9 mm Type X gypsum board ⁽⁵⁾	1 h	1 h	57

WEST COAST DESIGN
250.215.1968
gregstapler@gmail.com

ISSUED / REVISIONS
NO. DATE DESCRIPTION
1 MAY 10, 2021 ISSUED FOR REVIEW
2 SEPT 15, 2023 REVISED FOR BP

NOTES

BUILDER

CLIENT
SNG DEVELOPMENTS

PROJECT
837 STOCKWELL AVE


SHEET
BUILDING SECTIONS 1

DESIGN BY GS
DRAWN BY GS
CHECKED BY GS
PROJECT 21-008
As indicated

A4.01
SHEET NO.



AA SECTION AA
A4.02 1/4" = 1'-0"

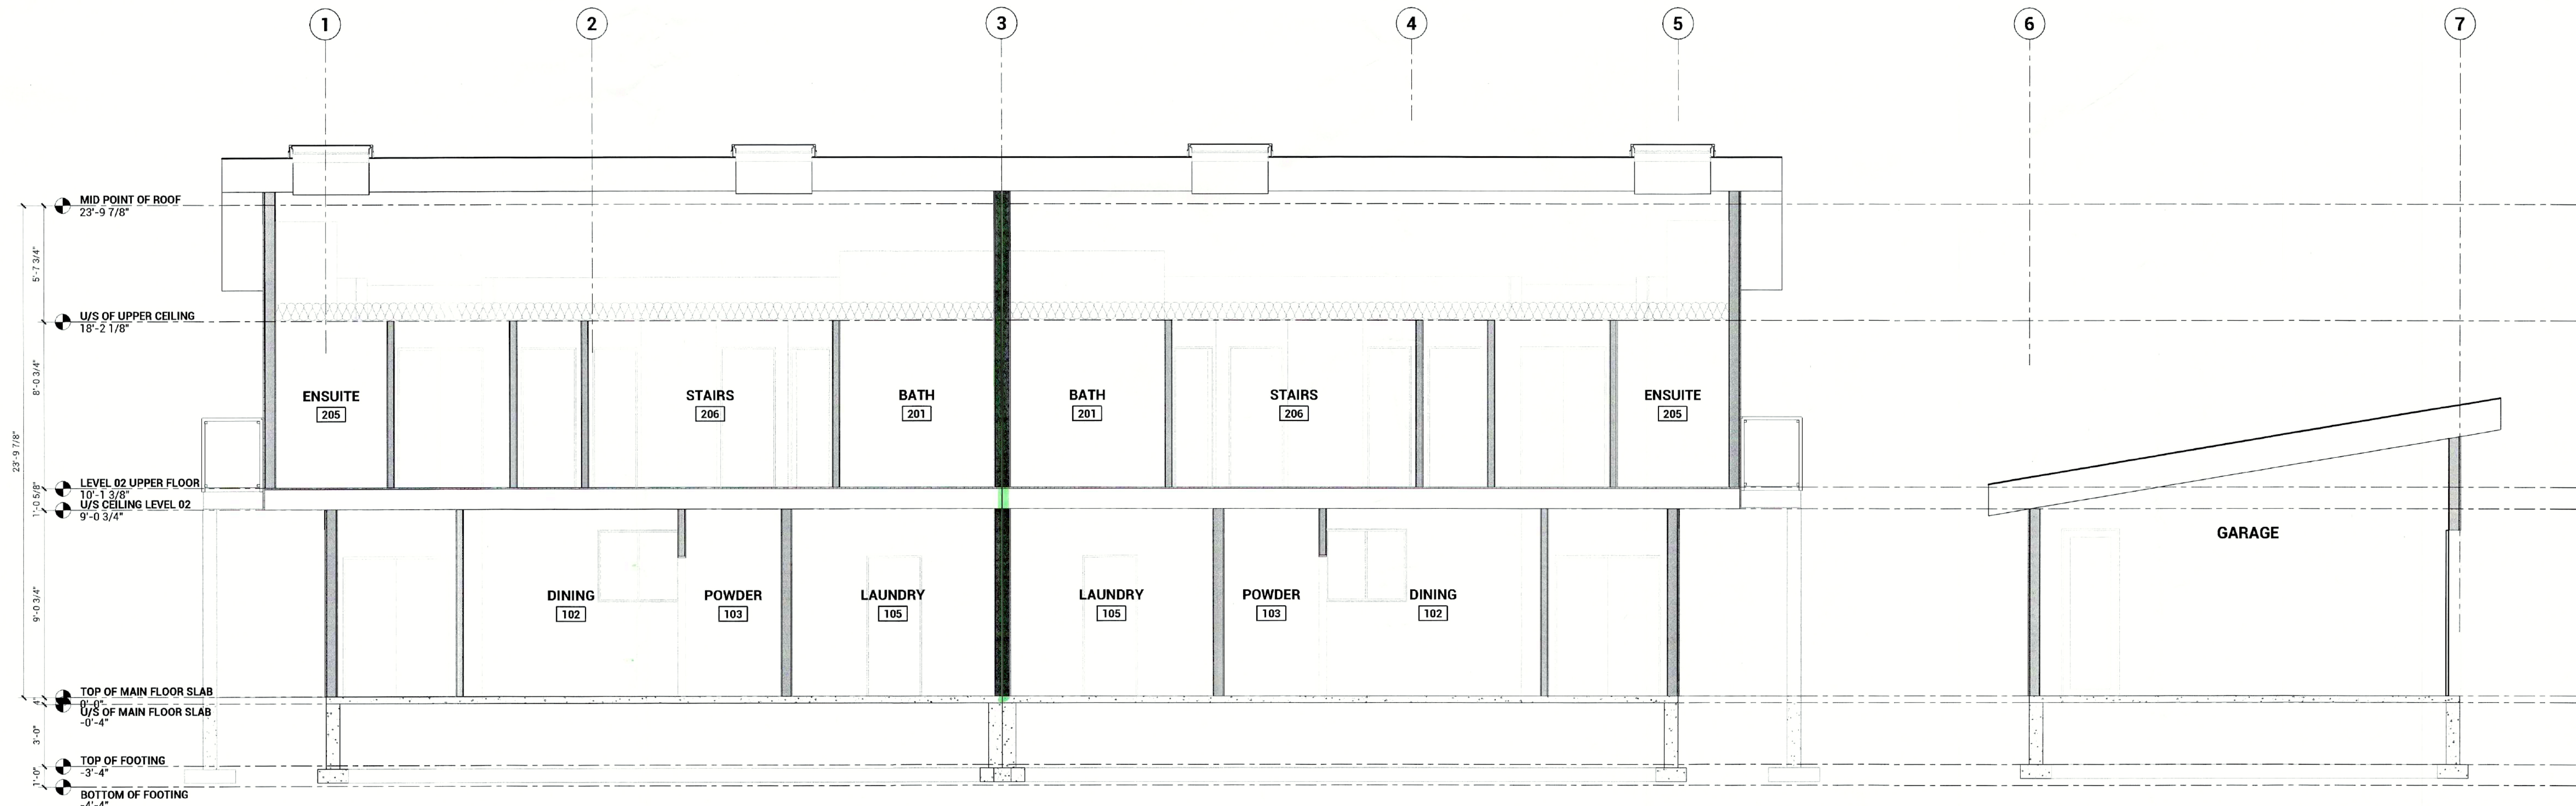

BB SECTION BB
A4.02 1/4" = 1'-0"

ISSUED / REVISIONS		
NO.	DATE	DESCRIPTION
1	MAY 10, 2021	ISSUED FOR REVIEW
2	SEPT 15, 2023	REVISED FOR BP

NOTES

BUILDER

CLIENT

SNG DEVELOPMENTS

PROJECT


837 STOCKWELL AVE

SHEET


BUILDING SECTIONS 2

DESIGN BY	GS
DRAWN BY	GS
CHECKED BY	GS
PROJECT	21-008


A4.02
1/4" = 1'-0"
SHEET NO.

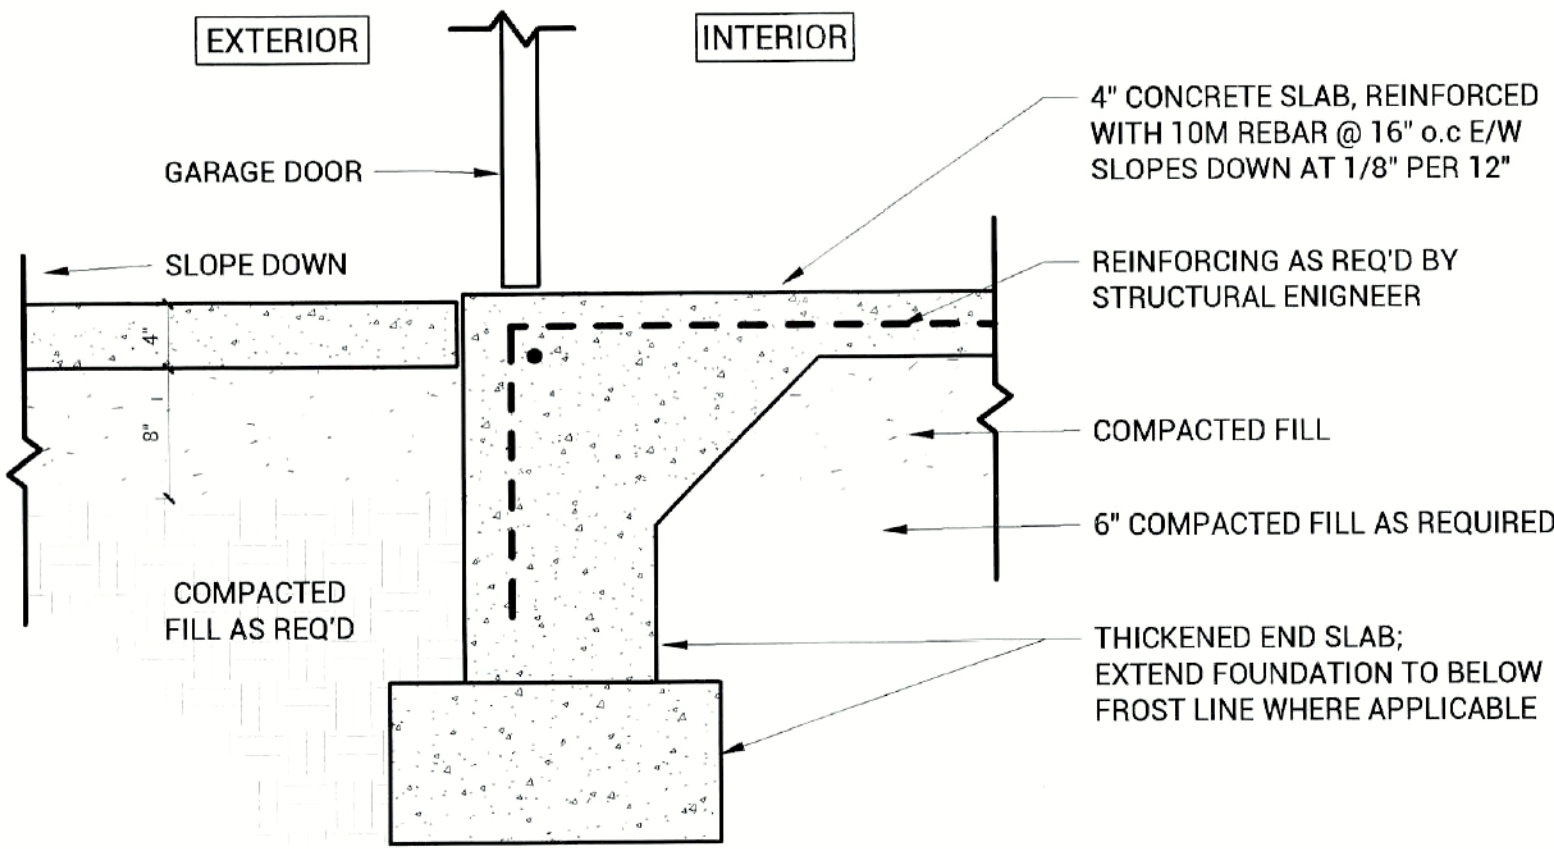


1 GARAGE OPENING - THICKENED SLAB
A5.01 1" = 1'-0"

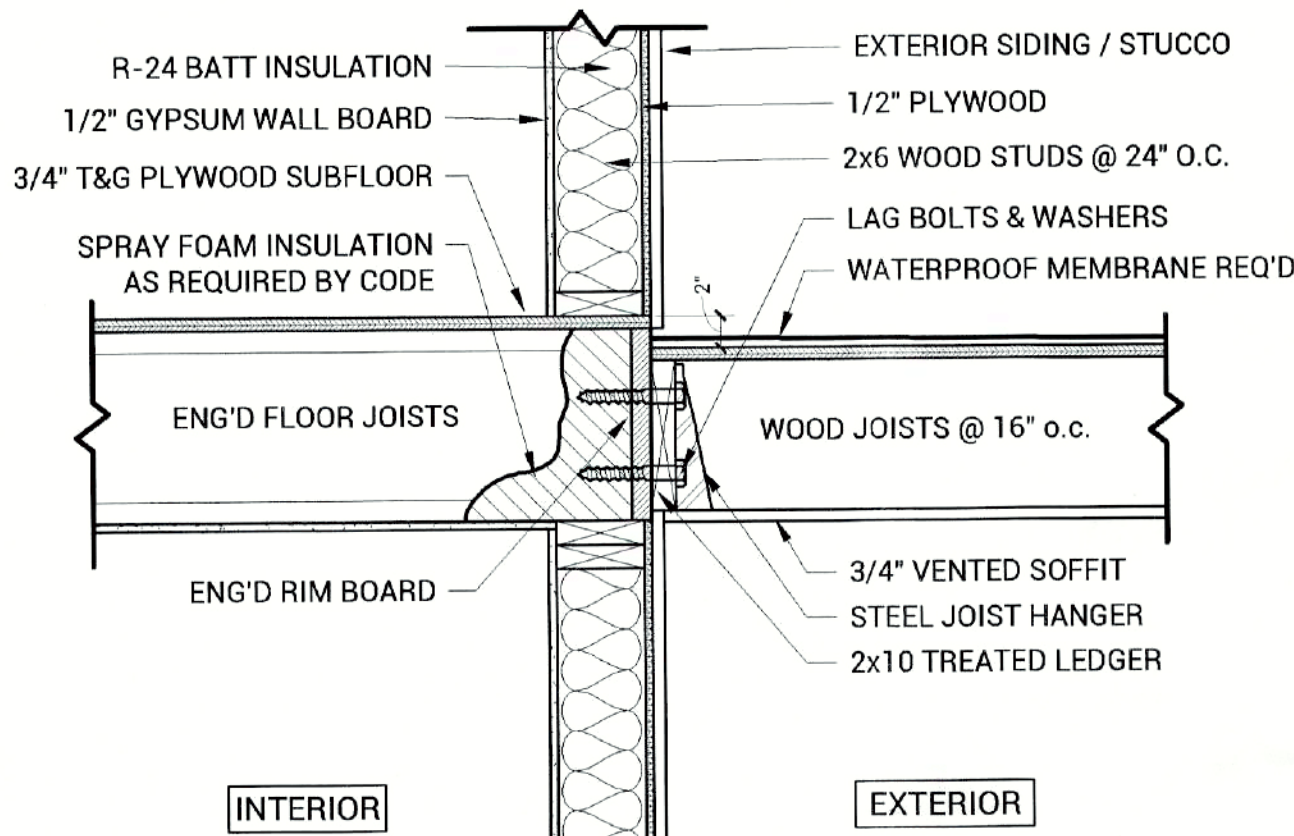


2 DECK - WALL DETAIL
A5.01 1" = 1'-0"

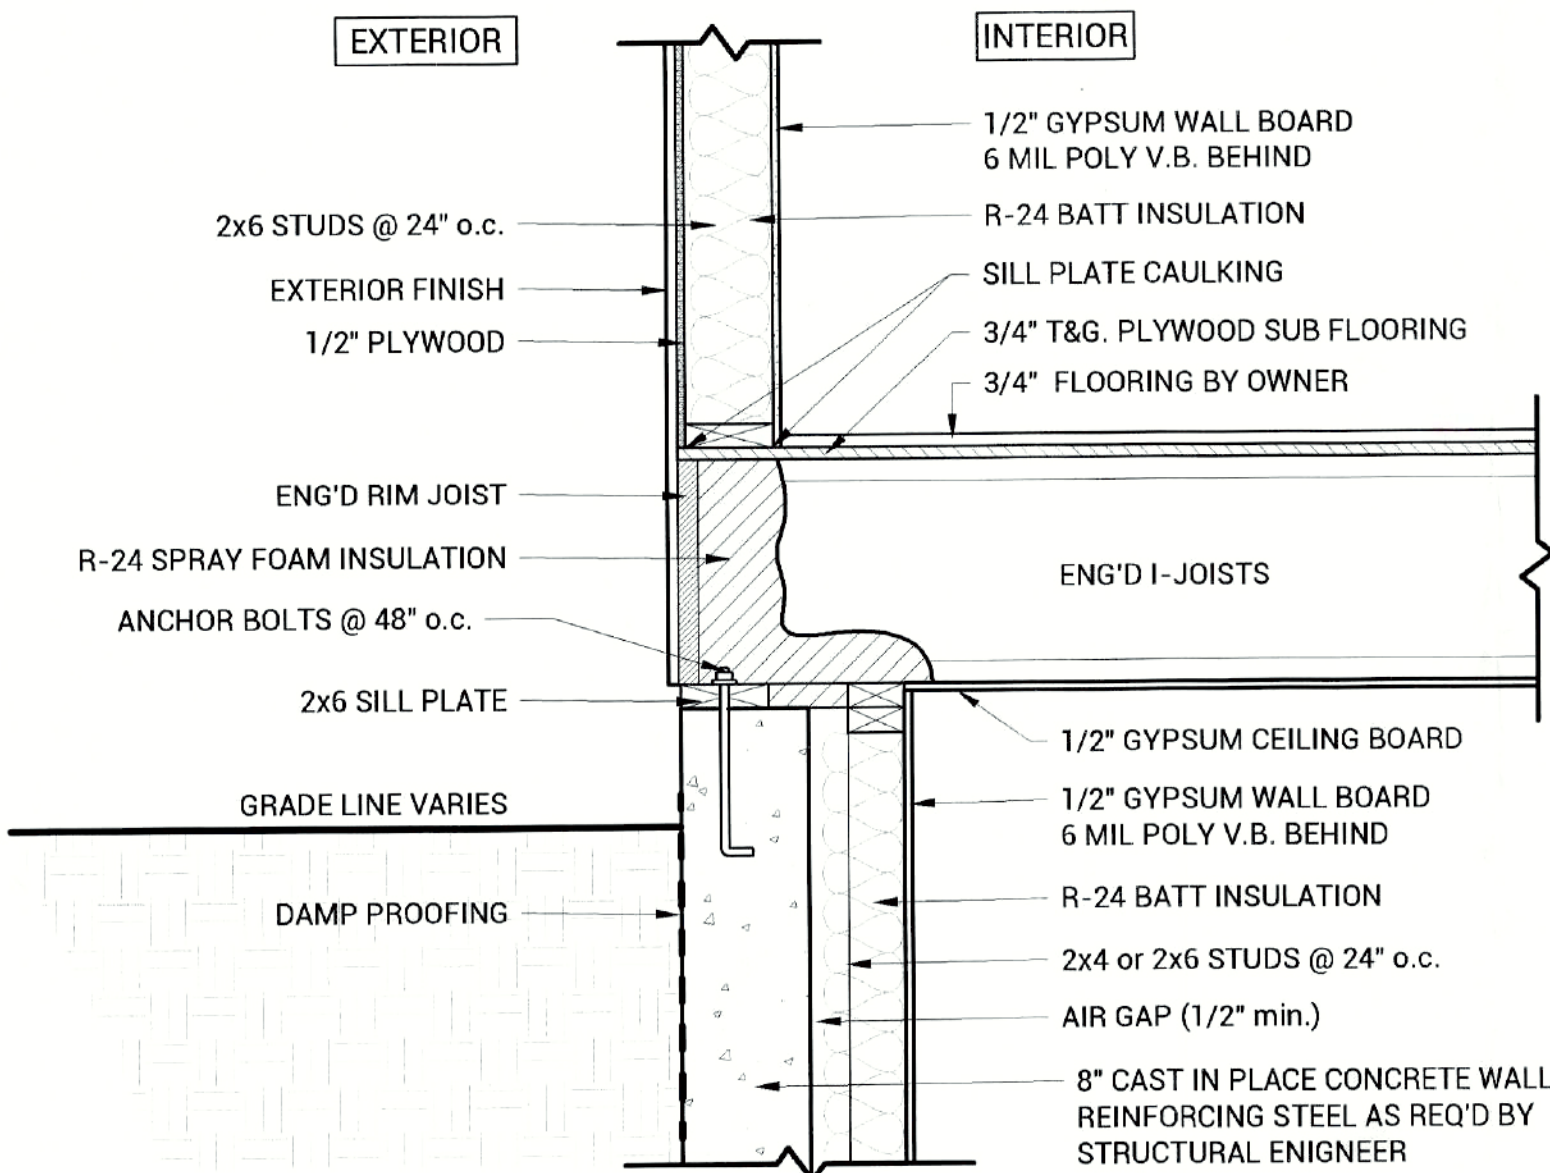


3 JOIST END DETAIL
A5.01 1" = 1'-0"

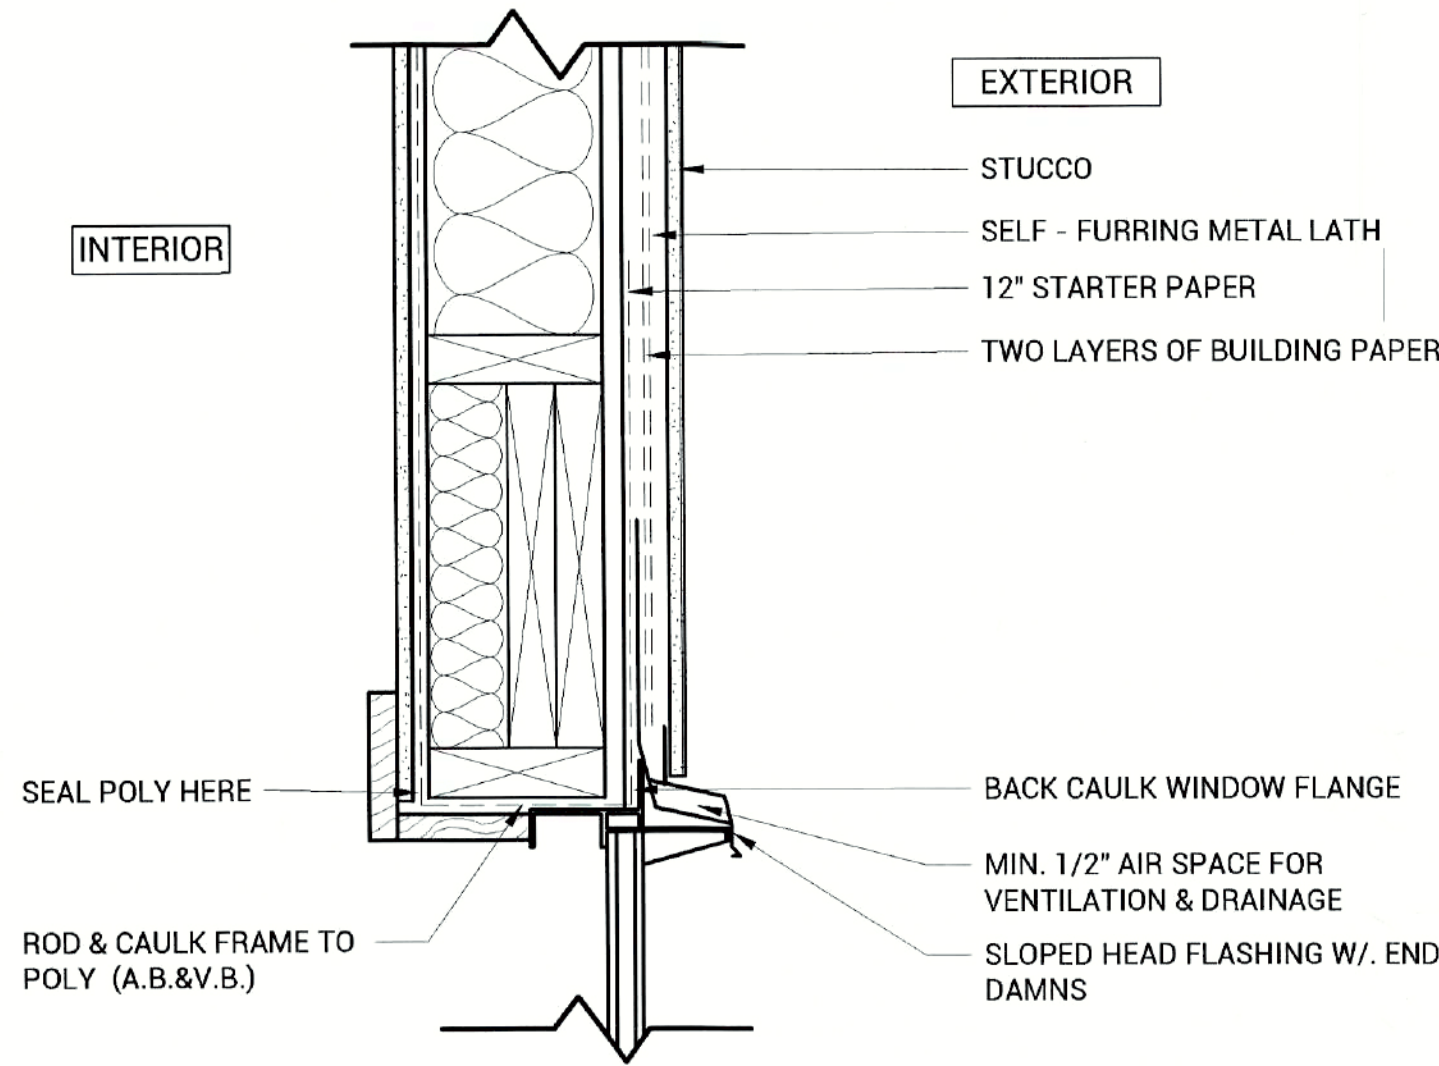

7 WINDOW HEAD DETAIL
A5.01 1 : 6

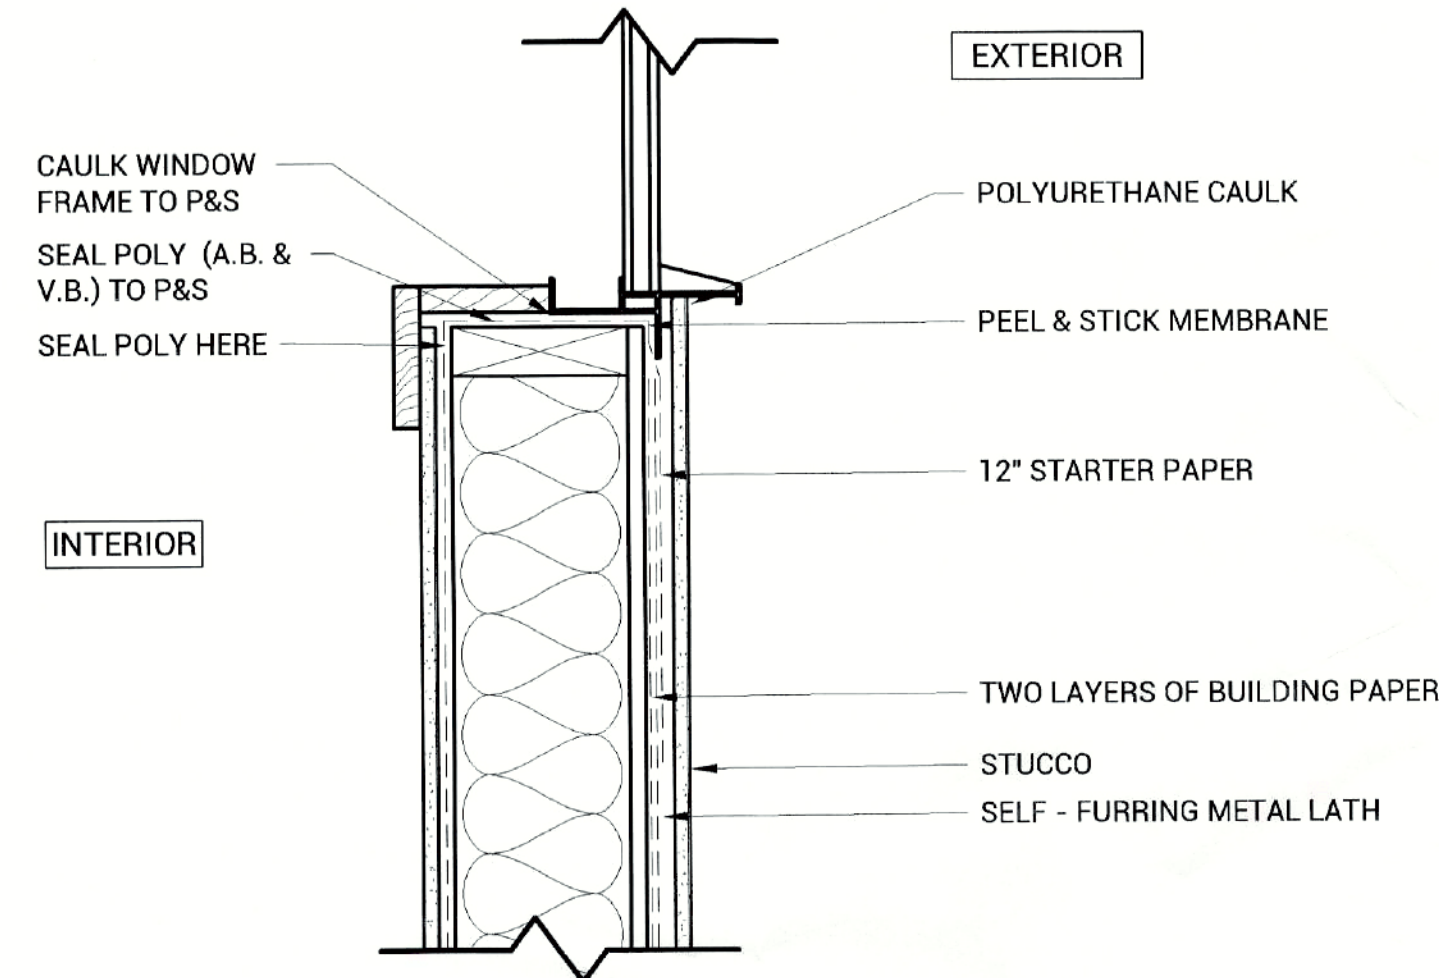

8 WINDOW SILL DETAIL
A5.01 1 : 6

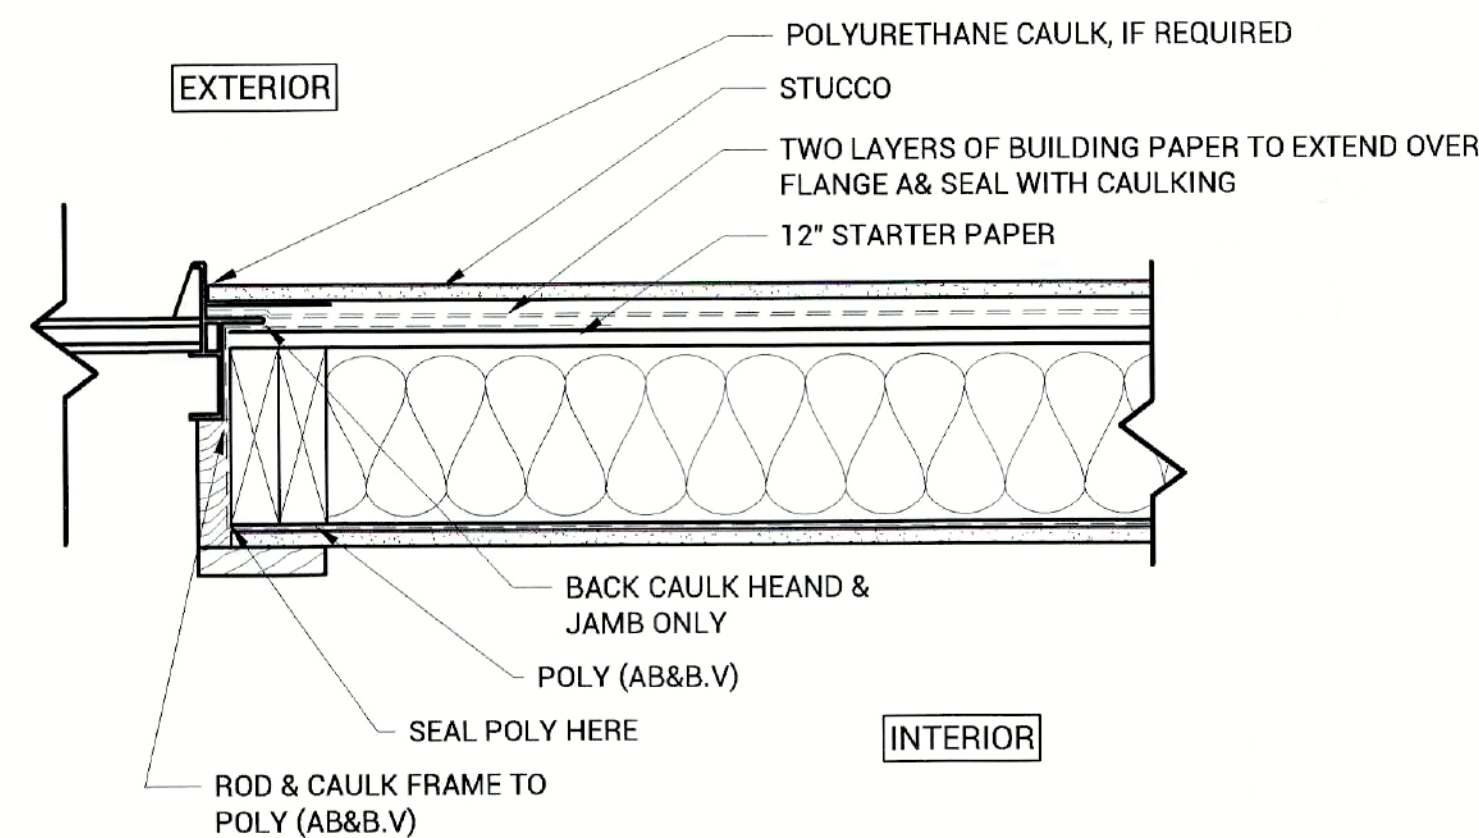

9 WINDOW JAMB DETAIL
A5.01 1 : 6

SCHEDULE - DOOR						
UNIT	DOOR NO.	DOOR TYPE	WIDTH	HEIGHT	COUNT	COMMENTS
	G101	9/0x8/0 OVERHEAD	9'-0"	8'-0"	1	
	G102	9/0x8/0 OVERHEAD	9'-0"	8'-0"	1	
	G103	9/0x8/0 OVERHEAD	9'-0"	8'-0"	1	
	G104	9/0x8/0 OVERHEAD	9'-0"	8'-0"	1	
	G105	2/8 x 8/0	2'-8"	8'-0"	1	
	G106	2/8 x 8/0	2'-8"	8'-0"	1	
	G107	2/8 x 8/0	2'-8"	8'-0"	1	
	G108	2/8 x 8/0	2'-8"	8'-0"	1	
	U100	2/8 x 8/0	2'-8"	8'-0"	1	

9						Windows Doors Skylights Require NAFS Label
Unit 1	101	2 - 2/6x6/8	2'-6"	6'-8"	1	
Unit 1	102	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 1	103	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 1	104	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 1	201a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 1	202a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 1	203a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 1	203b	2/0 x 6/8	2'-0"	6'-8"	1	
Unit 1	204a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 1	204b	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 1	204c	2 - 2/6x6/8	2'-6"	6'-8"	1	
Unit 1	205a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 1	206a	2/0 x 6/8	2'-0"	6'-8"	1	
Unit 1	E101	2/8 x 8/0	2'-8"	8'-0"	1	
Unit 1	E110	2 - 2/0x6/8	2'-0"	6'-8"	1	
Unit 1	E200	6/0 x 6/8 SLIDER	5'-11"	6'-7 1/2"	1	

16						
Unit 2	101	2 - 2/6x6/8	2'-6"	6'-8"	1	
Unit 2	102	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 2	103	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 2	104	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 2	201a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 2	202a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 2	203a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 2	203b	2/0 x 6/8	2'-0"	6'-8"	1	
Unit 2	204a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 2	204b	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 2	204c	2 - 2/0x6/8	2'-0"	6'-8"	1	
Unit 2	205a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 2	206a	2/0 x 6/8	2'-0"	6'-8"	1	
Unit 2	E101	2/8 x 8/0	2'-8"	8'-0"	1	
Unit 2	E110	2 - 2/0x6/8	2'-0"	6'-8"	1	
Unit 2	E200	6/0 x 6/8 SLIDER	5'-11"	6'-7 1/2"	1	

SCHEDULE - DOOR						
UNIT	DOOR NO.	DOOR TYPE	WIDTH	HEIGHT	COUNT	COMMENTS
Unit 3	101	2 - 2/6x6/8	2'-6"	6'-8"	1	
Unit 3	102	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 3	103	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 3	104	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 3	201a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 3	202a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 3	203a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 3	203b	2/0 x 6/8	2'-0"	6'-8"	1	
Unit 3	204a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 3	204b	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 3	204c	2 - 2/6x6/8	2'-6"	6'-8"	1	
Unit 3	205a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 3	206a	2/0 x 6/8	2'-0"	6'-8"	1	
Unit 3	E101	2/8 x 8/0	2'-8"	8'-0"	1	
Unit 3	E110	2 - 2/0x6/8	2'-0"	6'-8"	1	
Unit 3	E200	6/0 x 6/8 SLIDER	5'-11"	6'-7 1/2"	1	

16						Windows Doors Skylights Require NAFS Label
Unit 4	101	2 - 2/6x6/8	2'-6"	6'-8"	1	
Unit 4	102	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 4	103	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 4	104	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 4	201a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 4	202a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 4	203a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 4	203b	2/0 x 6/8	2'-0"	6'-8"	1	
Unit 4	204a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 4	204b	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 4	204c	2 - 2/0x6/8	2'-0"	6'-8"	1	
Unit 4	205a	2/6 x 6/8	2'-6"	6'-8"	1	
Unit 4	206a	2/0 x 6/8	2'-0"	6'-8"	1	
Unit 4	E101	2/8 x 8/0	2'-8"	8'-0"	1	
Unit 4	E110	2 - 2/0x6/8	2'-0"	6'-8"	1	
Unit 4	E200	6/0 x 6/8 SLIDER	5'-11"	6'-7 1/2"	1	

TOTAL: 73

SCHEDULE - WINDOWS								
UNIT	MARK	TYPE	WIDTH	HEIGHT	HEAD HT.	COUNT	LEVEL	COMMENTS

Unit 1								
Unit 1	SKY01	2/0 x 4/0	2'-0"	4'-0"		1	U/S OF UPPER CEILING	
Unit 1	SKY02	2/0 x 4/0	2'-0"	4'-0"		1	U/S OF UPPER CEILING	
Unit 1	W1-01	8/0 x 6/0	8'-0"	6'-0"	8'-0"	1	TOP OF MAIN FLOOR	
Unit 1	W1-02	3/0 x 3/6	3'-0"	3'-5 1/4"	8'-0"	1	TOP OF MAIN FLOOR	
Unit 1	W1-03	4/0 x 3/6	4'-0"	3'-6"	8'-0 3/4"	1	TOP OF MAIN FLOOR	
Unit 1	W2-01	4/0 x 3/6	4'-0"	3'-6"	7'-0"	1	LEVEL 02 UPPER FLOOR	
Unit 1	W2-02	4/0 x 3/6	4'-0"	3'-6"	7'-0"	1	LEVEL 02 UPPER FLOOR	
Unit 1	W2-03	2/6 x 5/0	2'-6"	5'-0"	7'-8"	1	LEVEL 02 UPPER FLOOR	

8								
Unit 2								
Unit 2	SKY01	2/0 x 4/0	2'-0"	4'-0"		1	U/S OF UPPER CEILING	
Unit 2	SKY02	2/0 x 4/0	2'-0"	4'-0"		1	U/S OF UPPER CEILING	
Unit 2	W1-01	8/0 x 6/0	8'-0"	6'-0"	8'-0"	1	TOP OF MAIN FLOOR	
Unit 2	W1-02	3/0 x 3/6	3'-0"	3'-5 1/4"	8'-0"	1	TOP OF MAIN FLOOR	
Unit 2	W1-03	4/0 x 3/6	4'-0"	3'-6"	8'-0 3/4"	1	TOP OF MAIN FLOOR	
Unit 2	W2-01	4/0 x 3/6	4'-0"	3'-6"	7'-0"	1	LEVEL 02 UPPER FLOOR	
Unit 2	W2-02	4/0 x 3/6	4'-0"	3'-6"	7'-0"	1	LEVEL 02 UPPER FLOOR	
Unit 2	W2-03	2/6 x 7/0	2'-6"	7'-0"	9'-8"	1	LEVEL 02 UPPER FLOOR	

8								
Unit 3								
Unit 3	SKY01	2/0 x 4/0	2'-0"	4'-0"		1	U/S OF UPPER CEILING	
Unit 3	SKY02	2/0 x 4/0	2'-0"	4'-0"		1	U/S OF UPPER CEILING	
Unit 3	W1-01	8/0 x 6/0	8'-0"	6'-0"	8'-0"	1	TOP OF MAIN FLOOR	
Unit 3	W1-02	3/0 x 3/6	3'-0"	3'-5 1/4"	8'-0"	1	TOP OF MAIN FLOOR	
Unit 3	W1-03	4/0 x 3/6	4'-0"	3'-6"	8'-0 3/4"	1	TOP OF MAIN FLOOR	
Unit 3	W2-01	4/0 x 3/6	4'-0"	3'-6"	7'-0"	1	LEVEL 02 UPPER FLOOR	
Unit 3	W2-02	4/0 x 3/6	4'-0"	3'-6"	7'-0"	1	LEVEL 02 UPPER FLOOR	
Unit 3	W2-03	2/6 x 5/0	2'-6"	5'-0"	7'-8"	1	LEVEL 02 UPPER FLOOR	

8								
Unit 4								
Unit 4	SKY01	2/0 x 4/0	2'-0"	4'-0"		1	U/S OF UPPER CEILING	
Unit 4	SKY02	2/0 x 4/0	2'-0"	4'-0"		1	U/S OF UPPER CEILING	
Unit 4	W1-01	8/0 x 6/0	8'-0"	6'-0"	8'-0"	1	TOP OF MAIN FLOOR	
Unit 4	W1-02	3/0 x 3/6	3'-0"	3'-5 1/4"	8'-0"	1	TOP OF MAIN FLOOR	
Unit 4	W1-03	4/0 x 3/6	4'-0"	3'-6"	8'-0 3/4"	1	TOP OF MAIN FLOOR	
Unit 4	W2-01	4/0 x 3/6	4'-0"	3'-6"	7'-0"	1	LEVEL 02 UPPER FLOOR	
Unit 4	W2-02	4/0 x 3/6	4'-0"	3'-6"	7'-0"	1	LEVEL 02 UPPER FLOOR	
Unit 4	W2-03	2/6 x 7/0	2'-6"	7'-0"	9'-8"	1	LEVEL 02 UPPER FLOOR	

TOTAL: 32