



© Crown copyright and database rights 2025 Ordnance Survey AC000085122
Data updated: 14/06/25
Scale: 1:2500
Map Centre: 425947, 341650
Date: 01/07/25
Our Ref: 182349-2
Wastewater Plan A0
Produced by: d3p4

Public Foot Gully/Lateral Drain	Highway Drain	Manhole Point
Public Combined Gully/Lateral Drain	Overflow Pipe	Manhole Surface
Public Surface Water Gully/Lateral Drain	Disposal Pipe	Abandoned Pipe
Pressure Fuel	Combined Water Course	Chamber
Pressure Combined	Pumping Station	Abandoned 150mm sewer line shown in green
Pressure Surface Water	Filling	Private sewers are shown in magenta

charlotte.whitman@erzogo.com

Bratford

Do not scale off this map. The plan and any information supplied with it is intended as a general guide. It is not valid in the date of issue and no warranty as to its correctness is given or implied. In particular this plan and any information shown on it must not be relied upon in the event of any development or works (including but not limited to excavations) in the vicinity of SEVERN TRENT WATER assets or for the purposes of determining the suitability of a point of connection to the sewerage or distribution systems. Reproduction by permission of Ordnance Survey on behalf of HMGO. Crown Copyright and database rights 2025. All rights reserved. Ordnance Survey license number AC000085122. Document users other than SEVERN TRENT WATER business users are advised that this document is provided for reference purpose only and is subject to copyright. Therefore, no further copies should be made from it.

(c) Crown copyright and database rights 2025 Ordnance Survey 1000080622
Data updated: 14/06/25

Scale: 1:1250	Date: 05/07/25	Chain Water Plan A0
Map Center: 425997.341601	Our Ref: 1812609 - 1	Powered by digdata

Hydrant		Valve		Aqueduct	
Washout		Water Main		Duct	
Meter		Abandoned Pipe		Service Pipe/ Private Pipe	

charlotte.whitham@enzygo.com

Brailsford





© Crown copyright and database rights 2025 Ordnance Survey 100009512
Data updated: 14/05/25

Scale: 1:2500
Map Centre: 477000,341842
Date: 01/01/25
Our Ref: 161249 - 3
Crown Water Plan (CWP)
Produced by digipix

				Charlotte Whitlam@encygo.com	
				Bristol	

Hydrant

Watercourse

Water

Valve

Water Main

Abandoned Pipe

Appurtenant

Duct

Service Pipe/Pressure Pipe

SEVERN

TRENT

This is not a scale off this map. The plan and any information supplied with it is intended as a general guide. It is only valid at the date of issue and no warranty as to its correctness is given or implied. In particular this plan and any information shown on it must not be relied upon in the event of any development or works (including but not limited to excavations) in the vicinity of SEVERN-TRENT WATER assets or for the purposes of determining the suitability of a point of connection to the sewerage or distribution systems. Reproduction by permission of Ordnance Survey on behalf of HMGO. Crown Copyright and database rights 2025. All rights reserved. Ordnance Survey licence number AC000088122. Document users other than SEVERN-TRENT WATER business users are advised that this document is provided for reference purpose only and is subject to copyright. No further copies should be made from it.



(c) Crown copyright and database rights 2025 Ordnance Survey AC0000808122
Data updated: 14/06/25

Scale: 1:1250
Map Centre: 426733.340910

Date: 01/07/25
Our Ref: 1812609 - 6


Wastewater Plan A2
Powered by digdat

Public Foul Gravity/Lateral Drain		Highway Drain		Manhole Foul	
Public Combined Gravity/Lateral Drain		Overflow Pipe		Manhole Surface	
Public Surface Water Gravity/Lateral Drain		Disposal Pipe		Abandoned Pipe	
Pressure Foul		Culverted Water Course		Chamber	
Pressure Combined		Pumping Station		Section 104 sewers are shown in green	
Pressure Surface Water		Fitting		Private sewers are shown in magenta	

charlotte.whitham@enzygo.com
Brailsford



Do not scale off this map. The plan and any information supplied with it is furnished as a general guide, is only valid at the date of issue and no warranty as to its correctness is given or implied. In particular this plan and any information shown on it must not be relied upon in the event of any development or works (including but not limited to excavations) in the vicinity of SEVERN TRENT WATER assets or for the purposes of determining the suitability of a point of connection to the sewerage or distribution systems. Reproduction by permission of Ordnance Survey on behalf of HMSO. ©Crown Copyright and database rights 2025 All rights reserved. Ordnance Survey licence number AC0000808122. Document users other than SEVERN TRENT WATER business users are advised that this document is provided for reference purpose only and is subject to copyright, therefore, no further copies should be made from it.



(c) Crown copyright and database rights 2025 Ordnance Survey AC0000808122
Data updated: 14/06/25

Scale: 1:1250
Map Centre: 426733.340910

Date: 01/07/25
Our Ref: 1812609 - 5

Clean Water Plan A2
Powered by digdat

Hydrant		Valve		Aqueduct	
Washout		Water Main		Duct	
Meter		Abandoned Pipe		Service Pipe/ Private Pipe	

charlotte.whitham@enzygo.com

Brailsford



Do not scale off this map. The plan and any information supplied with it is furnished as a general guide, is only valid at the date of issue and no warranty as to its correctness is given or implied. In particular this plan and any information shown on it must not be relied upon in the event of any development or works (including but not limited to excavations) in the vicinity of SEVERN TRENT WATER assets or for the purposes of determining the suitability of a point of connection to the sewerage or distribution systems. Reproduction by permission of Ordnance Survey on behalf of HMSO. ©Crown Copyright and database rights 2025 All rights reserved. Ordnance Survey licence number AC0000808122. Document users other than SEVERN TRENT WATER business users are advised that this document is provided for reference purpose only and is subject to copyright, therefore, no further copies should be made from it.




Public Foul Gravity/Lateral Drain		Highway Drain		Manhole Foul	
Public Combined Gravity/Lateral Drain		Overflow Pipe		Manhole Surface	
Public Surface Water Gravity/Lateral Drain		Disposal Pipe		Abandoned Pipe	
Pressure Foul		Culverted Water Course		Chamber	
Pressure Combined		Pumping Station			
Pressure Surface Water		Fitting			

Section 101 sewers are shown in green
Private sewers are shown in magenta

charlotte.whitham@enzigo.com

Brailsford



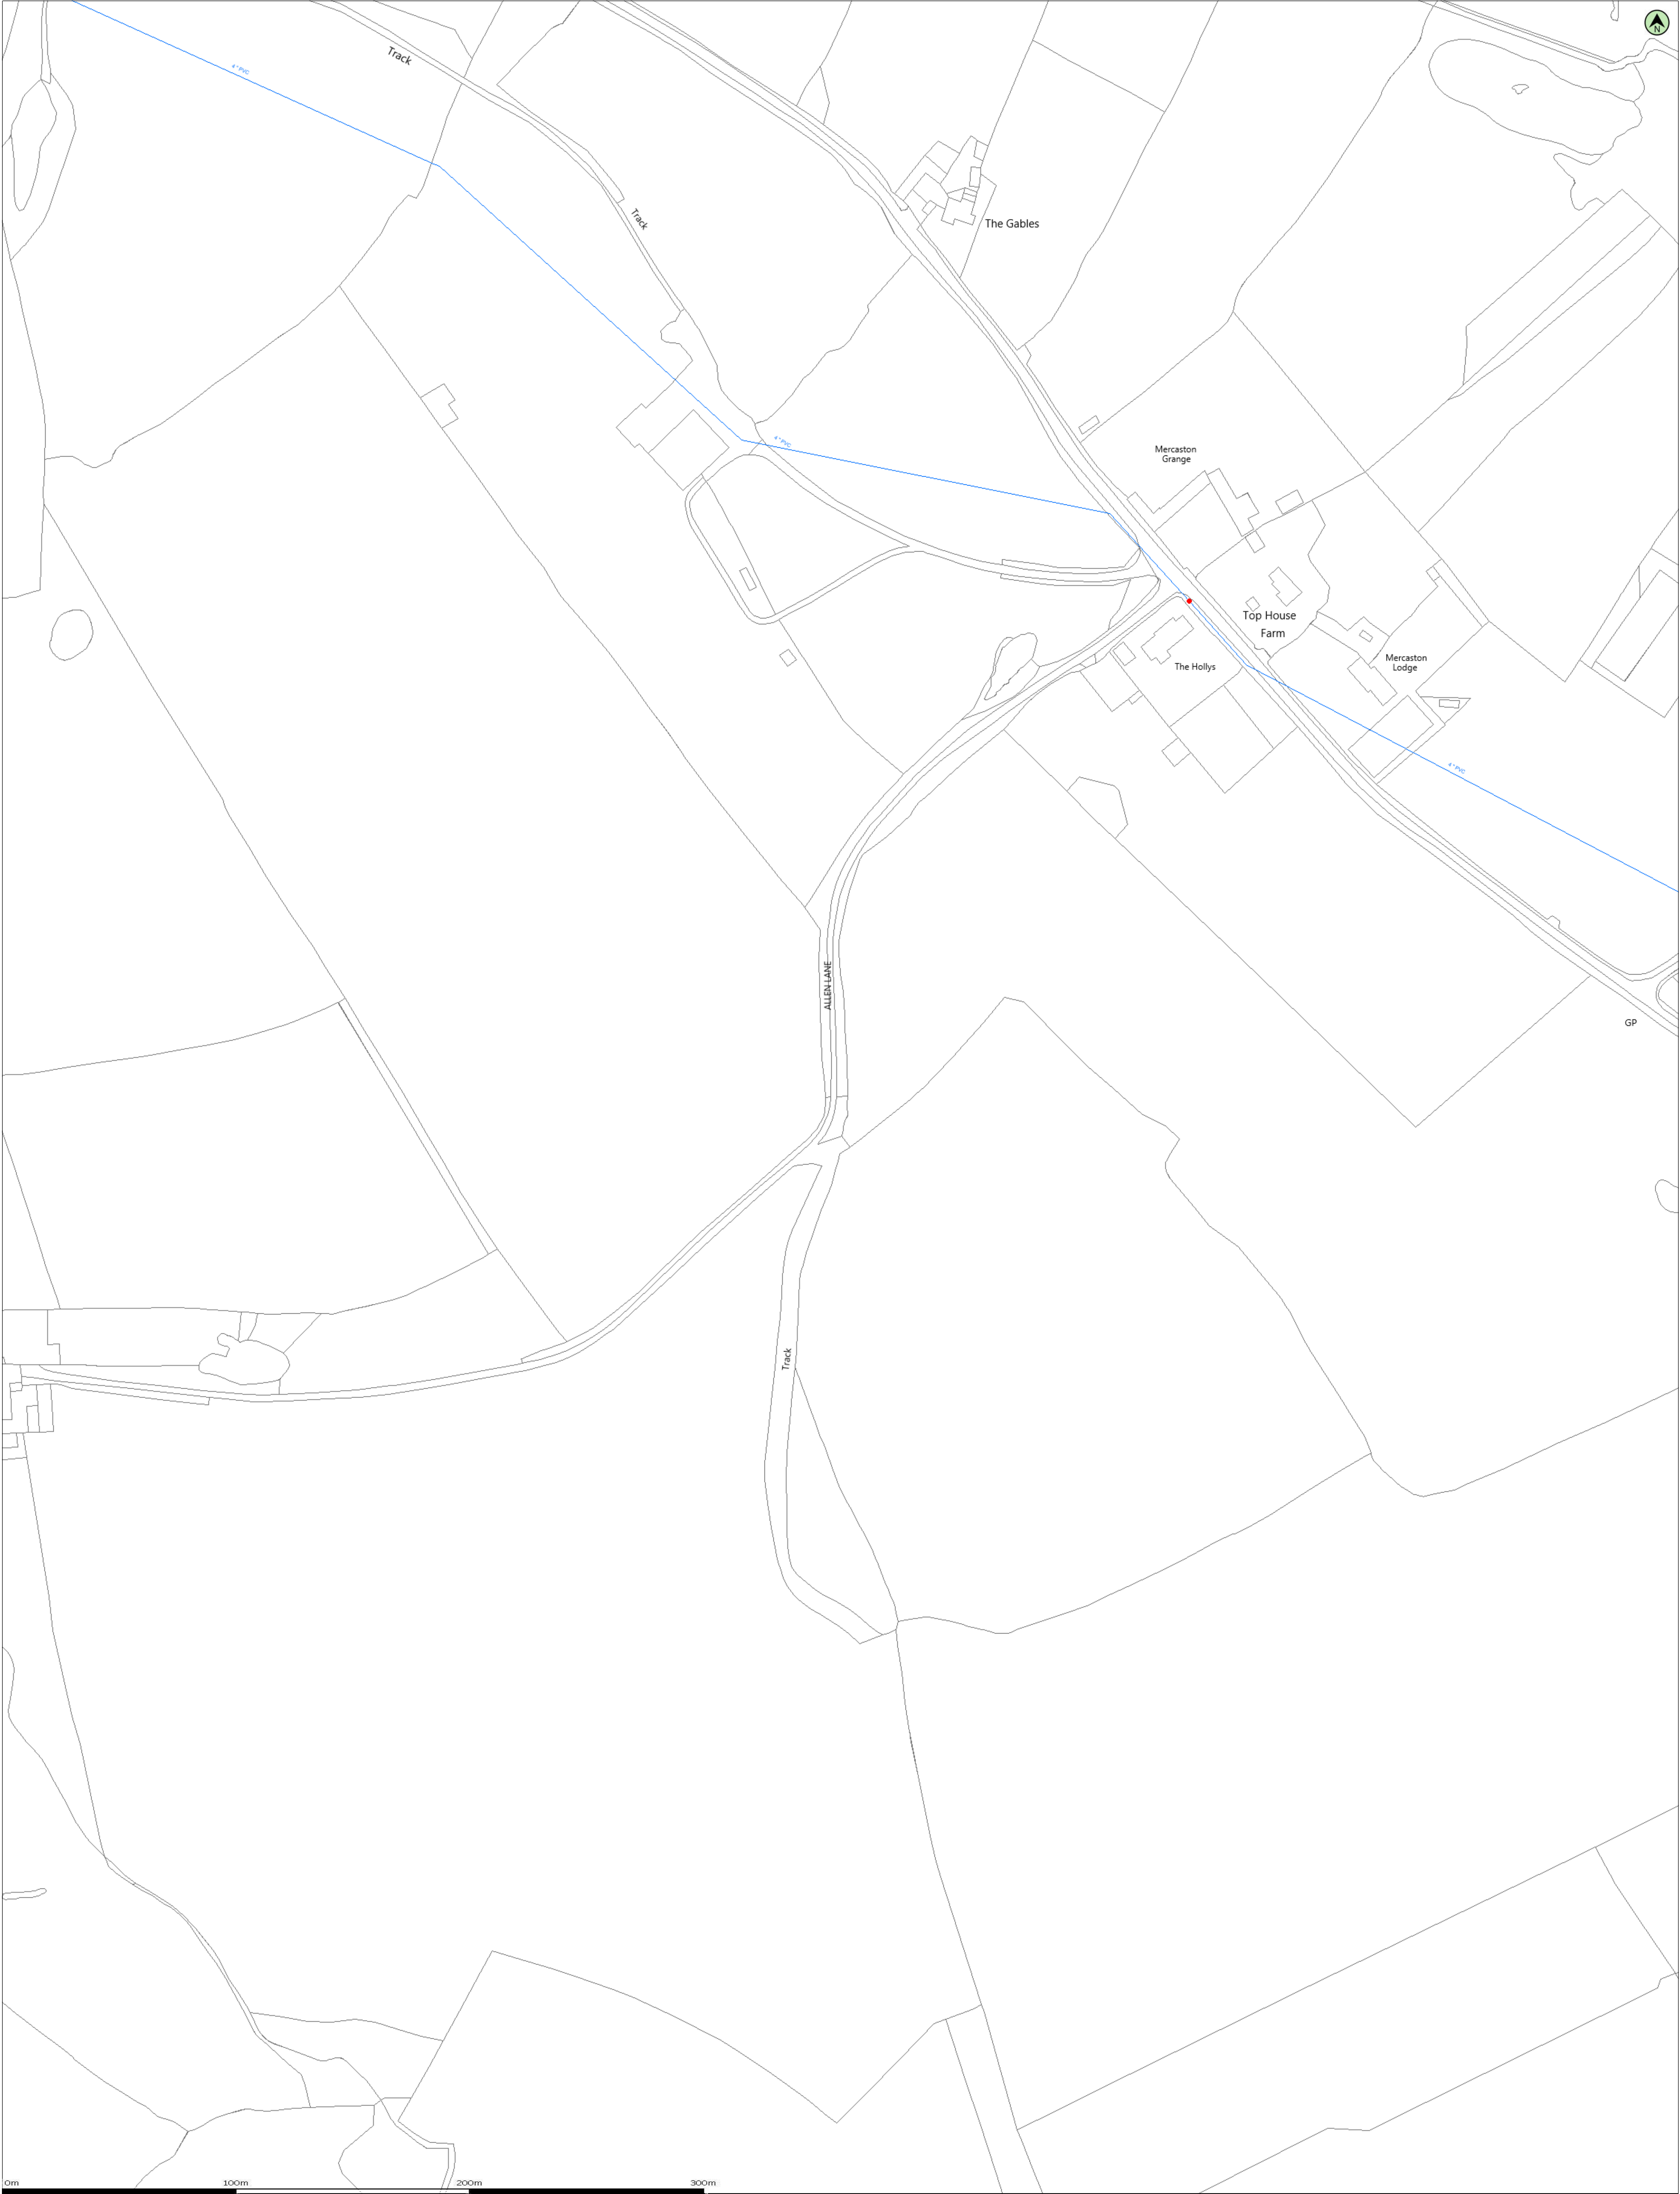

© Crown copyright and database rights 2025 Ordnance Survey AC0000808122
Data updated: 14/06/25

Scale: 1:1250
Map Centre: 427475.342276

Date: 01/07/25
Our Ref: 1812809 - 7

Clean Water Plan A1
Powered by digipix

Hydrant Washout Meter	Valve Water Main Abandoned Pipe	Aqueduct Duct Service Pipe/ Private Pipe	charlotte.whitham@enzygo.com Brailsford
--	--	---	---



Do not scale off this map. The plan and any information supplied with it is furnished as a general guide, is only valid at the date of issue and no warranty as to its correctness is given or implied. In particular this plan and any information shown on it must not be relied upon in the event of any development or works (including but not limited to excavations) in the vicinity of SEVERN TRENT WATER assets or for the purposes of determining the suitability of a point of connection to the sewerage or distribution systems. Reproduction by permission of Ordnance Survey on behalf of HMSO. ©Crown Copyright and database rights 2025. All rights reserved. Ordnance Survey licence number AC0000808122. Document users other than SEVERN TRENT WATER business users are advised that this document is provided for reference purpose only and is subject to copyright, therefore, no further copies should be made from it.

GENERAL CONDITIONS AND PRECAUTIONS TO BE TAKEN WHEN CARRYING OUT WORK ADJACENT TO SEVERN TRENT WATER'S APPARATUS

Please ensure that a copy of these conditions is passed to your representative and/or your contractor on site. If any damage is caused to Severn Trent Water Limited (STW) apparatus (defined below), the person, contractor or subcontractor responsible must inform STW immediately on: **0800 783 4444 (24 hours)**

- a) These general conditions and precautions apply to the public sewerage, water distribution and cables in ducts including (but not limited to) sewers which are the subject of an Agreement under Section 104 of the Water Industry Act 1991(a legal agreement between a developer and STW, where a developer agrees to build sewers to an agreed standard, which STW will then adopt); mains installed in accordance with an agreement for the self-construction of water mains entered into with STW and the assets described at condition b) of these general conditions and precautions. Such apparatus is referred to as "STW Apparatus" in these general conditions and precautions.
- b) Please be aware that due to The Private Sewers Transfer Regulations June 2011, the number of public sewers has increased, but many of these are not shown on the public sewer record. However, some idea of their positions may be obtained from the position of inspection covers and their existence must be anticipated.
- c) On request, STW will issue a copy of the plan showing the approximate locations of STW Apparatus although in certain instances a charge will be made. The position of private drains, private sewers and water service pipes to properties are not normally shown but their presence must be anticipated. This plan and the information supplied with it is furnished as a general guide only and STW does not guarantee its accuracy.
- d) STW does not update these plans on a regular basis. Therefore the position and depth of STW Apparatus may change and this plan is issued subject to any such change. Before any works are carried out, you should confirm whether any changes to the plan have been made since it was issued.
- e) The plan must not be relied upon in the event of excavations or other works in the vicinity of STW Apparatus. It is your responsibility to ascertain the precise location of any STW Apparatus prior to undertaking any development or other works (including but not limited to excavations).
- f) No person or company shall be relieved from liability for loss and/or damage caused to STW Apparatus by reason of the actual position and/or depths of STW Apparatus being different from those shown on the plan.

In order to achieve safe working conditions adjacent to any STW Apparatus the following should be observed:

- All STW Apparatus should be located by hand digging prior to the use of mechanical excavators.
- All information set out in any plans received from us, or given by our staff at the site of the works, about the position and depth of the mains, is approximate. Every possible precaution should be taken to avoid damage to STW Apparatus. You or your contractor must ensure the safety of STW Apparatus and will be responsible for the cost of repairing any loss and/or damage caused (including without limitation replacement parts).
- Water mains are normally laid at a depth of 900mm. No records are kept of customer service pipes which are normally laid at a depth of 750mm; but some idea of their positions may be obtained from the position of stop tap covers and their existence must be anticipated.
- During construction work, where heavy plant will cross the line of STW Apparatus, specific crossing points must be agreed with STW and suitably reinforced where required. These crossing points should be clearly marked and crossing of the line of STW Apparatus at other locations must be prevented.
- Where it is proposed to carry out piling or boring within 20 metres of any STW Apparatus, STW should be consulted to enable any affected STW Apparatus to be surveyed prior to the works commencing.
- Where excavation of trenches adjacent to any STW Apparatus affects its support, the STW Apparatus must be supported to the satisfaction of STW. Water mains and some sewers are pressurised and can fail if excavation removes support to thrust blocks to bends and other fittings.
- Where a trench is excavated crossing or parallel to the line of any STW Apparatus, the backfill should be adequately compacted to prevent any settlement which could subsequently cause damage to the STW Apparatus. In special cases, it may be necessary to provide permanent support to STW Apparatus which has been exposed over a length of the excavation before backfilling and reinstatement is carried out. There should be no concrete backfill in contact with the STW Apparatus.
- No other apparatus should be laid along the line of STW Apparatus irrespective of clearance. Above ground apparatus must not be located within a minimum of 3 metres either side of the centre line of STW Apparatus for smaller sized pipes and 6 metres either side for larger sized pipes without prior approval. No manhole or chamber shall be built over or around any STW Apparatus.
- A minimum radial clearance of 300 millimetres should be allowed between any plant or equipment being installed and existing STW Apparatus. We reserve the right to increase this distance where strategic assets are affected.
- Where any STW Apparatus coated with a special wrapping is damaged, even to a minor extent, STW must be notified and the trench left open until the damage has been inspected and the necessary repairs have been carried out. In the case of any material damage to any STW Apparatus causing leakage, weakening of the mechanical strength of the pipe or corrosion-protection damage, the necessary remedial work will be recharged to you.
- It may be necessary to adjust the finished level of any surface boxes which may fall within your proposed construction. Please ensure that these are not damaged, buried or otherwise rendered inaccessible as a result of the works and that all stop taps, valves, hydrants, etc. remain accessible and operable. Minor reduction in existing levels may result in conflict with STW Apparatus such as valve spindles or tops of hydrants housed under the surface boxes. Checks should be made during site investigations to ascertain the level of such STW Apparatus in order to determine any necessary alterations in advance of the works.
- With regard to any proposed resurfacing works, you are required to contact STW on the number given above to arrange a site inspection to establish the condition of any STW Apparatus in the nature of surface boxes or manhole covers and frames affected by the works. STW will then advise on any measures to be taken, in the event of this a proportionate charge will be made.
- You are advised that STW will not agree to either the erection of posts, directly over or within 1.0 metre of valves and hydrants.
- No explosives are to be used in the vicinity of any STW Apparatus without prior consultation with STW.

TREE PLANTING RESTRICTIONS

There are many problems with the location of trees adjacent to sewers, water mains and other STW Apparatus and these can lead to the loss of trees and hence amenity to the area which many people may have become used to. It is best if the problem is not created in the first place. Set out below are the recommendations for tree planting in close proximity to public sewers, water mains and other STW Apparatus.

- Please ensure that, in relation to STW Apparatus, the mature root systems and canopies of any tree planted do not and will not encroach within the recommended distances specified in the notes below.
- Both Poplar and Willow trees have extensive root systems and should not be planted within 12 metres of a sewer, water main or other STW Apparatus.
- The following trees and those of similar size, be they deciduous or evergreen, should not be planted within 6 metres of a sewer, water main or other STW Apparatus. E.g. Ash, Beech, Birch, most Conifers, Elm, Horse Chestnut, Lime, Oak, Sycamore, Apple and Pear. Asset Protection Statements Updated May 2014
- STW personnel require a clear path to conduct surveys etc. No shrubs or bushes should be planted within 2 metre of the centre line of a sewer, water main or other STW Apparatus.
- In certain circumstances, both STW and landowners may wish to plant shrubs/bushes in close proximity to a sewer, water main of other STW Apparatus for screening purposes. The following are shallow rooting and are suitable for this purpose: Blackthorn, Broom, Cotoneaster, Elder, Hazel, Laurel, Privet, Quickthorn, Snowberry, and most ornamental flowering shrubs.

GENERAL CONDITIONS AND PRECAUTIONS TO BE TAKEN WHEN CARRYING OUT WORK ADJACENT TO SEVERN TRENT WATER'S APPARATUS

Please ensure that a copy of these conditions is passed to your representative and/or your contractor on site. If any damage is caused to Severn Trent Water Limited (STW) apparatus (defined below), the person, contractor or subcontractor responsible must inform STW immediately on: **0800 783 4444 (24 hours)**

- a) These general conditions and precautions apply to the public sewerage, water distribution and cables in ducts including (but not limited to) sewers which are the subject of an Agreement under Section 104 of the Water Industry Act 1991(a legal agreement between a developer and STW, where a developer agrees to build sewers to an agreed standard, which STW will then adopt); mains installed in accordance with an agreement for the self-construction of water mains entered into with STW and the assets described at condition b) of these general conditions and precautions. Such apparatus is referred to as "STW Apparatus" in these general conditions and precautions.
- b) Please be aware that due to The Private Sewers Transfer Regulations June 2011, the number of public sewers has increased, but many of these are not shown on the public sewer record. However, some idea of their positions may be obtained from the position of inspection covers and their existence must be anticipated.
- c) On request, STW will issue a copy of the plan showing the approximate locations of STW Apparatus although in certain instances a charge will be made. The position of private drains, private sewers and water service pipes to properties are not normally shown but their presence must be anticipated. This plan and the information supplied with it is furnished as a general guide only and STW does not guarantee its accuracy.
- d) STW does not update these plans on a regular basis. Therefore the position and depth of STW Apparatus may change and this plan is issued subject to any such change. Before any works are carried out, you should confirm whether any changes to the plan have been made since it was issued.
- e) The plan must not be relied upon in the event of excavations or other works in the vicinity of STW Apparatus. It is your responsibility to ascertain the precise location of any STW Apparatus prior to undertaking any development or other works (including but not limited to excavations).
- f) No person or company shall be relieved from liability for loss and/or damage caused to STW Apparatus by reason of the actual position and/or depths of STW Apparatus being different from those shown on the plan.

In order to achieve safe working conditions adjacent to any STW Apparatus the following should be observed:

1. All STW Apparatus should be located by hand digging prior to the use of mechanical excavators.
2. All information set out in any plans received from us, or given by our staff at the site of the works, about the position and depth of the mains, is approximate. Every possible precaution should be taken to avoid damage to STW Apparatus. You or your contractor must ensure the safety of STW Apparatus and will be responsible for the cost of repairing any loss and/or damage caused (including without limitation replacement parts).
3. Water mains are normally laid at a depth of 900mm. No records are kept of customer service pipes which are normally laid at a depth of 750mm; but some idea of their positions may be obtained from the position of stop tap covers and their existence must be anticipated.
4. During construction work, where heavy plant will cross the line of STW Apparatus, specific crossing points must be agreed with STW and suitably reinforced where required. These crossing points should be clearly marked and crossing of the line of STW Apparatus at other locations must be prevented.
5. Where it is proposed to carry out piling or boring within 20 metres of any STW Apparatus, STW should be consulted to enable any affected STW Apparatus to be surveyed prior to the works commencing.
6. Where excavation of trenches adjacent to any STW Apparatus affects its support, the STW Apparatus must be supported to the satisfaction of STW. Water mains and some sewers are pressurised and can fail if excavation removes support to thrust blocks to bends and other fittings.
7. Where a trench is excavated crossing or parallel to the line of any STW Apparatus, the backfill should be adequately compacted to prevent any settlement which could subsequently cause damage to the STW Apparatus. In special cases, it may be necessary to provide permanent support to STW Apparatus which has been exposed over a length of the excavation before backfilling and reinstatement is carried out. There should be no concrete backfill in contact with the STW Apparatus.
8. No other apparatus should be laid along the line of STW Apparatus irrespective of clearance. Above ground apparatus must not be located within a minimum of 3 metres either side of the centre line of STW Apparatus for smaller sized pipes and 6 metres either side for larger sized pipes without prior approval. No manhole or chamber shall be built over or around any STW Apparatus.
9. A minimum radial clearance of 300 millimetres should be allowed between any plant or equipment being installed and existing STW Apparatus. We reserve the right to increase this distance where strategic assets are affected.
10. Where any STW Apparatus coated with a special wrapping is damaged, even to a minor extent, STW must be notified and the trench left open until the damage has been inspected and the necessary repairs have been carried out. In the case of any material damage to any STW Apparatus causing leakage, weakening of the mechanical strength of the pipe or corrosion-protection damage, the necessary remedial work will be recharged to you.
11. It may be necessary to adjust the finished level of any surface boxes which may fall within your proposed construction. Please ensure that these are not damaged, buried or otherwise rendered inaccessible as a result of the works and that all stop taps, valves, hydrants, etc. remain accessible and operable. Minor reduction in existing levels may result in conflict with STW Apparatus such as valve spindles or tops of hydrants housed under the surface boxes. Checks should be made during site investigations to ascertain the level of such STW Apparatus in order to determine any necessary alterations in advance of the works.
12. With regard to any proposed resurfacing works, you are required to contact STW on the number given above to arrange a site inspection to establish the condition of any STW Apparatus in the nature of surface boxes or manhole covers and frames affected by the works. STW will then advise on any measures to be taken, in the event of this a proportionate charge will be made.
13. You are advised that STW will not agree to either the erection of posts, directly over or within 1.0 metre of valves and hydrants.
14. No explosives are to be used in the vicinity of any STW Apparatus without prior consultation with STW.

TREE PLANTING RESTRICTIONS

There are many problems with the location of trees adjacent to sewers, water mains and other STW Apparatus and these can lead to the loss of trees and hence amenity to the area which many people may have become used to. It is best if the problem is not created in the first place. Set out below are the recommendations for tree planting in close proximity to public sewers, water mains and other STW Apparatus.

15. Please ensure that, in relation to STW Apparatus, the mature root systems and canopies of any tree planted do not and will not encroach within the recommended distances specified in the notes below.
16. Both Poplar and Willow trees have extensive root systems and should not be planted within 12 metres of a sewer, water main or other STW Apparatus.
17. The following trees and those of similar size, be they deciduous or evergreen, should not be planted within 6 metres of a sewer, water main or other STW Apparatus. E.g. Ash, Beech, Birch, most Conifers, Elm, Horse Chestnut, Lime, Oak, Sycamore, Apple and Pear. Asset Protection Statements Updated May 2014
18. STW personnel require a clear path to conduct surveys etc. No shrubs or bushes should be planted within 2 metre of the centre line of a sewer, water main or other STW Apparatus.
19. In certain circumstances, both STW and landowners may wish to plant shrubs/bushes in close proximity to a sewer, water main of other STW Apparatus for screening purposes. The following are shallow rooting and are suitable for this purpose: Blackthorn, Broom, Cotoneaster, Elder, Hazel, Laurel, Privet, Quickthorn, Snowberry, and most ornamental flowering shrubs.

Appendix 6 – BGS Borehole Records

Brailsford--Map 125.
Two wells, Map 44 S.W. Height above O.D. about 500 ft.
15. 47 ft. deep; 6 ft. diameter; brick lined.
Gravel and running sand.
No detailed section.
S.W.L. 31 ft. down. P.W.L. 34 ft. down.
16. 36 ft. deep; 6 ft. diameter; brick lined. Ft.
Pleistocene { Gravelly clay ... about 8
 { Over gravelly sand. 3-4
 { Gravelly clay at bottom.

Undertaking of Col. G. A. Smith, supplying part of the Parish of
Brailsford.

a) Pottery village pump-out N.W. side of village.
Sole supply for houses N.W. side of village - Handpump
Visited 1 mile N. of Brailsford 44 S.W.W.
O.D.

b) Handpump
O.D.
Supplies S.E. side of village
S.W. of Brailsford 44 S.W.W.

2-18 VIII 49

Brailsford village is supplied from a public supply, a
diesel engine, and a pump, which has a windmill for fuelled engine.
The windmill is a 12 ft. high. The pump is a 12 ft. high.
The pump is a 12 ft. high. The pump is a 12 ft. high.
The pump is a 12 ft. high. The pump is a 12 ft. high.
The pump is a 12 ft. high. The pump is a 12 ft. high.
The pump is a 12 ft. high. The pump is a 12 ft. high.



Enzygo specialise in a wide range of technical services:

Property and Sites

Waste and Mineral Planning

Flooding, Drainage and Hydrology

Landscape Architecture

Arboriculture

Permitting and Regulation

Waste Technologies and Renewables

Waste Contract Procurement

Noise and Vibration

Ecology Services

Contaminated Land and Geotechnical

Traffic and Transportation

Planning Services

BRISTOL

The Byre
Woodend Lane
Cromhall
Gloucestershire
GL12 8AA
Tel: 01454 269 237

SHEFFIELD

Samuel House
5 Fox Valley Way
Stocksbridge
Sheffield S36 2AA
Tel: 0114 321 5151

MANCHESTER

Ducie House
Ducie Street
Manchester
M1 2JW
Tel: 0161 413 6444

CARDIFF

Regus House
Malthouse Avenue
Cardiff Gate Business Park
CF23 8RU
Tel: 02920 023 700

Please visit our website for more information.

enzygo.com