

# 20-Renewable Energy Integration

ECEGR 4530

Renewable Energy Systems

# ➤ Overview

- Introduction
- Generation
- Load
- Generator Commitment

# → Introduction


- The power system is NOT “plug-and-play”
- Renewable resources are not always good citizens
  - intermittent availability
  - variable power output
  - difficult to predict (in many cases)
  - reactive power consumers (if induction generators are used)

# » Introduction

- A level of accommodation is necessary to **integrate** renewable resources
- What determines how ease/difficult it is to integrate?
  - characteristic of renewable resource
  - characteristics of the power system

# Introduction

- Recall that power systems are comprised of three classifications of components
  - generation
  - transmission
  - load

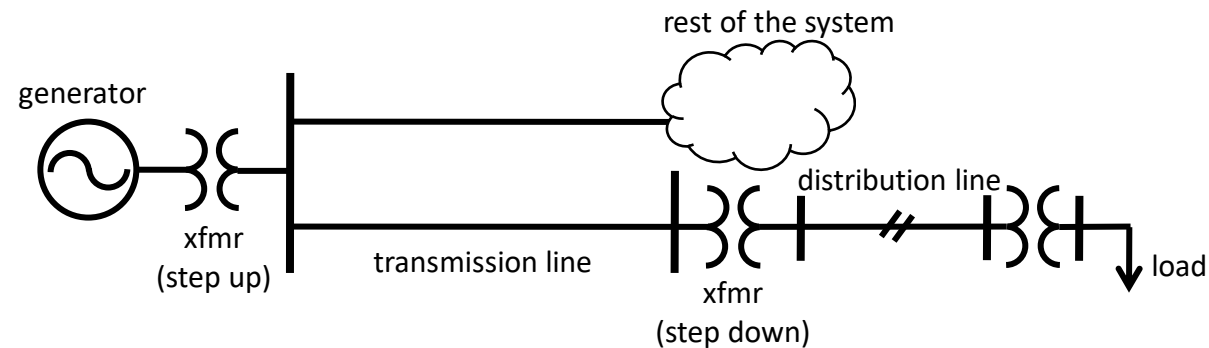

## » Generation (2015 Data)

- Total number and capacity of generators in U.S.: 20,068
  - Natural Gas: 5,774; 503,936 MW
  - Hydro: 4,020; 78,956 MW
  - Petroleum: 3,550; 42,321 MW
  - Coal: 968; 304,789 MW
  - Wind: 1098; 73,393 MW
  - Solar PV: 1633; 11,983 MW
  - Solar Thermal: 19, 1,774 MW
  - Geothermal: 197; 3,811 MW
  - Nuclear: 99; 103,860 MW
- Total nameplate capacity: 1,167,365 MW

A single power plant may have more than one generator.


# » Generation-Load Balance

- Power generated must equal load (plus losses) at any instant
- If load exceeds generation, kinetic energy is extracted from the rotors, slowing down their rotational speed
  - System frequency decreases
- If generation exceeds load, kinetic energy is added to the rotors, increasing their rotational speed
  - System frequency increases

## → Generation-Load Balance


- Rotating machines provide the inertia that buffer against moment-to-moment mismatches in generation and load
- If load increases for a prolonged period, the generation must also increase or the system frequency will eventually decay to zero
  - But the generators will have tripped off-line before this happens



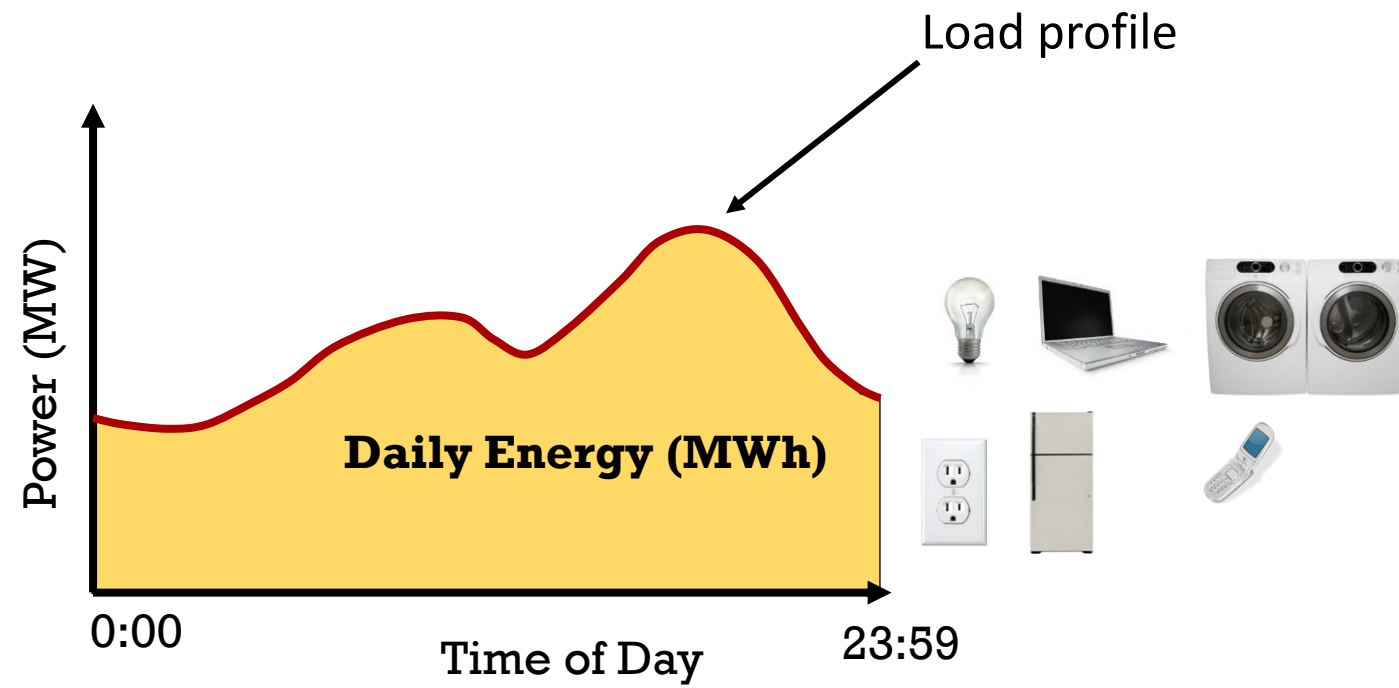

# » Load Profiles

- Load profiles are influenced by:
  - Time of day
  - Day of week
  - Season
  - Special events (e.g. Super Bowl)
  - Weather (primarily temperature)
- Customer size and make up (commercial, industry, business, etc.)

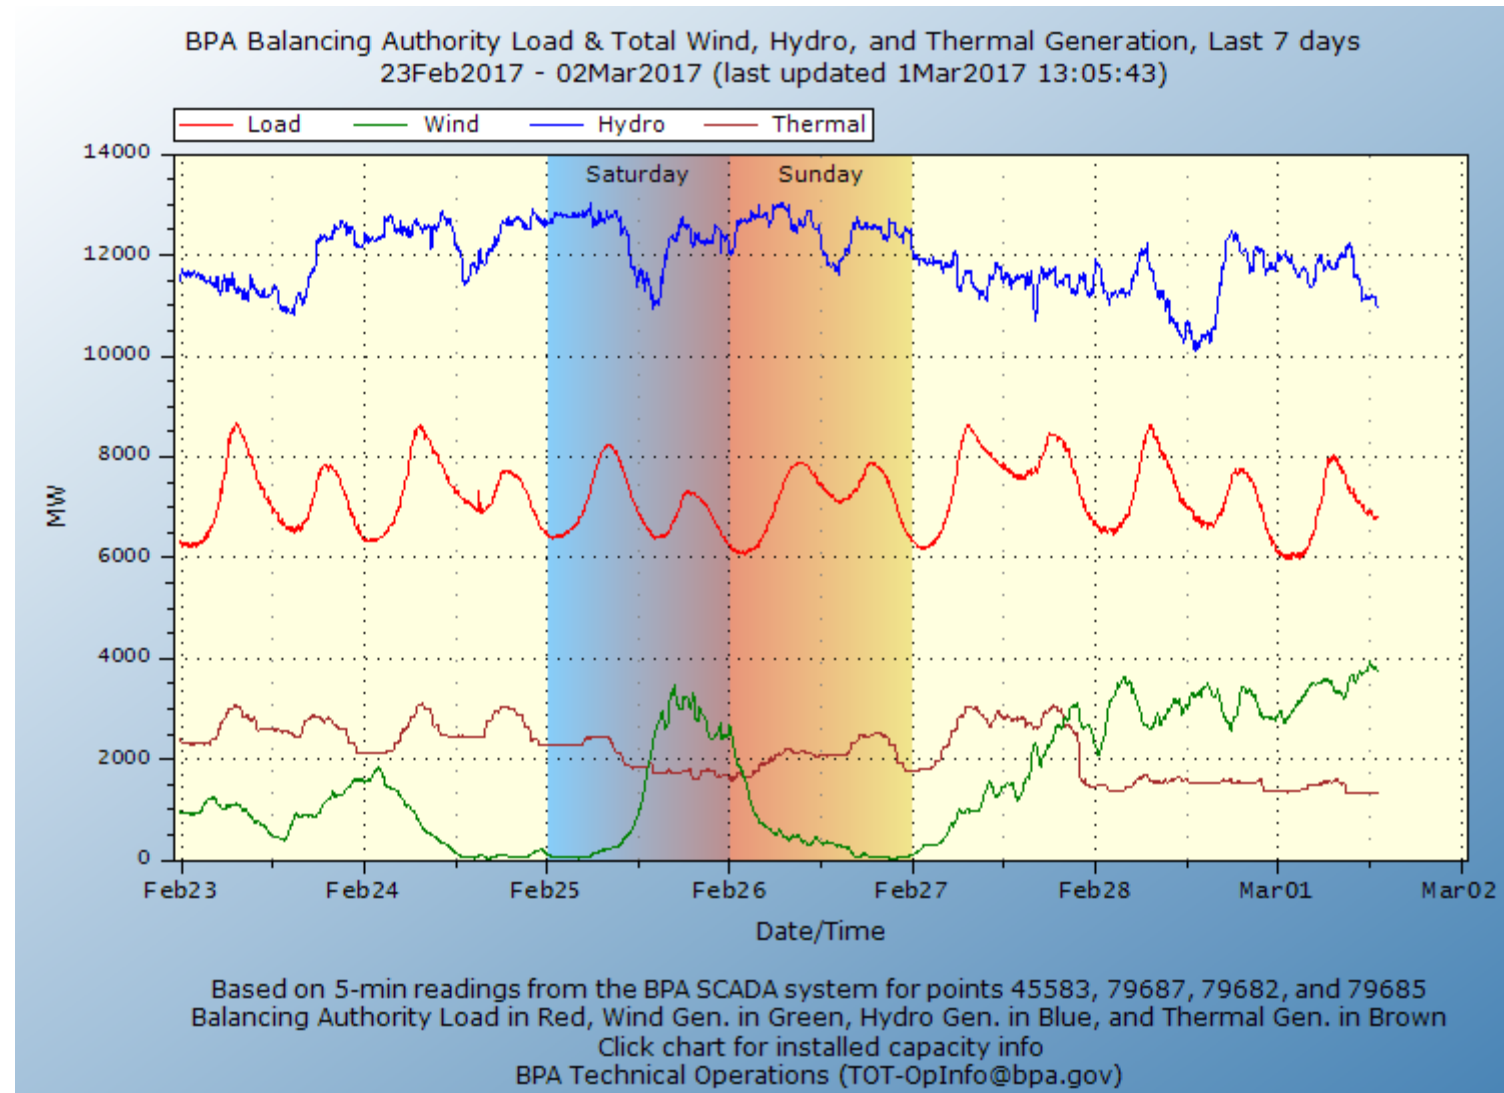

# ➤ Generator Commitment & Dispatch

- System operators attempt to **dispatch** and **commit** generators to match supply and demand, plus a safety margin in case of a contingency
  - Contingencies typically include: loss of generator(s), transmission line(s)
- Forecasting load, and control of generators are important in maintaining system reliability


# » Load Forecasting

- Load profiles can generally be accurately predicted
  - Utilities have long historical records
  - Models account for day of week, temperature, season, etc.
- As forecast horizon (amount of time in the future the forecast is for) increases, accuracy decreases
- Utilities make forecasts with different horizons and durations
  - Hour ahead (or even less)
  - Day ahead



- Day-ahead forecast matches actual shape
- Hour-ahead forecast has greater accuracy

### Today's Outlook

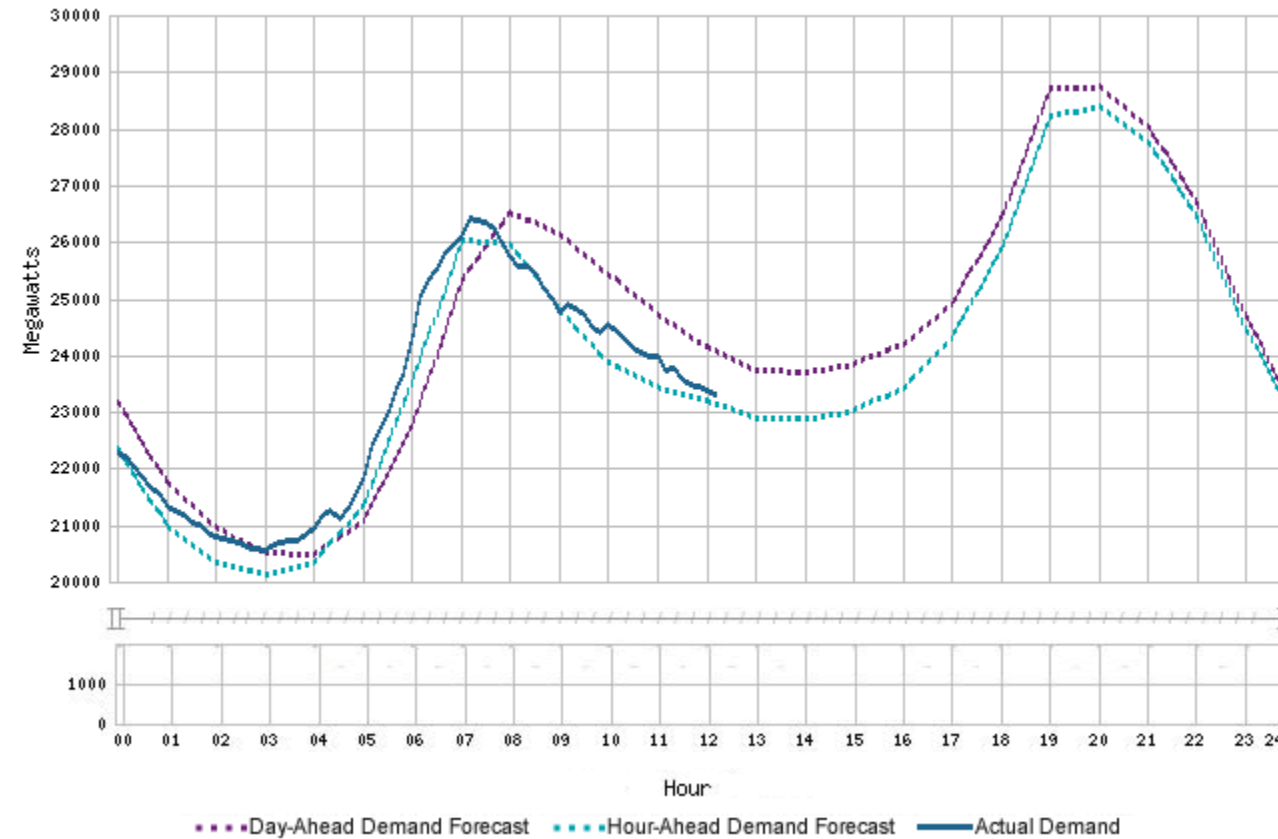


# → Generator Commitment

- Nuclear and Coal-fired power plants
  - Long start-up times from several hours to days
  - Slow ramp rates
  - Inexpensive
- Natural Gas power plants
  - Short start-up times
  - Fast ramp rates
  - Expensive


# Generator Commitment

- How should power plants be dispatched to satisfy the load?

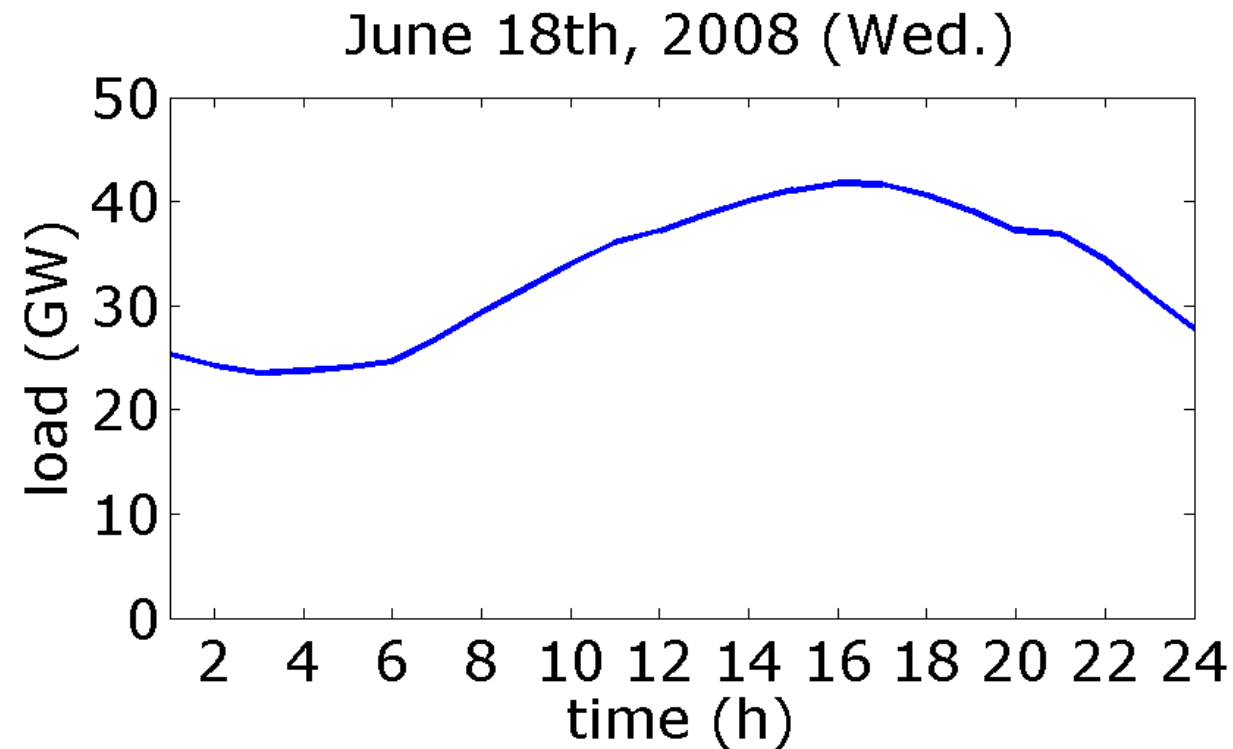



# Generator Commitment

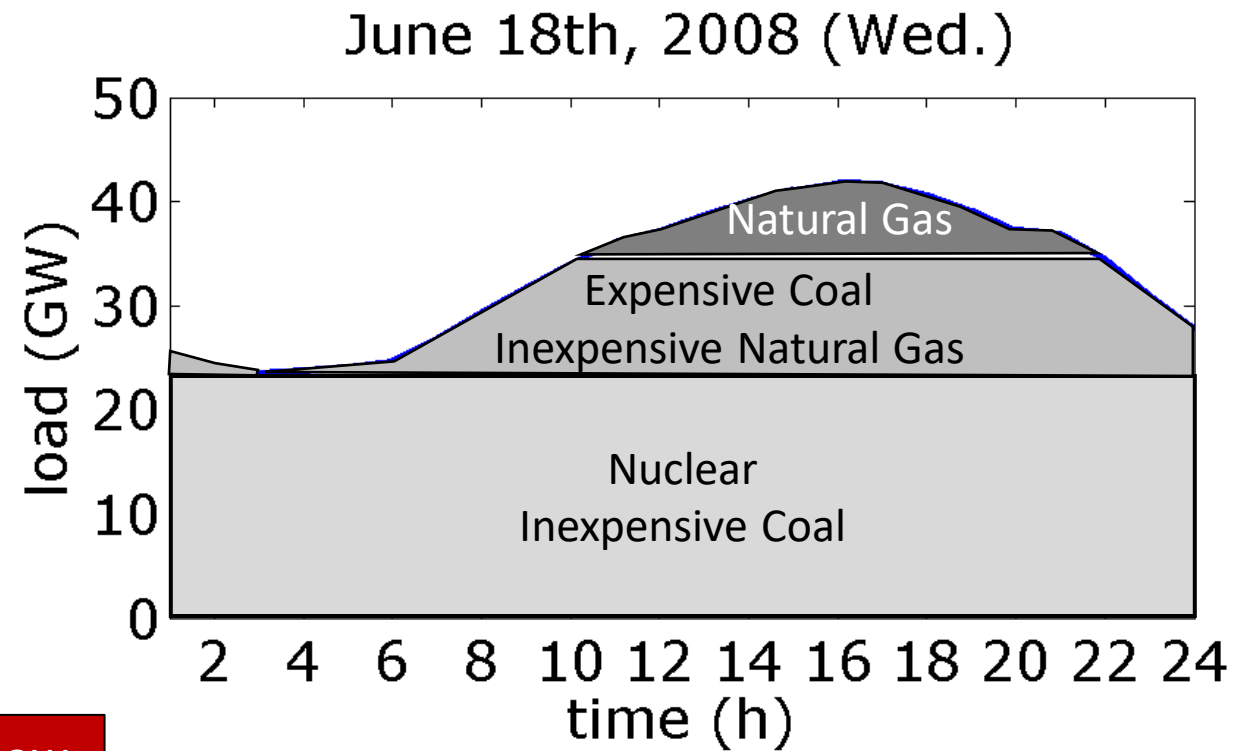


Natural gas is now displacing coal


# → Integration of Renewable Resources

- How does the inclusion of uncontrollable renewable resources affect generator commitment?
  - We can control the resource to produce less power, but not more


# Integration of Renewable Resources

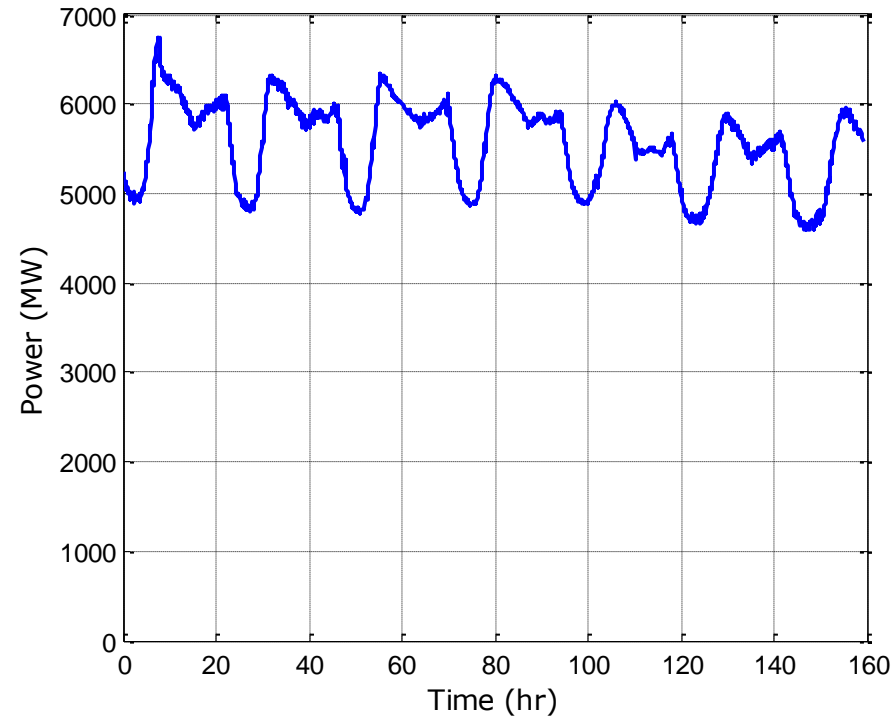

# Integration of Renewable Resources

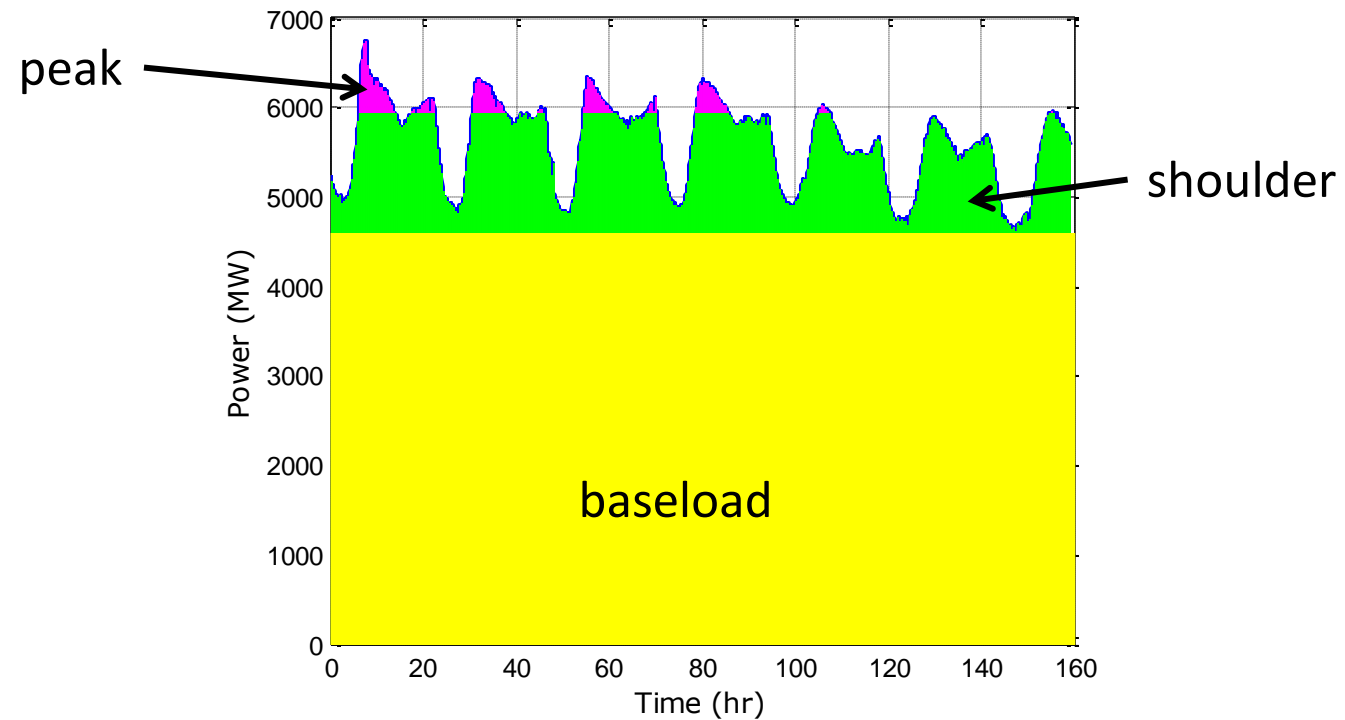


# Integration of Renewable Resources

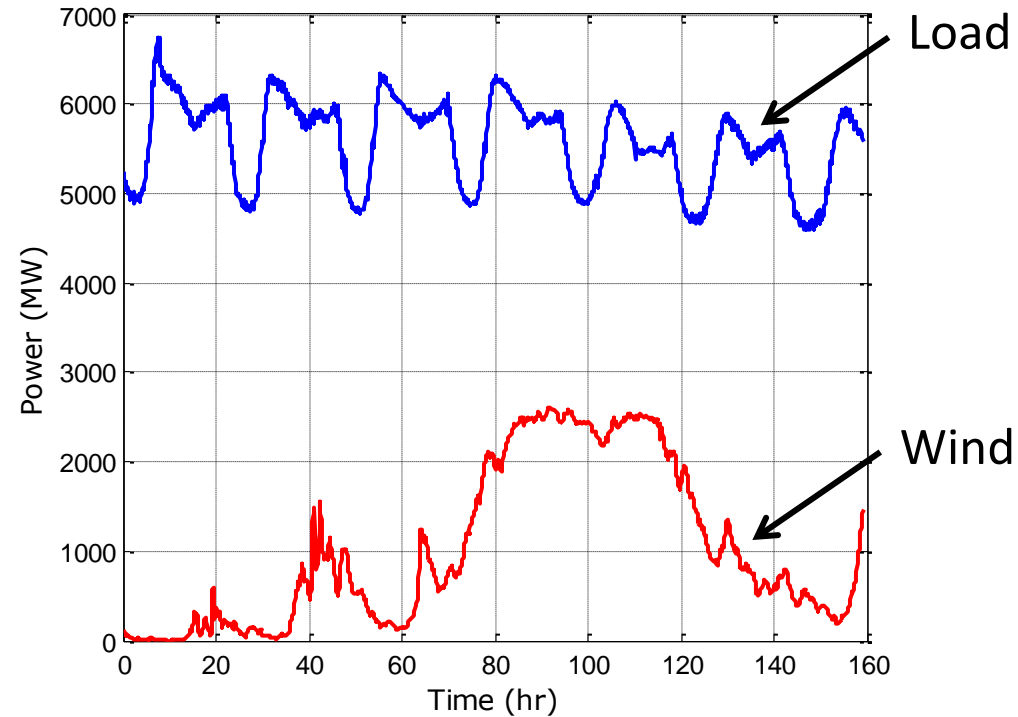


Note: Total Wind Plant Capacity is 2780 MW


# Integration of Renewable Resources

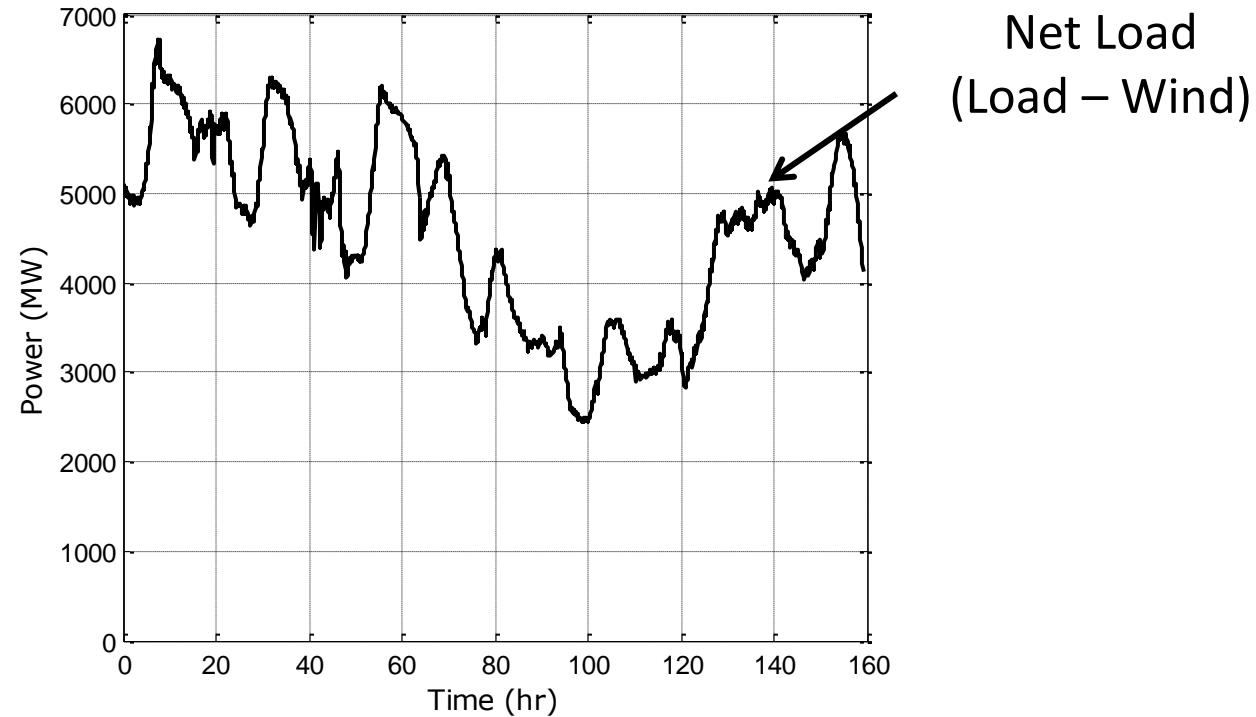

# Integration of Renewable Resources


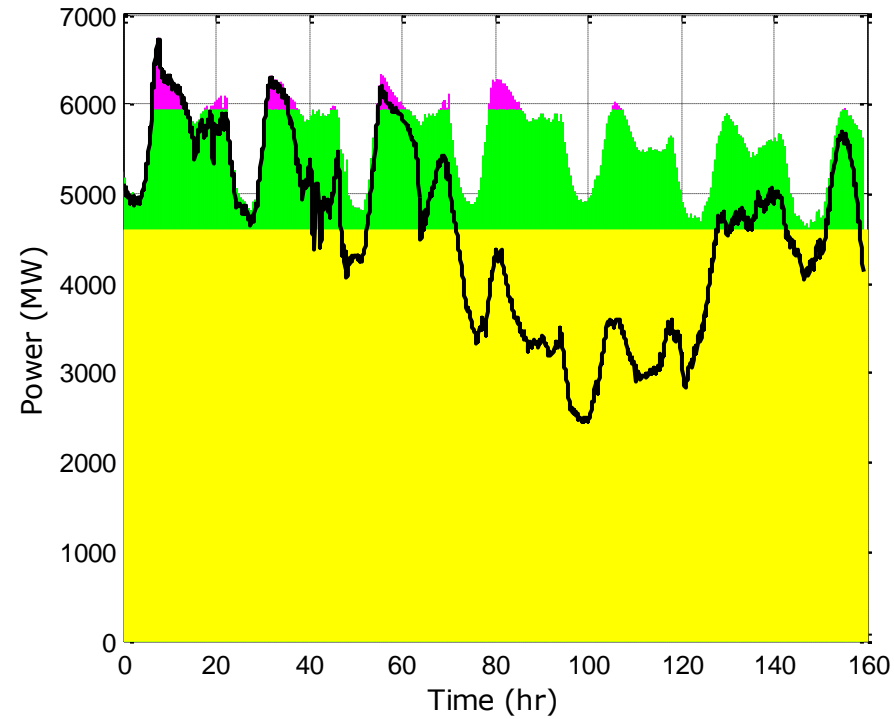


# Integration of Renewable Resources

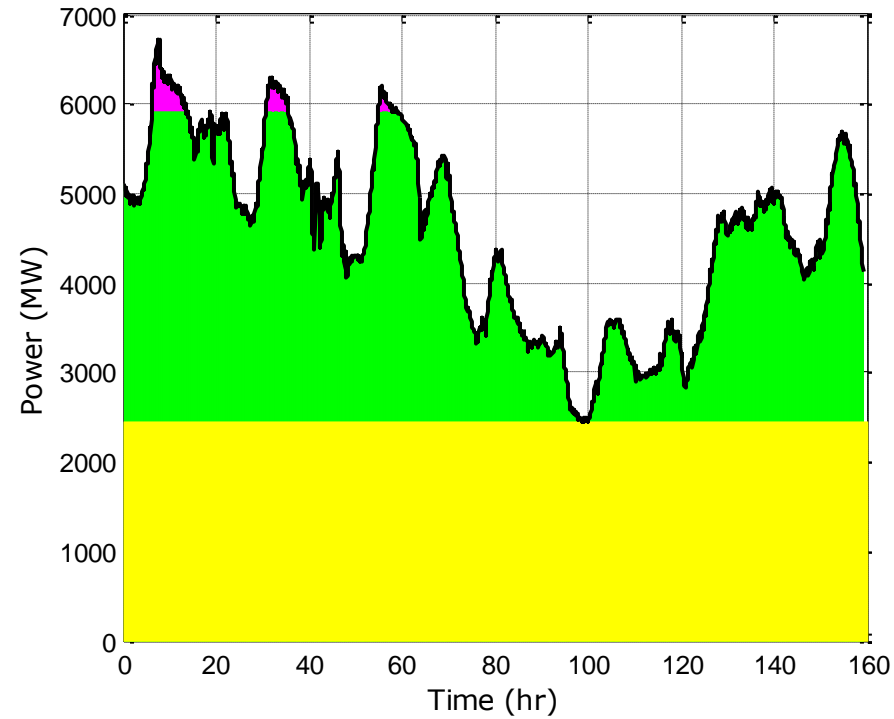



# Integration of Renewable Resources

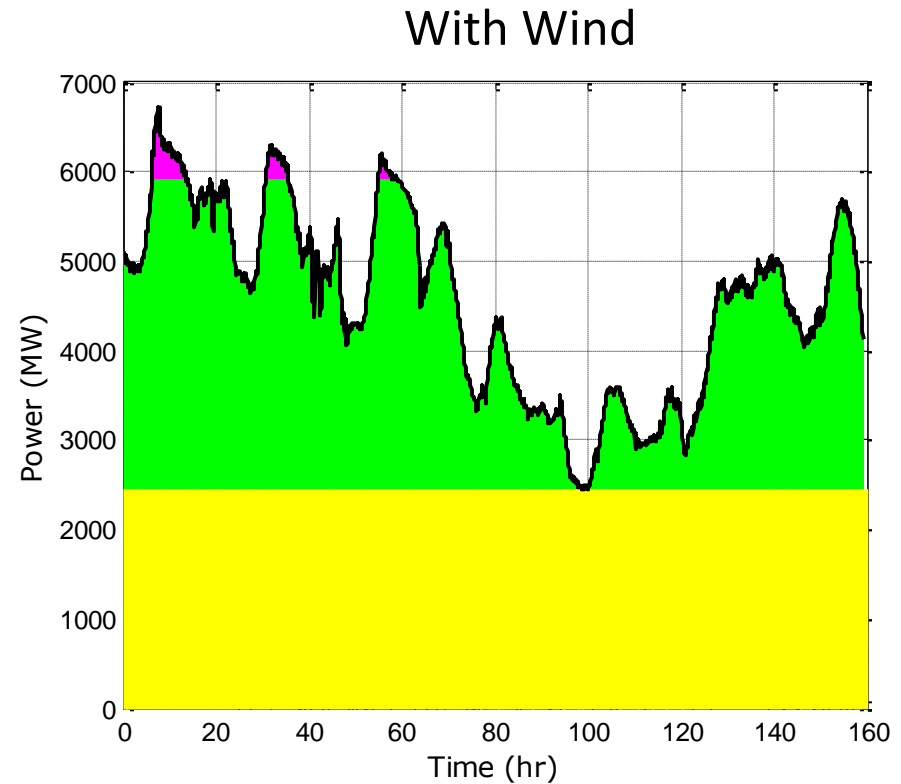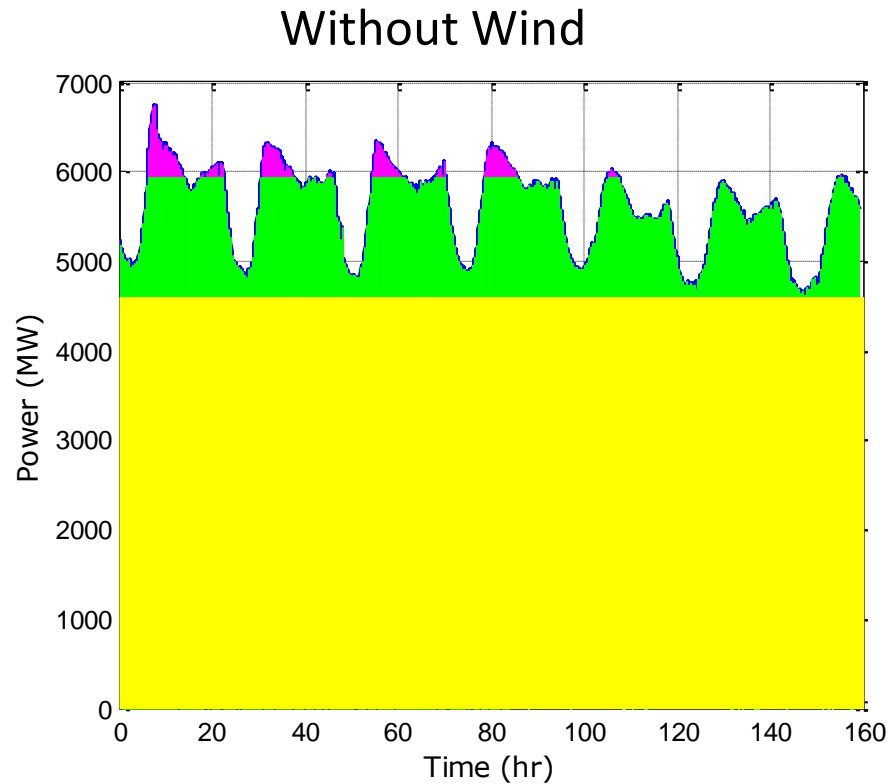


# » Integration of Renewable Resources

- Presence of wind plants disrupts the “natural” commitment of generators
- Assuming integration is done into an existing system (i.e. non-renewable generators are already built)
  - Baseload units may not run continuously
  - Shoulder units may start-up, shut down and ramp more frequently
  - Peaking units may or may not be used more often
- All of the above threaten reliability and economy of the power system

# » Integration of Renewable Resources


- Factors affecting integration of renewable resources:
  - Capacity
  - Resource characteristic
    - Correlation with load
    - Variability
    - Uncertainty
  - Transmission
  - Generation Resource Mix (flexibility of the system)

# ➤ Geographic Diversity

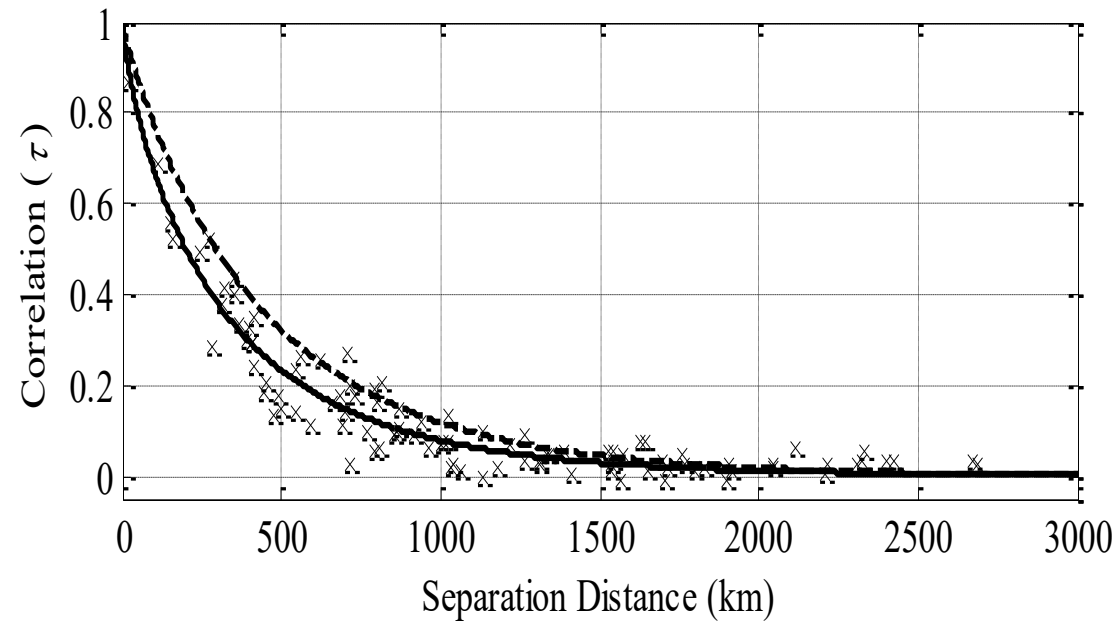


Correlation of wind power decreases  
as separation of wind plants increases

# → Geographic Diversity

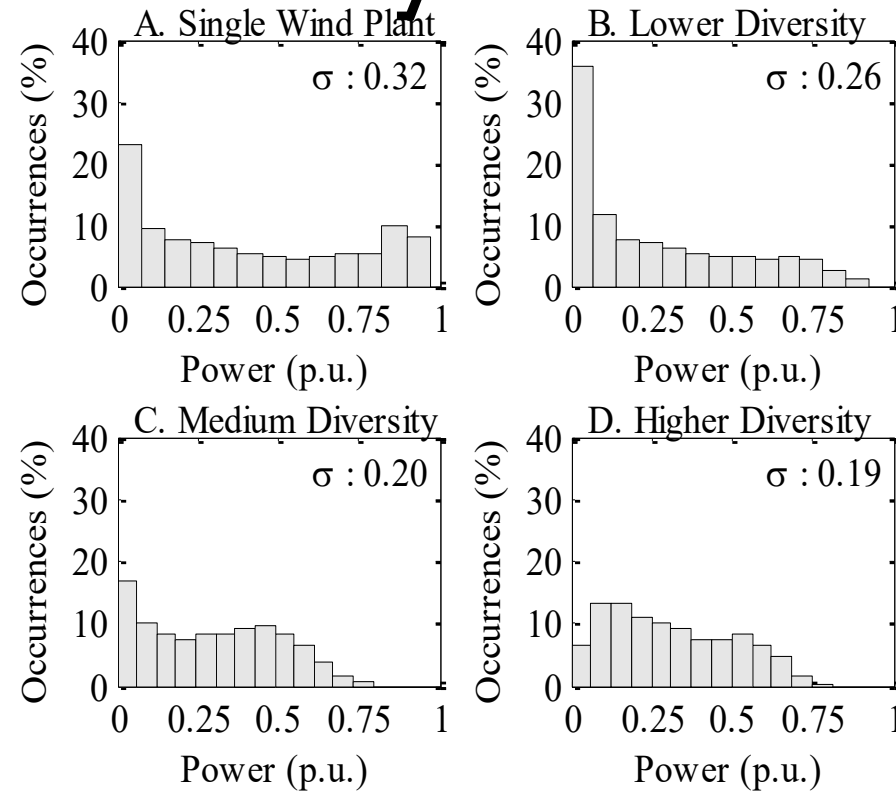

PDF tends toward a Normal distribution as diversity increases.

# Smoothing Effect

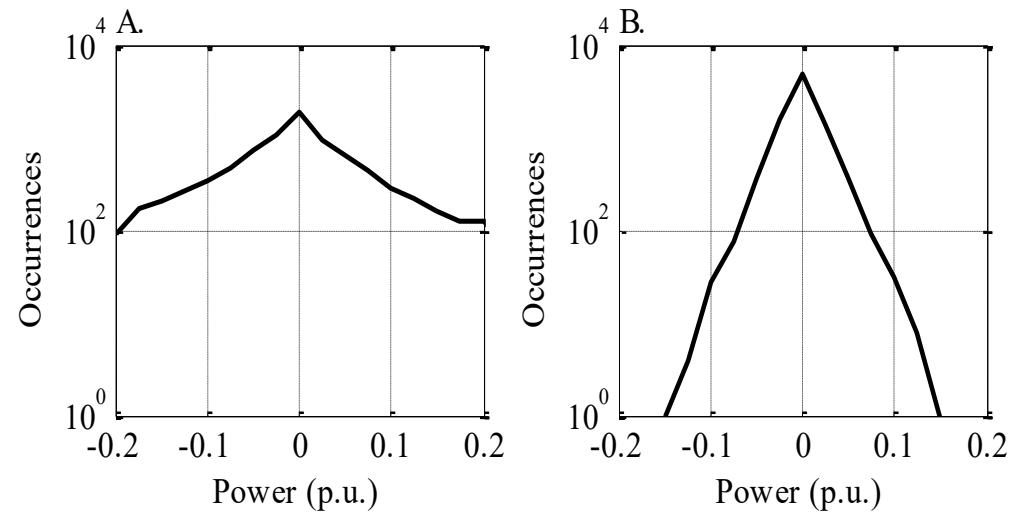


Variation is larger for single wind plant (A) than a large system (B)

# ➤ Renewable Resource Penetration

- Penetration by Energy: ratio of energy from renewable resource to energy consumed by load over a given period
- Penetration by Capacity: ratio of total wind plant capacity to peak load (annual or given period)

# ➤ Renewable Resource Penetration

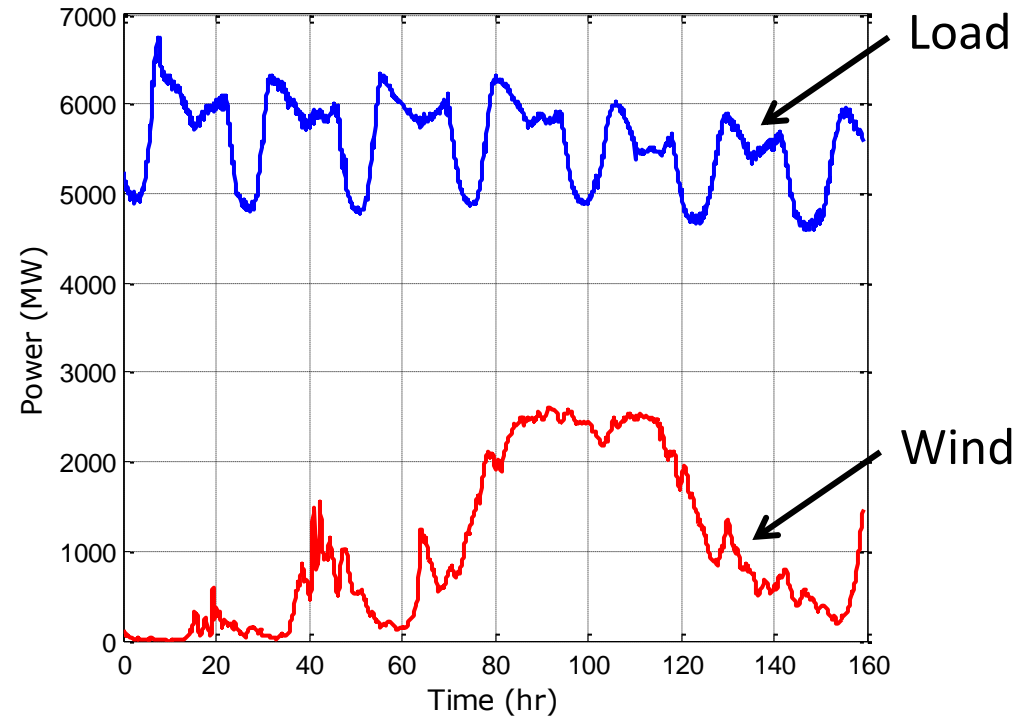




# → Renewable Resource Penetration

- Penetration by Energy: 18%
- Penetration by Capacity: 42%


# Integration of Renewable Resources

- Assume that instead of wind plants, the renewable resources is PV plants (2,780 MW)



Solar tends to coincide with peak load

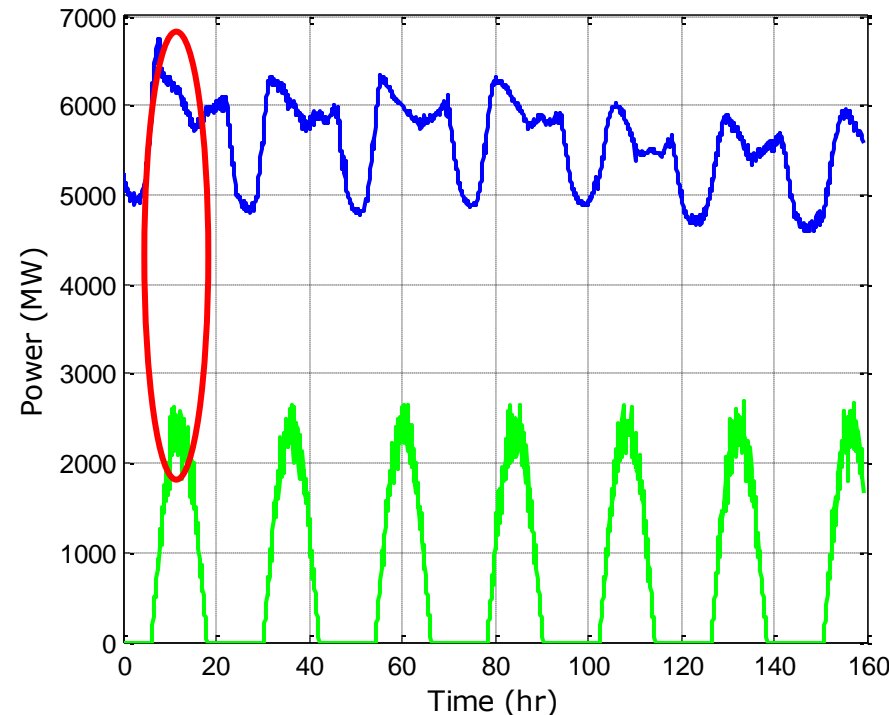

# Integration of Renewable Resources

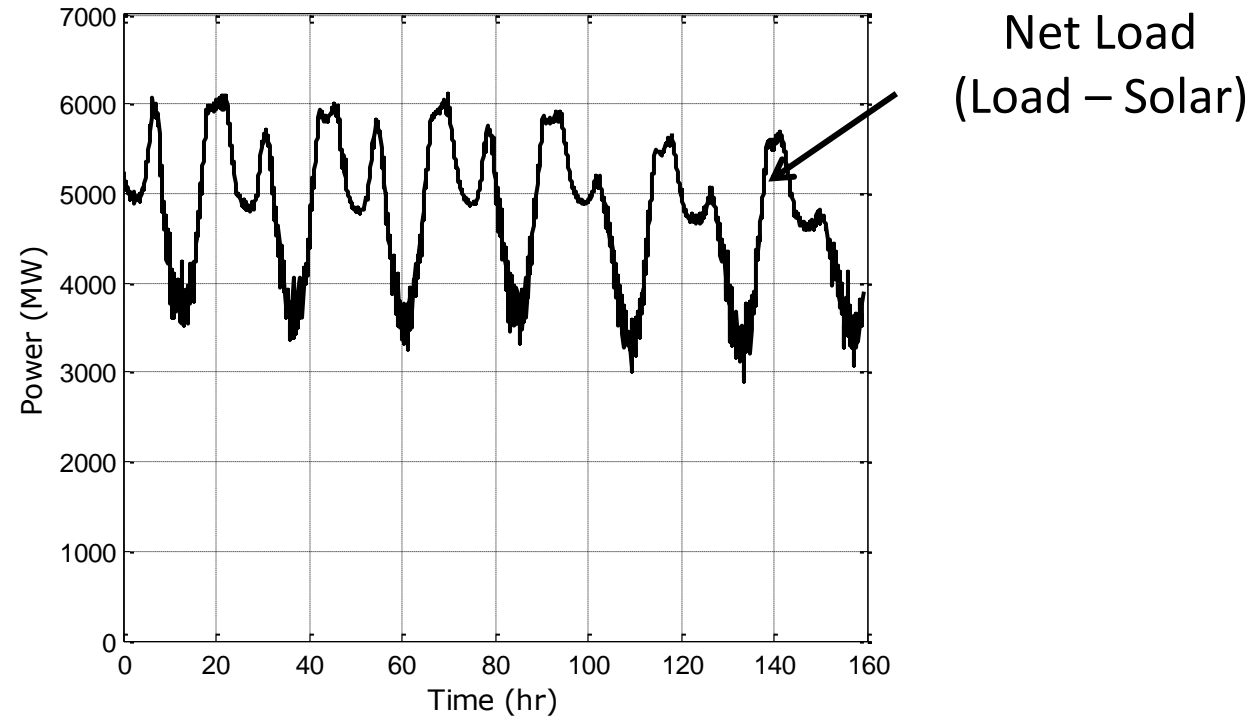

# Integration of Renewable Resources

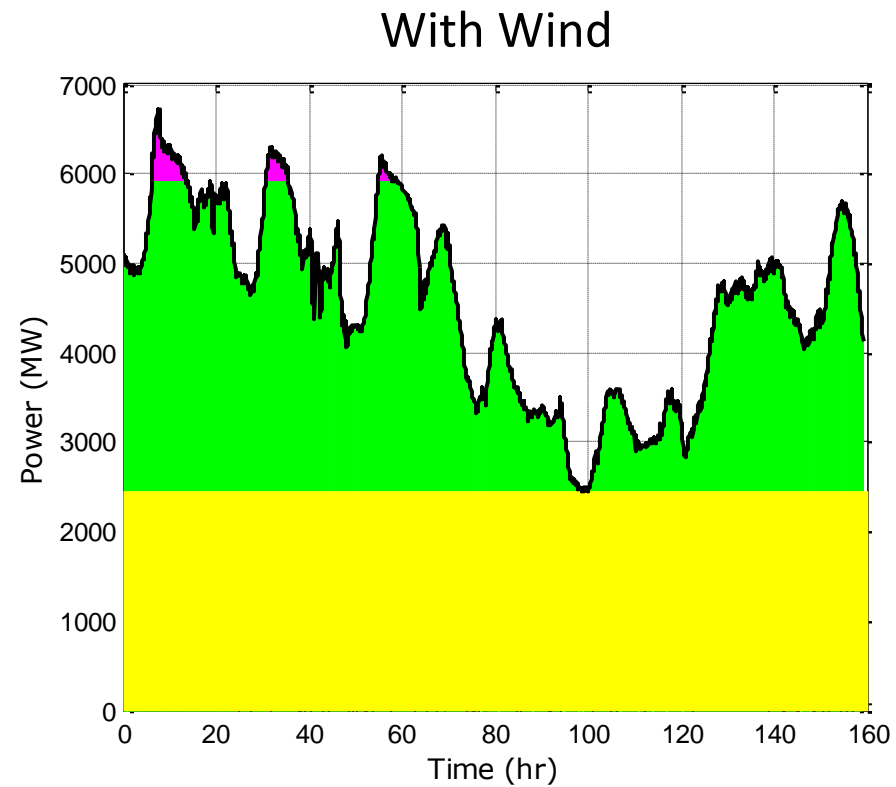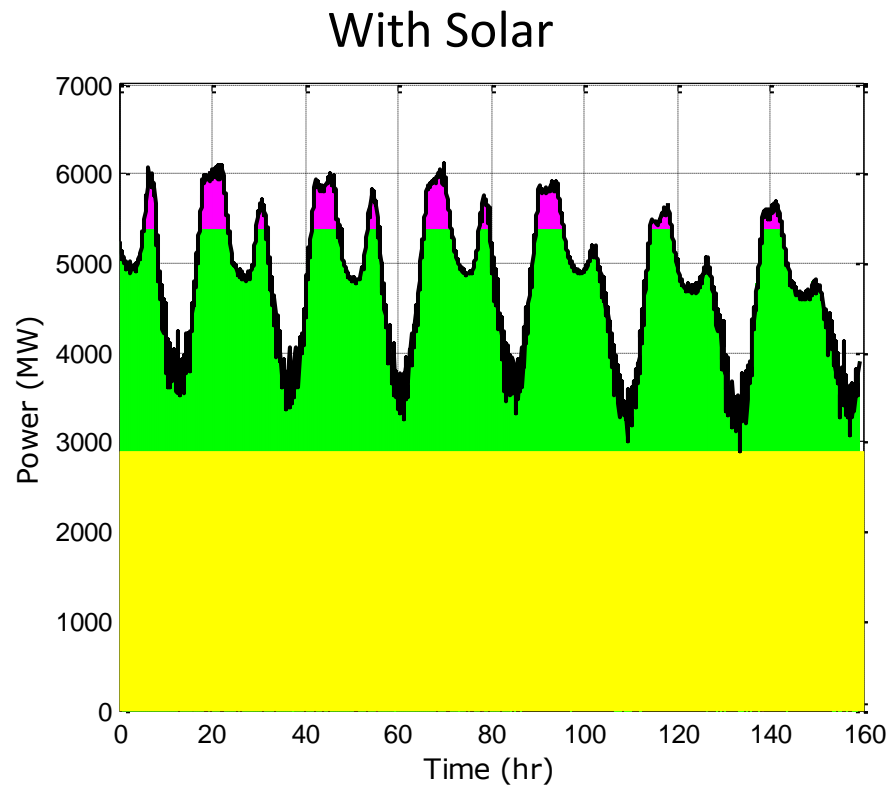

# » Integration of Renewable Resources

- Integration of solar power tends to be easier than with wind power
  - Easier to forecast
  - Coincides with peak load
    - Beneficial to offset air conditioning load in hot climates
- As solar penetration increases, fast-ramping generators are needed near sun set hours

# » Integration of Renewable Resources

- Solutions:
  - Curtail renewable resources
  - Add energy storage
  - Include forecasting
  - Demand Response

# What happens when there is too much wind?

- Net load: load – wind power
  - Wind power potential > load late at night
- Hydro systems can be constrained due to environmental concerns
- Solution:
  - Curtail wind power production
- Result:
  - Lawsuits!


# » Forecasting Renewables

- Integration of renewables becomes easier if the wind, solar, etc. can be accurately forecasted
- More challenging than forecasting load, but accuracy is improving
- Geographic diversity improves forecast accuracy



# Forecasting Techniques

- Approaches to forecasting depend on time scale
  - Short term
    - “persistence”
    - neural networks
    - time-series models
  - Long term (1-2 days)
    - Numerical weather prediction models
  - Longer term
    - Climatology (historical averages)
- Many new approaches being researched

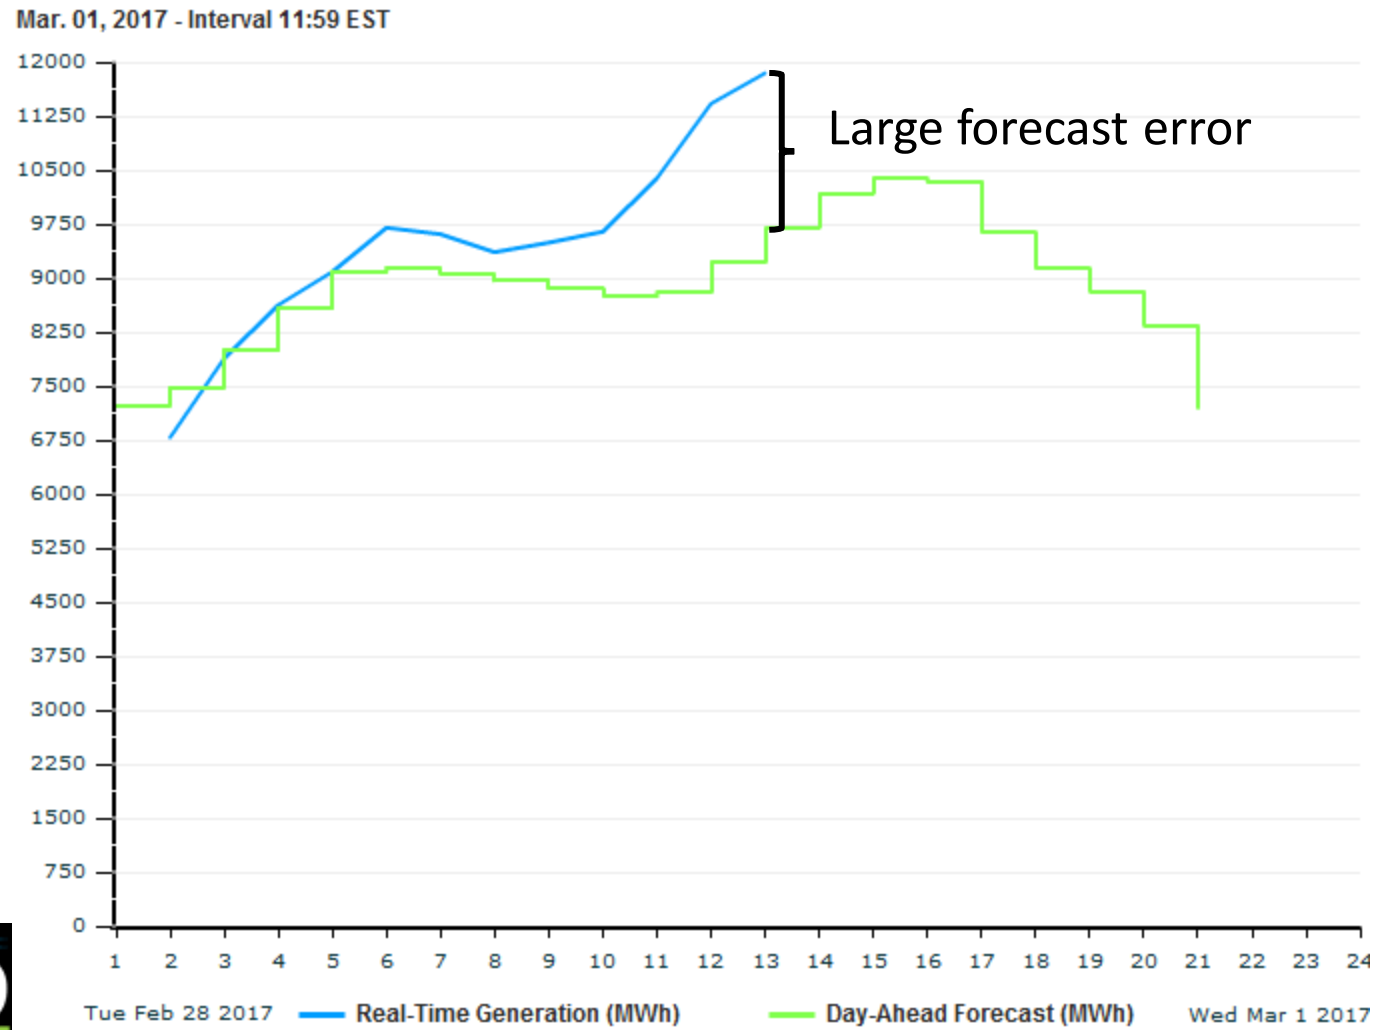

# ➤ Renewable Energy Credits

- Value of renewable energy can be split into two commodities:
  - Energy
  - “green-ness”
- Renewable Energy Credit (REC): value associated with the green-ness with 1 MWh of energy produced from a qualifying renewable resource

# » Renewable Energy Credits

- Just like energy, RECs can be sold by the owner of the renewable energy plant
- Who might purchase a REC?
  - Carbon-offset companies
  - Utilities that are in states with Renewable Portfolio Standards (buy REC instead of build a renewable power plant)
  - Companies/individuals wanting to reduce their carbon footprint
- REC purchase can be entirely independent of energy purchase

# » Renewable Energy Credits

- RECs can be bought and sold in markets
- RECs can be differentiated by generation source (Solar RECs)
- Prices vary:
  - Typically range from \$10 to \$50 per MWh

## » Example


- A Wind Plant produces 100 MWh of electricity
- Electricity is sold on the spot market for \$30/MWh
- RECs are sold at the market rate of \$10/MWh
- The Wind Plant receives  $100 \times 30 + 100 \times 10 = \$400$
- The Wind Plant could sell less than 100 MWh of RECs, but not more

# » Production Tax Credit

- U.S. government has supported renewable energy through Production Tax Credit (PTC)
- For every MWh of generation, the owner is awarded a tax credit
  - Amount varies, and is inflation-adjusted
  - ~\$23/MWh
- PTC requires renewal by Congress
  - Has lapsed several times, creating volatility in the construction of wind plants
- Tax credits can be sold to other companies

The LMP Contour map below provides a real-time map of the MISO footprint showing selected Commercial Nodess, with their respective LMP values. Each Commercial Node is represented as a circle with the regional color dependent on the price. The map and the table will automatically refresh every 5 minutes to show the updated information.

Interactive LMP map below requires free [SVG 3.0 plug-in](#). Please install the plug-in if you do not see the LMP map.

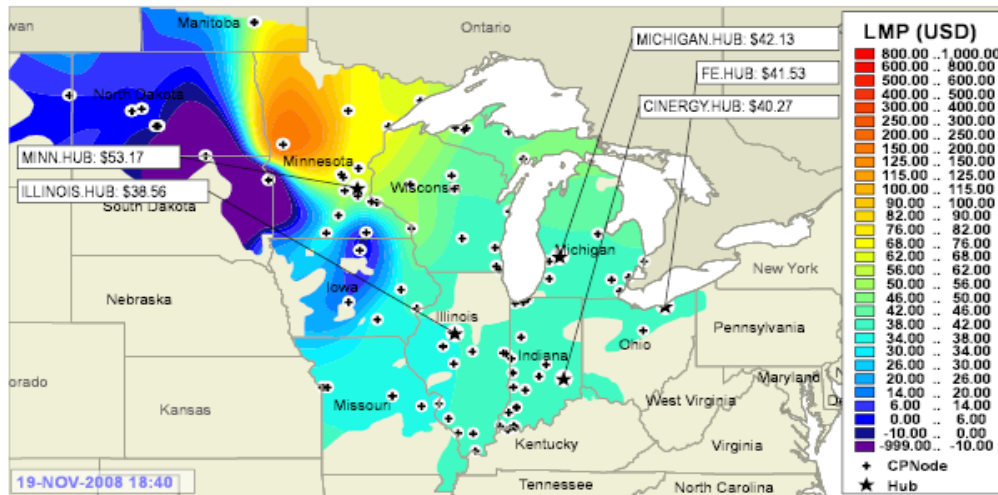


Location	Hourly Day Ahead			5-Minute Real Time			Delta			Last Hour Estimated		
	HE 19			18:40						HE 18		
	LMP	MLC	MCC	LMP	MLC	MCC	LMP	MLC	MCC	LMP	MLC	MCC
AEC	84.28	-2.55	-0.74	39.34	-1.53	-3.29	44.94	-1.02	2.55	44.73	-1.65	-0.85
AECI	80.39	-4.62	-2.56	38.06	-2.81	-3.29	42.33	-1.81	0.73	35.85	-3.61	-7.77
AEP	83.9	-0.77	-2.9	40.47	-0.4	-3.29	43.43	-0.37	0.39	53.06	0.14	5.70
ALTE.ALTE	87.47	1.17	-1.27	41.23	0.35	-3.28	46.24	0.82	2.01	29.64	0.44	-18.02
ALTE.COLUMBAL1	85.04	-1.79	-0.74	39.6	-1.27	-3.29	45.44	-0.52	2.55	27.95	-0.86	-18.41
ALTE.EDGSG5	79.83	-0.97	-6.77	39.84	-1.03	-3.29	39.99	0.06	-3.48	27.80	-0.67	-18.75
ALTW.ALTW	84.51	-2.15	-0.91	30.66	-1.87	-11.63	53.85	-0.28	10.72	29.16	-2.77	-15.30
ALTW.DAEC	82.09	-4.74	-0.74	37.77	-3.1	-3.29	44.32	-1.64	2.55	30.15	-3.95	-13.12
ALTW.EMERY31	86.28	-0.55	-0.74	-84.76	-3.66	-125.26	171.04	3.11	124.52	12.15	-4.61	-30.46
ALTW.FPL_DAEC	82.09	-4.74	-0.74	37.77	-3.1	-3.29	44.32	-1.64	2.55	30.15	-3.95	-13.12
ALTW.OTTUMW1	80.14	-6.69	-0.74	37.11	-3.76	-3.29	43.03	-2.93	2.55	25.42	-4.66	-17.14
AMIL.BALDWI52	77.85	-5.73	-3.99	37.91	-2.96	-3.29	39.94	-2.77	-0.7	35.16	-3.51	-8.55
AMIL.CLINTO51	77.08	-5.3	-5.19	38.2	-2.67	-3.29	38.88	-2.63	-1.9	22.17	-2.70	-22.35
AMIL.HAVANA86	84.64	-2.19	-0.74	37.08	-3.79	-3.29	47.56	1.6	2.55	27.26	-3.89	-16.08
AMIL.HENNEPN81	85.62	-1.21	-0.74	39.24	-1.63	-3.29	46.38	0.42	2.55	27.71	-1.45	-18.06
AMIL.TILTNC1	87.65	-2.86	2.94	39.38	-1.49	-3.29	48.27	-1.37	6.23	53.25	-1.66	7.68
AMII.VFRMII N83	86.69	-3.12	2.74	39.51	-1.36	-3.29	47.18	-1.76	5.53	51.61	-1.70	6.09



The LMP Contour map below provides a real-time map of the MISO footprint showing selected Commercial Nodess, with their respective LMP values. Each Commercial Node is represented as a circle with the regional color dependent on the price. The map and the table will automatically refresh every 5 minutes to show the updated information.

Interactive LMP map below requires free [SVG 3.0 plug-in](#). Please install the plug-in if you do not see the LMP map.

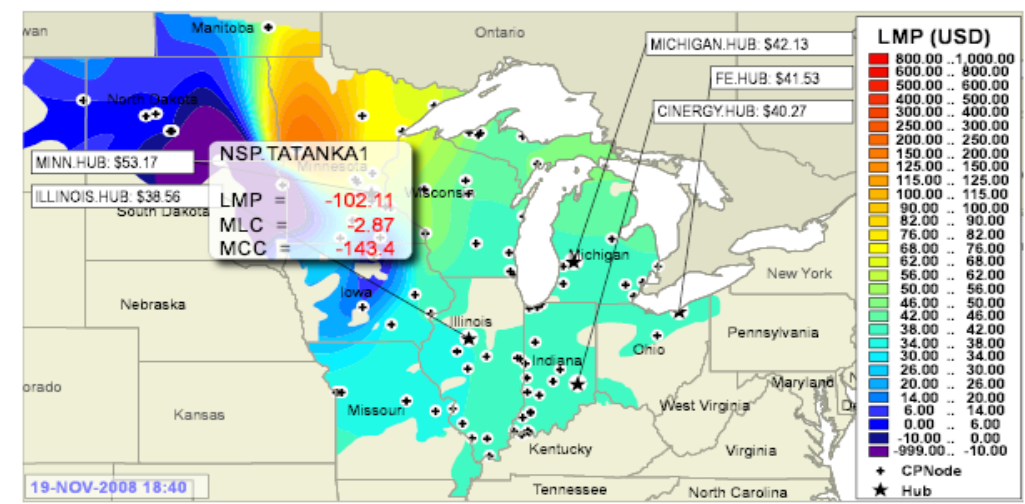

Location	Hourly Day Ahead			5-Minute Real Time			Delta			Last Hour Estimated		
	HE 19			18:40						HE 18		
	LMP	MLC	MCC	LMP	MLC	MCC	LMP	MLC	MCC	LMP	MLC	MCC
AEC	84.28	-2.55	-0.74	39.34	-1.53	-3.29	44.94	-1.02	2.55	44.73	-1.65	-0.85
AECI	80.39	-4.62	-2.56	38.06	-2.81	-3.29	42.33	-1.81	0.73	35.85	-3.61	-7.77
AEP	83.9	-0.77	-2.9	40.47	-0.4	-3.29	43.43	-0.37	0.39	53.06	0.14	5.70
ALTE.ALTE	87.47	1.17	-1.27	41.23	0.35	-3.28	46.24	0.82	2.01	29.64	0.44	-18.02
ALTE.COLUMBAL1	85.04	-1.79	-0.74	39.6	-1.27	-3.29	45.44	-0.52	2.55	27.95	-0.86	-18.41
ALTE.EDGSG5	79.83	-0.97	-6.77	39.84	-1.03	-3.29	39.99	0.06	-3.48	27.80	-0.67	-18.75
ALTW.ALTW	84.51	-2.15	-0.91	30.66	-1.87	-11.63	53.85	-0.28	10.72	29.16	-2.77	-15.30
ALTW.DAEC	82.09	-4.74	-0.74	37.77	-3.1	-3.29	44.32	-1.64	2.55	30.15	-3.95	-13.12
ALTW.EMERY31	86.28	-0.55	-0.74	-84.76	-3.66	-125.26	171.04	3.11	124.52	12.15	-4.61	-30.46
ALTW.FPL_DAEC	82.09	-4.74	-0.74	37.77	-3.1	-3.29	44.32	-1.64	2.55	30.15	-3.95	-13.12
ALTW.OTTUMW1	80.14	-6.69	-0.74	37.11	-3.76	-3.29	43.03	-2.93	2.55	25.42	-4.66	-17.14
AMIL.BALDWI52	77.85	-5.73	-3.99	37.91	-2.96	-3.29	39.94	-2.77	-0.7	35.16	-3.51	-8.55
AMIL.CLINTO51	77.08	-5.3	-5.19	38.2	-2.67	-3.29	38.88	-2.63	-1.9	22.17	-2.70	-22.35
AMIL.HAVANA86	84.64	-2.19	-0.74	37.08	-3.79	-3.29	47.56	1.6	2.55	27.26	-3.89	-16.08
AMIL.HENNEPN81	85.62	-1.21	-0.74	39.24	-1.63	-3.29	46.38	0.42	2.55	27.71	-1.45	-18.06
AMIL.TILTNC1	87.65	-2.86	2.94	39.38	-1.49	-3.29	48.27	-1.37	6.23	53.25	-1.66	7.68
AMII.VFRMII N83	86.69	-3.12	2.24	39.51	-1.36	-3.29	47.18	-1.76	5.53	51.61	-1.70	6.09

## → RECs and PTCs

- RECs and PTCs provide revenue streams to renewable power plants external to the energy market
- Renewable power plants can bid zero or negative prices into electricity markets and still profit

## » Example

- Let the PTC be \$23/MWh and the REC price be \$15/MWh
- A renewable energy power plant can offer  
-\$37/MWh for energy and make \$1 profit (ignoring their variable costs)
- In other words, they will pay \$37 to produce  
1 MWh of electricity but make \$38 in RECs and PTCs