

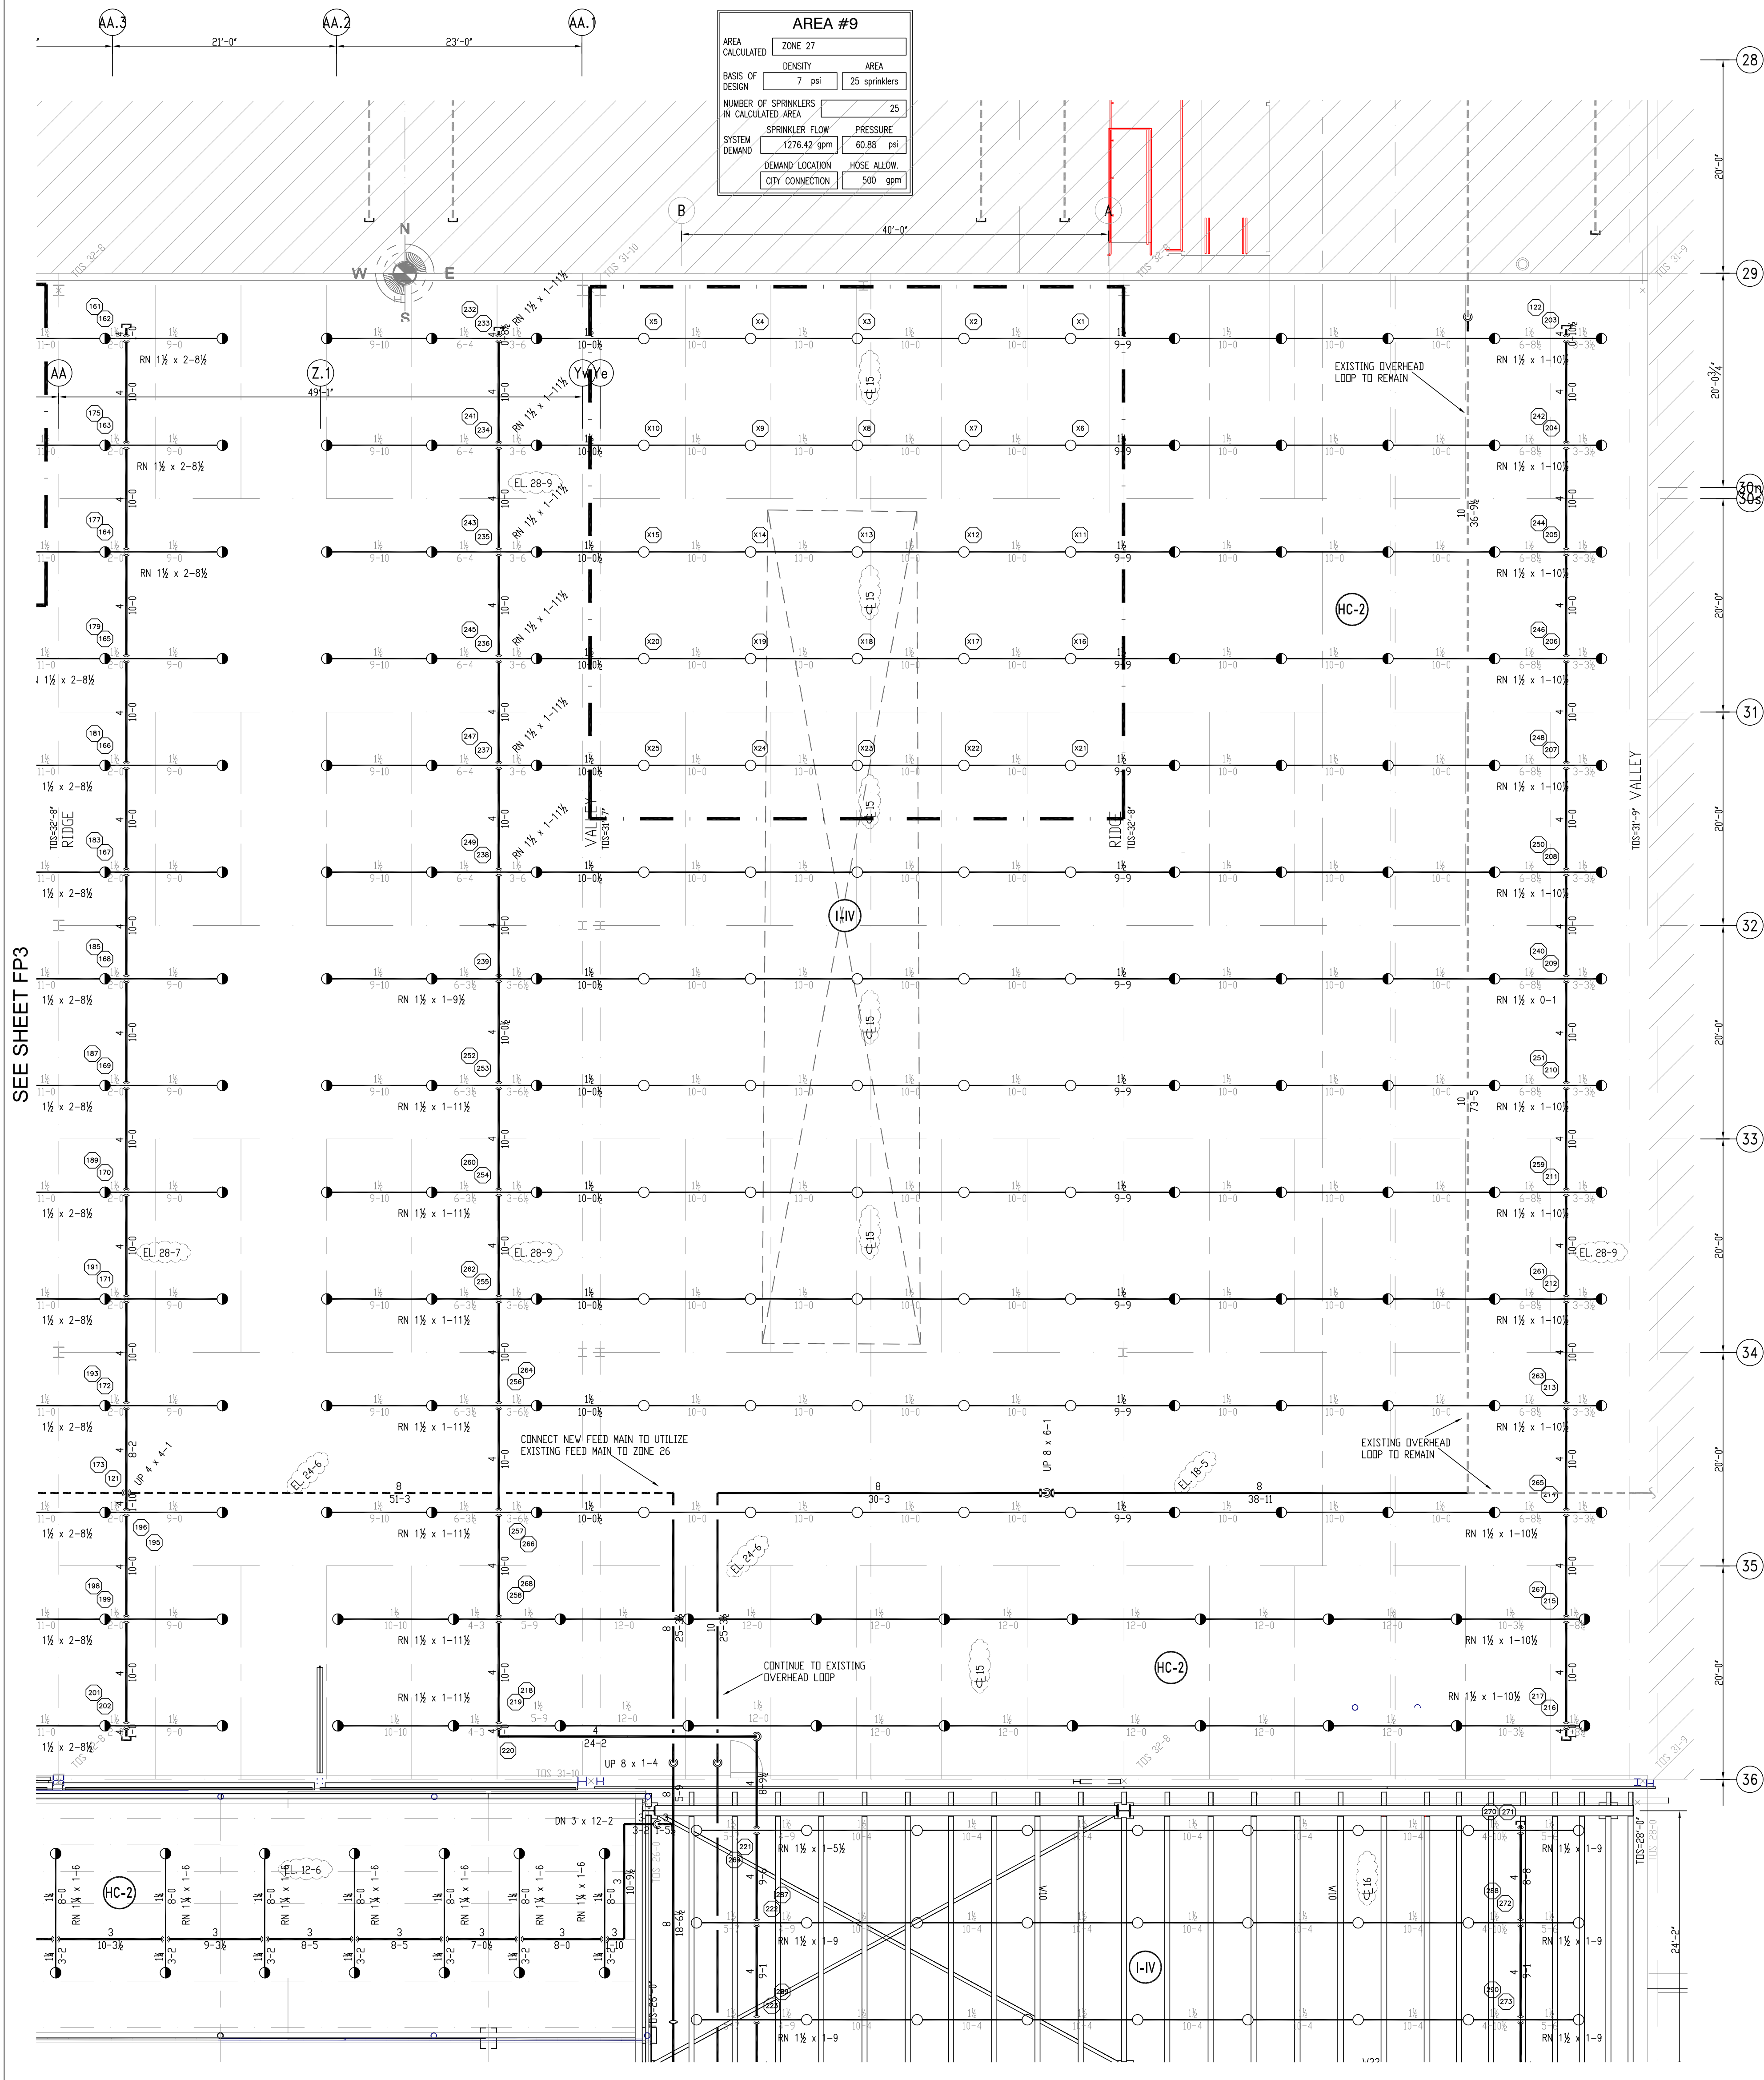


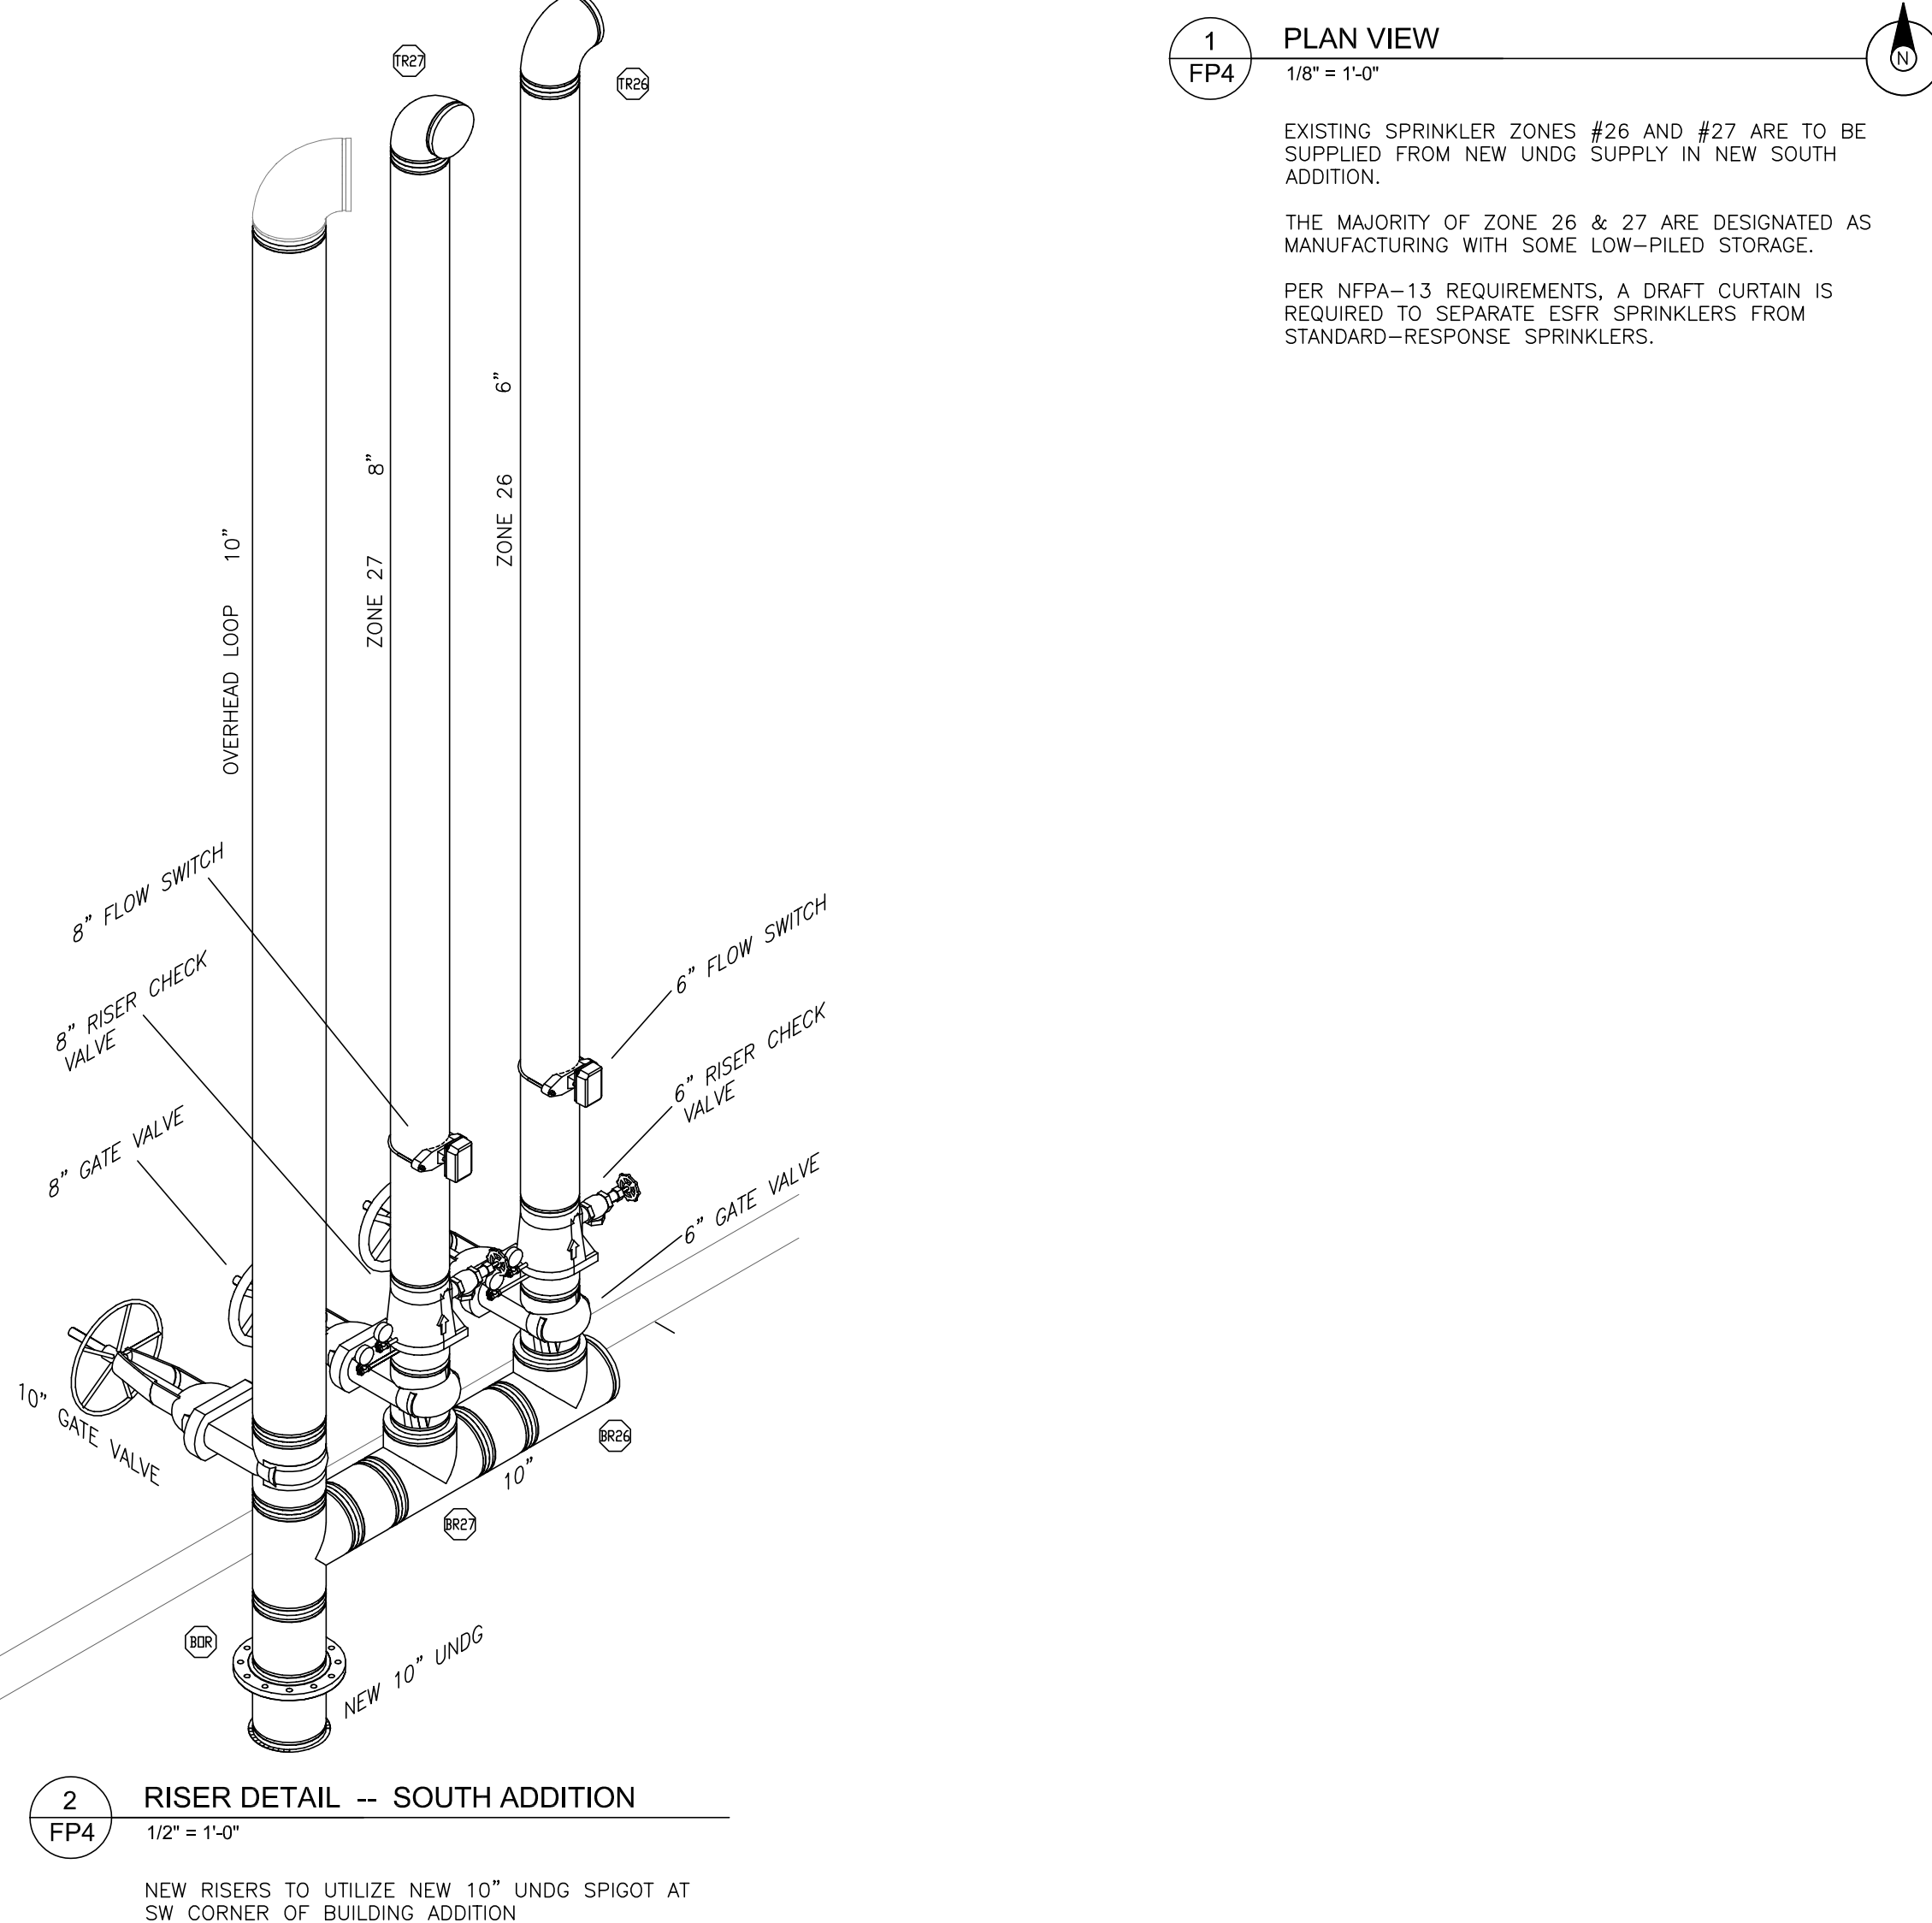

SEE SHEET FP3

MATCHLINE C

Sprinkler Head Schedule					
Symbol	Count	Thread	KF	Description	Temp
○	87	3/4"	11.2	VICTAULIC V3403 FL-SR BRASS UPRIGHT	200°F
●	201	3/4"	8.0	VICTAULIC V3401 FL-SR BRASS UPRIGHT	200°F
288 = Total Number of Heads This Sheet					

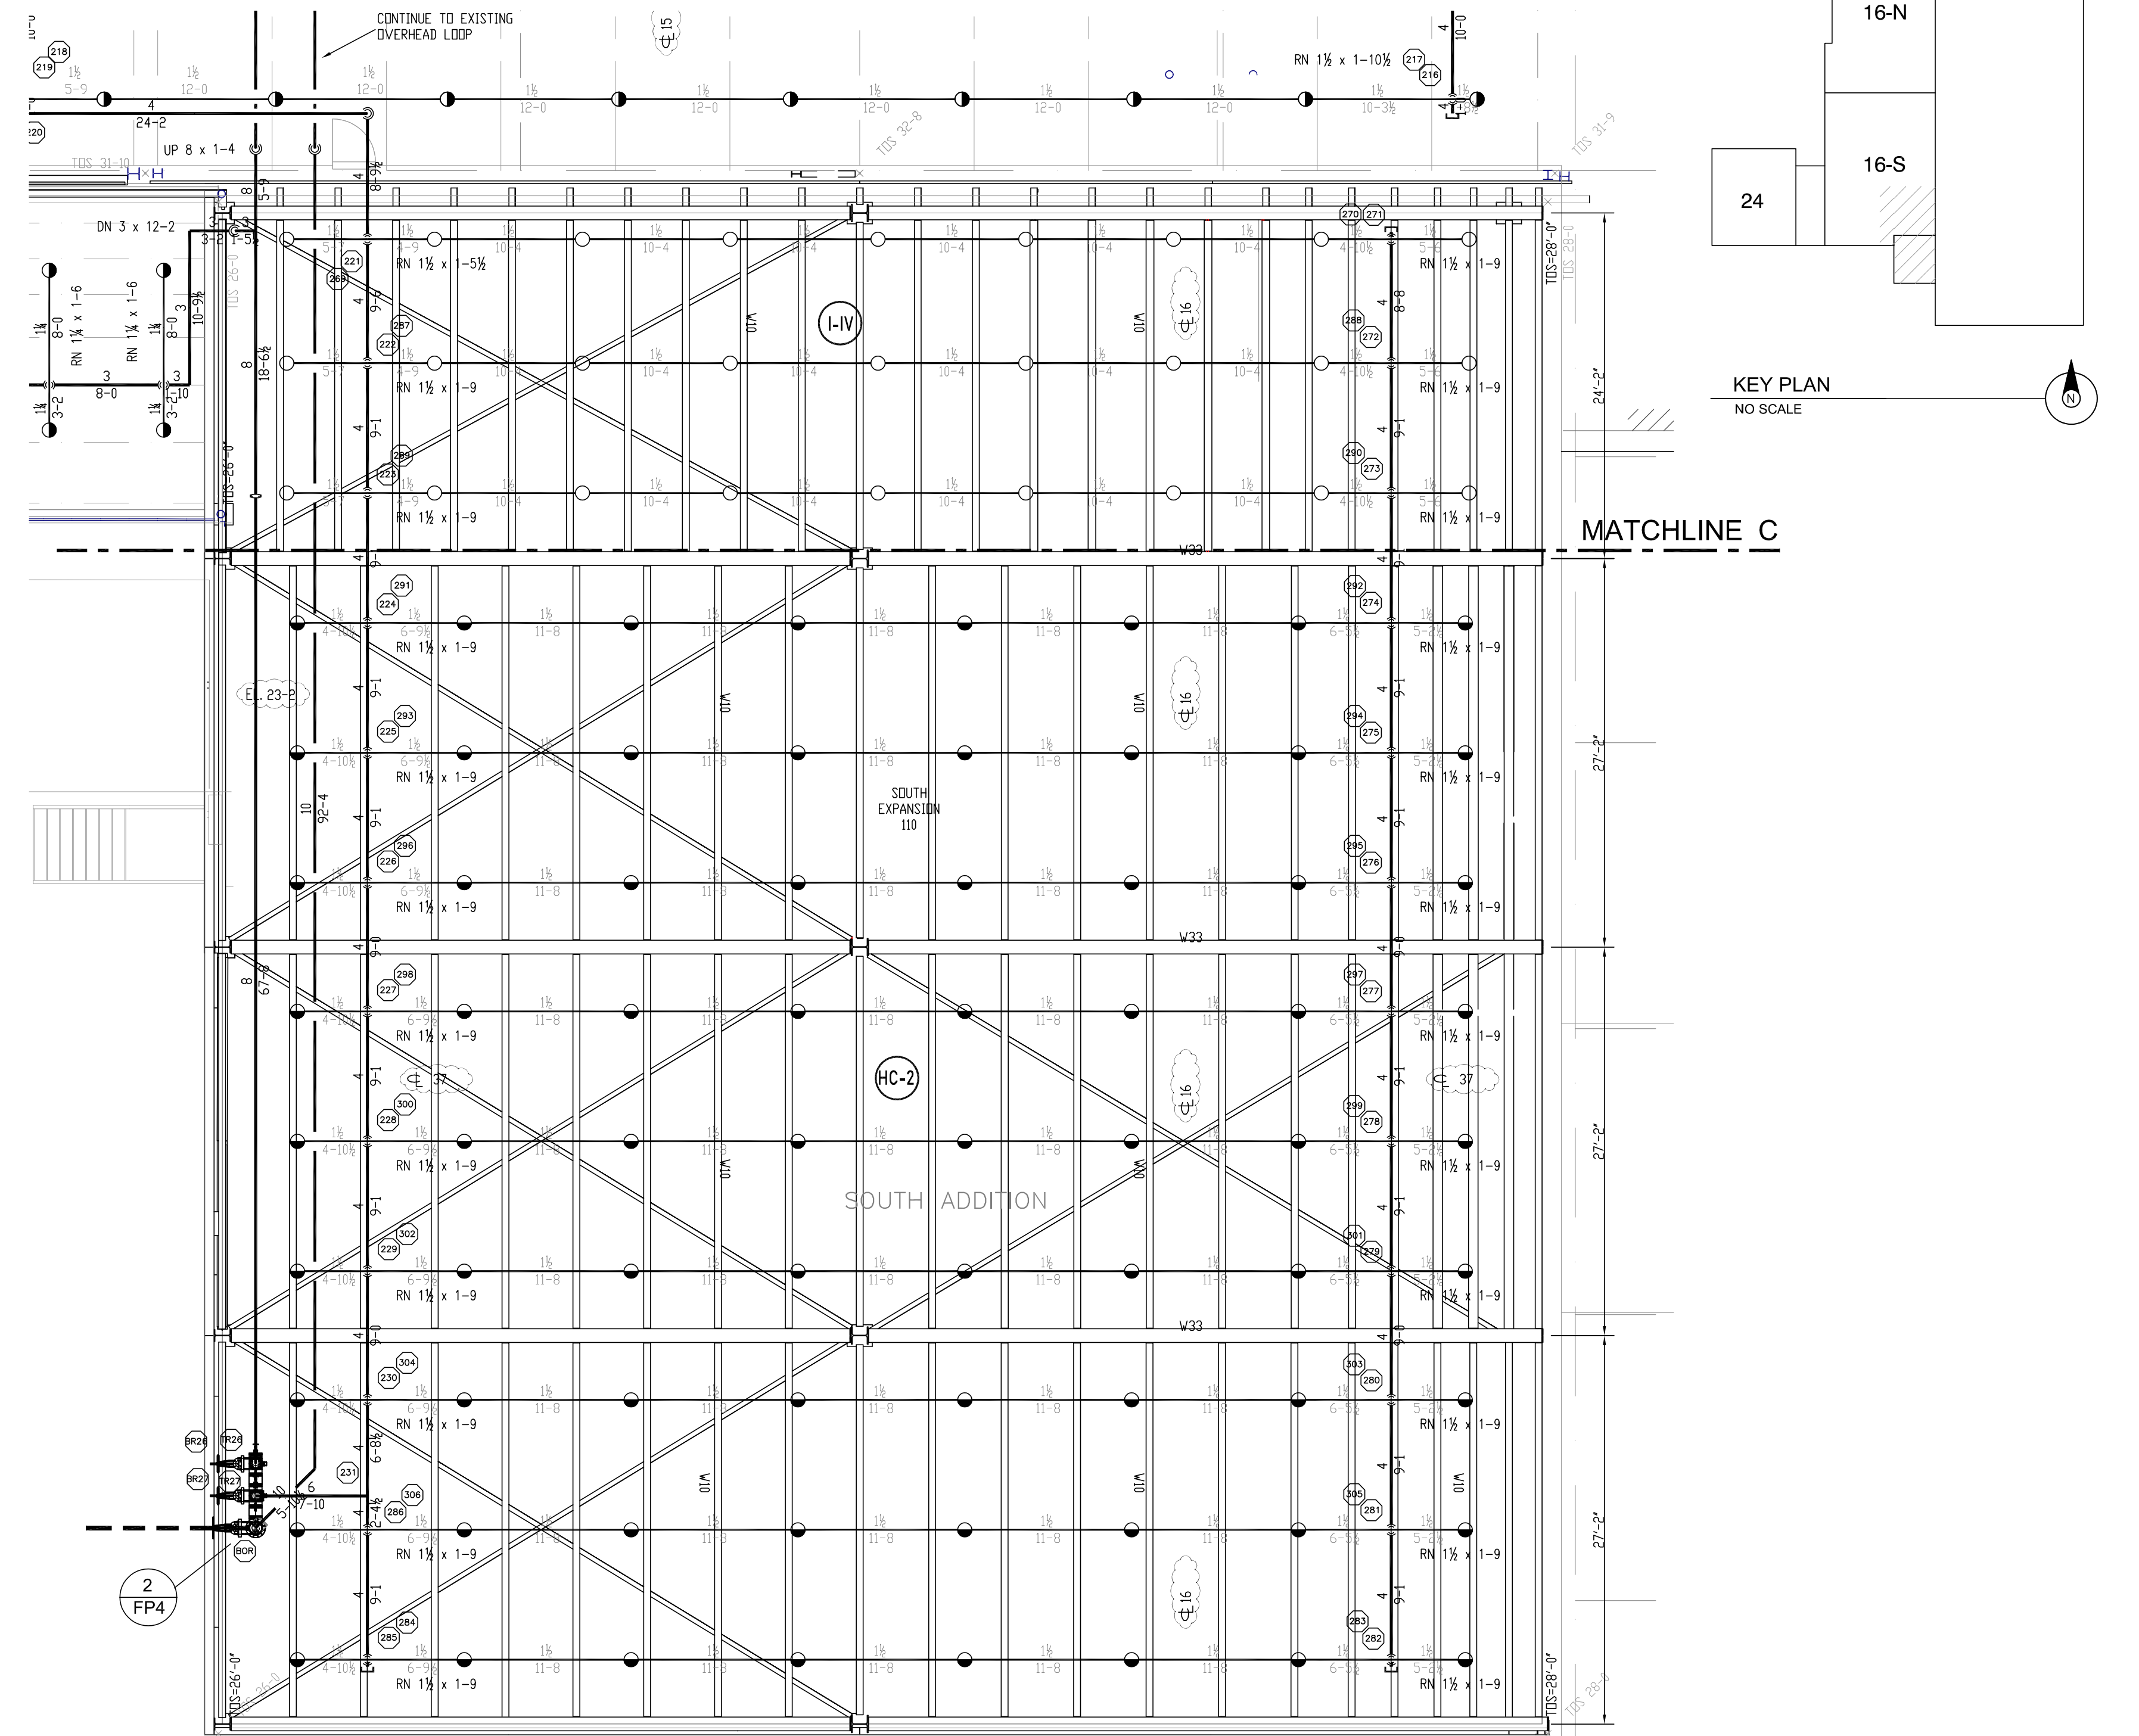

2 RISER DETAIL -- SOUTH ADDITION
1/2" = 1'-0"

NEW RISERS TO UTILIZE NEW 10" UND G SPIGOT AT SW CORNER OF BUILDING ADDITION