

City of Kingston

Lead Protection Program Water Line Inspections



The City of Kingston (KWD) is asking you to assist with a lead inspection program, per EPA and GA EPD requirements. To allow us to inspect your water service line, please complete the attached Authorization to Access Property form by hand, or online Kingstonga.org


Accessing Property Lines

Dear Customer,

To continually improve the quality of services, we are inspecting the water service lines that bring water to your residence from the water main. Inspection crews will include KWD staff and/or its contractors.

For us to do this, we ask for your permission to come on the property at the water meter.

- Take photos of existing conditions of the property only at the water meter.
- Determine the best location for two inspection holes. We will excavate one hole on each side of the water meter (public and private sides). Each hole will be 2 feet to 6 feet from the meter box. Crews will minimize private property disturbance.
- Excavate two holes, 12 to 18-inches wide and 18 to 24-inches deep. The depth depends on where the service line is located at each residence
- Inspect the service line to determine the pipe material and take photos.
- Crews will fill the holes with the material they removed, restore the ground surface and take final photos.
- Restoration will be provided as needed.

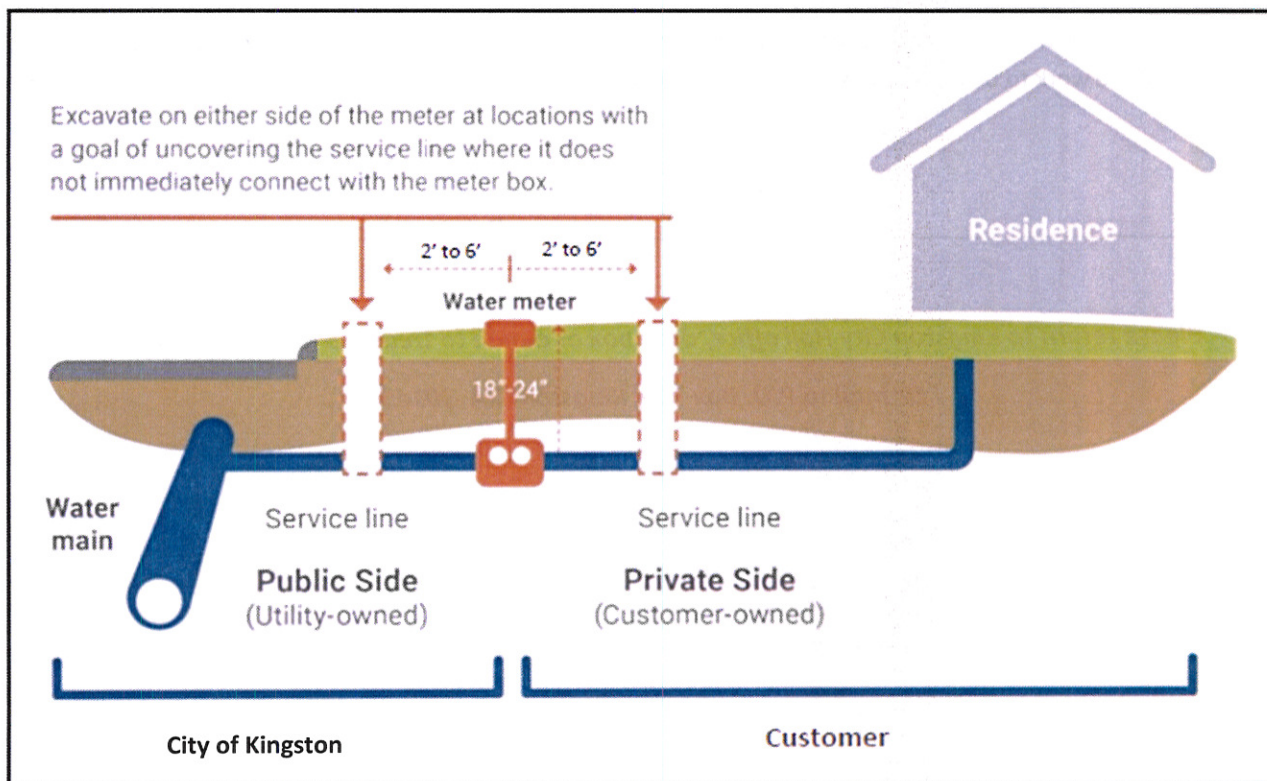

*If your property is in suitable condition, inspection activities could take approximately two hours to complete.
Crews will not need to enter your home for this inspection.*