



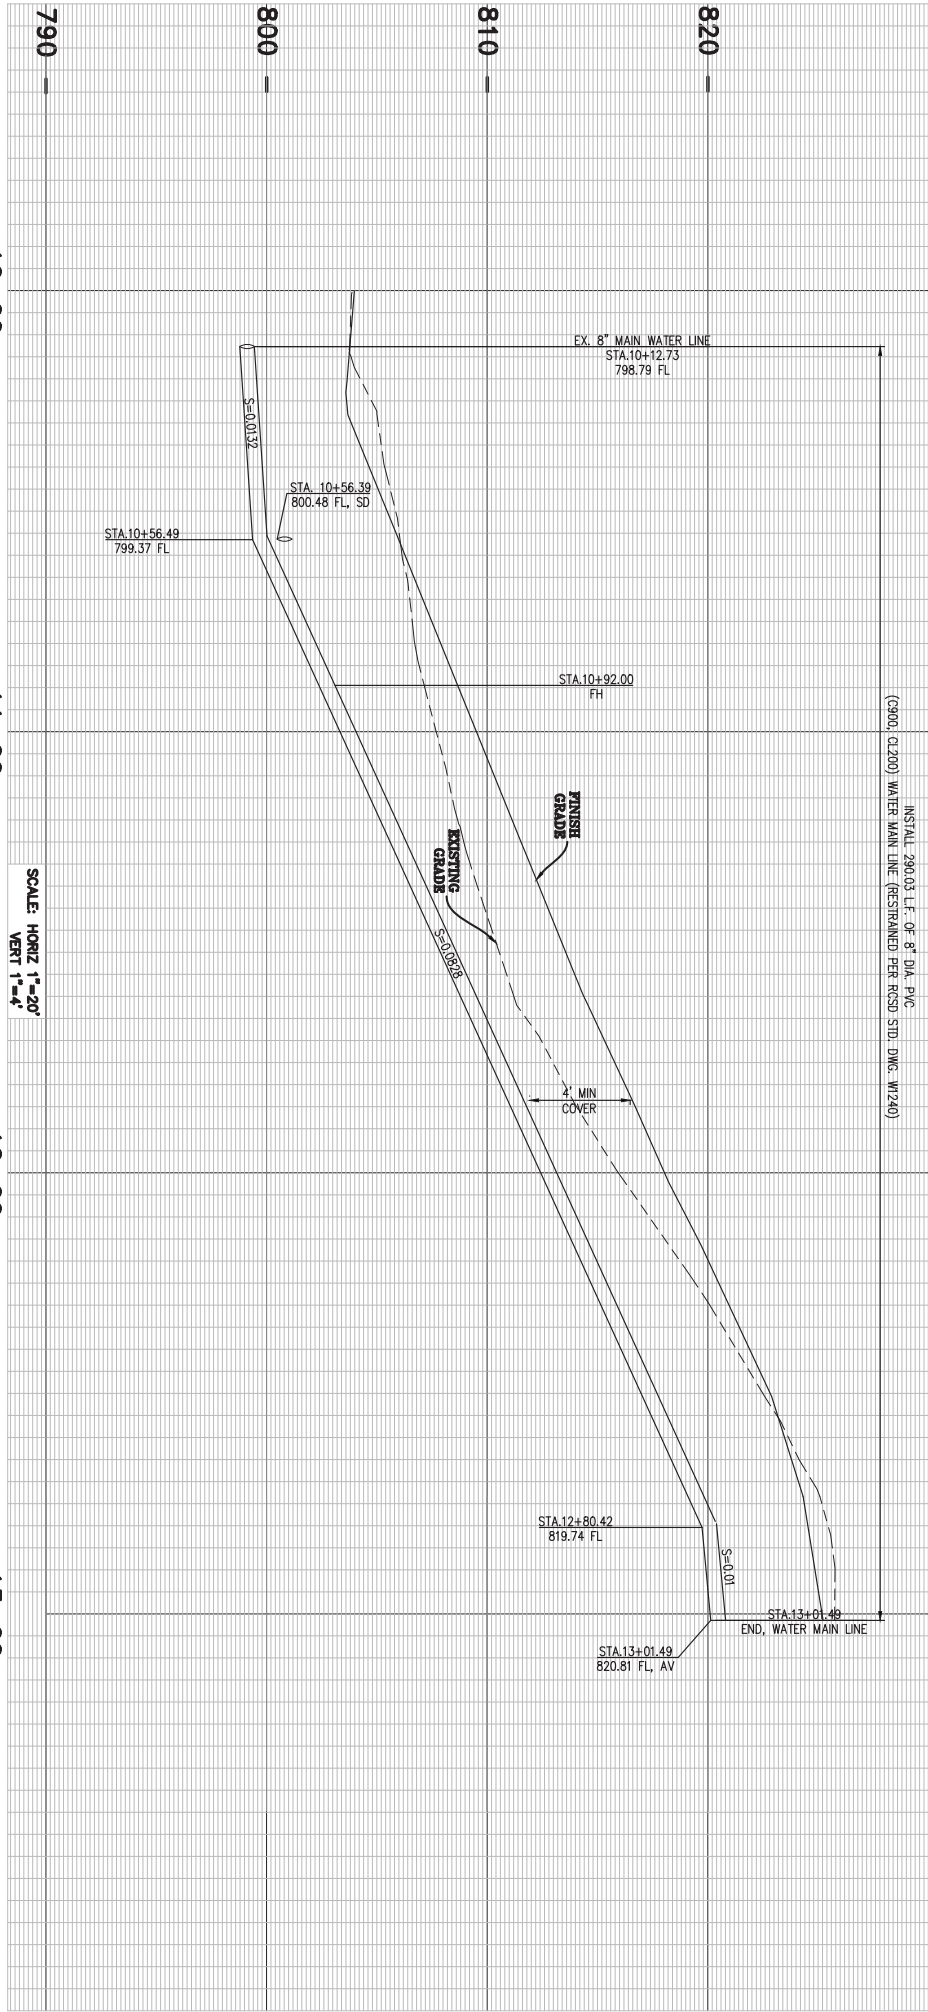


CONSTRUCTION NOTES: WATER

- DESCRIPTION
- INSTALL 8" AWWA C900 Q.200 PVC WATER LINE. SEE TRENCH DETAIL PER RCSD STD. DWG. A-1.
 - CONNECT TO EXISTING MAIN LINE PER RCSD SPECS.
 - INSTALL 1" DOMESTIC WATER SERVICE LINE PER RCSD STD. DWG. W1000.
 - INSTALL 6" FIRE HYDRANT PER RCSD STD. DWG. W1050.
 - INSTALL 3/4" WATER METER. WATER METER TO BE FURNISHED BY RCSD.
 - CONSTRUCT CONCRETE THRUST BLOCK PER RCSD STD. DWG. G40.
 - INSTALL 6" RESILIENT SEAT GATE VALVE PER RCSD STD. DWG. W1020.
 - INSTALL 8"x6" REDUCER.
 - INSTALL 6" AWWA C900 PVC WATER LINE. SEE TRENCH DETAIL PER RCSD STD. DWG. G20.
 - INSTALL 8" RESILIENT SEAT GATE VALVE PER RCSD STD. DWG. W1020.
 - INSTALL 1" AIR VALVE PER RCSD STD. DWG. W1070.
 - INSTALL 8"x8"x8" PVC TEE.

WATER - CURVE/LINE DATA				
DELTA/BRG	RADIUS	LENGTH	TANGENT	COMMENTS
A	S47°28'52" W	24.95'	-	8" PVC
B	8°14'36"	289.00'	-	8" PVC
C	I4°51'38"	311.00'	-	8" PVC
D	S42°51'50" W	-	142.84'	8" PVC

WATER SERVICE TABLE	
Nothing	WATER
LOT #	Pressure Regulator Needed?
1	YES
2	YES
3	YES
4	YES
5	YES
6	YES
7	YES
8	YES
9	YES
10	YES
11	YES
12	YES

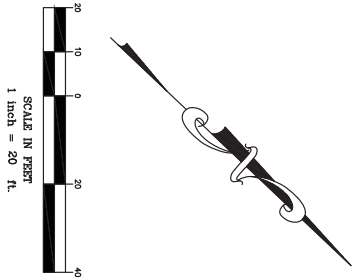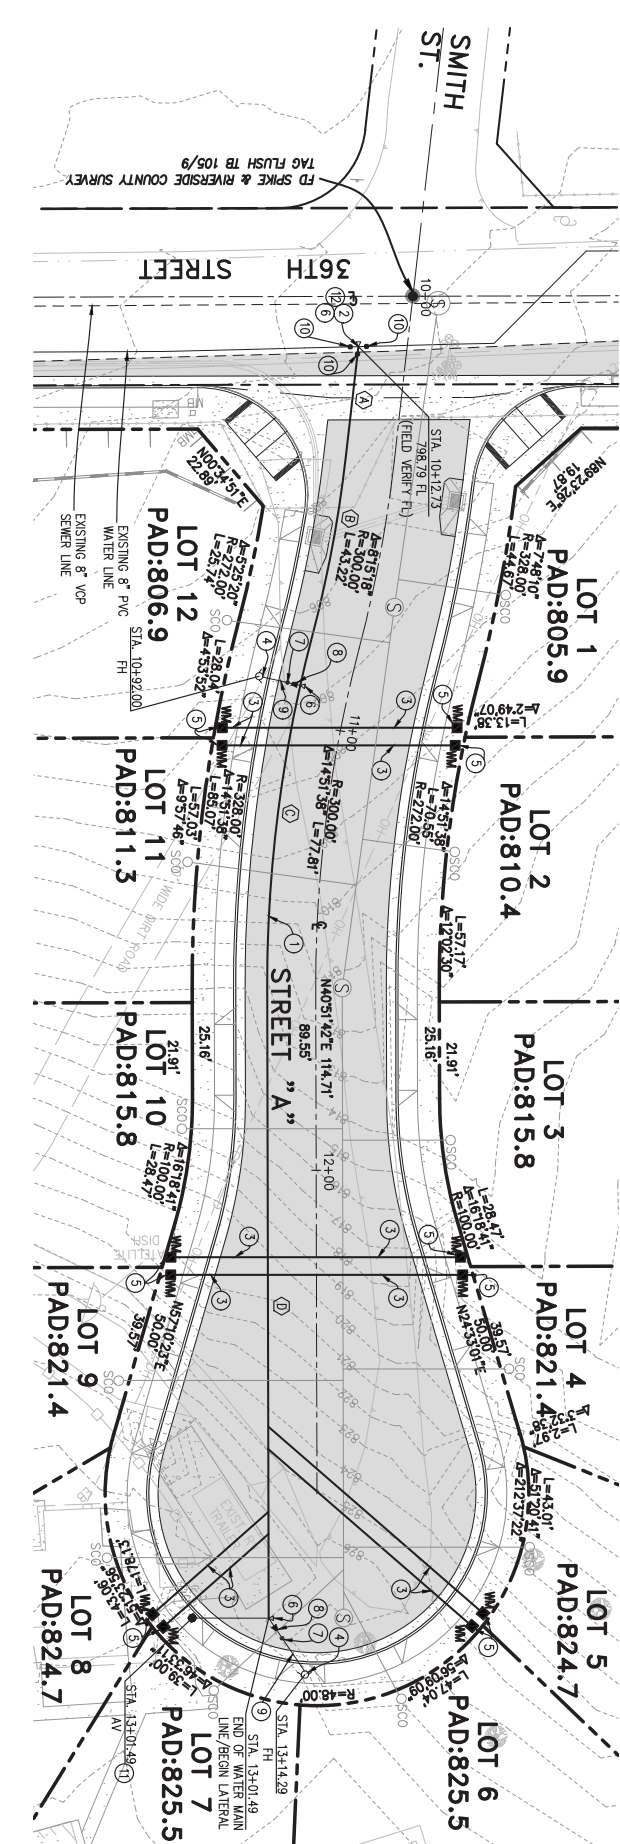

NO WORK SHALL BE DONE ON THIS PROJECT WITHOUT A GRANT OR EXCAVATION UNDERGROUND SERVICE ALERT



Call: 811

TWO WORKING DAYS BEFORE YOU DIG

APPROVED BY THE RUBIDOUX COMMUNITY SERVICES DISTRICT FOR CONSTRUCTION

DATE: _____

VOID AFTER ONE YEAR FROM THIS DATE

ASSISTANT GENERAL MANAGER/
DISTRICT ENGINEER/ RCE 48109

SYN

DESCRIPTION

REVISIONS

DATE

BY

RUBIDOUX COMMUNITY SERVICES DISTRICT

CITY OF JURUPA VALLEY

WATER PLANS AT STREET A

TRACT NO. 36649

STA. 10+00.00 TO STA. 13+01.49

SHEET NO.

5

OF 6 SHEETS

PLAN NO.

IP17-006