



- NOTES:
- 1. INSTALL WIRE FERRULES ON WIRES TERMINATED ON SCREW TERMINALS.
 - 2. PROVIDE WIRE LABELS AT BOTH ENDS OF WIRE. FASTEN MODULE WIRES TOGETHER WITH CABLE TIES AT 6 INCH INTERVALS.

LEGEND

--- FIELD WIRING

— RTU WIRING


REVISION RECORD	REV	DESCRIPTION	DATE	FOR	DWN	CHK	APPV
	△	COVER	8/14/24	Approval	NE		
	△						
	△						
	△						
	△						
	△						
	△						

THE INFORMATION CONTAINED ON THIS DRAWING IS THE SOLE PROPERTY OF VANZANDT CONTROLS, LLC. ANY USE OR DISCLOSURE OF THIS INFORMATION TO OTHERS WITHOUT THE PRIOR WRITTEN APPROVAL OF VANZANDT CONTROLS, LLC IS PROHIBITED.

DRAWING RECORD		PROJECT RECORD	
DRAWN BY:	N.ELLIOTT	CLIENT	
CHECKED BY:		PROJECT	14X12X8 ENCLOSURE.DWG
ENGINEER:	***	UNIT	
PROJECT MANAGER:	A. WASHBURN	LOCATION	



VanZandt Fort Worth 14X12X8 ENCLOSURE.DWG				REV	1
SIZE	PROJECT NO.	DWG NO.			
B		SD01			
SCALE: none	ACAD FILE NAME: VZ Drawing Template	SHEET	of		

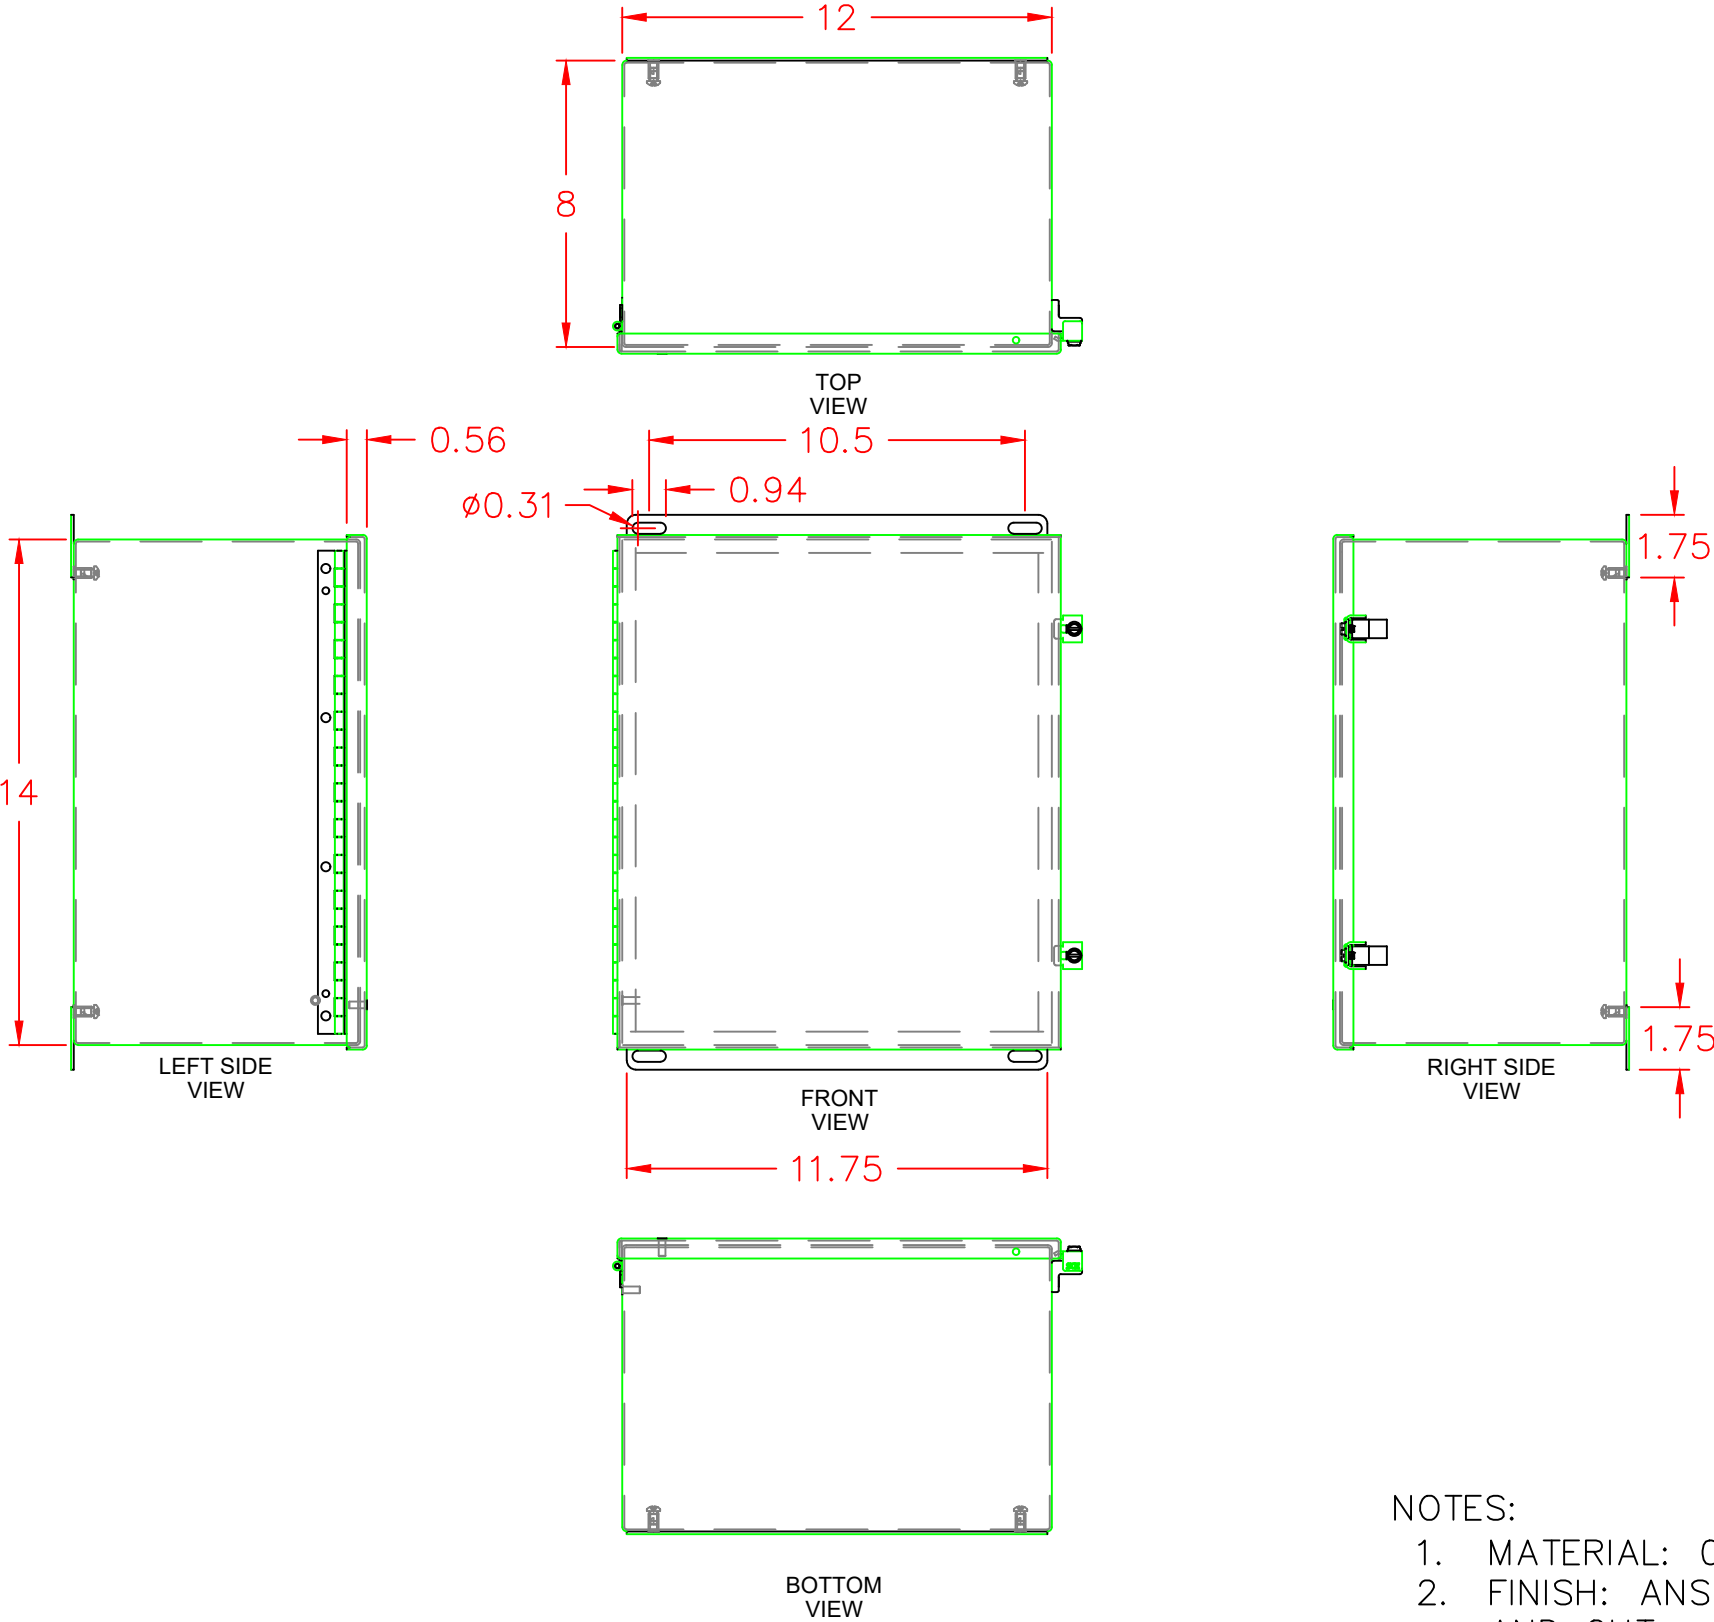

- NOTES:
- 1. MATERIAL: 0.063” CARBON STEEL.
 - 2. FINISH: ANSI-61 GRAY POWDER COATING INSIDE AND OUT.

- NOTES:
- 1. INSTALL WIRE FERRULES ON WIRES TERMINATED ON SCREW TERMINALS.
 - 2. PROVIDE WIRE LABELS AT BOTH ENDS OF WIRE. FASTEN MODULE WIRES TOGETHER WITH CABLE TIES AT 6 INCH INTERVALS.

LEGEND

---	FIELD WIRING
---	RTU WIRING

REV	DESCRIPTION	DATE	FOR	DWN	CHK	APPV
△	ENCLOSURE	8/14/24	Approval	NE		
△						
△						
△						
△						
△						
△						
△						

THE INFORMATION CONTAINED ON THIS DRAWING IS THE SOLE PROPERTY OF VANZANDT CONTROLS, LLC. ANY USE OR DISCLOSURE OF THIS INFORMATION TO OTHERS WITHOUT THE PRIOR WRITTEN APPROVAL OF VANZANDT CONTROLS, LLC IS PROHIBITED.

DRAWING RECORD		PROJECT RECORD	
DRAWN BY:	N.ELLIOTT	CLIENT	
CHECKED BY:		PROJECT	14X12X8 ENCLOSURE.DWG
ENGINEER:	***	UNIT	
PROJECT MANAGER:	A. WASHBURN	LOCATION	



VanZandt Fort Worth 14X12X8 ENCLOSURE.DWG				REV	1
SIZE	PROJECT NO.	DWG NO.	M001		
B					
SCALE: none	ACAD FILE NAME: VZ Drawing Template	SHEET	of		