



- NOTES:
- 1. INSTALL WIRE FERRULES ON WIRES TERMINATED ON SCREW TERMINALS.
 - 2. PROVIDE WIRE LABELS AT BOTH ENDS OF WIRE. FASTEN MODULE WIRES TOGETHER WITH CABLE TIES AT 6 INCH INTERVALS.

LEGEND

--- FIELD WIRING

— RTU WIRING


REVISION RECORD	REV	DESCRIPTION	DATE	FOR	DWN	CHK	APPV
	△	COVER	8/14/24	Approval	NE		
	△						
	△						
	△						
	△						
	△						
	△						

THE INFORMATION CONTAINED ON THIS DRAWING IS THE SOLE PROPERTY OF VANZANDT CONTROLS, LLC. ANY USE OR DISCLOSURE OF THIS INFORMATION TO OTHERS WITHOUT THE PRIOR WRITTEN APPROVAL OF VANZANDT CONTROLS, LLC IS PROHIBITED.

DRAWING RECORD		PROJECT RECORD	
DRAWN BY:	N.ELLIOTT	CLIENT	
CHECKED BY:		PROJECT	16X12X8 ENCLOSURE.DWG
ENGINEER:	***	UNIT	
PROJECT MANAGER:	A. WASHBURN	LOCATION	



VanZandt Fort Worth 16X12X8 ENCLOSURE.DWG				REV 1
SIZE B	PROJECT NO.	DWG NO. SD01		
SCALE: none	ACAD FILE NAME: VZ Drawing Template		SHEET 1 of 2	

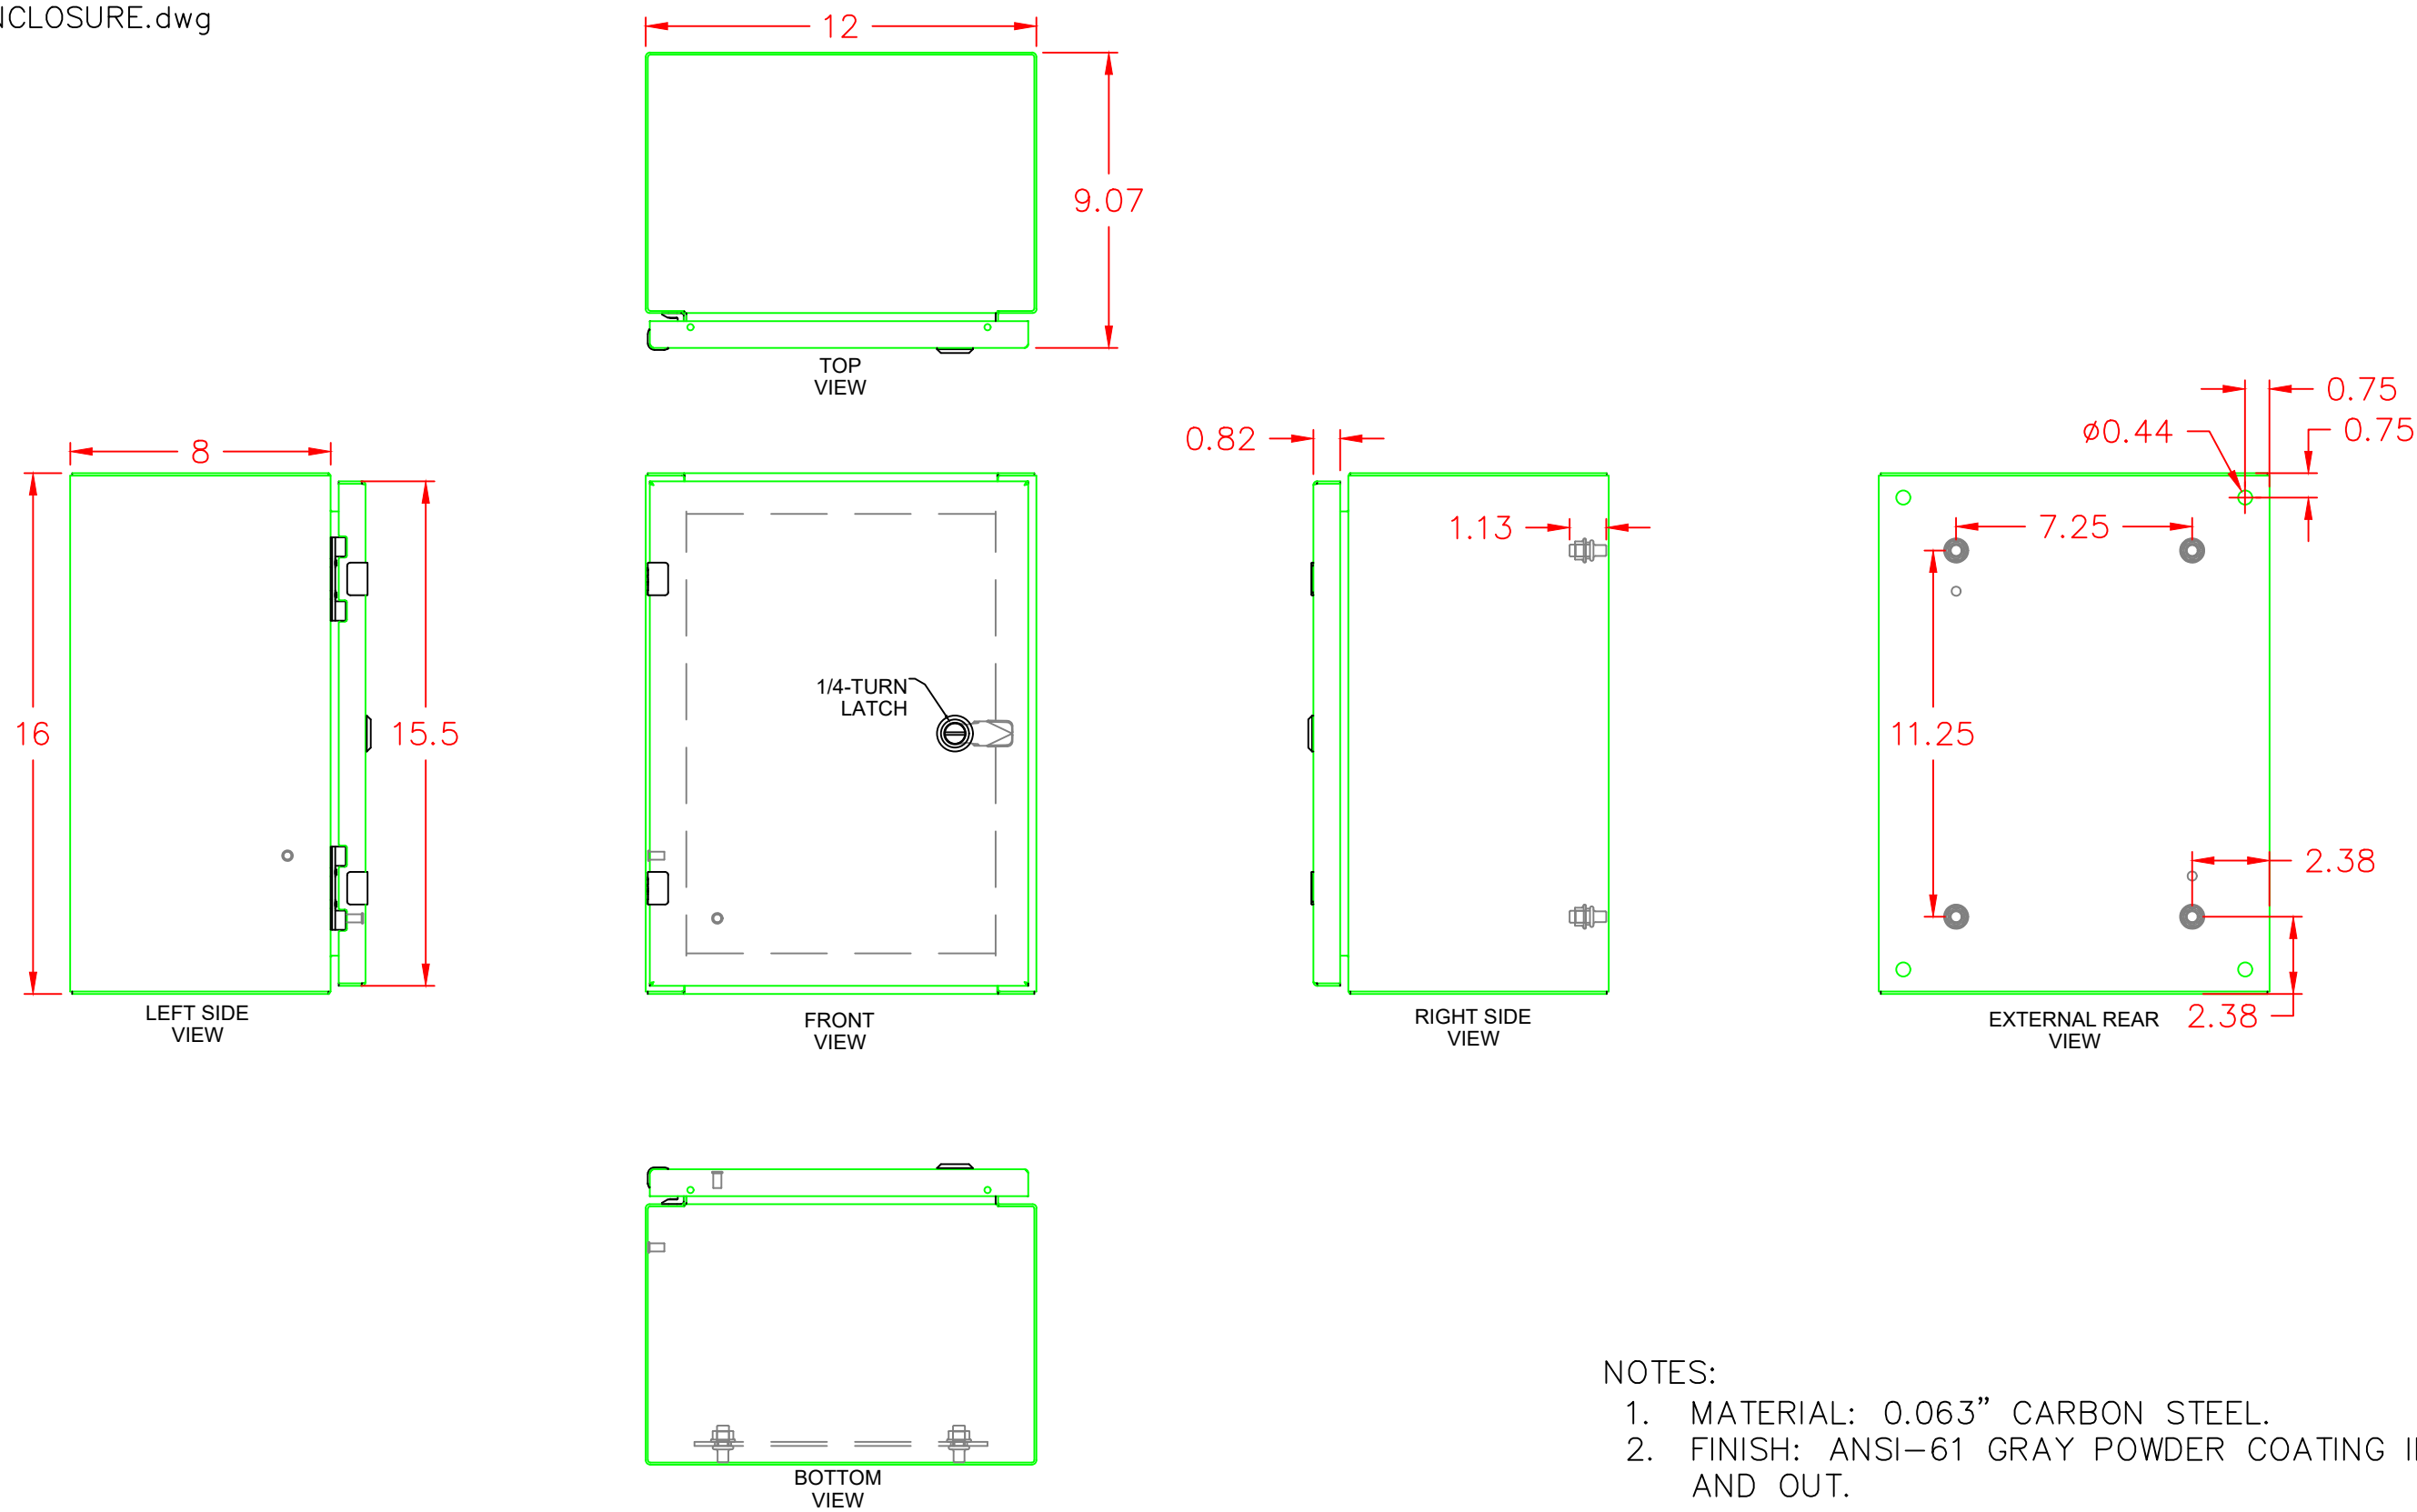

- NOTES:
- 1. MATERIAL: 0.063" CARBON STEEL.
 - 2. FINISH: ANSI-61 GRAY POWDER COATING INSIDE AND OUT.

- NOTES:
- 1. INSTALL WIRE FERRULES ON WIRES TERMINATED ON SCREW TERMINALS.
 - 2. PROVIDE WIRE LABELS AT BOTH ENDS OF WIRE. FASTEN MODULE WIRES TOGETHER WITH CABLE TIES AT 6 INCH INTERVALS.

LEGEND

--- FIELD WIRING

--- RTU WIRING

REV	DESCRIPTION	DATE	FOR	DWN	CHK	APPV	THE INFORMATION CONTAINED ON THIS DRAWING IS THE SOLE PROPERTY OF VANZANDT CONTROLS, LLC. ANY USE OR DISCLOSURE OF THIS INFORMATION TO OTHERS WITHOUT THE PRIOR WRITTEN APPROVAL OF VANZANDT CONTROLS, LLC IS PROHIBITED.			
16128		8/14/24	Approval	NE						
REVISION RECORD							DRAWING RECORD		PROJECT RECORD	
							DRAWN BY:	N.ELLIOTT	CLIENT	
							CHECKED BY:		PROJECT	16X12X8 ENCLOSURE.DWG
							ENGINEER:	***	UNIT	
							PROJECT MANAGER:	A. WASHBURN	LOCATION	
							VanZandt Fort Worth 16X12X8 ENCLOSURE.DWG			REV 1
							SIZE B	PROJECT NO.	DWG NO. M001	
							SCALE: none	ACAD FILE NAME: VZ Drawing Template		SHEET 2 of 2